

050m100m150m200m

LEGEND

Road

Land Parcel

Building

Stream / River

Townland Boundary

EP

Existing Electricity Lines

Marsh

Forestry

Guarding Location - Temporary Works

Geo - Directory Point

xxx

Distance to Existing Dwelling / Planning Permission within 200m of centreline (See note 4 also)

Existing 400kV Tower Location


19.5m

Proposed Outer Conductor Line

Centreline of Existing & Proposed Line Route

Existing Oldstreet - Woodland 400 kV Line (Note: Maximum distance between outer conductors at towers 402 and 410 = 22.8m)

Lake

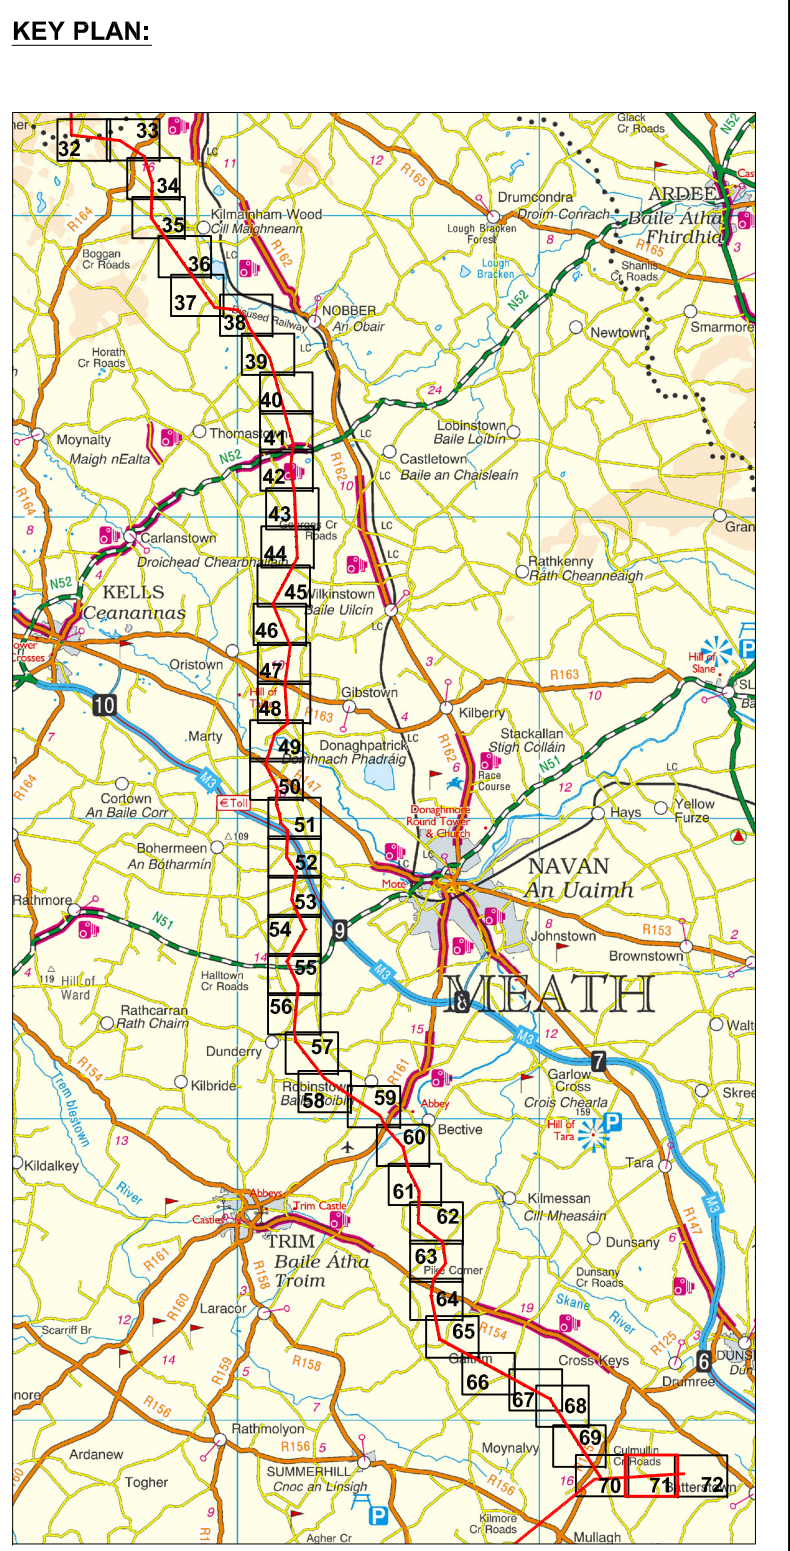

- NOTES :
1. Transmission lines and towers not to be scaled.
 2. For details of proposed structures see structure description schedule.
 3. Figured dimensions only to be taken from this drawing.
 4. Dimensions are shown from nearest point of dwelling to the centreline of proposed line route and nearest outer conductor.
- OSI Sheet(s): 2919, 2919-D

C	May '15	UPDATE FOLLOWING DESIGN REVIEW	MN	DG
B	Dec. '14	PLANNING ISSUE	M.N	D.G.
A	Jan. '14	CLIENT ISSUE	MN	DG
Rev	Date	Description	By	Chkd.

Client:

Project:

NORTH - SOUTH 400 kV
INTERCONNECTION DEVELOPMENT

Title:

MEATH STUDY AREA (MSA)
1:2,500 LINE ROUTE MAP
- Sheet 71 of 72 -

Scale @ A1:

1:2,500

Prepared by:

M. Nolan

Checked:

D. Grehan

Date:

May 2015

Project Director:

D. Grehan

Planning Dwg Ref:

MT-004-071

TOBIN Consulting Engineers,
Block 10-4, Blanchardstown Corporate Park,
Dublin 15, Ireland.
tel: +353-(0)1-8030406
fax: +353-(0)1-8030409
e-mail: dublin@tobin.ie
www.tobin.ie

TOBIN Consulting Engineers will not be liable for any use of this document for any purpose other than that for which it was originally prepared and provided. Engineers, as copyright holder, no part of this document may be reproduced or transmitted in any form and this document shall not be relied upon by any third party for any purpose.

Revision:

C

Drawing No.:

6244-2050