"This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client.
Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM."

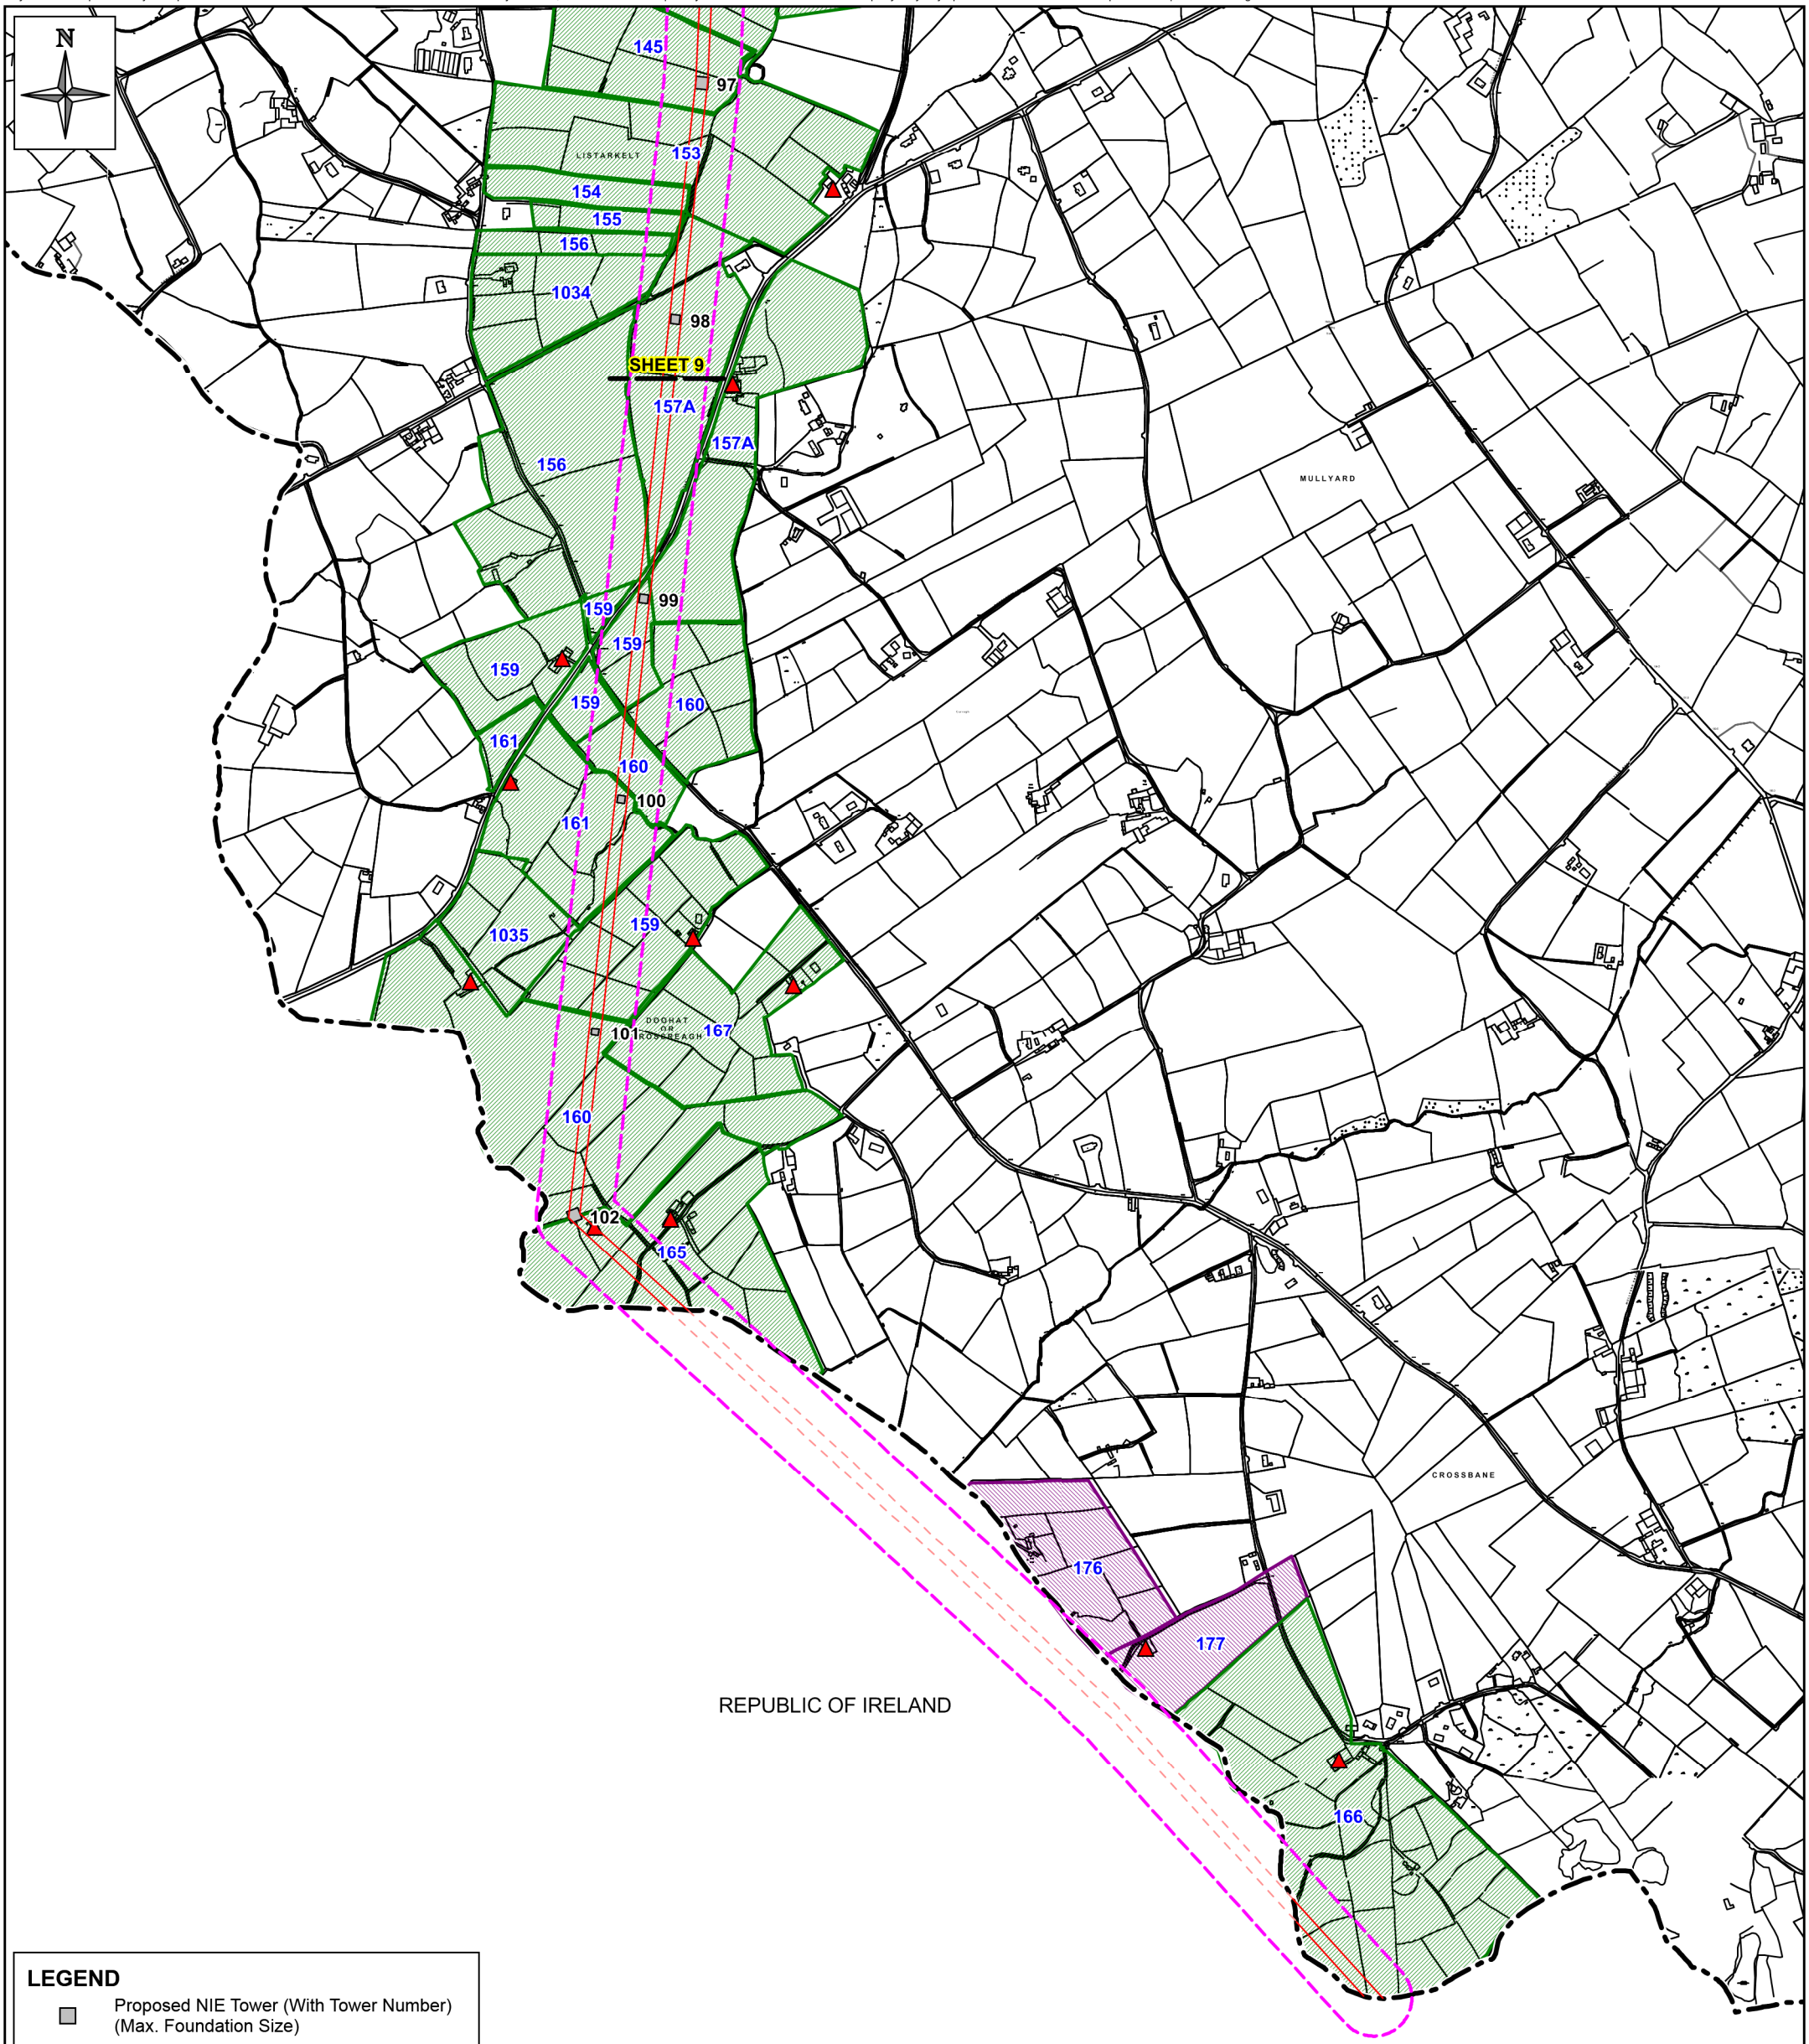

LEGEND

- Proposed NIE Tower (With Tower Number) (Max. Foundation Size)
- Proposed NIE 400kV Overhead Line
- Indicative EirGrid 400kV Overhead Line
- Farmyard
- Agricultural Land Parcel Affected By Proposed NIE 400kV Overhead Line
- Agricultural Land Parcel Affected By Indicative EirGrid 400kV Overhead Line
- 60m Buffer From Proposed OHL Centreline
- NI / RoI Border

This material is based upon Crown Copyright and is reproduced with the permission of Land & Property Services under delegated authority from the Controller of Her Majesty's Stationery Office, © Crown Copyright & database rights FLA213. Unauthorised reproduction infringes © Crown Copyright and may lead to prosecution or civil proceedings.

Client: Northern Ireland Electricity

Project: TYRONE TO CAVAN INTERCONNECTOR CONSOLIDATED ES

Title: FIGURE 14.10: AFFECTED AGRICULTURAL LAND PARCELS (SHEET 10 OF 10)

AECOM
9th Floor
The Clarence West Building
2 Clarence Street West
BELFAST, BT2 7GP
Tel: +44 (0) 28 9060 7200
Fax: +44 (0) 28 9060 7399
www.aecom.com

Design:	CC	Drawn:	GB
Chk'd:	FL	App'd:	FL
Date:	24/05/2013	Scale:	1:10,000 @ A3

No: 60032220/3528/14.10/10