


NOTES
SERVICES
 THE POSITION OF THE SERVICES SHOWN ON THIS PLAN ARE APPROXIMATE AND ARE FOR INFORMATION PURPOSES ONLY. TRIAL HOLES SHOULD BE DUG BY HAND, WHERE PROPOSED OPERATIONS ARE IN CLOSE PROXIMITY TO THE SERVICES SHOWN, TO DETERMINE THE PRECISE LOCATIONS OF THE SERVICES.

LANDSCAPING
 FOR DETAILS OF PROPOSED PLANTING SEE LANDSCAPE ARCHITECT DRAWING

- KEY**
- PLANNING APPLICATION BOUNDARY FOR SUBSTATION
 - ESTIMATED LEVEL OF A 1% (Q100) FLOOD EVENT
 - ESTIMATED LEVEL OF A 0.5% (Q200) FLOOD EVENT
 - SLOPES AND BUNDING
 - - - PROPOSED PERFORATED FIELD DRAIN (WAVIN COIL OR SIMILAR APPROVED)
 - - - PROPOSED UNPERFORATED FILTER DRAIN (WAVIN TWINWALL OR SIMILAR APPROVED)
 - - - PROPOSED HALF PERFORATED FILTER DRAIN (WAVIN TWINWALL OR SIMILAR APPROVED)
 - - - PROPOSED UPVC FOUL SEWER

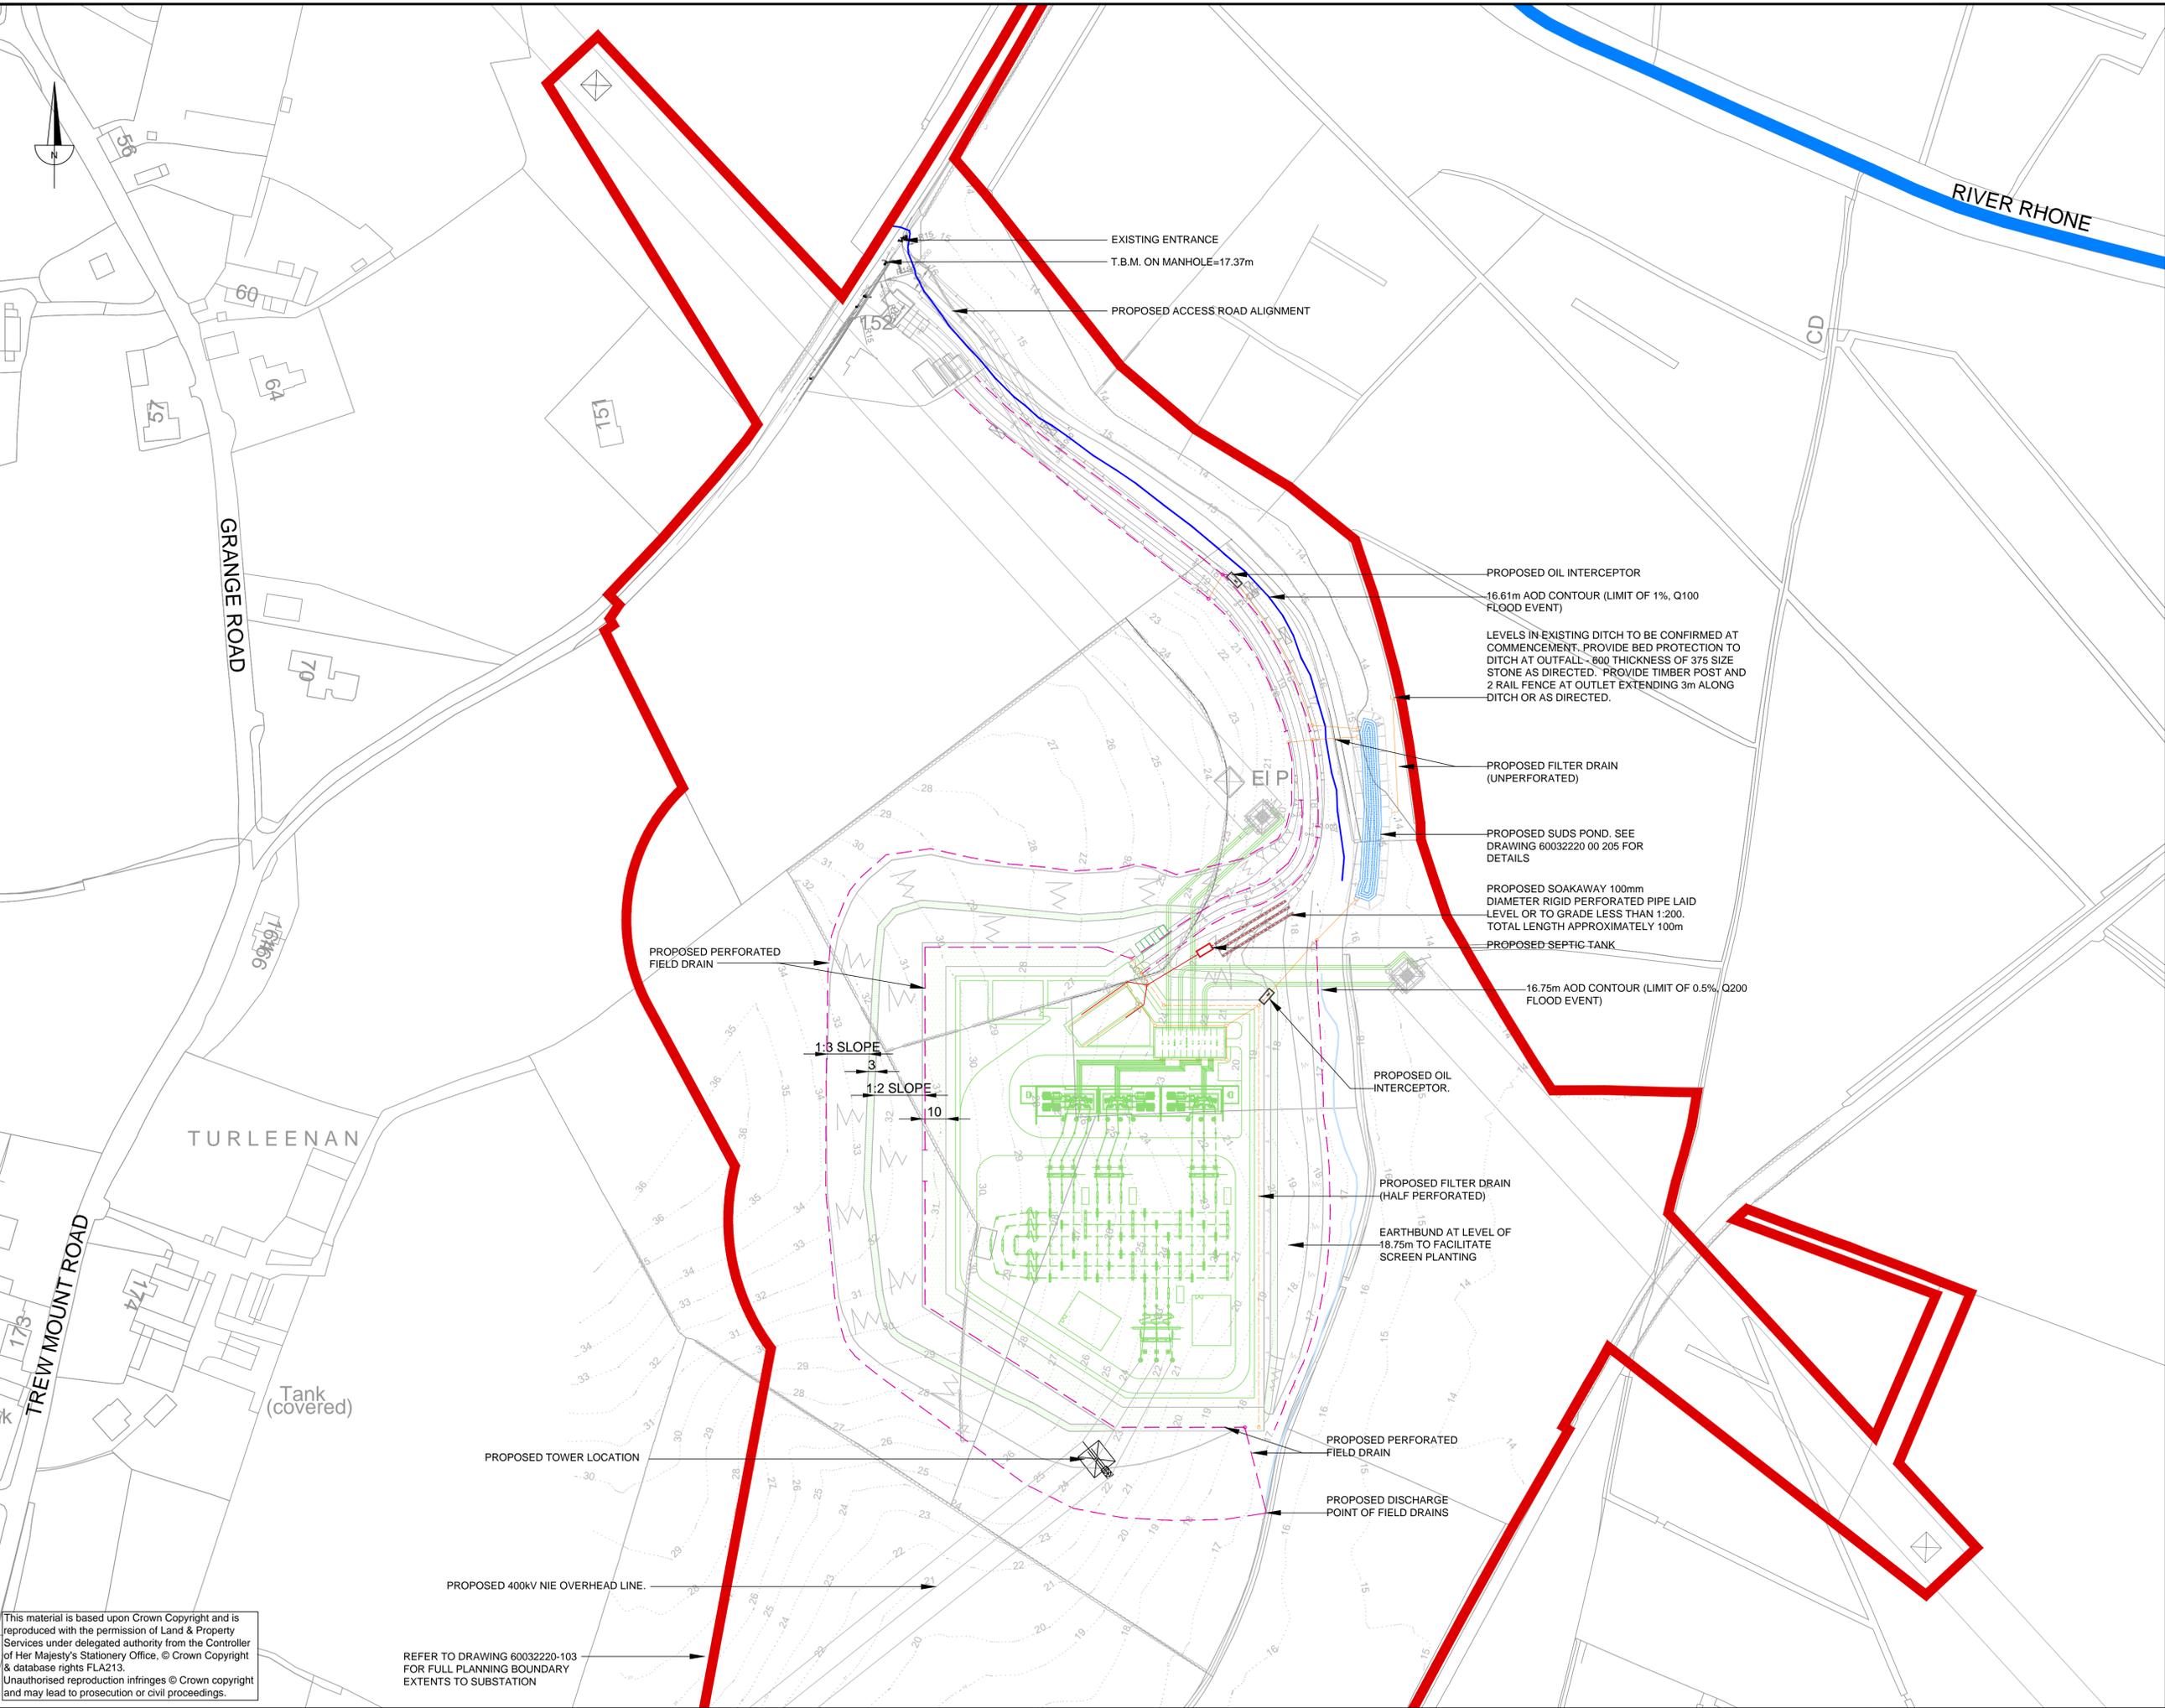

Rev	Date	Detail	Made	Chk'd	App'd

Status: **PLANNING**

Client:

Project: **TYRONE TO CAVAN INTERCONNECTOR**

Title: **PROPOSED DRAINAGE LAYOUT**

Design: RM	CAD: RM
Chk'd: PMcA	App'd: PMcA
Date: 03/03/13	Scale: 1:1250

AECOM

9th Floor
 The Clarence West Building
 2 Clarence West Street
 BELFAST
 BT2 7GP

Tel: +44 (0) 28 9060 7200
 Fax: +44 (0) 28 9060 7399
 www.aecom.com

No. 60032220 00 204	Rev: F
---------------------	--------

This material is based upon Crown Copyright and is reproduced with the permission of Land & Property Services under delegated authority from the Controller of Her Majesty's Stationery Office, © Crown Copyright & database rights FLA213.
 Unauthorised reproduction infringes © Crown copyright and may lead to prosecution or civil proceedings.

REFER TO DRAWING 60032220-103 FOR FULL PLANNING BOUNDARY EXTENTS TO SUBSTATION