



LABORATORY TEST REPORT

BRE Test Suite B - Greenfield Site

Project:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co. Cork	Lab Ref. No.:	ST 93430
Order No.:	2003-104	Date Received:	09/03/2020
Originator:	Ian Holley	Date Reported:	08/04/2020
		Material:	Soil
		Date Tested:	07/04/2020
		Specification:	Client

Sample Details

XC219-CPRC02 Type D Sample 6

Supplier:	Client Info	Date of Sampling:	Client Info.
Source:	Client Info	Sampled By:	Client
Sample Location:	2.0-3.0m	Sampling Reason:	Request

Parameter	RESULT
pH	8.1
Sulphate Aqueous Extract (SO4) (mg/l)	11
Sulphur as S, Total (%)	0.01
Sulphate as SO4, Total (%)	0.01

Comments:

None

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

**Tested in accordance with the above specifications
Subcontracted to a laboratory UKAS accredited for this testing**

Approved Signature
JAMES FISHER TESTING SERVICES (IRELAND) LTD.

James Ward, Operations Manager





LABORATORY TEST REPORT

MOISTURE CONTENT BS 1377 : Part 2 : 1990 Oven Drying Method cl 3.2

Site:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton	Lab Ref No.:	ST 93428
Order No:	2003-104	Date Received:	09/03/2020
Originator:	Ian Holley	Date Tested:	27/03/2020
		Date Reported:	02/04/2020
		Specification:	Client

Sampled Ref: XC219-CPRC02 Type D Sample 6

Sample Type: Bulk **Location:** XC219-CPRC02 Type D Sample 6

Date Sampled: Client Info **Sample by:** Client

Depth: 2.0-3.0m **Material Type:** Soil

Moisture Content (%): 5.9

Tested in accordance with BS 1377: Part 2: 1990
Sample preparation by cone and quarter

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature

James Fisher Testing Services (Ireland) Ltd
James Ward, Operations Manager






LABORATORY TEST REPORT
LIQUID & PLASTIC LIMIT TESTS BS 1377: Part 2: 1990 CI 4.4,5.3

Site Ref.:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co Cork	Lab Ref No.:	ST 93429
Order No:	2003-104	Sample Ref.:	XC219-CPRC02 2.0-3.0m Type D S.6
Originator:	Ian Holley	Date Sampled:	Client Info
		Date Received:	09/03/2020
		Date Tested:	02/04/2020
		Date Reported:	22/04/2020

Sampling Certificate	No
Sampled By	Client
Sample Type	Bulk
Sample Preparation Method	Washed
MATERIAL	Soil
Retained 425 micron (%)	22
Natural Moisture Content (%)	10
Liquid Limit (single point)(%)	17
Plastic Limit (%)	Non-Plastic
Plasticity Index	N/A

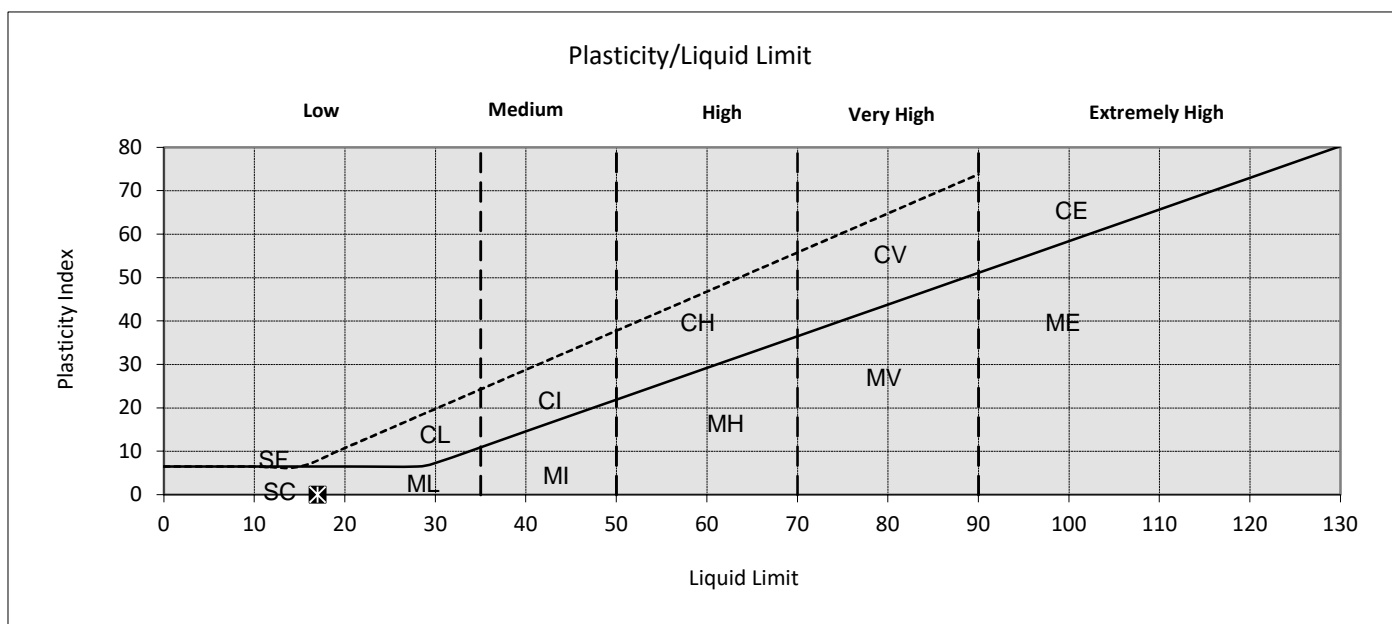

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature
 James Fisher Testing Services Ltd
 Phil Thorp, Laboratory Manager



LABORATORY TEST REPORT


Determination of Particle Size Distribution - BS 1377 : Part 2 : 1990

Determination of Particle Size Distribution (Hydrometer Sedimentation) - BS 1377 : Part 2 : 1990 Cl. 9.5

Project:	Cork Line Level Crossings	Job No:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton	Lab Ref No.:	ST 93427
		Date Received:	09/03/2020
		Date Reported:	02/04/2020
		Date Tested:	01/04/2020
Order No:	2003-104	Material:	Soil
Originator:	Ian Holley	Visual Description	Large Cobble, Dark Clay, Sandy

Client Ref.	XC219-CPRC02 Type B Sample 5
Location:	XC219-CPRC02 Type B Sample 5
Supplier:	Bulk
Source:	Client Info.
Depth (m):	2.0-3.0m
Sampling Reason:	Client Request
Sampled By:	Client
Specification:	Client
Preparation Method:	Without Organics Preparation
Notes:	Disturbed sample from cleanout

BS Sieve Size	% Passing	Specification
300 mm	100	
125 mm	100	
100 mm	62	
75 mm	45	
63 mm	45	
50 mm	45	
37.5 mm	32	
28 mm	31	
20 mm	29	
14 mm	28	
10 mm	26	
6.3 mm	24	
5 mm	22	
3.35 mm	20	
2 mm	18	
1.18 mm	17	
0.6 mm	15	
0.425 mm	15	
0.3 mm	14	
0.15 mm	12	
0.063 mm	10	
0.020 mm	9	
0.006 mm	5	
0.003 mm	4	
0.002 mm	3	
0.001 mm	2	

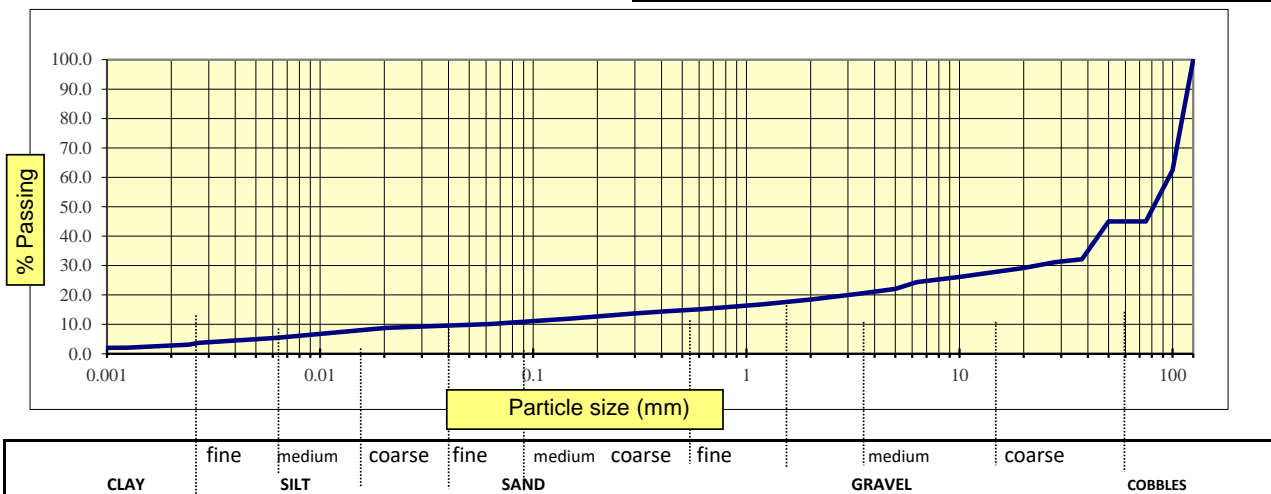

Tested in accordance with BS 1377: Part 2 : 1990 Clause 9.2 and 9.5

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.
 Sedimentation by Hydrometer - Not UKAS



Approved Signature
JAMES FISHER TESTING SERVICES (IRELAND) LTD.
 James Ward, Operations Manager



LABORATORY TEST REPORT


Determination of Particle Size Distribution - BS 1377 : Part 2 : 1990

Determination of Particle Size Distribution (Hydrometer Sedimentation) - BS 1377 : Part 2 : 1990 Cl. 9.5

Project:	Cork Line Level Crossings	Job No:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton	Lab Ref No.:	ST 93431
		Date Received:	09/03/2020
		Date Reported:	02/04/2020
		Date Tested:	01/04/2020
Order No:	2003-104	Material:	Soil
Originator:	Ian Holley	Visual Description	Large Cobble, Dark Clay, Sandy

Client Ref.	XC219-CPRC02 Type B Sample 7
Location:	XC219-CPRC02 Type B Sample 7
Supplier:	Bulk
Source:	Client Info.
Depth (m):	3.0-3.4m
Sampling Reason:	Client Request
Sampled By:	Client
Specification:	Client
Preparation Method:	Without Organics Preparation
Notes:	Disturbed sample from cleanout

BS Sieve Size	% Passing	Specification
300 mm	100	
125 mm	76	
100 mm	76	
75 mm	60	
63 mm	60	
50 mm	60	
37.5 mm	49	
28 mm	45	
20 mm	38	
14 mm	35	
10 mm	32	
6.3 mm	28	
5 mm	24	
3.35 mm	20	
2 mm	16	
1.18 mm	13	
0.6 mm	10	
0.425 mm	9	
0.3 mm	9	
0.15 mm	7	
0.063 mm	6	
0.020 mm	5	
0.006 mm	3	
0.003 mm	2	
0.002 mm	2	
0.001 mm	1	

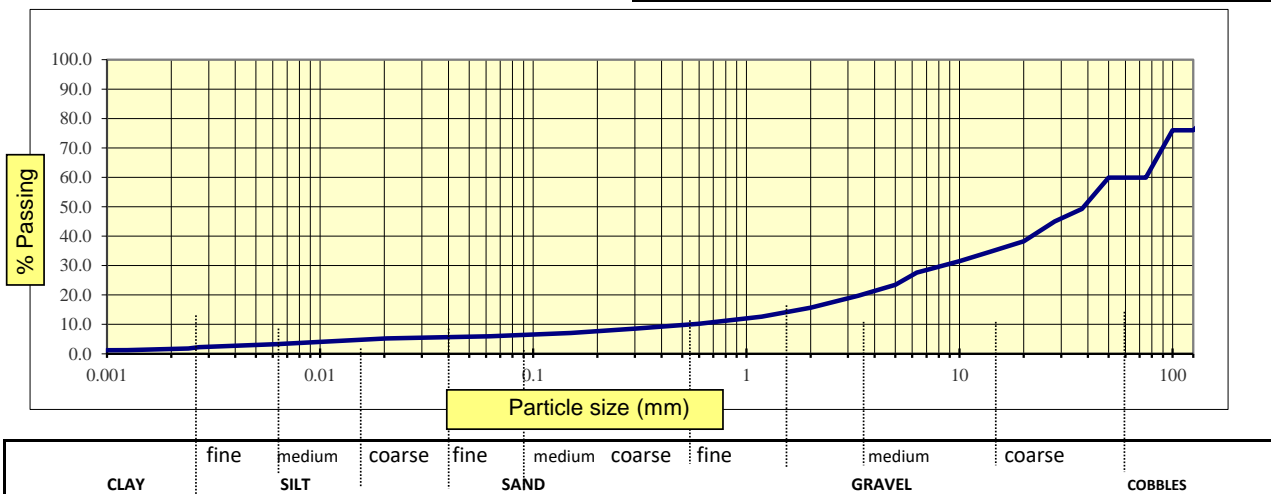

Tested in accordance with BS 1377: Part 2 : 1990 Clause 9.2 and 9.5

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.
 Sedimentation by Hydrometer - Not UKAS


 Approved Signature

JAMES FISHER TESTING SERVICES (IRELAND) LTD.

James Ward, Operations Manager





LABORATORY TEST REPORT

MOISTURE CONTENT BS 1377 : Part 2 : 1990 Oven Drying Method cl 3.2

Site:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton	Lab Ref No.:	ST 93432
Order No:	2003-104	Date Received:	09/03/2020
Originator:	Ian Holley	Date Tested:	27/03/2020
		Date Reported:	02/04/2020
		Specification:	Client

Sampled Ref: XC219-CPRC03 Type D Sample 3

Sample Type: Bulk **Location:** XC219-CPRC03 Type D Sample 3

Date Sampled: Client Info **Sample by:** Client

Depth: 0.5-1.2m **Material Type:** Soil

Moisture Content (%): 23

Tested in accordance with BS 1377: Part 2: 1990
Sample preparation by cone and quarter

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature

James Fisher Testing Services (Ireland) Ltd
James Ward, Operations Manager






LABORATORY TEST REPORT
LIQUID & PLASTIC LIMIT TESTS BS 1377: Part 2: 1990 CI 4.4,5.3

Site Ref.:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co Cork	Lab Ref No.:	ST 93433
Order No:	2003-104	Sample Ref.:	XC219-CPRC03 0.5-1.2m Type D S.3
Originator:	Ian Holley	Date Sampled:	Client Info
		Date Received:	09/03/2020
		Date Tested:	02/04/2020
		Date Reported:	22/04/2020

Sampling Certificate	No
Sampled By	Client
Sample Type	Bulk
Sample Preparation Method	Washed
MATERIAL	Soil
Retained 425 micron (%)	20
Natural Moisture Content (%)	20
Liquid Limit (single point)(%)	29
Plastic Limit (%)	22
Plasticity Index	6

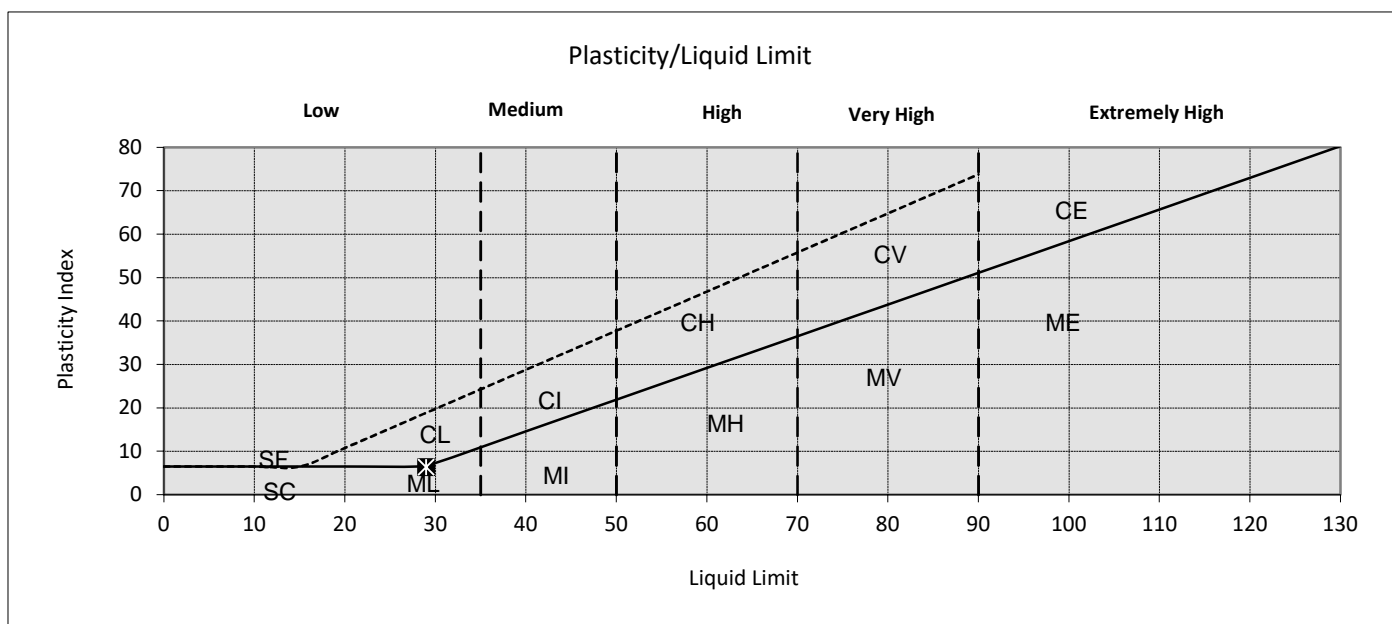

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature
 James Fisher Testing Services Ltd
 Phil Thorp, Laboratory Manager





LABORATORY TEST REPORT

BRE Test Suite B - Greenfield Site

Project:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co. Cork	Lab Ref. No.:	ST 93437
Order No.:	2003-104	Date Received:	09/03/2020
Originator:	Ian Holley	Date Reported:	08/04/2020
		Material:	Soil
		Date Tested:	07/04/2020
		Specification:	Client

Sample Details

XC219-CPRC03 Type D Sample 5

Supplier:	Client Info	Date of Sampling:	Client Info.
Source:	Client Info	Sampled By:	Client
Sample Location:	1.2-2.0m	Sampling Reason:	Request

Parameter	RESULT
pH	8.4
Sulphate Aqueous Extract (SO4) (mg/l)	11
Sulphur as S, Total (%)	0.01
Sulphate as SO4, Total (%)	0.02

Comments:

None

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Tested in accordance with the above specifications

Subcontracted to a laboratory UKAS accredited for this testing

Approved Signature

JAMES FISHER TESTING SERVICES (IRELAND) LTD.

James Ward, Operations Manager





LABORATORY TEST REPORT

MOISTURE CONTENT BS 1377 : Part 2 : 1990 Oven Drying Method cl 3.2

Site:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton	Lab Ref No.:	ST 93435
Order No:	2003-104	Date Received:	09/03/2020
Originator:	Ian Holley	Date Tested:	27/03/2020
		Date Reported:	02/04/2020
		Specification:	Client

Sampled Ref: XC219-CPRC03 Type D Sample 5

Sample Type: Bulk **Location:** XC219-CPRC03 Type D Sample 5

Date Sampled: Client Info **Sample by:** Client

Depth: 1.2-2.0m **Material Type:** Soil

Moisture Content (%): 5.1

Tested in accordance with BS 1377: Part 2: 1990
Sample preparation by cone and quarter

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature

James Fisher Testing Services (Ireland) Ltd
James Ward, Operations Manager






LABORATORY TEST REPORT
LIQUID & PLASTIC LIMIT TESTS BS 1377: Part 2: 1990 CI 4.4,5.3

Site Ref.:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co Cork	Lab Ref No.:	ST 93436
Order No:	2003-104	Sample Ref.:	XC219-CPRC03 1.2-2.0m Type D S.5
Originator:	Ian Holley	Date Sampled:	Client Info
		Date Received:	09/03/2020
		Date Tested:	27/03/2020
		Date Reported:	02/04/2020

Sampling Certificate	No
Sampled By	Client
Sample Type	Bulk
Sample Preparation Method	Washed
MATERIAL	Soil
Retained 425 micron (%)	65
Natural Moisture Content (%)	7
Liquid Limit (single point)(%)	19
Plastic Limit (%)	Non-Plastic
Plasticity Index	N/A

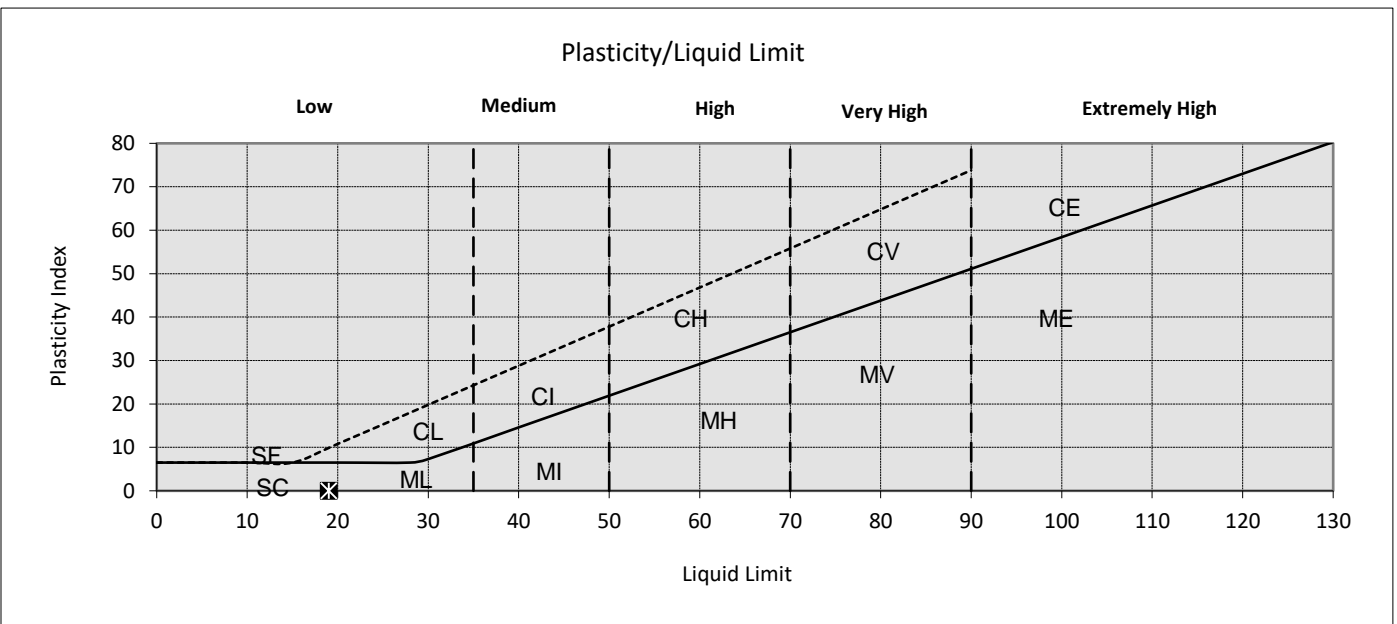

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature
 James Fisher Testing Services Ltd
 Phil Thorp, Laboratory Manager



LABORATORY TEST REPORT


Determination of Particle Size Distribution - BS 1377 : Part 2 : 1990

Determination of Particle Size Distribution (Hydrometer Sedimentation) - BS 1377 : Part 2 : 1990 Cl. 9.5

Project:	Cork Line Level Crossings	Job No:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton	Lab Ref No.:	ST 93434
		Date Received:	09/03/2020
		Date Reported:	02/04/2020
		Date Tested:	01/04/2020
Order No:	2003-104	Material:	Soil
Originator:	Ian Holley	Visual Description	Cobbly Clay, Sandy

Client Ref.	XC219-CPRC03 Type B Sample 4
Location:	XC219-CPRC03 Type B Sample 4
Supplier:	Bulk
Source:	Client Info.
Depth (m):	1.2-2.0m
Sampling Reason:	Client Request
Sampled By:	Client
Specification:	Client
Preparation Method:	Without Organics Preparation
Notes:	Disturbed sample from cleanout

BS Sieve Size	% Passing	Specification
300 mm	100	
125 mm	100	
100 mm	100	
75 mm	81	
63 mm	81	
50 mm	81	
37.5 mm	45	
28 mm	41	
20 mm	35	
14 mm	33	
10 mm	31	
6.3 mm	28	
5 mm	24	
3.35 mm	22	
2 mm	19	
1.18 mm	17	
0.6 mm	15	
0.425 mm	14	
0.3 mm	13	
0.15 mm	11	
0.063 mm	9	
0.020 mm	8	
0.006 mm	5	
0.003 mm	3	
0.002 mm	3	
0.001 mm	2	

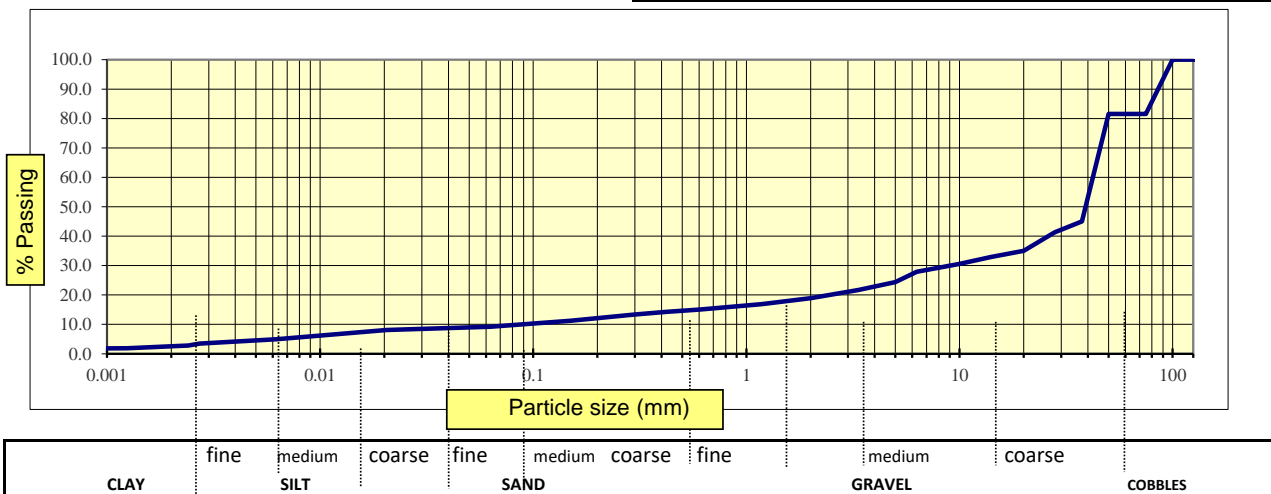

Tested in accordance with BS 1377: Part 2 : 1990 Clause 9.2 and 9.5

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.
 Sedimentation by Hydrometer - Not UKAS


 Approved Signature

JAMES FISHER TESTING SERVICES (IRELAND) LTD.
 James Ward, Operations Manager



LABORATORY TEST REPORT


Determination of Particle Size Distribution - BS 1377 : Part 2 : 1990

Determination of Particle Size Distribution (Hydrometer Sedimentation) - BS 1377 : Part 2 : 1990 Cl. 9.5

Project:	Cork Line Level Crossings	Job No:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton	Lab Ref No.:	ST 93438
		Date Received:	09/03/2020
		Date Reported:	02/04/2020
		Date Tested:	01/04/2020
Order No:	2003-104	Material:	Soil
Originator:	Ian Holley	Visual Description	Cobble, Light Clay, Sandy

Client Ref.	XC219-CPRC03 Type B Sample 7
Location:	XC219-CPRC03 Type B Sample 7
Supplier:	Bulk
Source:	Client Info.
Depth (m):	2.5-3.5m
Sampling Reason:	Client Request
Sampled By:	Client
Specification:	Client
Preparation Method:	Without Organics Preparation
Notes:	Disturbed sample from cleanout

BS Sieve Size	% Passing	Specification
300 mm	100	
125 mm	100	
100 mm	100	
75 mm	100	
63 mm	100	
50 mm	100	
37.5 mm	86	
28 mm	73	
20 mm	62	
14 mm	57	
10 mm	52	
6.3 mm	46	
5 mm	40	
3.35 mm	34	
2 mm	28	
1.18 mm	25	
0.6 mm	21	
0.425 mm	20	
0.3 mm	19	
0.15 mm	16	
0.063 mm	13	
0.020 mm	12	
0.006 mm	7	
0.003 mm	5	
0.002 mm	4	
0.001 mm	3	

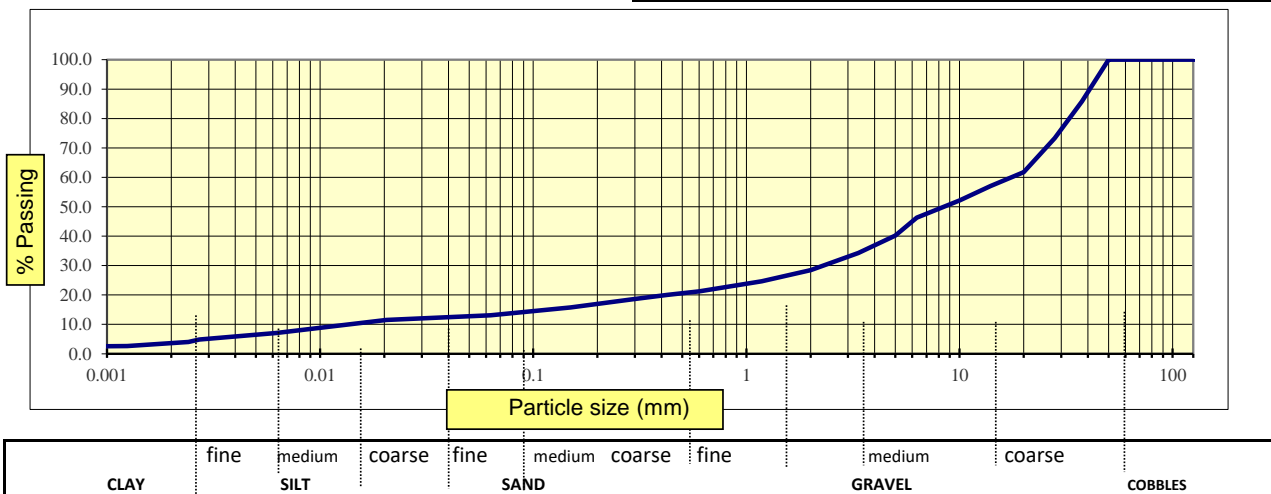

Tested in accordance with BS 1377: Part 2 : 1990 Clause 9.2 and 9.5

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.
 Sedimentation by Hydrometer - Not UKAS


 Approved Signature

JAMES FISHER TESTING SERVICES (IRELAND) LTD.
 James Ward, Operations Manager





LABORATORY TEST REPORT

BRE Test Suite B - Greenfield Site

Project:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co. Cork	Lab Ref. No.:	ST 93442
Order No.:	2003-104	Date Received:	09/03/2020
Originator:	Ian Holley	Date Reported:	09/04/2020
		Material:	Soil
		Date Tested:	07/04/2020
		Specification:	Client

Sample Details

XC219-CPRC03 Type B Sample 9

Supplier:	Client Info	Date of Sampling:	Client Info.
Source:	Client Info	Sampled By:	Client
Sample Location:	3.5-4.5m	Sampling Reason:	Request

Parameter	RESULT
pH	8.2
Sulphate Aqueous Extract (SO4) (mg/l)	11
Sulphur as S, Total (%)	0.01
Sulphate as SO4, Total (%)	0.01

Comments:

None

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Tested in accordance with the above specifications

Subcontracted to a laboratory UKAS accredited for this testing

Approved Signature

JAMES FISHER TESTING SERVICES (IRELAND) LTD.

James Ward, Operations Manager





LABORATORY TEST REPORT

MOISTURE CONTENT BS 1377 : Part 2 : 1990 Oven Drying Method cl 3.2

Site:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton	Lab Ref No.:	ST 93439
Order No:	2003-104	Date Received:	09/03/2020
Originator:	Ian Holley	Date Tested:	27/03/2020
		Date Reported:	02/04/2020
		Specification:	Client

Sampled Ref: XC219-CPRC03 Type D Sample 10

Sample Type: Bulk **Location:** XC219-CPRC03 Type D Sample 10

Date Sampled: Client Info **Sample by:** Client

Depth: 3.5-4.5m **Material Type:** Soil

Moisture Content (%): 2.7

Tested in accordance with BS 1377: Part 2: 1990
Sample preparation by cone and quarter

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature

James Fisher Testing Services (Ireland) Ltd
James Ward, Operations Manager



LABORATORY TEST REPORT


Determination of Particle Size Distribution - BS 1377 : Part 2 : 1990

Determination of Particle Size Distribution (Hydrometer Sedimentation) - BS 1377 : Part 2 : 1990 Cl. 9.5

Project:	Cork Line Level Crossings	Job No:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton	Lab Ref No.:	ST 93441
		Date Received:	09/03/2020
		Date Reported:	02/04/2020
		Date Tested:	01/04/2020
Order No:	2003-104	Material:	Soil
Originator:	Ian Holley	Visual Description	Cobbly Clay, Sandy

Client Ref.	XC219-CPRC03 Type B Sample 9
Location:	XC219-CPRC03 Type B Sample 9
Supplier:	Bulk
Source:	Client Info.
Depth (m):	3.5-4.5m
Sampling Reason:	Client Request
Sampled By:	Client
Specification:	Client
Preparation Method:	Without Organics Preparation
Notes:	Disturbed sample from cleanout

BS Sieve Size	% Passing	Specification
300 mm	100	
125 mm	100	
100 mm	80	
75 mm	65	
63 mm	65	
50 mm	65	
37.5 mm	10	
28 mm	10	
20 mm	9	
14 mm	8	
10 mm	7	
6.3 mm	6	
5 mm	5	
3.35 mm	5	
2 mm	4	
1.18 mm	3	
0.6 mm	3	
0.425 mm	3	
0.3 mm	2	
0.15 mm	2	
0.063 mm	2	
0.020 mm	1	
0.006 mm	1	
0.003 mm	1	
0.002 mm	0	
0.001 mm	0	

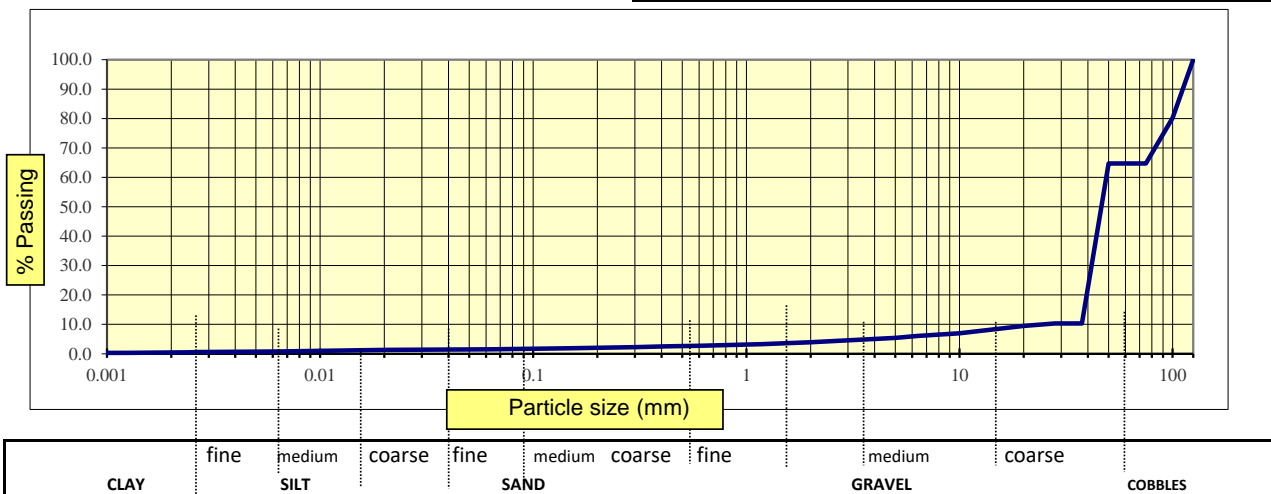

Tested in accordance with BS 1377: Part 2 : 1990 Clause 9.2 and 9.5

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.
 Sedimentation by Hydrometer - Not UKAS


 Approved Signature

JAMES FISHER TESTING SERVICES (IRELAND) LTD.

James Ward, Operations Manager






LABORATORY TEST REPORT
LIQUID & PLASTIC LIMIT TESTS BS 1377: Part 2: 1990 CI 4.4,5.3

Site Ref.:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co Cork	Lab Ref No.:	ST 93440
Order No:	2003-104	Sample Ref.:	XC219-CPRC03 3.5-4.5m Type D S.10
Originator:	Ian Holley	Date Sampled:	Client Info
		Date Received:	09/03/2020
		Date Tested:	06/04/2020
		Date Reported:	22/04/2020

Sampling Certificate	No
Sampled By	Client
Sample Type	Bulk
Sample Preparation Method	Washed
MATERIAL	Soil
Retained 425 micron (%)	19
Natural Moisture Content (%)	3
Liquid Limit (single point)(%)	17
Plastic Limit (%)	Non-Plastic
Plasticity Index	N/A

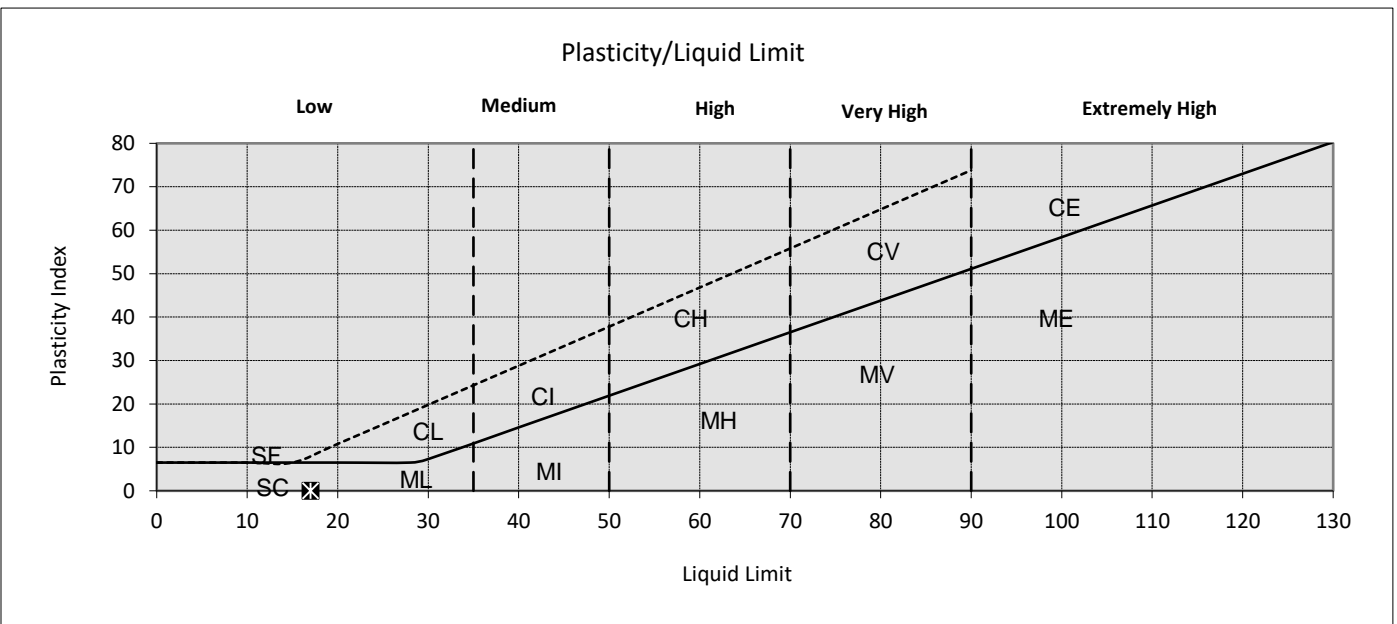

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature
James Fisher Testing Services Ltd
Phil Thorp, Laboratory Manager





LABORATORY TEST REPORT

BRE Test Suite B - Greenfield Site

Project:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co. Cork	Lab Ref. No.:	ST 93446
Order No.:	2003-104	Date Received:	09/03/2020
Originator:	Ian Holley	Date Reported:	09/04/2020
		Material:	Soil
		Date Tested:	07/04/2020
		Specification:	Client

Sample Details

XC219-CPRC04 Type D Sample 4

Supplier:	Client Info	Date of Sampling:	Client Info.
Source:	Client Info	Sampled By:	Client
Sample Location:	1.2-2.0m	Sampling Reason:	Request

Parameter	RESULT
pH	8.1
Sulphate Aqueous Extract (SO4) (mg/l)	11
Sulphur as S, Total (%)	<0.01
Sulphate as SO4, Total (%)	<0.01

Comments:

None

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Tested in accordance with the above specifications

Subcontracted to a laboratory UKAS accredited for this testing

Approved Signature

JAMES FISHER TESTING SERVICES (IRELAND) LTD.

James Ward, Operations Manager





LABORATORY TEST REPORT

MOISTURE CONTENT BS 1377 : Part 2 : 1990 Oven Drying Method cl 3.2

Site:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton	Lab Ref No.:	ST 93444
Order No:	2003-104	Date Received:	09/03/2020
Originator:	Ian Holley	Date Tested:	27/03/2020
		Date Reported:	02/04/2020
		Specification:	Client

Sampled Ref: XC219-CPRC04 Type D Sample 4

Sample Type: Bulk **Location:** XC219-CPRC04 Type D Sample 4

Date Sampled: Client Info **Sample by:** Client

Depth: 1.2-2.0m **Material Type:** Soil

Moisture Content (%): 5.7

Tested in accordance with BS 1377: Part 2: 1990
Sample preparation by cone and quarter

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature

James Fisher Testing Services (Ireland) Ltd
James Ward, Operations Manager



LABORATORY TEST REPORT


Determination of Particle Size Distribution - BS 1377 : Part 2 : 1990

Determination of Particle Size Distribution (Hydrometer Sedimentation) - BS 1377 : Part 2 : 1990 Cl. 9.5

Project:	Cork Line Level Crossings	Job No:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton	Lab Ref No.:	ST 93443
		Date Received:	09/03/2020
		Date Reported:	02/04/2020
		Date Tested:	01/04/2020
Order No:	2003-104	Material:	Soil
Originator:	Ian Holley	Visual Description	Large Cobble, Light Clay, Sandy

Client Ref.	XC219-CPRC04 Type B Sample 3
Location:	XC219-CPRC04 Type B Sample 3
Supplier:	Bulk
Source:	Client Info.
Depth (m):	1.2-2.0m
Sampling Reason:	Client Request
Sampled By:	Client
Specification:	Client
Preparation Method:	Without Organics Preparation
Notes:	Disturbed sample from cleanout

BS Sieve Size	% Passing	Specification
300 mm	100	
125 mm	32	
100 mm	32	
75 mm	32	
63 mm	32	
50 mm	32	
37.5 mm	26	
28 mm	23	
20 mm	22	
14 mm	21	
10 mm	20	
6.3 mm	18	
5 mm	17	
3.35 mm	16	
2 mm	15	
1.18 mm	14	
0.6 mm	13	
0.425 mm	12	
0.3 mm	12	
0.15 mm	11	
0.063 mm	10	
0.020 mm	9	
0.006 mm	5	
0.003 mm	4	
0.002 mm	3	
0.001 mm	2	

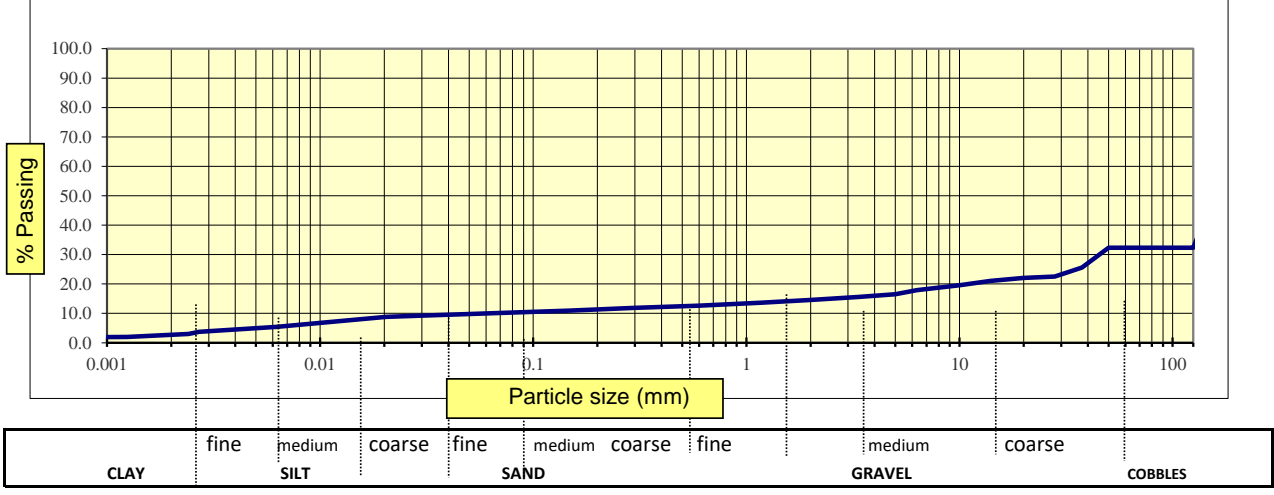

Tested in accordance with BS 1377: Part 2 : 1990 Clause 9.2 and 9.5

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.
 Sedimentation by Hydrometer - Not UKAS


 Approved Signature

JAMES FISHER TESTING SERVICES (IRELAND) LTD.
 James Ward, Operations Manager






LABORATORY TEST REPORT
LIQUID & PLASTIC LIMIT TESTS BS 1377: Part 2: 1990 CI 4.4,5.3

Site Ref.:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co Cork	Lab Ref No.:	ST 93445
Order No:	2003-104	Sample Ref.:	XC219-CPRC04 1.2-2.0m Type D S.4
Originator:	Ian Holley	Date Sampled:	Client Info
		Date Received:	09/03/2020
		Date Tested:	02/04/2020
		Date Reported:	22/04/2020

Sampling Certificate	No
Sampled By	Client
Sample Type	Bulk
Sample Preparation Method	Washed
MATERIAL	Soil
Retained 425 micron (%)	22
Natural Moisture Content (%)	18
Liquid Limit (single point)(%)	23
Plastic Limit (%)	17
Plasticity Index	6

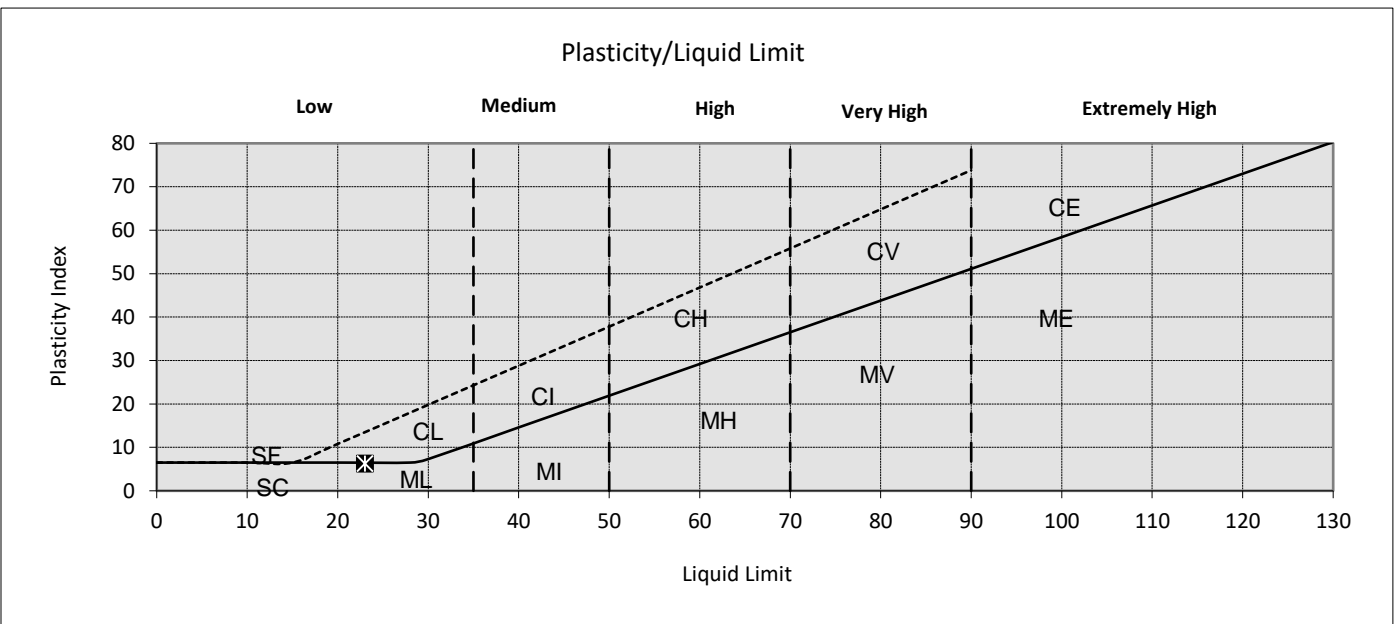

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature
 James Fisher Testing Services Ltd
 Phil Thorp, Laboratory Manager





LABORATORY TEST REPORT

Determination of Particle Size Distribution - BS 1377 : Part 2 : 1990


Determination of Particle Size Distribution (Hydrometer Sedimentation) - BS 1377 : Part 2 : 1990 Cl. 9.5

Moisture content to BS 1377: Part 2 : 1990 Oven Drying Method Cl 3.2

Project:	Cork Line Level Crossings	Job No:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co Cork	Lab Ref No.:	ST 93449
Order No:	2003-104	Date Received:	09/03/2020
Originator:	Ian Holley	Date Reported:	02/04/2020
		Date Tested:	31/03/2020
		Material:	Soil
		Visual Description	Cobbly, Sandy Clay

Client Ref.	XC219-CRPC05 Type B Sample 3
Location:	XC219-CRPC05 Type B Sample 3
Supplier:	Client Info.
Source:	Client Info.
Depth (m):	1.2-2.0m
Sampling Reason:	Client Request
Sampled By:	Client
Specification:	Client
Preparation Method:	Without Organics Preparation
Notes:	Disturbed sample from cleanout
Moisture Content%:	3

BS Sieve Size	% Passing	Specification
125 mm	100	
100 mm	100	
90 mm	100	
75 mm	100	
63 mm	100	
50 mm	100	
37.5 mm	43	
28 mm	33	
20 mm	27	
14 mm	25	
10 mm	23	
6.3 mm	20	
5 mm	19	
3.35 mm	17	
2 mm	14	
1.18 mm	10	
0.6 mm	7	
0.425 mm	6	
0.3 mm	4	
0.15 mm	3	
0.063 mm	2	
0.0205 mm	2	
0.0060 mm	1	
0.0029 mm	1	

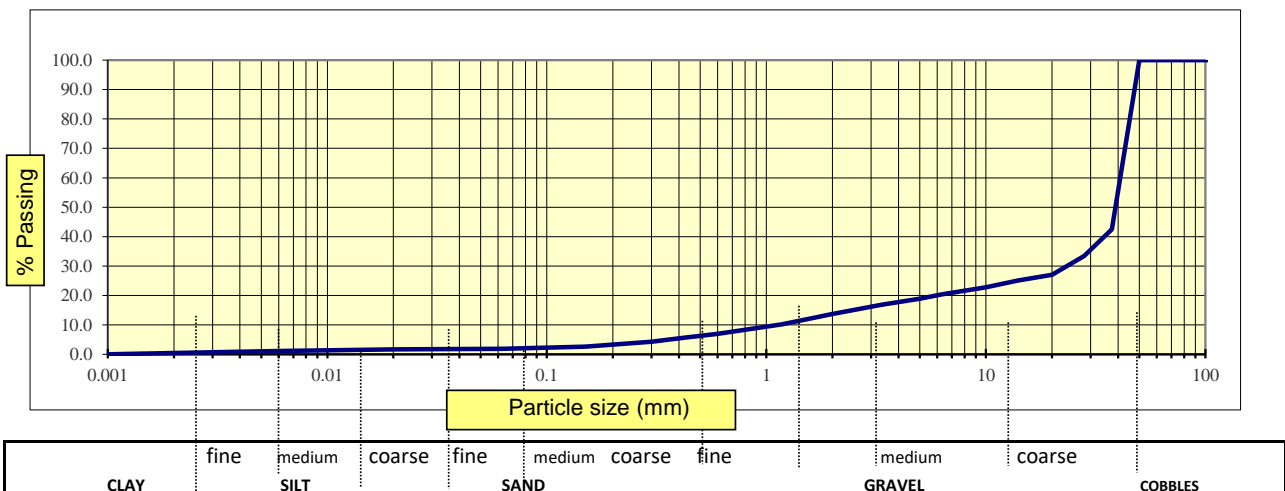

Tested in accordance with BS 1377: Part 2 : 1990 Clause 3.2. 9.2 and 9.5

Sedimentation by Hydrometer - Not UKAS

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature
JAMES FISHER TESTING SERVICES (IRELAND) LTD.
 James Ward, Operations Manager






LABORATORY TEST REPORT
LIQUID & PLASTIC LIMIT TESTS BS 1377: Part 2: 1990 CI 4.4,5.3

Site Ref.:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co Cork	Lab Ref No.:	ST 93448
Order No:	2003-104	Sample Ref.:	XC219-CPRC05 1.2-2.0m Type B S.3
Originator:	Ian Holley	Date Sampled:	Client Info
		Date Received:	09/03/2020
		Date Tested:	02/04/2020
		Date Reported:	22/04/2020

Sampling Certificate	No
Sampled By	Client
Sample Type	Bulk
Sample Preparation Method	Washed
MATERIAL	Soil
Retained 425 micron (%)	18
Natural Moisture Content (%)	3
Liquid Limit (single point)(%)	20
Plastic Limit (%)	Non-Plastic
Plasticity Index	N/A

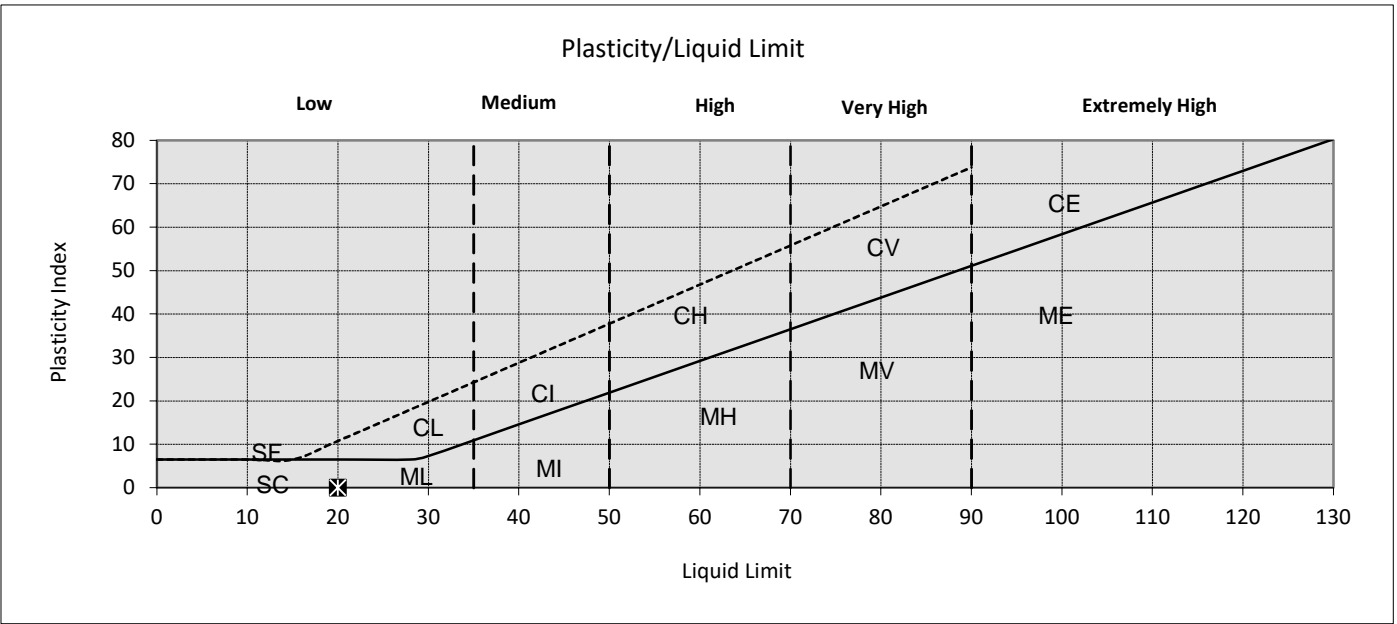

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature
James Fisher Testing Services Ltd
Phil Thorp, Laboratory Manager





LABORATORY TEST REPORT

Determination of Particle Size Distribution - BS 1377 : Part 2 : 1990


Determination of Particle Size Distribution (Hydrometer Sedimentation) - BS 1377 : Part 2 : 1990 Cl. 9.5

Moisture content to BS 1377: Part 2 : 1990 Oven Drying Method Cl 3.2

Project:	Cork Line Level Crossings	Job No:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co Cork	Lab Ref No.:	ST 93452
Order No:	2003-104	Date Received:	09/03/2020
Originator:	Ian Holley	Date Reported:	02/04/2020
		Date Tested:	31/03/2020
		Material:	Soil
		Visual Description	Dark Clay, Fine Sand

Client Ref.	XC219-TP02 Type B Sample 3
Location:	XC219-TP02 Type B Sample 3
Supplier:	Client Info.
Source:	Client Info.
Depth (m):	0.5-1.0m
Sampling Reason:	Client Request
Sampled By:	Client
Specification:	Client
Preparation Method:	Without Organics Preparation
Notes:	Disturbed sample from cleanout
Moisture Content%:	25

BS Sieve Size	% Passing	Specification
125 mm	100	
100 mm	100	
90 mm	100	
75 mm	100	
63 mm	100	
50 mm	100	
37.5 mm	100	
28 mm	100	
20 mm	100	
14 mm	100	
10 mm	100	
6.3 mm	100	
5 mm	100	
3.35 mm	100	
2 mm	100	
1.18 mm	99	
0.6 mm	97	
0.425 mm	95	
0.3 mm	91	
0.15 mm	83	
0.063 mm	77	
0.0205 mm	69	
0.0060 mm	48	
0.0029 mm	29	

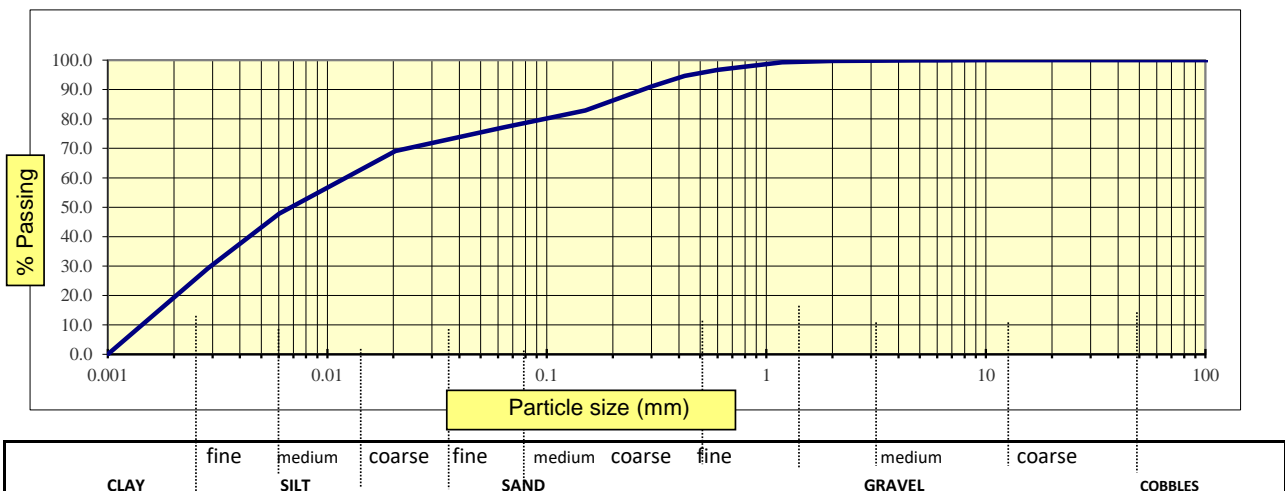

Tested in accordance with BS 1377: Part 2 : 1990 Clause 3.2, 9.2 and 9.5
 Sedimentation by Hydrometer - Not UKAS

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature
JAMES FISHER TESTING SERVICES (IRELAND) LTD.
 James Ward, Operations Manager




0955




LABORATORY TEST REPORT
 DETERMINATION OF CALIFORNIA BEARING RATIO - BS 1377 : Part 4 : 1990

Project : Cork Line Level Crossings	Job No: 19-135
Client : OCB Geotechnical	Lab Ref No: ST 93453
Unit 1 Carrigogna	Date Received: 09/03/2020
Midleton	Date Tested: 14/04/2020
Co Cork	Date Reported: 22/04/2020
Order No: 2003-104	Sample Ref: XC219-TP02 Type D Sample 4
Originator : Ian Holley	Location: 0.5-1.0m

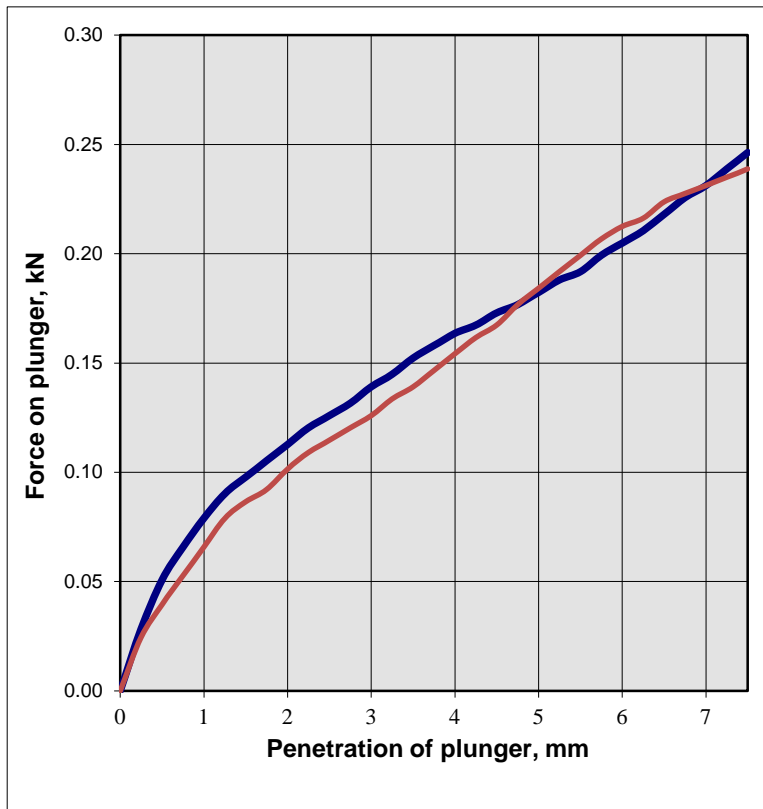

Type of Reaction Load
Load Frame
Technician(s)
NW
Mass of Surcharge Weights
8.8Kg
Overburden Pressure
3.9kPa
Material Type
Soil
Density (Mg/m³)
2.03
Proportion of material removed from initial sample by dry mass (%)
5.6

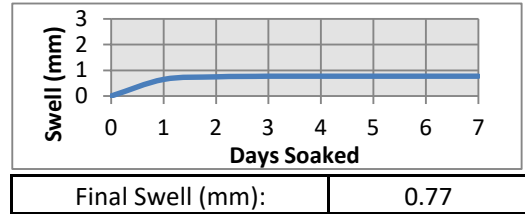

Final Swell (mm): 0.77

Penetration (mm)	Force (kN)	Standard Force (kN)	Top CBR (%)
2.5	0.13	13.2	1.0
5.0	0.18	20.0	0.9
Moisture content : %	24.3	Mean CBR value : %	0.9
Penetration (mm)	Force (kN)	Standard Force (kN)	Bottom CBR (%)
2.5	0.11	13.2	0.9
5.0	0.18	20.0	0.9
Moisture content : %	24.3	Mean CBR value : %	0.9

Moisture content determined in accordance with BS 1377 : Part 2 : 1990 - oven drying method
 CBR determined in accordance with BS 1377 : Part 4 : 1990
 The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature
 James Fisher Testing Services Ltd
 Phil Thorp, Laboratory Manager

James Fisher Testing Services Limited, a company registered in England and Wales with registration number: 01182561
 Registered office: Fisher House, PO Box 4, Barrow-in-Furness, Cumbria, LA14 1HR






LABORATORY TEST REPORT
LIQUID & PLASTIC LIMIT TESTS BS 1377: Part 2: 1990 CI 4.4,5.3

Site Ref.:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co Cork	Lab Ref No.:	ST 93451
Order No:	2003-104	Sample Ref.:	XC219-TP02 0.5-1.0m Type B S.3
Originator:	Ian Holley	Date Sampled:	Client Info
		Date Received:	09/03/2020
		Date Tested:	01/04/2020
		Date Reported:	22/04/2020

Sampling Certificate	No
Sampled By	Client
Sample Type	Bulk
Sample Preparation Method	Washed
MATERIAL	Soil
Retained 425 micron (%)	27
Natural Moisture Content (%)	33
Liquid Limit (single point)(%)	44
Plastic Limit (%)	31
Plasticity Index	13

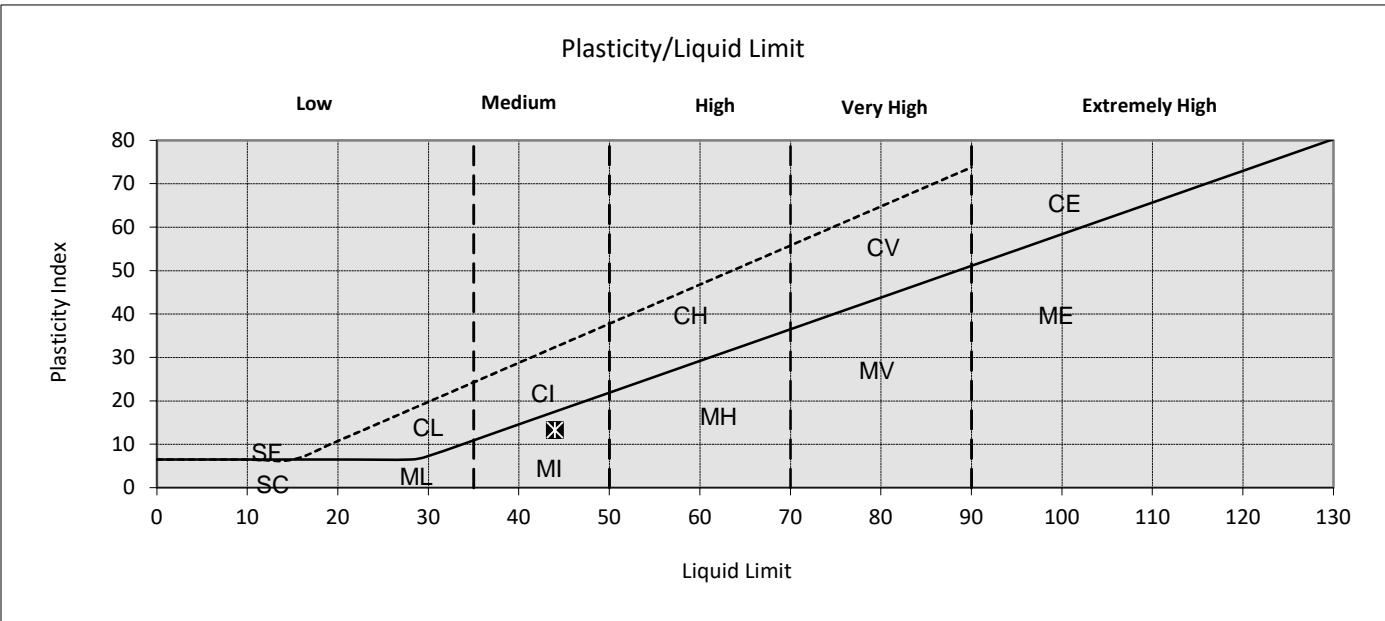

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature
James Fisher Testing Services Ltd
Phil Thorp, Laboratory Manager





LABORATORY TEST REPORT

MOISTURE CONTENT BS 1377 : Part 2 : 1990 Oven Drying Method cl 3.2

Site:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton	Lab Ref No.:	ST 93454
Order No:	2003-104	Date Received:	09/03/2020
Originator:	Ian Holley	Date Tested:	26/03/2020
		Date Reported:	06/04/2020
		Specification:	Client

Sampled Ref: XC219-TP02 Type B Sample 6

Sample Type: Bulk **Location:** XC219-TP02 Type B Sample 6

Date Sampled: Client Info **Sample by:** Client

Depth: 1.3-1.8m **Material Type:** Soil

Moisture Content (%): 32

Tested in accordance with BS 1377: Part 2: 1990
Sample preparation by cone and quarter

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature

James Fisher Testing Services (Ireland) Ltd
James Ward, Operations Manager






LABORATORY TEST REPORT
LIQUID & PLASTIC LIMIT TESTS BS 1377: Part 2: 1990 CI 4.4,5.3

Site Ref.:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co Cork	Lab Ref No.:	ST 93455
Order No:	2003-104	Sample Ref.:	XC219-TP02 1.3-1.8m Type B S.6
Originator:	Ian Holley	Date Sampled:	Client Info
		Date Received:	09/03/2020
		Date Tested:	07/04/2020
		Date Reported:	22/04/2020

Sampling Certificate	No
Sampled By	Client
Sample Type	Bulk
Sample Preparation Method	Washed
MATERIAL	Soil
Retained 425 micron (%)	25
Natural Moisture Content (%)	31
Liquid Limit (single point)(%)	38
Plastic Limit (%)	25
Plasticity Index	13

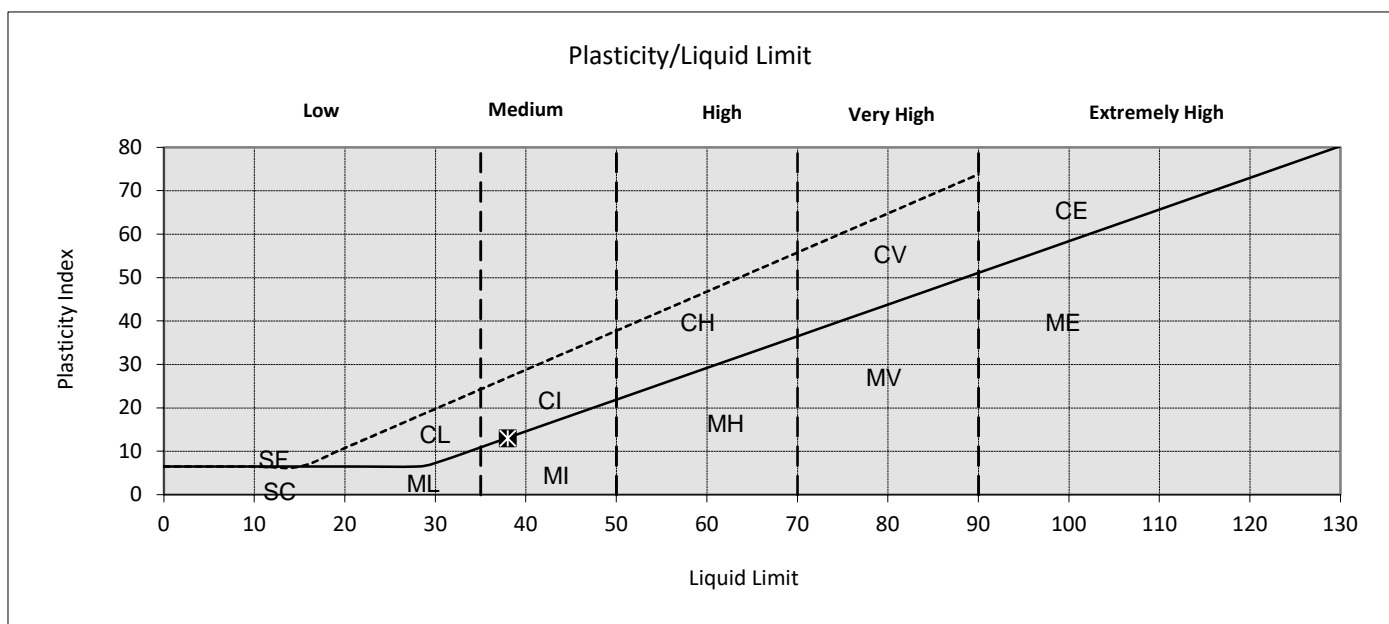

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature
 James Fisher Testing Services Ltd
 Phil Thorp, Laboratory Manager



LABORATORY TEST REPORT


Determination of Particle Size Distribution - BS 1377 : Part 2 : 1990

Determination of Particle Size Distribution (Hydrometer Sedimentation) - BS 1377 : Part 2 : 1990 Cl. 9.5

Project:	Cork Line Level Crossings	Job No:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton	Lab Ref No.:	ST 93456
		Date Received:	09/03/2020
		Date Reported:	02/04/2020
		Date Tested:	31/03/2020
Order No:	2003-104	Material:	Soil
Originator:	Ian Holley	Visual Description	Cobble, Light Clay, Sandy

Client Ref.	XC219-TP02 Type B Sample 7
Location:	XC219-TP02 Type B Sample 7
Supplier:	Bulk
Source:	Client Info.
Depth (m):	2.5-3.0m
Sampling Reason:	Client Request
Sampled By:	Client
Specification:	Client
Preparation Method:	Without Organics Preparation
Notes:	Disturbed sample from cleanout

BS Sieve Size	% Passing	Specification
300 mm	100	
125 mm	100	
100 mm	100	
75 mm	85	
63 mm	85	
50 mm	85	
37.5 mm	66	
28 mm	63	
20 mm	59	
14 mm	56	
10 mm	53	
6.3 mm	51	
5 mm	49	
3.35 mm	46	
2 mm	44	
1.18 mm	41	
0.6 mm	38	
0.425 mm	37	
0.3 mm	35	
0.15 mm	30	
0.063 mm	26	
0.020 mm	23	
0.006 mm	14	
0.003 mm	10	
0.002 mm	8	
0.001 mm	5	

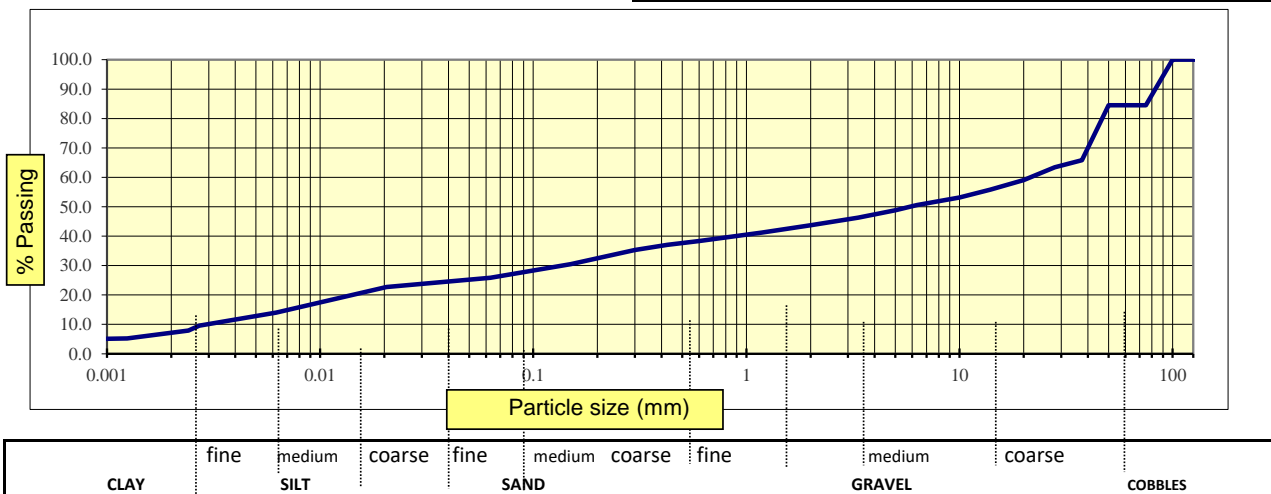

Tested in accordance with BS 1377: Part 2 : 1990 Clause 9.2 and 9.5

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.
 Sedimentation by Hydrometer - Not UKAS



Approved Signature
JAMES FISHER TESTING SERVICES (IRELAND) LTD.
 James Ward, Operations Manager





LABORATORY TEST REPORT

BRE Test Suite B - Greenfield Site

Project:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co. Cork	Lab Ref. No.:	ST 93457
Order No.:	2003-104	Date Received:	09/03/2020
Originator:	Ian Holley	Date Reported:	09/04/2020
		Material:	Soil
		Date Tested:	07/04/2020
		Specification:	Client

Sample Details

XC219-TP02 Type B Sample 9

Supplier:	Client Info	Date of Sampling:	Client Info.
Source:	Client Info	Sampled By:	Client
Sample Location:	3.5-4.0m	Sampling Reason:	Request

Parameter	RESULT
pH	8.2
Sulphate Aqueous Extract (SO4) (mg/l)	<10
Sulphur as S, Total (%)	<0.01
Sulphate as SO4, Total (%)	0.01

Comments:

None

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Tested in accordance with the above specifications

Subcontracted to a laboratory UKAS accredited for this testing

Approved Signature

JAMES FISHER TESTING SERVICES (IRELAND) LTD.

James Ward, Operations Manager






LABORATORY TEST REPORT
LIQUID & PLASTIC LIMIT TESTS BS 1377: Part 2: 1990 CI 4.4,5.3

Site Ref.:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co Cork	Lab Ref No.:	ST 93459
Order No:	2003-104	Sample Ref.:	XC219-TP03 0.3-0.55m Type B Sample
Originator:	Ian Holley	Date Sampled:	Client Info
		Date Received:	09/03/2020
		Date Tested:	26/03/2020
		Date Reported:	31/03/2020

Sampling Certificate	No
Sampled By	Client
Sample Type	Bulk
Sample Preparation Method	Washed
MATERIAL	Soil
Retained 425 micron (%)	81
Natural Moisture Content (%)	21
Liquid Limit (single point)(%)	18
Plastic Limit (%)	Non-Plastic
Plasticity Index	N/A

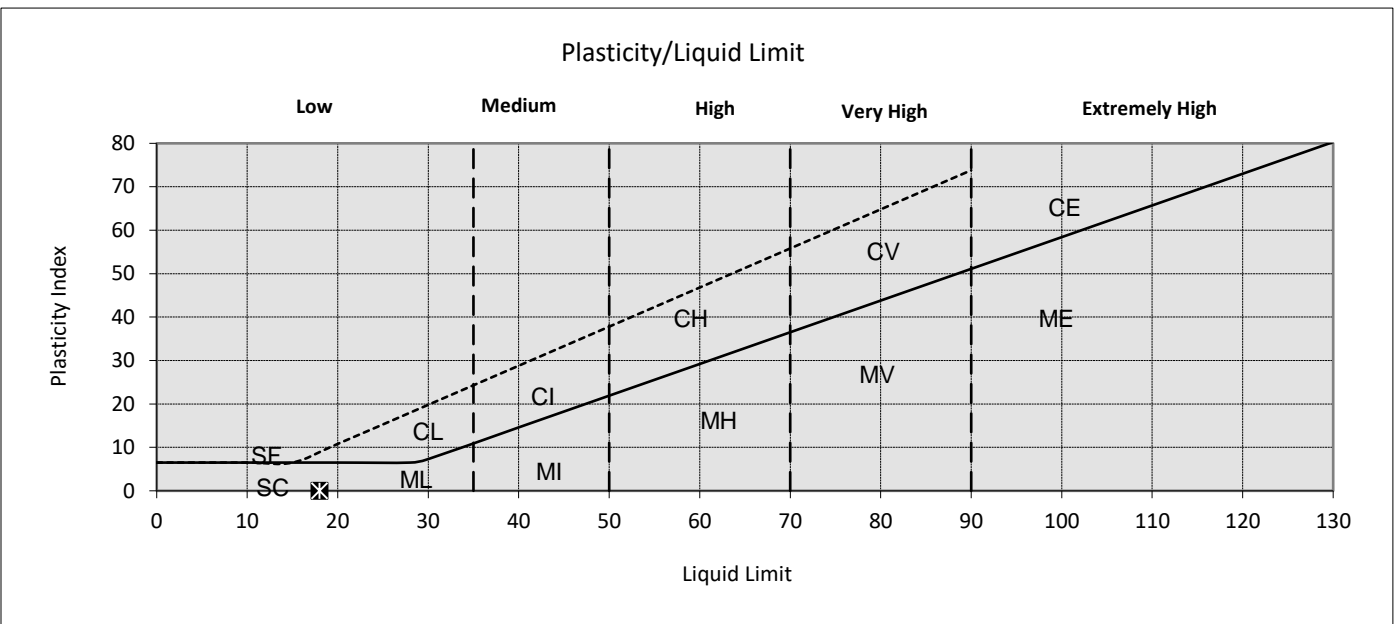

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature
 James Fisher Testing Services Ltd
 Phil Thorp, Laboratory Manager





LABORATORY TEST REPORT

Determination of Particle Size Distribution - BS 1377 : Part 2 : 1990


Determination of Particle Size Distribution (Hydrometer Sedimentation) - BS 1377 : Part 2 : 1990 Cl. 9.5

Moisture content to BS 1377: Part 2 : 1990 Oven Drying Method Cl 3.2

Project:	Cork Line Level Crossings	Job No:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co Cork	Lab Ref No.:	ST 93460
Order No:	2003-104	Date Received:	09/03/2020
Originator:	Ian Holley	Date Reported:	02/04/2020
		Date Tested:	31/03/2020
		Material:	Soil
		Visual Description	Cobble, Dark Clay

Client Ref.	XC219-TP03 Type B Sample 2
Location:	XC219-TP03 Type B Sample 2
Supplier:	Client Info.
Source:	Client Info.
Depth (m):	0.30-0.55m
Sampling Reason:	Client Request
Sampled By:	Client
Specification:	Client
Preparation Method:	Without Organics Preparation
Notes:	Disturbed sample from cleanout
Moisture Content%:	16

BS Sieve Size	% Passing	Specification
125 mm	100	
100 mm	100	
90 mm	100	
75 mm	100	
63 mm	100	
50 mm	100	
37.5 mm	69	
28 mm	64	
20 mm	64	
14 mm	62	
10 mm	61	
6.3 mm	60	
5 mm	59	
3.35 mm	58	
2 mm	56	
1.18 mm	54	
0.6 mm	52	
0.425 mm	50	
0.3 mm	47	
0.15 mm	39	
0.063 mm	28	
0.0205 mm	25	
0.0060 mm	17	
0.0029 mm	10	

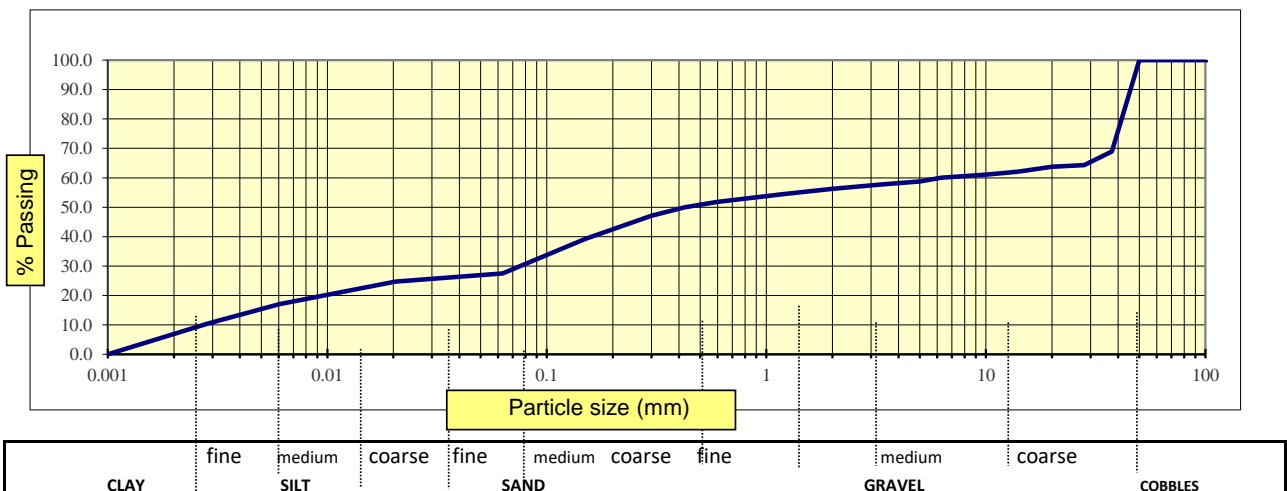

Tested in accordance with BS 1377: Part 2 : 1990 Clause 3.2, 9.2 and 9.5

Sedimentation by Hydrometer - Not UKAS

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature
JAMES FISHER TESTING SERVICES (IRELAND) LTD.
 James Ward, Operations Manager





LABORATORY TEST REPORT

MOISTURE CONTENT BS 1377 : Part 2 : 1990 Oven Drying Method cl 3.2

Site:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton	Lab Ref No.:	ST 93461
Order No:	2003-104	Date Received:	09/03/2020
Originator:	Ian Holley	Date Tested:	13/03/2020
		Date Reported:	25/03/2020
		Specification:	Client

Sampled Ref: XC219-TP03 Type B Sample 4

Sample Type: Bulk **Location:** XC219-TP03 Type B Sample 4

Date Sampled: Client Info **Sample by:** Client

Depth: 0.7-1.2m **Material Type:** Soil

Moisture Content (%): 20

Tested in accordance with BS 1377: Part 2: 1990
Sample preparation by cone and quarter

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature

James Fisher Testing Services (Ireland) Ltd
James Ward, Operations Manager






LABORATORY TEST REPORT
LIQUID & PLASTIC LIMIT TESTS BS 1377: Part 2: 1990 CI 4.4,5.3

Site Ref.:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co Cork	Lab Ref No.:	ST 93462
Order No:	2003-104	Sample Ref.:	XC219-TP03 0.7-1.2m Type B Sample 4
Originator:	Ian Holley	Date Sampled:	Client Info
		Date Received:	09/03/2020
		Date Tested:	20/03/2020
		Date Reported:	31/03/2020

Sampling Certificate	No
Sampled By	Client
Sample Type	Bulk
Sample Preparation Method	Washed
MATERIAL	Soil
Retained 425 micron (%)	72
Natural Moisture Content (%)	16
Liquid Limit (single point)(%)	21
Plastic Limit (%)	Non-Plastic
Plasticity Index	N/A

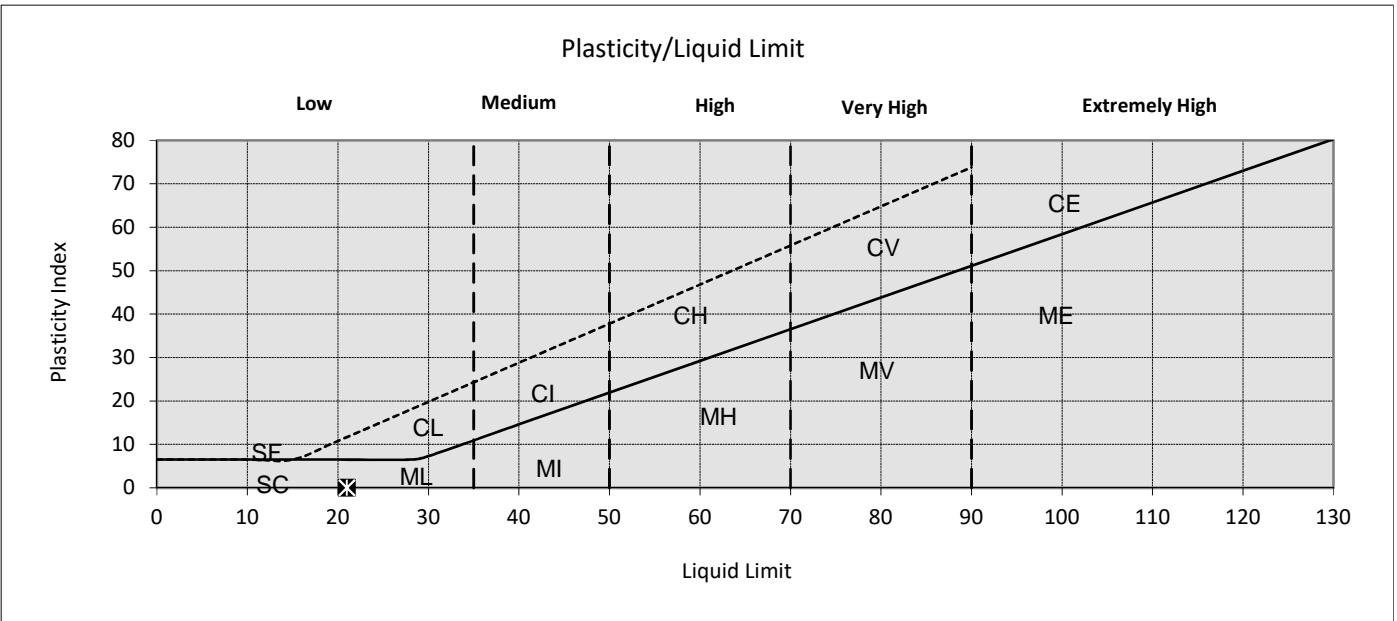

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature
James Fisher Testing Services Ltd
Phil Thorp, Laboratory Manager





LABORATORY TEST REPORT

Determination of Particle Size Distribution - BS 1377 : Part 2 : 1990

Project:	Cork Line Level Crossings	Job No:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton	Lab Ref No.:	ST 93463
		Date Received:	09/03/2020
		Date Reported:	25/03/2020
		Date Tested:	23/03/2020
Order No:	2003-104	Material:	Soil
Originator:	Ian Holley	Visual Description	Cobbly, Dark Clay

Client Ref. XC219-TP03 Type B Sample 4

Location: XC219-TP03 Type B Sample 4

Supplier: Bulk

Source: Client Info.

Depth (m): 0.7-1.2m

Sampling Reason: Client Request


Sampled By: Client

Specification: Client

Preparation Method: Without Organics Preparation

Notes: Disturbed sample from cleanout

BS Sieve Size	% Passing	Specification
300 mm	100	
125 mm	100	
100 mm	62	
75 mm	62	
63 mm	62	
50 mm	62	
37.5 mm	50	
28 mm	46	
20 mm	45	
14 mm	43	
10 mm	41	
6.3 mm	40	
5 mm	39	
3.35 mm	38	
2 mm	36	
1.18 mm	34	
0.6 mm	32	
0.425 mm	30	
0.3 mm	28	
0.15 mm	22	
0.063 mm	20	
0.019 mm	19	
0.006 mm	12	
0.003 mm	4	
0.003 mm	3	
0.001 mm	3	

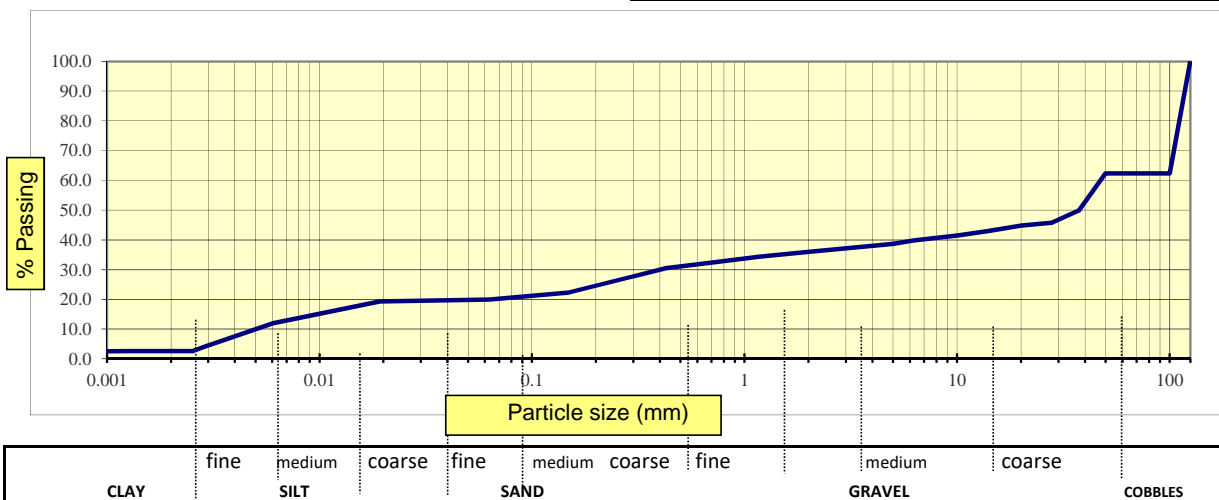

Tested in accordance with BS 1377: Part 2 : 1990 Clause 3.2, 9.2 and 9.5

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.
 Sedimentation by Hydrometer - Not UKAS

Approved Signature
JAMES FISHER TESTING SERVICES (IRELAND) LTD.
 James Ward, Operations Manager





LABORATORY TEST REPORT

BRE Test Suite B - Greenfield Site

Project:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co. Cork	Lab Ref. No.:	ST 93465
Order No.:	2003-104	Date Received:	09/03/2020
Originator:	Ian Holley	Date Reported:	09/04/2020
		Material:	Soil
		Date Tested:	07/04/2020
		Specification:	Client

Sample Details

XC219-TP03 Type B Sample 7

Supplier:	Client Info	Date of Sampling:	Client Info.
Source:	Client Info	Sampled By:	Client
Sample Location:	2.8-3.0m	Sampling Reason:	Request

Parameter	RESULT
pH	8.1
Sulphate Aqueous Extract (SO4) (mg/l)	<10
Sulphur as S, Total (%)	<0.01
Sulphate as SO4, Total (%)	0.01

Comments:

None

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Tested in accordance with the above specifications

Subcontracted to a laboratory UKAS accredited for this testing

Approved Signature

JAMES FISHER TESTING SERVICES (IRELAND) LTD.

James Ward, Operations Manager



LABORATORY TEST REPORT


Determination of Particle Size Distribution - BS 1377 : Part 2 : 1990

Determination of Particle Size Distribution (Hydrometer Sedimentation) - BS 1377 : Part 2 : 1990 Cl. 9.5

Project:	Cork Line Level Crossings	Job No:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton	Lab Ref No.:	ST 93464
		Date Received:	09/03/2020
		Date Reported:	02/04/2020
		Date Tested:	01/04/2020
Order No:	2003-104	Material:	Soil
Originator:	Ian Holley	Visual Description	Light Gravel, Sandy

Client Ref.	XC219-TP03 Type B Sample 6
Location:	XC219-TP03 Type B Sample 6
Supplier:	Bulk
Source:	Client Info.
Depth (m):	2.0-2.5m
Sampling Reason:	Client Request
Sampled By:	Client
Specification:	Client
Preparation Method:	Without Organics Preparation
Notes:	Disturbed sample from cleanout

BS Sieve Size	% Passing	Specification
300 mm	100	
125 mm	100	
100 mm	100	
75 mm	100	
63 mm	100	
50 mm	100	
37.5 mm	100	
28 mm	91	
20 mm	86	
14 mm	79	
10 mm	74	
6.3 mm	67	
5 mm	61	
3.35 mm	55	
2 mm	49	
1.18 mm	44	
0.6 mm	39	
0.425 mm	37	
0.3 mm	35	
0.15 mm	29	
0.063 mm	24	
0.020 mm	21	
0.006 mm	13	
0.003 mm	9	
0.002 mm	7	
0.001 mm	5	

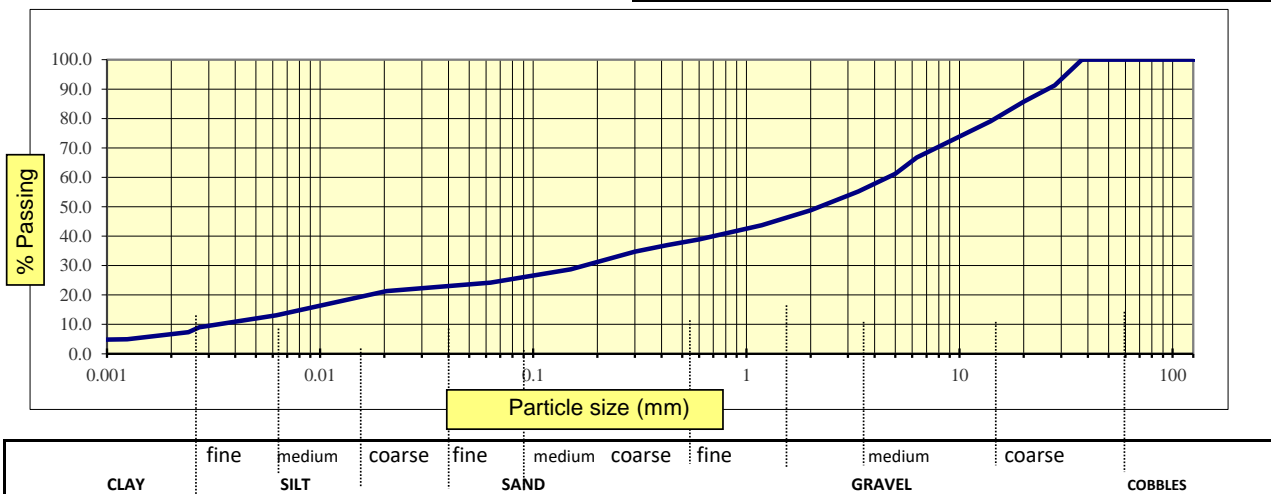

Tested in accordance with BS 1377: Part 2 : 1990 Clause 9.2 and 9.5

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.
 Sedimentation by Hydrometer - Not UKAS


 Approved Signature

JAMES FISHER TESTING SERVICES (IRELAND) LTD.
 James Ward, Operations Manager





LABORATORY TEST REPORT

BRE Test Suite B - Greenfield Site

Project:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co. Cork	Lab Ref. No.:	ST 93468
Order No.:	2003-104	Date Received:	09/03/2020
Originator:	Ian Holley	Date Reported:	09/04/2020
		Material:	Soil
		Date Tested:	07/04/2020
		Specification:	Client

Sample Details

XC219-TP04 Type B Sample 2

Supplier:	Client Info	Date of Sampling:	Client Info.
Source:	Client Info	Sampled By:	Client
Sample Location:	0.3-0.8m	Sampling Reason:	Request

Parameter	RESULT
pH	7.6
Sulphate Aqueous Extract (SO4) (mg/l)	<10
Sulphur as S, Total (%)	<0.01
Sulphate as SO4, Total (%)	0.01

Comments:

None

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Tested in accordance with the above specifications

Subcontracted to a laboratory UKAS accredited for this testing

Approved Signature

JAMES FISHER TESTING SERVICES (IRELAND) LTD.


James Ward, Operations Manager





LABORATORY TEST REPORT
 DETERMINATION OF CALIFORNIA BEARING RATIO - BS 1377 : Part 4 : 1990

Project : Cork Line Level Crossings	Job No: 19-135
Client : OCB Geotechnical	Lab Ref No: ST 93469
Unit 1 Carrigogna	Date Received: 09/03/2020
Midleton	Date Tested: 17/04/2020
Co Cork	Date Reported: 21/04/2020
Order No: 2003-104	Sample Ref: XC219-TP04 Type B Sample 2
Originator : Ian Holley	Location: 0.3-0.8m

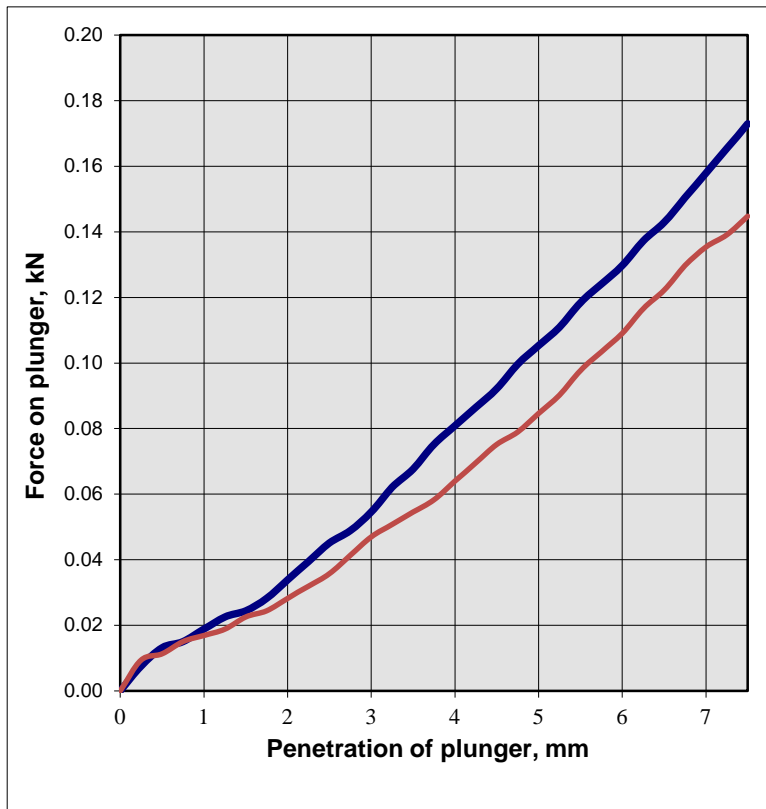

Type of Reaction Load
Load Frame
Technician(s)
NW
Mass of Surcharge Weights
8.8Kg
Overburden Pressure
3.9kPa
Material Type
Soil
Density (Mg/m³)
2.18
Proportion of material removed from initial sample by dry mass (%)
12.7
Swell (mm)
0
Days Soaked
0
Final Swell (mm):
N/A

Penetration (mm)	Force (kN)	Standard Force (kN)	Top CBR (%)
2.5	0.05	13.2	0.3
5.0	0.11	20.0	0.5
Moisture content : %	22.8	Mean CBR value : %	0.4
Penetration (mm)	Force (kN)	Standard Force (kN)	Bottom CBR (%)
2.5	0.04	13.2	0.3
5.0	0.08	20.0	0.4
Moisture content : %	22.8	Mean CBR value : %	0.3

Moisture content determined in accordance with BS 1377 : Part 2 : 1990 - oven drying method
 CBR determined in accordance with BS 1377 : Part 4 : 1990
 The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature
 James Fisher Testing Services Ltd
 Phil Thorp, Laboratory Manager

James Fisher Testing Services Limited, a company registered in England and Wales with registration number: 01182561
 Registered office: Fisher House, PO Box 4, Barrow-in-Furness, Cumbria, LA14 1HR





LABORATORY TEST REPORT

MOISTURE CONTENT BS 1377 : Part 2 : 1990 Oven Drying Method cl 3.2

Site:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton	Lab Ref No.:	ST 93466
Order No:	2003-104	Date Received:	09/03/2020
Originator:	Ian Holley	Date Tested:	27/03/2020
		Date Reported:	02/04/2020
		Specification:	Client

Sampled Ref: XC219-TP04 Type D Sample 2

Sample Type: Bulk **Location:** XC219-TP04 Type D Sample 2

Date Sampled: Client Info **Sample by:** Client

Depth: 0.3-0.8m **Material Type:** Soil

Moisture Content (%): 19

Tested in accordance with BS 1377: Part 2: 1990
Sample preparation by cone and quarter

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.


Approved Signature

James Fisher Testing Services (Ireland) Ltd
James Ward, Operations Manager






LABORATORY TEST REPORT
LIQUID & PLASTIC LIMIT TESTS BS 1377: Part 2: 1990 CI 4.4,5.3

Site Ref.:	Cork Line Level Crossings	Job No.:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton Co Cork	Lab Ref No.:	ST 93467
Order No:	2003-104	Sample Ref.:	XC219-TP04 0.3-0.8m Type B S.2
Originator:	Ian Holley	Date Sampled:	Client Info
		Date Received:	09/03/2020
		Date Tested:	03/04/2020
		Date Reported:	22/04/2020

Sampling Certificate	No
Sampled By	Client
Sample Type	Bulk
Sample Preparation Method	Washed
MATERIAL	Soil
Retained 425 micron (%)	23
Natural Moisture Content (%)	19
Liquid Limit (single point)(%)	24
Plastic Limit (%)	17
Plasticity Index	7

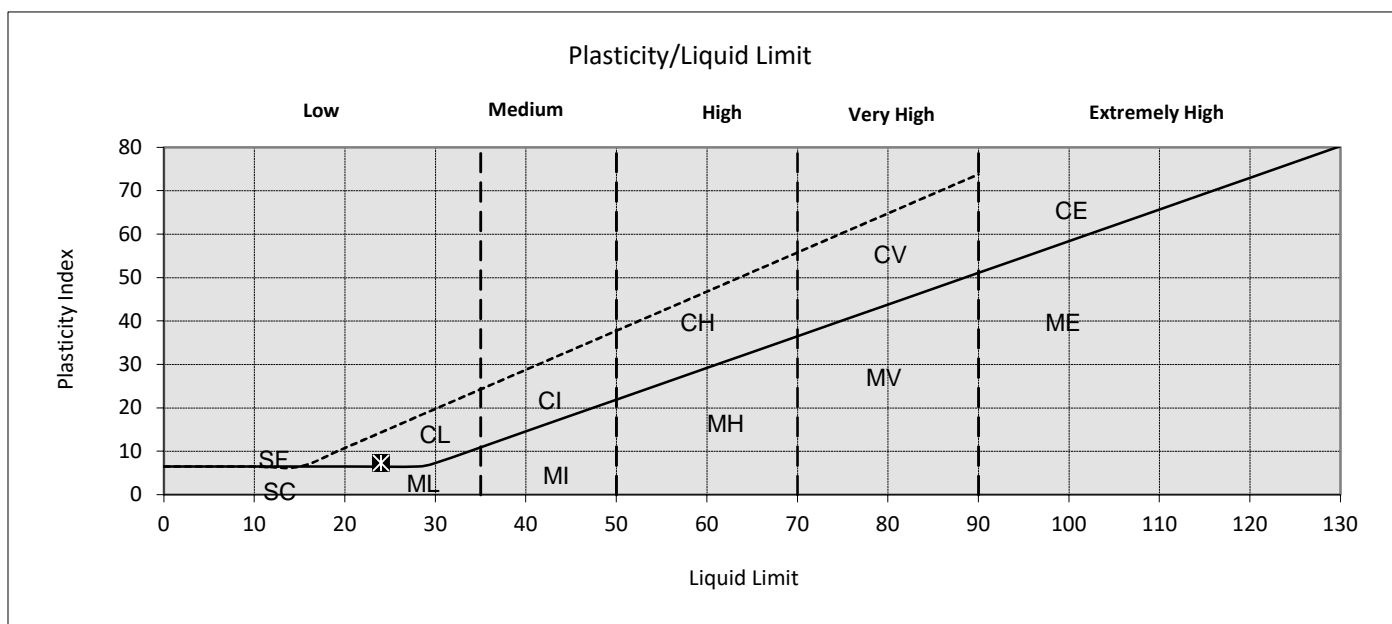

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.

Approved Signature
 James Fisher Testing Services Ltd
 Phil Thorp, Laboratory Manager



LABORATORY TEST REPORT


Determination of Particle Size Distribution - BS 1377 : Part 2 : 1990

Determination of Particle Size Distribution (Hydrometer Sedimentation) - BS 1377 : Part 2 : 1990 Cl. 9.5

Project:	Cork Line Level Crossings	Job No:	19-135
Client:	OCB Geotechnical Unit 1 Carrigogna Midleton	Lab Ref No.:	ST 93470
		Date Received:	09/03/2020
		Date Reported:	02/04/2020
		Date Tested:	31/03/2020
Order No:	2003-104	Material:	Soil
Originator:	Ian Holley	Visual Description	Cobbly Dark Clay, Fine Sand

Client Ref.	XC219-TP04 Type B Sample 5
Location:	XC219-TP04 Type B Sample 5
Supplier:	Bulk
Source:	Client Info.
Depth (m):	1.0-1.5m
Sampling Reason:	Client Request
Sampled By:	Client
Specification:	Client
Preparation Method:	Without Organics Preparation
Notes:	Disturbed sample from cleanout

BS Sieve Size	% Passing	Specification
300 mm	100	
125 mm	100	
100 mm	100	
75 mm	100	
63 mm	100	
50 mm	100	
37.5 mm	57	
28 mm	51	
20 mm	46	
14 mm	43	
10 mm	40	
6.3 mm	37	
5 mm	34	
3.35 mm	32	
2 mm	30	
1.18 mm	28	
0.6 mm	26	
0.425 mm	25	
0.3 mm	24	
0.15 mm	21	
0.063 mm	17	
0.020 mm	15	
0.006 mm	9	
0.003 mm	6	
0.002 mm	5	
0.001 mm	3	

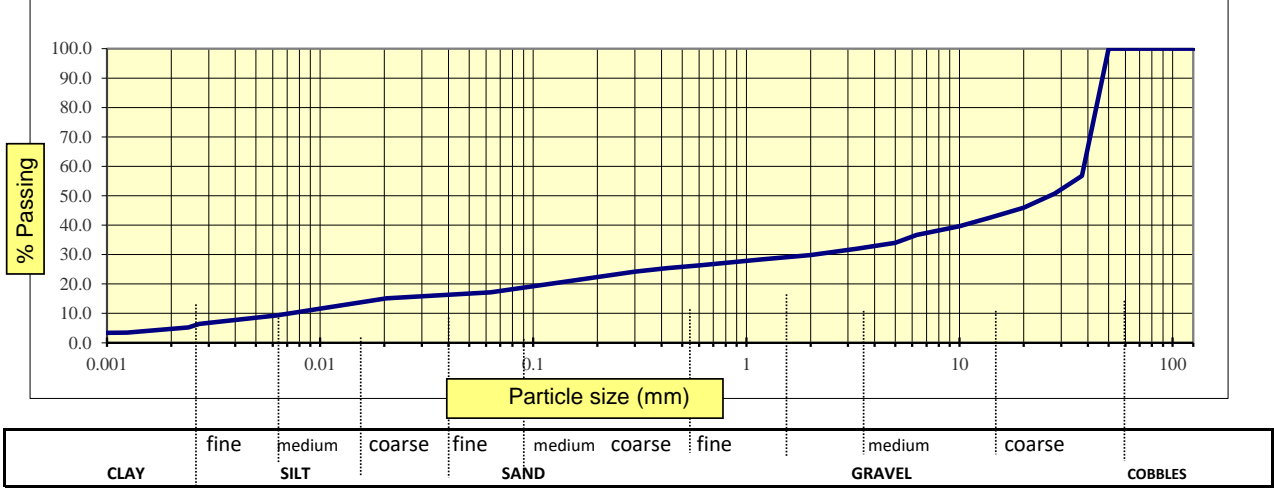

Tested in accordance with BS 1377: Part 2 : 1990 Clause 9.2 and 9.5

The stated result only relates to the item/location tested, this report shall not be reproduced except in full.
 Sedimentation by Hydrometer - Not UKAS


 Approved Signature

JAMES FISHER TESTING SERVICES (IRELAND) LTD.
 James Ward, Operations Manager




INDEX PROPERTIES - SUMMARY OF RESULTS

Hole No.	Sample			Soil Description	ρ	ρ_d	W	< 425 μm sieve	W_L	W_P	I_P	ρ_s	Remarks
	No.	Depth (m)			type	Mg/m3	%	%	%	%	Mg/m3		
		from	to										
XC219-CPRC01	6	0.50	1.20	D	Brown slightly sandy slightly gravelly CLAY			21	78 s	34 a	20	14	

General notes: All above tests carried out to BS1377 : 1990 unless annotated otherwise. See Remarks for further details


Key : ρ bulk density, linear W_L Liquid limit W_P Plastic limit <425 μm preparation ρ_s particle density
 ρ_d dry density a 4 point cone test NP non - plastic n from natural soil -g = gas jar
 w moisture content b 1 point cone test IP Plasticity Index s sieved specimen -p = small pyknometer

* test carried out to BS EN ISO 17892 h removed by hand

QA Ref SLR 1 Rev 2.95 Mar 17		Project No N9426-20 Project Name Cork Line Level Crossings	Figure INDX
		The results reported relate only to the samples tested; opinions and interpretations expressed herein are outside the scope of UKAS accreditation. © Copyright 2017 SOCOTEC UK Limited	Printed: 20/11/2020 09:59

Particle Size Distribution Analysis

Sample Details:	SAMPLE ID:	Hole No	XC219-TP01
	SOCO2020100237	Sample Depth (m BGL)	0.50 - 1.00
		Sample Type and No	B5
		Specimen Ref	

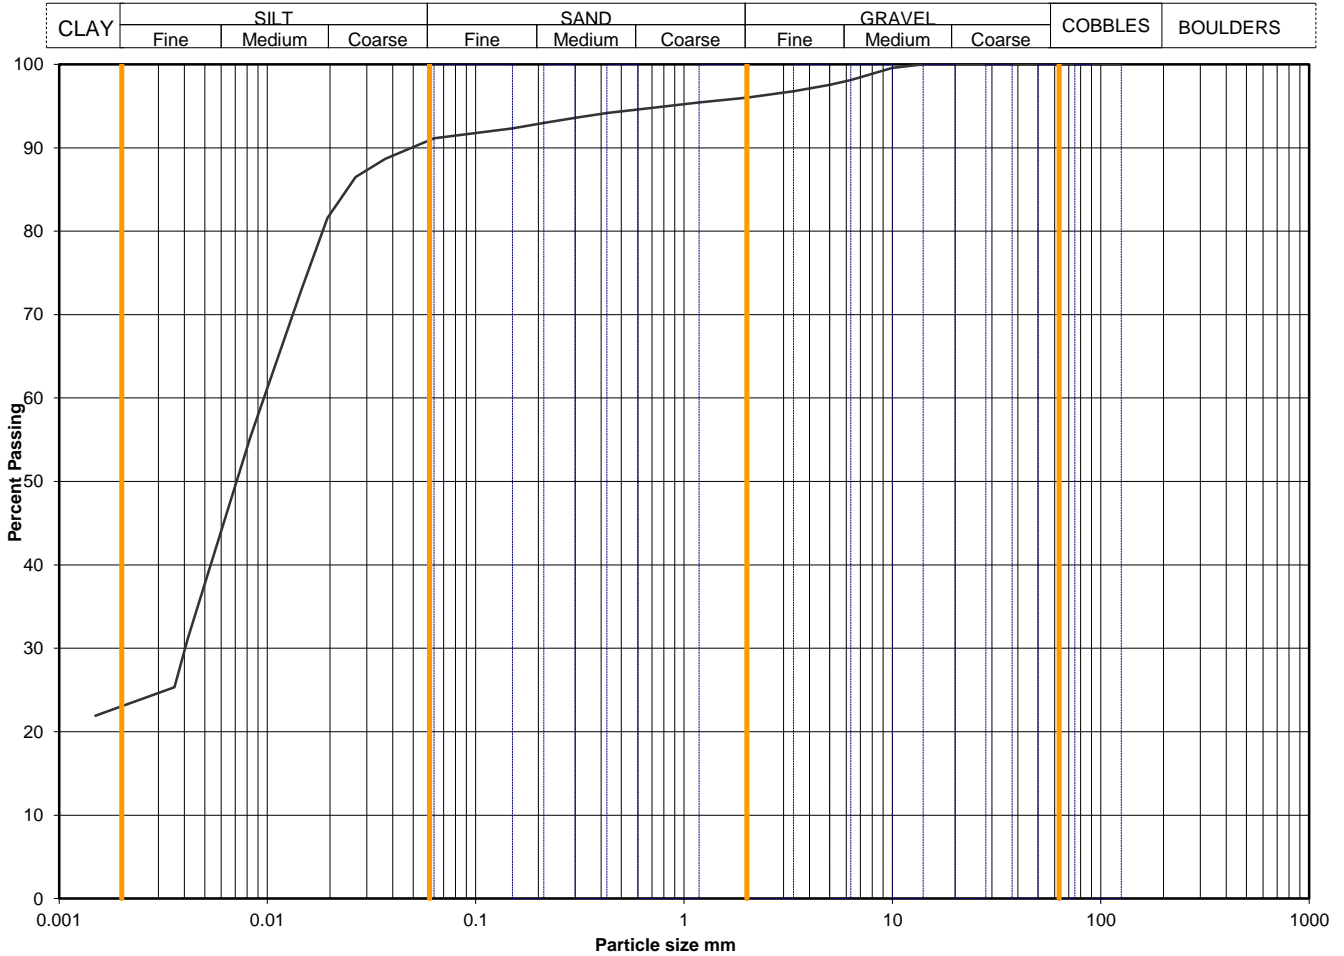

Sieving		Sedimentation	
Particle Size mm	% Passing	Particle Size mm	% Passing
125	100	0.0630	91
90	100	0.0369	89
75	100	0.0265	87
63	100	0.0194	82
50	100	0.0145	73
37.5	100	0.0083	55
28	100	0.0042	31
20	100	0.0036	25
14	100	0.0015	22
10	100		
6.3	98		
5.0	98		
3.35	97		
2.00	96		
1.18	95		
0.600	95		
0.425	94		
0.300	94		
0.212	93		
0.150	92		
0.063	91		
		Particle density, Mg/m ³	
		2.65 assumed	
		Dry mass of sample, kg	
		2.0	

Soil description	Brown slightly sandy slightly gravelly silty CLAY with occasional rootlets.
Preparation / Pretreatment	Sieve: pre dried, Hydro: as BS1377
Remarks	

Sample Proportions	Cobbles / boulders	Whole	* <60mm
		Gravel	0.0
	Sand	3.9	3.9
	Silt	4.9	4.9
	Clay	68.1	68.1
		23.1	23.1

* <60mm values to aid description only

Uniformity Coefficient	D60 / D10	Not applicable
-------------------------------	------------------	----------------

Test Method	BS 1377 : Part 2 : 1990	
	Sieving	9.2 wet sieve
	Sedimentation	9.5 hydrometer

QA Ref
SLR 2,9
Rev 2.22
Jul 17



Project No N9425-20
Project Name Cork Line Level Crossings


Figure
PSD

The results reported relate only to the samples tested; opinions and interpretations expressed herein are outside the scope of UKAS accreditation. © Copyright 2016 SOCOTEC UK Limited

Printed: 20/11/2020 10:52

Particle Size Distribution Analysis

Sample Details:	SAMPLE ID:	Hole No	XC219-TP01
	SOCO2020100243	Sample Depth (m BGL)	2.30 - 2.50
		Sample Type and No	B12
		Specimen Ref	

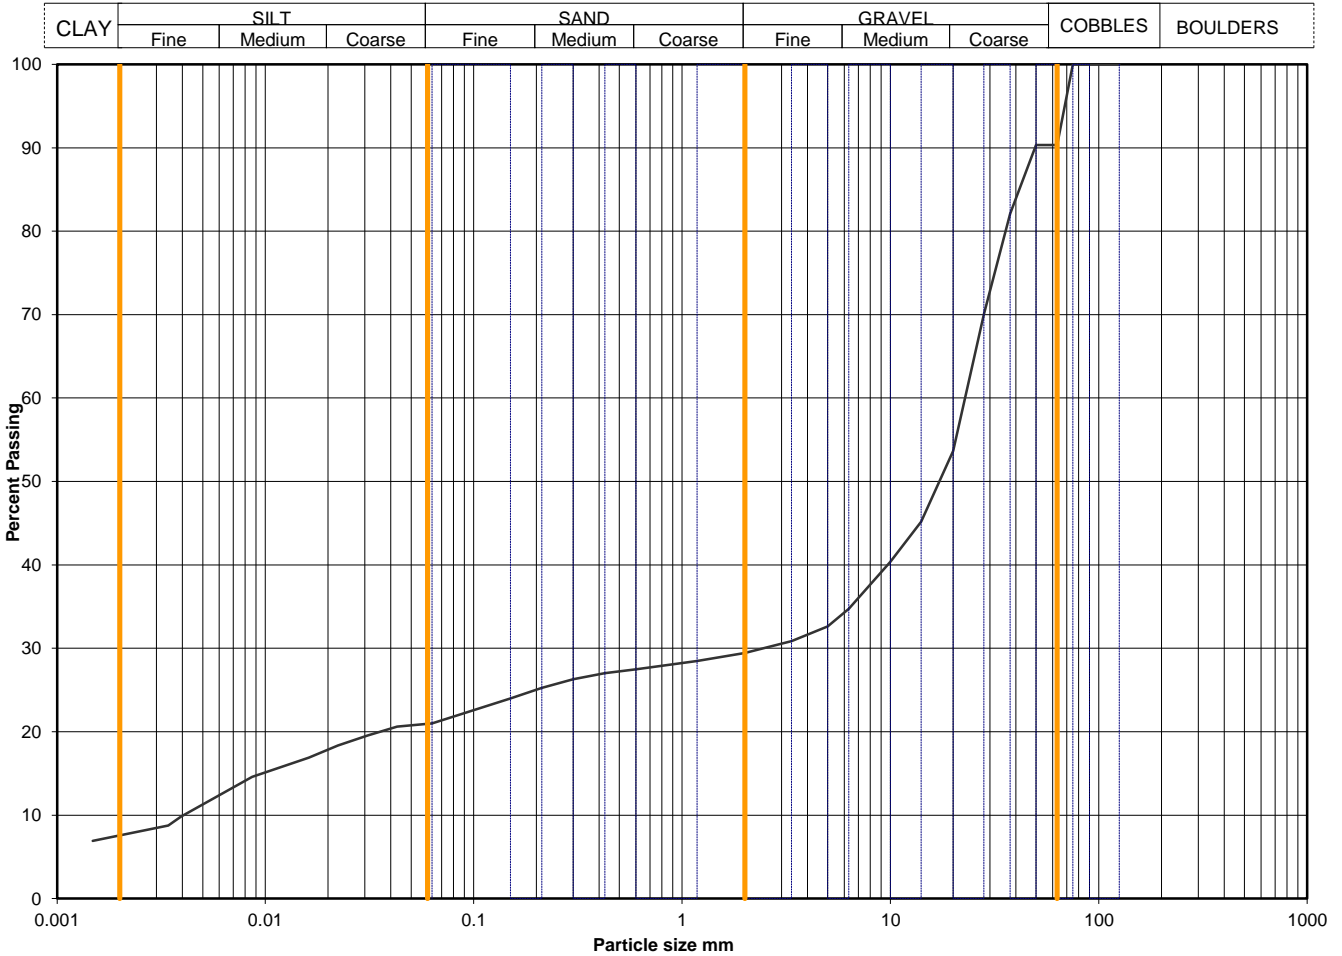

Sieving		Sedimentation	
Particle Size mm	% Passing	Particle Size mm	% Passing
125	100	0.0630	21
90	100	0.0429	21
75	100	0.0309	20
63	90	0.0223	18
50	90	0.0161	17
37.5	82	0.0086	15
28	70	0.0039	10
20	54	0.0034	9
14	45	0.0015	7
10	40		
6.3	35		
5.0	33		
3.35	31		
2.00	29		
1.18	28		
0.600	27	Particle density, Mg/m ³	
0.425	27	2.65 assumed	
0.300	26	Dry mass of sample, kg	
0.212	25	5.3	
0.150	24		
0.063	21		

Soil description	Brown sandy clayey GRAVEL with one cobble.
Preparation / Pretreatment	Sieve: pre dried, Hydro: as BS1377
Remarks	

Sample Proportions	Cobbles / boulders Gravel Sand Silt Clay	Whole	*<60mm
		9.6	0.0
60.9	67.4		
8.5	9.4		
13.4	14.8		
7.6	8.4		

*<60mm values to aid description only

Uniformity Coefficient	D60 / D10	5605
-------------------------------	------------------	------

Test Method	BS 1377 : Part 2 : 1990	
	Sieving	9.2 wet sieve
	Sedimentation	9.5 hydrometer

QA Ref
SLR 2,9
Rev 2.22
Jul 17



Project No N9425-20
Project Name Cork Line Level Crossings


Figure
PSD

The results reported relate only to the samples tested; opinions and interpretations expressed herein are outside the scope of UKAS accreditation. © Copyright 2016 SOCOTEC UK Limited

Printed: 20/11/2020 10:52

Particle Size Distribution Analysis

Sample Details:	SAMPLE ID:	Hole No	XC219-CPRC01
	SOCO2020100679	Sample Depth (m BGL)	1.20 - 2.00
		Sample Type and No	B7
		Specimen Ref	

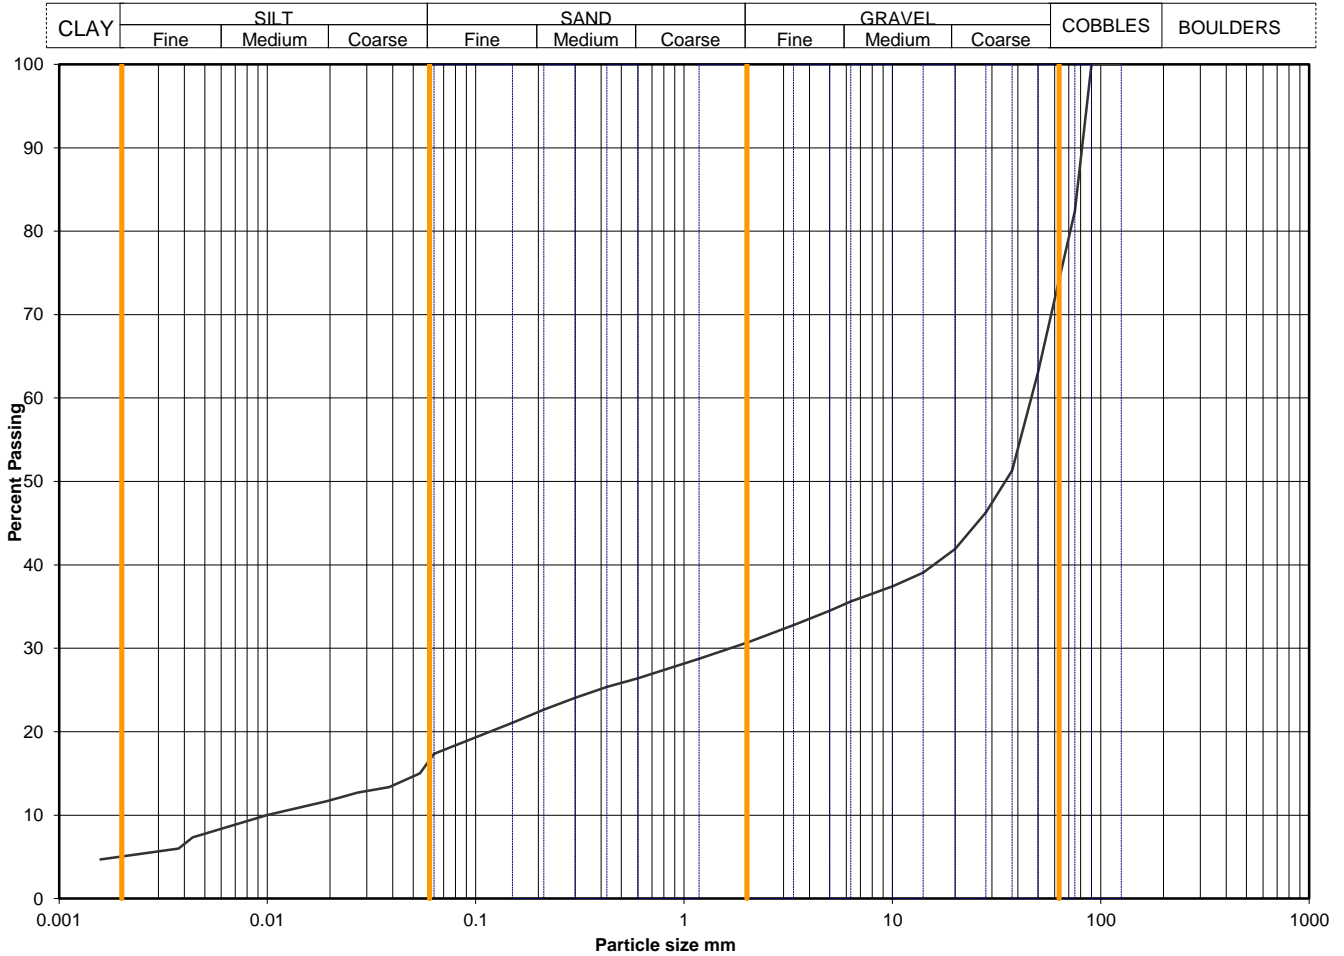

Sieving		Sedimentation	
Particle Size mm	% Passing	Particle Size mm	% Passing
125	100	0.0630	17
90	100	0.0539	15
75	82	0.0384	13
63	74	0.0272	13
50	63	0.0193	12
37.5	51	0.0100	10
28	46	0.0044	7
20	42	0.0037	6
14	39	0.0016	5
10	37		
6.3	36		
5.0	35		
3.35	33		
2.00	31		
1.18	29		
0.600	26	Particle density, Mg/m ³	
0.425	25	2.65 assumed	
0.300	24	Dry mass of sample, kg	
0.212	23	7.3	
0.150	21		
0.063	17		

Soil description	Brown sandy clayey GRAVEL with two cobbles.
Preparation / Pretreatment	Sieve: pre dried, Hydro: as BS1377
Remarks	

Sample Proportions	Cobbles / boulders Gravel Sand Silt Clay	Whole	*<60mm
		25.8	0.0
	43.6	58.8	
	13.3	17.9	
	12.3	16.6	
	5.0	6.7	

*<60mm values to aid description only

Uniformity Coefficient	D60 / D10	4661
-------------------------------	------------------	------

Test Method	BS 1377 : Part 2 : 1990	
	Sieving	9.2 wet sieve
	Sedimentation	9.5 hydrometer

QA Ref
SLR 2,9
Rev 2.22
Jul 17



0001



Project No N9426-20
Project Name Cork Line Level Crossings


Figure
PSD

The results reported relate only to the samples tested; opinions and interpretations expressed herein are outside the scope of UKAS accreditation. © Copyright 2016 SOCOTEC UK Limited

Printed: 20/11/2020 10:00

Particle Size Distribution Analysis

Sample Details:	SAMPLE ID:	Hole No	XC219-CPRC01
	SOCO2020100685	Sample Depth (m BGL)	3.00 - 4.00
		Sample Type and No	B15
		Specimen Ref	

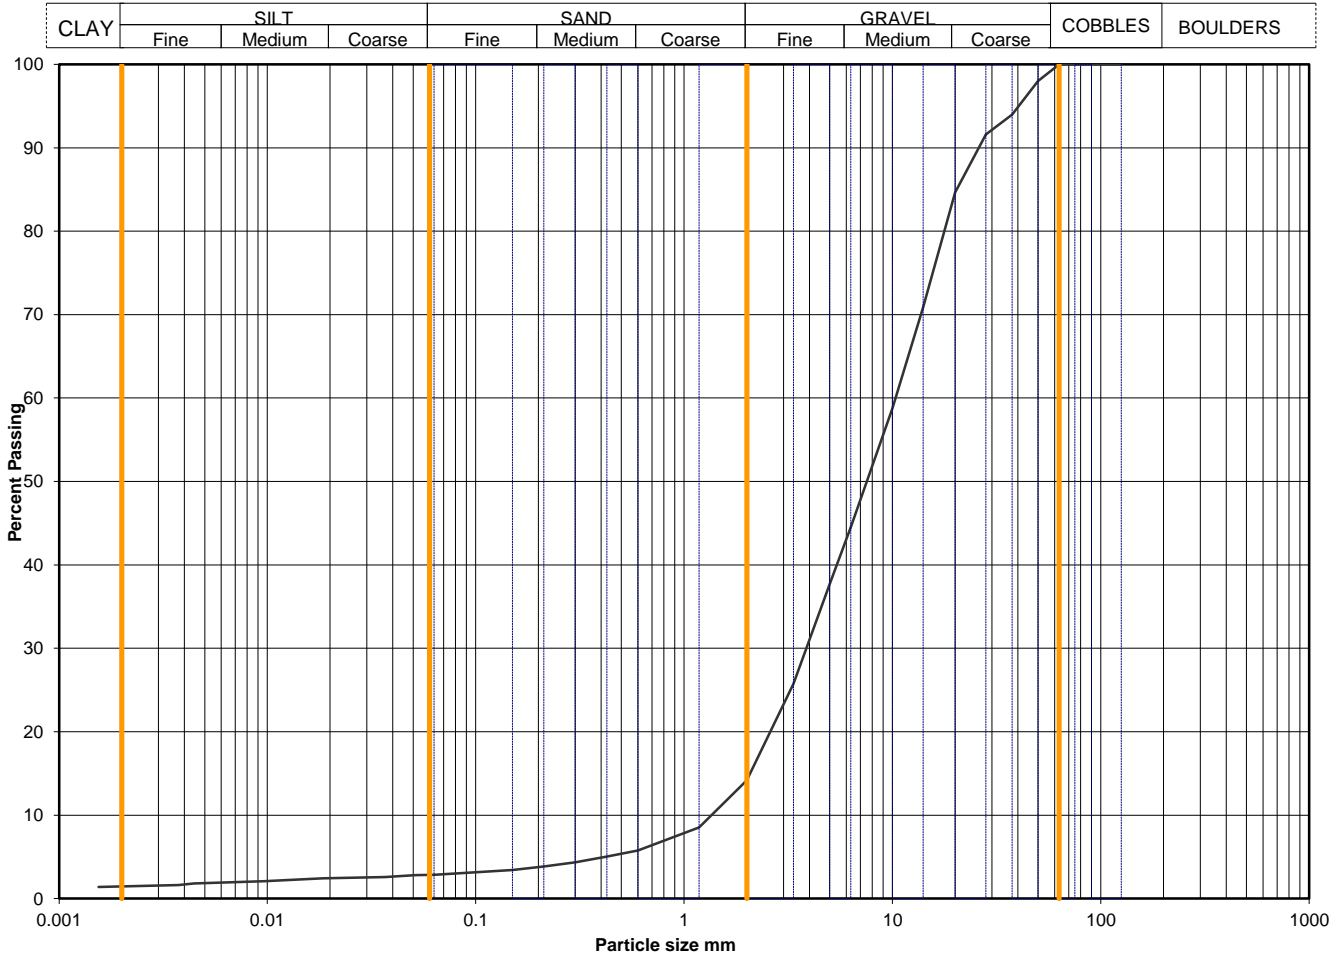

Sieving		Sedimentation	
Particle Size mm	% Passing	Particle Size mm	% Passing
125	100	0.0630	3
90	100	0.0513	3
75	100	0.0366	3
63	100	0.0260	3
50	98	0.0184	2
37.5	94	0.0096	2
28	92	0.0044	2
20	85	0.0038	2
14	71	0.0015	1
10	59		
6.3	45		
5.0	38		
3.35	26		
2.00	14		
1.18	9		
0.600	6	Particle density, Mg/m ³	
0.425	5	2.65	assumed
0.300	4	Dry mass of sample, kg	
0.212	4	12.1	
0.150	3		
0.063	3		

Soil description	Brown sandy slightly silty GRAVEL.
Preparation / Pretreatment	Sieve: pre dried, Hydro: as BS1377
Remarks	

Sample Proportions	Cobbles / boulders	Whole	*<60mm
		Gravel	85.8
	Sand	11.3	11.3
	Silt	1.4	1.4
	Clay	1.5	1.5

*<60mm values to aid description only

Uniformity Coefficient	D60 / D10	8
-------------------------------	------------------	---

Test Method	BS 1377 : Part 2 : 1990	
	Sieving	9.2 wet sieve
	Sedimentation	9.5 hydrometer

QA Ref
SLR 2,9
Rev 2.22
Jul 17



Project No N9426-20
Project Name Cork Line Level Crossings


Figure
PSD

The results reported relate only to the samples tested; opinions and interpretations expressed herein are outside the scope of UKAS accreditation. © Copyright 2016 SOCOTEC UK Limited

Printed: 20/11/2020 10:00

Particle Size Distribution Analysis

Sample Details:	SAMPLE ID:	Hole No	XC219-CPRC01
	SOCO2020100691	Sample Depth (m BGL)	6.00 - 7.00
		Sample Type and No	B21
		Specimen Ref	

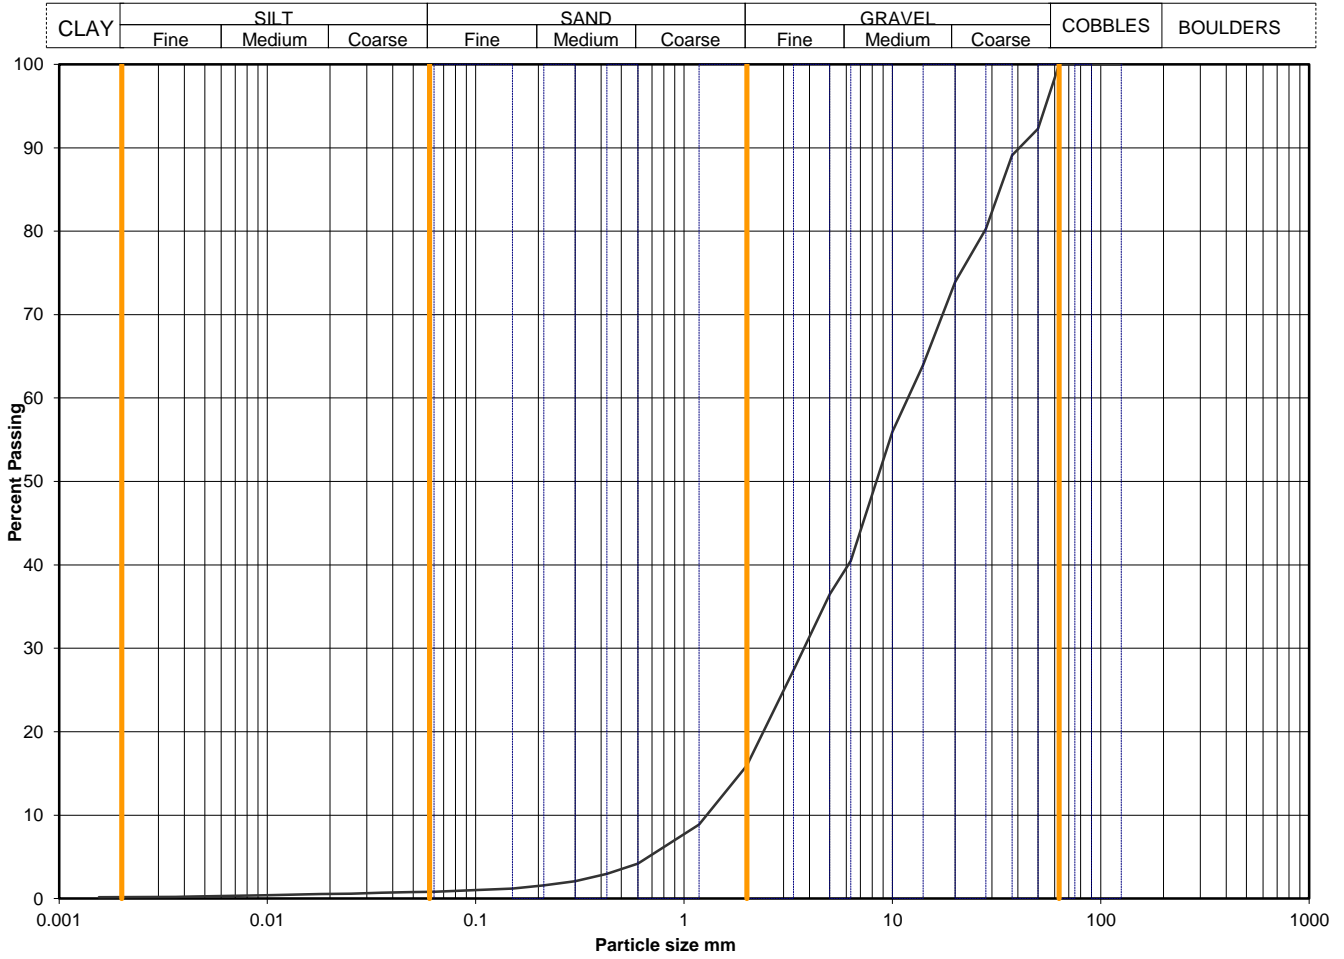

Sieving		Sedimentation	
Particle Size mm	% Passing	Particle Size mm	% Passing
125	100	0.0630	1
90	100	0.0487	1
75	100	0.0350	1
63	100	0.0253	1
50	92	0.0181	1
37.5	89	0.0096	0
28	80	0.0042	0
20	74	0.0036	0
14	64	0.0016	0
10	56		
6.3	40		
5.0	36		
3.35	27		
2.00	16		
1.18	9		
0.600	4	Particle density, Mg/m ³	
0.425	3	2.65	assumed
0.300	2	Dry mass of sample, kg	
0.212	2	13.2	
0.150	1		
0.063	1		

Soil description	Brown sandy GRAVEL.
Preparation / Pretreatment	Sieve: pre dried, Hydro: as BS1377
Remarks	

Sample Proportions	Cobbles / boulders Gravel Sand Silt Clay	Whole	*<60mm
		0.0	0.0
	84.1	84.1	
	15.1	15.1	
	0.6	0.6	
	0.2	0.2	

*<60mm values to aid description only

Uniformity Coefficient	D60 / D10	9
-------------------------------	------------------	---

Test Method	BS 1377 : Part 2 : 1990	
	Sieving	9.2 wet sieve
	Sedimentation	9.5 hydrometer

QA Ref
SLR 2,9
Rev 2.22
Jul 17



Project No N9426-20
Project Name Cork Line Level Crossings


Figure
PSD

The results reported relate only to the samples tested; opinions and interpretations expressed herein are outside the scope of UKAS accreditation. © Copyright 2016 SOCOTEC UK Limited

Printed: 20/11/2020 10:00

California Bearing Ratio (BS1377:1990:Part 4 , section 7)

Sample Details:	SAMPLE ID:	Hole No	XC219-TP01
	SOCO2020100239	Sample Depth (m)	1.20 - 1.70
		Sample Type and No	B8
		Specimen Ref	1

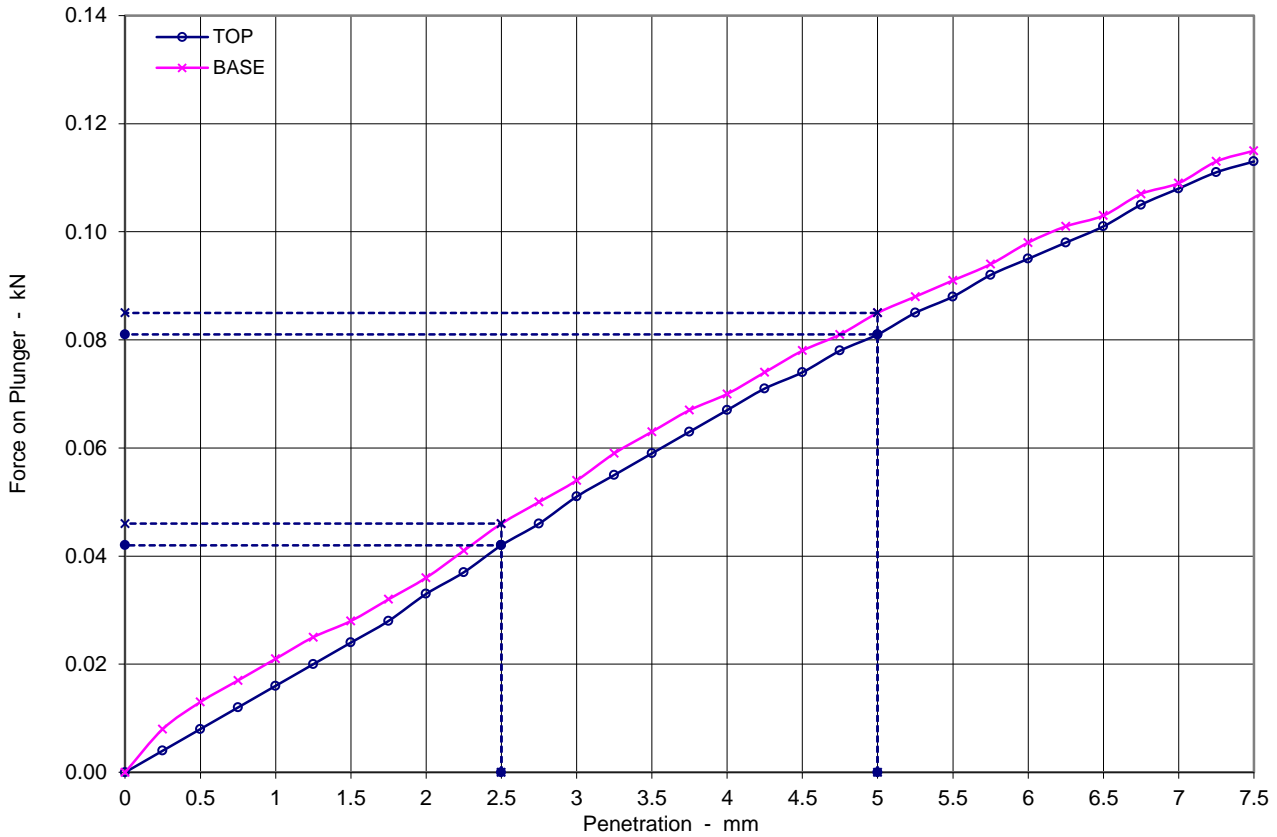

Soil description	Brown slightly sandy CLAY.
------------------	----------------------------

Test Conditions		
Sample Retained on 20 mm sieve	%	0

Sample Conditions		
Initial Moisture Content	%	28.0
Bulk Density	Mg/m ³	2.00
Dry Density	Mg/m ³	1.56
Moisture Content - TOP	%	27.0
Moisture Content - BASE	%	28.0

Preparation	Method of Compaction	
	Remoulded - Rammer compaction to specified density (2.5kg)	
	Soaked test	YES
	Soaking Period	days 4
	Amount of Swell	mm 0.69

Penetration mm	CBR Values %	
	TOP	BASE
2.5	0.3	0.4
5	0.4	0.4

Surcharge applied	kg	0
	kPa	0

Notes :

Accepted CBR %	0.4	0.4
-----------------------	------------	------------

QA Ref
SLR 4.7
Rev 2.8
Mar 17



Project No N9425-20
Project Name Cork Line Level Crossings

The results reported relate only to the samples tested; opinions and interpretations expressed herein are outside the scope of UKAS accreditation. © Copyright 2017 SOCOTEC UK Limited

Figure
CBR

Printed: 20/11/2020 10:49

Appendix I Geotechnical Rock Core Laboratory Test Results

Point Load Index Test

All specimens tested at as received water content unless shown otherwise

Test Type

D - Diametral, A - Axial, I - Irregular Lump, B - Block

Direction (U = unknown or random)

L - parallel to planes of weakness

P - perpendicular to planes of weakness


Dimensions

Dps - Distance between platens (platen separation)

Dps' - at failure

Lne - Length from platens to nearest free end

W - Width of shortest dimension perpendicular to load, P

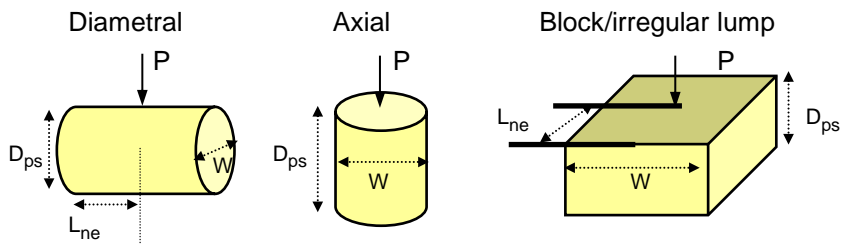

Borehole	Depth, m	Sample Ref	Sample Type	Specimen Ref	Specimen Depth	Rock type	Test Type see ISRM Fig 5 and 8			Dimensions				LOAD P kN	De equivalent diameter, mm	Point Load Index MPa		Remarks
							Type (D, A, I, B)	Direction (L, P or U)	Failure Valid (Y/N)	Lne mm	W mm	Dps mm	Dps' mm			F = (De/50)0.45		
																Is	Is(50)	
XC219-CPRC02	3.90		C	1		LIMESTONE	A	P	Y		73.8	62.0	57.0	14.60	73.17	2.73	3.24	
XC219-CPRC02	4.25		C	1		LIMESTONE	D	L	Y	60.0	75.5	76.0	74.0	1.02	74.74	0.18	0.22	
XC219-CPRC02	6.25		C	1		LIMESTONE	D	L	Y	80.0	77.7	66.0	64.0	1.61	70.51	0.32	0.38	
XC219-CPRC02	7.30		C	1		LIMESTONE	A	P	Y		75.8	84.0	78.0	15.66	86.73	2.08	2.67	
XC219-CPRC02	10.00		C	1		LIMESTONE	A	P	Y		75.7	90.0	86.0	14.33	91.07	1.73	2.26	
XC219-CPRC02	14.62		C	1		LIMESTONE	D	L	Y	70.0	75.9	76.0	62.0	14.16	68.62	3.01	3.47	
XC219-CPRC03	5.50		C	1		LIMESTONE	D	L	Y	80.0	77.5	76.0	75.0	17.97	76.23	3.09	3.74	
XC219-CPRC03	6.75		C	1		LIMESTONE	D	L	Y	100.0	78.8	76.0	69.0	14.88	73.73	2.74	3.26	
XC219-CPRC03	6.95		C	1		LIMESTONE	D	L	Y	50.0	74.6	75.0	71.0	18.65	72.80	3.52	4.17	
XC219-CPRC03	8.00		C	1		LIMESTONE	D	L	Y	55.0	76.1	77.0	66.0	11.63	70.87	2.32	2.71	
XC219-CPRC03	8.40		C	1		LIMESTONE	I	P	Y	50.0	75.6	62.0	59.0	15.80	75.35	2.78	3.35	
XC219-CPRC03	9.25		C	1		LIMESTONE	A	P	Y		76.1	71.0	66.0	17.67	79.95	2.76	3.41	

QA Ref
ISRM 85
Rev 2.10
Aug 17



Project No N9366-20
Project Name Irish Rail - Cork Line

Figure
PLT

The results reported relate only to the samples tested; opinions and interpretations expressed herein are outside the scope of UKAS accreditation. © Copyright 2017 SOCOTEC UK Limited

Sheet Printed
12/11/2020 09:13

Point Load Index Test

All specimens tested at as received water content unless shown otherwise

Test Type

D - Diametral, A - Axial, I - Irregular Lump, B - Block

Direction (U = unknown or random)

L - parallel to planes of weakness

P - perpendicular to planes of weakness


Dimensions

Dps - Distance between platens (platen separation)



Dps' - at failure

Lne - Length from platens to nearest free end

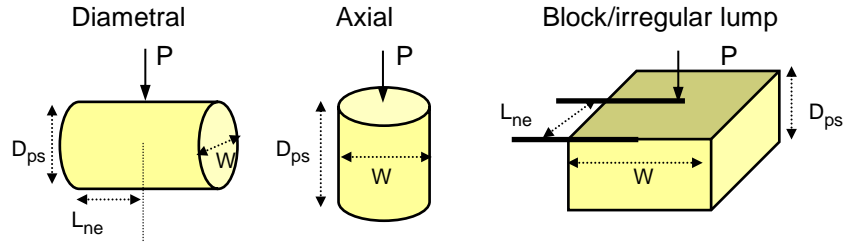W - Width of shortest dimension perpendicular to load, P



Borehole	Depth, m	Sample Ref	Sample Type	Specimen Ref	Specimen Depth	Rock type	Test Type see ISRM Fig 5 and 8			Dimensions				LOAD P kN	De equivalent diameter, mm	Point Load Index MPa		Remarks
							Type (D, A, I, B)	Direction (L, P or U)	Failure Valid (Y/N)	Lne mm	W mm	Dps mm	Dps' mm			F = (De/50) ^{0.45}		
																Is	Is(50)	
XC219-CPRC04	2.70		C	1		LIMESTONE	I	P	Y	45.0	77.9	62.0	58.0	15.55	75.86	2.70	3.26	
XC219-CPRC04	3.00		C	1		LIMESTONE	D	L	Y	80.0	81.5	76.0	63.0	15.60	71.63	3.04	3.57	
XC219-CPRC04	3.70		C	1		LIMESTONE	D	L	Y	70.0	76.4	76.0	61.0	11.85	68.24	2.54	2.93	
XC219-CPRC05	3.00		C	1		LIMESTONE	D	L	Y	90.0	76.0	66.0	43.0	16.60	57.15	5.08	5.40	
XC219-CPRC05	3.45		C	1		LIMESTONE	D	L	Y	100.0	75.8	66.0	62.0	10.01	68.57	2.13	2.45	
XC219-CPRC05	3.90		C	1		LIMESTONE	D	L	Y	65.0	77.9	74.0	61.0	21.68	68.94	4.56	5.27	
XC219-CPRC05	5.10		C	1		LIMESTONE	D	L	Y	90.0	75.6	66.0	56.0	14.60	65.06	3.45	3.88	
XC219-CPRC05	8.75		C	1		LIMESTONE	D	L	Y	85.0	75.3	71.0	70.0	12.74	72.59	2.42	2.86	
XC219-CPRC05	11.30		C	1		LIMESTONE	D	L	Y	60.0	75.2	72.0	64.0	19.64	69.38	4.08	4.73	

QA Ref ISRM 85 Rev 2.10 Aug 17	 0001	 SOCOTEC	Project No N9366-20	Figure PLT
			Project Name Irish Rail - Cork Line	
The results reported relate only to the samples tested; opinions and interpretations expressed herein are outside the scope of UKAS accreditation. © Copyright 2017 SOCOTEC UK Limited			Sheet Printed 12/11/2020 09:13	

Point Load Index Test

All specimens tested at as received water content unless shown otherwise

Test Type

D - Diametral, A - Axial, I - Irregular Lump, B - Block

Direction (U = unknown or random)

L - parallel to planes of weakness

P - perpendicular to planes of weakness


Dimensions

Dps - Distance between platens (platen separation)



Dps' - at failure

Ln - Length from platens to nearest free end

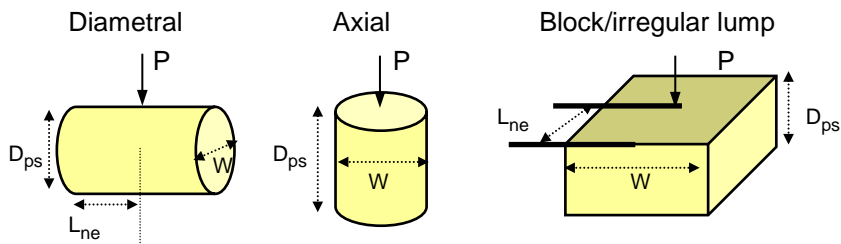W - Width of shortest dimension perpendicular to load, P



Borehole	Depth, m	Sample Ref	Sample Type	Specimen Ref	Specimen Depth	Rock type	Test Type see ISRM Fig 5 and 8			Dimensions				LOAD P kN	De equivalent diameter, mm	Point Load Index MPa		Remarks
							Type (D, A, I, B)	Direction (L, P or U)	Failure Valid (Y/N)	Ln mm	W mm	Dps mm	Dps' mm			Is	Is(50)	
XC219-CPRC01A	8.30		C	1		LIMESTONE	D	L	Y	60.0	75.8	74.0	66.0	26.60	70.74	5.32	6.21	8.30-8.45m
XC219-CPRC01A	8.30		C	2		LIMESTONE	D	L	Y	75.0	75.3	72.0	71.0	21.97	73.11	4.11	4.88	9.01-9.17m
XC219-CPRC06	5.30		C	1		LIMESTONE	D	L	Y	80.0	75.9	76.0	70.0	16.26	72.90	3.06	3.63	6.14-6.32m
XC219-CPRC06	6.80		C	1		LIMESTONE	D	L	Y	110.0	77.7	77.0	71.0	21.39	74.26	3.88	4.63	7.01-7.26m
XC219-CPRC06	6.80		C	2		LIMESTONE	D	L	Y	90.0	76.1	76.0	75.0	6.03	75.53	1.06	1.27	7.84-8.03m
XC219-CPRC07	3.70		C	2		LIMESTONE	D	L	Y	60.0	73.2	72.0	49.0	21.12	75.53	1.06	1.27	5.07-5.20m

QA Ref ISRM 85 Rev 2.10 Aug 17	 0001		Project No N9435-20	Figure PLT
			Project Name Cork Line Level Crossings	
The results reported relate only to the samples tested; opinions and interpretations expressed herein are outside the scope of UKAS accreditation. © Copyright 2017 SOCOTEC UK Limited			Sheet Printed 04/11/2020 11:34	

Point Load Index Test

All specimens tested at as received water content unless shown otherwise

Test Type

D - Diametral, A - Axial, I - Irregular Lump, B - Block

Direction (U = unknown or random)

L - parallel to planes of weakness

P - perpendicular to planes of weakness


Dimensions

Dps - Distance between platens (platen separation)



Dps' - at failure

Lne - Length from platens to nearest free end

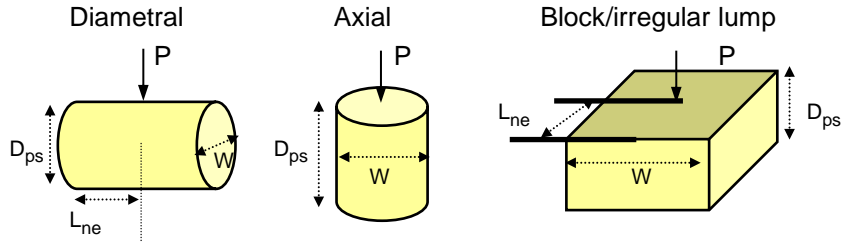W - Width of shortest dimension perpendicular to load, P



Borehole	Depth, m	Sample Ref	Sample Type	Specimen Ref	Specimen Depth	Rock type	Test Type see ISRM Fig 5 and 8		Failure Valid (Y/N)	Dimensions				LOAD P kN	De equivalent diameter, mm	Point Load Index MPa		Remarks
							Type (D, A, I, B)	Direction (L, P or U)		Lne mm	W mm	Dps mm	Dps' mm			F = (De/50) ^{0.45}		
																Is	Is(50)	
XC219-CPRC07	6.70		C	1		LIMESTONE	A	P	Y		74.4	41.0	38.0	8.60	59.99	2.39	2.59	6.96-7.24m
XC219-CPRC07	6.70		C	2		LIMESTONE	D	L	Y	70.0	73.8	76.0	71.0	0.97	72.37	0.19	0.22	6.80-6.96m
XC219-CPRC07	8.20		C	2		LIMESTONE	D	L	Y	140.0	74.8	74.0	56.0	18.59	59.89	5.89	6.39	9.35-9.63m

QA Ref ISRM 85 Rev 2.10 Aug 17	 0001	 SOCOTEC	Project No N9435-20	Figure PLT
			Project Name Cork Line Level Crossings	

Point Load Index Test

All specimens tested at as received water content unless shown otherwise

Test Type

D - Diametral, A - Axial, I - Irregular Lump, B - Block

Direction (U = unknown or random)

L - parallel to planes of weakness

P - perpendicular to planes of weakness


Dimensions

Dps - Distance between platens (platen separation)



Dps' - at failure

Lne - Length from platens to nearest free end

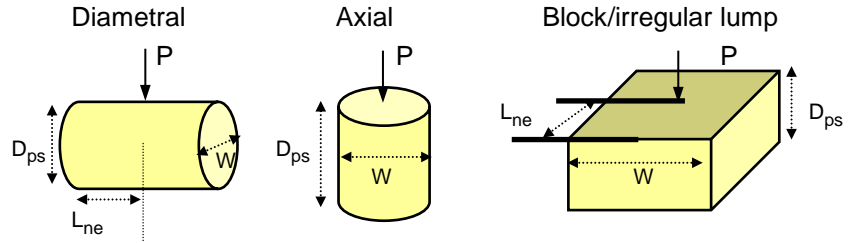W - Width of shortest dimension perpendicular to load, P



Borehole	Depth, m	Sample Ref	Sample Type	Specimen Ref	Specimen Depth	Rock type	Test Type see ISRM Fig 5 and 8		Failure Valid (Y/N)	Dimensions				LOAD P kN	De equivalent diameter, mm	Point Load Index MPa $F = (De/50)0.45$		Remarks
							Type (D, A, I, B)	Direction (L, P or U)		Lne mm	W mm	Dps mm	Dps' mm			Is	Is(50)	
							XC219-CPRC08	5.40			C	1				LIMESTONE	D	
XC219-CPRC08	5.40		C	2		LIMESTONE	A	P	Y		75.4	66.0	64.0	17.01	78.37	2.77	3.39	5.60-5.90m
XC219-CPRC08	5.40		C	3		LIMESTONE	D	L	Y	130.0	76.0	71.0	66.0	18.20	70.82	3.63	4.24	6.10-6.39m
XC219-CPRC08	5.40		C	4		LIMESTONE	A	P	Y		75.5	56.0	55.0	12.04	72.70	2.28	2.70	6.10-6.39m
XC219-CPRC08	6.90		C	1		LIMESTONE	A	P	Y		73.5	58.0	53.0	17.80	70.41	3.59	4.19	7.97-8.02m
XC219-CPRC08	6.90		C	2		LIMESTONE	I	P	Y	35.0	75.1	41.0	36.0	11.18	58.67	3.25	3.49	7.97-8.02m
XC219-CPRC08	6.90		C	3		LIMESTONE	A	P	Y		75.3	41.0	39.0	7.89	61.14	2.11	2.31	8.36-8.40m
XC219-CPRC08	6.90		C	4		LIMESTONE	I	P	Y	40.0	76.0	43.0	41.0	10.47	62.97	2.64	2.93	8.36-8.40m

QA Ref ISRM 85 Rev 2.10 Aug 17	 0001	 SOCOTEC	Project No N9436-20	Figure PLT
			Project Name Cork Line Level Crossings	
The results reported relate only to the samples tested; opinions and interpretations expressed herein are outside the scope of UKAS accreditation. © Copyright 2017 SOCOTEC UK Limited			Sheet Printed 04/11/2020 08:11	

Uniaxial Compressive Strength Of Rock - Summary of Results

Hole No.	Sample			Rock Type	Specimen Dimensions ²			Bulk Density ² Mg/m ³	Water Content ¹ %	Uniaxial Compression ³				Remarks	
	No.	Depth (m)			type	Dia. mm	Height mm			H/D	Stress Rate MPa/s	Time to failure secs	Mode of failure		UCS MPa
		from	to												
XC219-CPRC02		6.25	6.58	C	LIMESTONE	75.6	187.7	2.5	2.66	0.2	0.1	224	shear	19	
XC219-CPRC02		8.75	9.25	C	LIMESTONE	75.5	198.3	2.6	2.67	0.1	0.1	305	axial cleavage	25.1	
XC219-CPRC02		11.85	12.40	C	LIMESTONE	75.3	199.8	2.7	2.66	0.1	0.1	248	axial cleavage	30.2	
XC219-CPRC02		13.95	14.42	C	LIMESTONE	75.4	197.0	2.6	2.67	0.1	0.1	328	axial cleavage	18.9	
XC219-CPRC04		4.75	5.25	C	LIMESTONE	75.3	198.8	2.6	2.68	0.1	0.1	329	axial cleavage	39.4	
XC219-CPRC04		6.70	7.02	C	LIMESTONE	75.6	199.4	2.6	2.68	0.1	0.1	480	shear	12.8	
XC219-CPRC05		5.10	5.50	C	LIMESTONE	75.6	199.1	2.6	2.69	0.3	0.1	296	multiple shear	24.5	
XC219-CPRC05		8.75	9.30	C	LIMESTONE	75.4	196.4	2.6	2.69	0.2	0.1	338	axial cleavage	20.2	
XC219-CPRC05		11.55	12.00	C	LIMESTONE	75.5	202.5	2.7	2.70	0	0.1	400	axial cleavage	24.9	

Notes : Test Specification : International Society for Rock Mechanics, The complete ISRM suggested methods for Rock Characterization Testing and Monitoring, 2007

1 ISRM p87 test 1, water content at 105 ± 3 oC, specimen as received at the laboratory

2 ISRM p86 clause (vii), Caliper method used for determination of bulk volume and derivation of bulk density

3 ISRM p153 part 1, determination of Uniaxial Compressive Strength (UCS) of Rock Materials

above notes apply unless annotated otherwise in the remarks

Mode of failure :

S - Single shear

MS - multiple shear

AC - Axial cleavage

F - Fragmented

QA Ref
RLR 2
Rev 2.19
Apr 19



Project No N9366-20
Project Name Irish Rail - Cork Line

Figure

RUCS

The results reported relate only to the samples tested; opinions and interpretations expressed herein are outside the scope of UKAS accreditation. © Copyright 2019 SOCOTEC UK Limited

Printed: 12/11/2020 09:14

Uniaxial Compressive Strength Of Rock - Summary of Results

Hole No.	Sample			Rock Type	Specimen Dimensions ²			Bulk Density ² Mg/m ³	Water Content ¹ %	Uniaxial Compression ³				Remarks	
	No.	Depth (m)			type	Dia. mm	Height mm			H/D	Stress Rate MPa/s	Time to failure secs	Mode of failure		UCS MPa
		from	to												
XC219-CPRC08		5.40	6.90	C	SILTSTONE	75.5	172.5	2.3	2.69	0.1	0.1	246	axial cleavage	37.5	Outside ISRM Specification. Tested between 6.48-6.82m
XC219-CPRC08		6.90	8.40	C	SILTSTONE	75.4	205.8	2.7	2.69	0.3	0.1	393	axial cleavage	61	

Notes : Test Specification : International Society for Rock Mechanics, The complete ISRM suggested methods for Rock Characterization Testing and Monitoring, 2007



1 ISRM p87 test 1, water content at 105 ± 3 oC, specimen as received at the laboratory

2 ISRM p86 clause (vii), Caliper method used for determination of bulk volume and derivation of bulk density

3 ISRM p153 part 1, determination of Uniaxial Compressive Strength (UCS) of Rock Materials

above notes apply unless annotated otherwise in the remarks

Mode of failure :
 S - Single shear MS - multiple shear
 AC - Axial cleavage F - Fragmented

QA Ref RLR 2 Rev 2.19 Apr 19			Project No	N9436-20	Figure RUCS
			Project Name	Cork Line Level Crossings	
The results reported relate only to the samples tested; opinions and interpretations expressed herein are outside the scope of UKAS accreditation. © Copyright 2019 SOCOTEC UK Limited					Printed: 04/11/2020 08:11



Certificate of Analysis

Certificate Number 20-19523

16-Oct-20

Client Socotec - Geotechnical Lab
Askern Road
Doncaster
DN6 8DG

Our Reference 20-19523

Client Reference N9366-20

Order No N20-O-2198

Contract Title Irish Rail- Cork Line

Description 13 Concrete samples.

Date Received 06-Oct-20

Date Started 06-Oct-20

Date Completed 16-Oct-20

Test Procedures Identified by prefix DETSn (details on request).

Notes Opinions and interpretations are outside the laboratory's scope of ISO 17025 accreditation. This certificate is issued in accordance with the accreditation requirements of the United Kingdom Accreditation Service. The results reported herein relate only to the material supplied to the laboratory. This certificate shall not be reproduced except in full, without the prior written approval of the laboratory.

Approved By

A handwritten signature in black ink, appearing to read "A Fenwick".

Adam Fenwick
Contracts Manager



2139

Summary of Chemical Analysis Concrete Samples

Our Ref 20-19523

Client Ref N9366-20

Contract Title Irish Rail- Cork Line

Lab No	1738512	1738513	1738514	1738515	1738516	1738517	1738518	1738519	1738520	1738521	1738522
Sample ID	XC219-CPRC02	XC219-CPRC02	XC219-CPRC02	XC219-CPRC03	XC219-CPRC03	XC219-CPR203	XC219-CPRC04	XC219-CPRC04	XC219-CPR204	XC219-CPRC05	XC219-CPRC05
Depth	3.90-4.00	11.85-12.40	14.62-14.78	6.75-6.90	8.00-8.13	9.25-9.30	3.70-3.88	6.70-7.02	2.70-2.80	3.00-3.20	5.10-5.50
Other ID											
Sample Type	ES	ES	ES	ES	ES	ES	ES	ES	ES	ES	ES
Sampling Date	n/s	n/s	n/s	n/s	n/s	n/s	n/s	n/s	n/s	n/s	n/s
Sampling Time	n/s	n/s	n/s	n/s	n/s	n/s	n/s	n/s	n/s	n/s	n/s

Test	Method	LOD	Units	1738512	1738513	1738514	1738515	1738516	1738517	1738518	1738519	1738520	1738521	1738522
Inorganics														
Sulphate Aqueous Extract as SO4	DETSC 2076#	10	mg/l	750	77	61	15	12	12	17	34	34	23	45
Sulphate, Total Potential as SO4	*	0.03	%	0.27	< 0.03	< 0.03	< 0.03	< 0.03	< 0.03	< 0.03	0.09	0.05	0.04	0.03
Sulphide, Oxidisable as SO4	*	0.01	%	0.12	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.06	0.03	0.02	< 0.01
Sulphur as S, Total	DETSC 2320	0.01	%	0.09	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.03	0.02	0.01	0.01
Sulphate as SO4, Total	DETSC 2321#	0.01	%	0.15	0.03	0.03	0.02	0.02	0.02	0.02	0.03	0.02	0.02	0.03
Sulphate as SO4, Total	DETSC 2321#	100	mg/kg	1510	310	253	213	189	159	211	323	191	237	259

Summary of Chemical Analysis

Concrete Samples

Our Ref 20-19523

Client Ref N9366-20

Contract Title Irish Rail- Cork Line

Lab No	1738523	1738524
	XC219-	XC219-
Sample ID	CPRC05	CPRC05
Depth	8.75	11.30-11.40
Other ID		
Sample Type	ES	ES
Sampling Date	n/s	n/s
Sampling Time	n/s	n/s

Test	Method	LOD	Units		
Inorganics					
Sulphate Aqueous Extract as SO4	DETSC 2076#	10	mg/l	76	1300
Sulphate, Total Potential as SO4	*	0.03	%	0.06	0.59
Sulphide, Oxidisable as SO4	*	0.01	%	0.03	0.16
Sulphur as S, Total	DETSC 2320	0.01	%	0.02	0.20
Sulphate as SO4, Total	DETSC 2321#	0.01	%	0.03	0.43
Sulphate as SO4, Total	DETSC 2321#	100	mg/kg	310	4300

Information in Support of the Analytical Results

Our Ref 20-19523
 Client Ref N9366-20
 Contract Irish Rail- Cork Line

Containers Received & Deviating Samples

Lab No	Sample ID	Date Sampled	Containers Received	Holding time exceeded for tests	Inappropriate container for tests
1738512	XC219-CPRC02 3.90-4.00 CONCRETE		PG	Sample date not supplied	
1738513	XC219-CPRC02 11.85-12.40 CONCRETE		PG	Sample date not supplied	
1738514	XC219-CPRC02 14.62-14.78 CONCRETE		PG	Sample date not supplied	
1738515	XC219-CPRC03 6.75-6.90 CONCRETE		PG	Sample date not supplied	
1738516	XC219-CPRC03 8.00-8.13 CONCRETE		PG	Sample date not supplied	
1738517	XC219-CPR203 9.25-9.30 CONCRETE		PG	Sample date not supplied	
1738518	XC219-CPRC04 3.70-3.88 CONCRETE		PG	Sample date not supplied	
1738519	XC219-CPRC04 6.70-7.02 CONCRETE		PG	Sample date not supplied	
1738520	XC219-CPR204 2.70-2.80 CONCRETE		PG	Sample date not supplied	
1738521	XC219-CPRC05 3.00-3.20 CONCRETE		PG	Sample date not supplied	
1738522	XC219-CPRC05 5.10-5.50 CONCRETE		PG	Sample date not supplied	
1738523	XC219-CPRC05 8.75 CONCRETE		PG	Sample date not supplied	
1738524	XC219-CPRC05 11.30-11.40 CONCRETE		PG	Sample date not supplied	

Key: P-Plastic G-Bag

DETS cannot be held responsible for the integrity of samples received whereby the laboratory did not undertake the sampling. In this instance samples received may be deviating. Deviating Sample criteria are based on British and International standards and laboratory trials in conjunction with the UKAS note 'Guidance on Deviating Samples'. All samples received are listed above. However, those samples that have additional comments in relation to hold time, inappropriate containers etc are deviating due to the reasons stated. This means that the analysis is accredited where applicable, but results may be compromised due to sample deviations. If no sampled date (soils) or date+time (waters) has been supplied then samples are deviating. However, if you are able to supply a sampled date (and time for waters) this will prevent samples being reported as deviating where specific hold times are not exceeded and where the container supplied is suitable.

Soil Analysis Notes

Inorganic soil analysis was carried out on a dried sample, crushed to pass a 425µm sieve, in accordance with BS1377.

Organic soil analysis was carried out on an 'as received' sample. Organics results are corrected for moisture and expressed on a dry weight basis.

The Loss on Drying, used to express organics analysis on an air dried basis, is carried out at a temperature of 28°C +/-2°C.


Disposal

From the issue date of this test certificate, samples will be held for the following times prior to disposal :-

Soils - 1 month, Liquids - 2 weeks, Asbestos (test portion) - 6 months

End of Report

Appendix J Environmental Laboratory Test Results



SOCOTEC

Environmental Chemistry
SOCOTEC UK
Ashby Rd, Bretby,
Burton-on-Trent, UK
DE15 0YZ

Certificate of Analysis

Project No: 20071478

Client: OCB Geotechnical Limited

Quote Number: BEC200710078

Project Reference: Irish Rail - Cork Line

Site Name: 19-135

Contact: Ian Holley

Address: Unit 1
Carrigogna
Midleton
County Cork

Post Code: Ireland

E-Mail: iholley@ocbgeotechnical.com

Phone No: 021 4638474

Number of Samples Received: 2

Date Received: 30/07/2020

Analysis Date: 11/08/2020

Date Issued: 11/08/2020

Job Status: Complete

Report Type: Final Version 01

This report supersedes any versions previously issued by the laboratory

Account Manager
Martin Elliott-Palmer

Authorised by the Operations Manager
Becky Batham



Client: OCB Geotechnical Limited

Project Name: 19-135

Project No: 20071478

Date Issued: 11/08/2020

Samples Analysed

<u>Sample Reference</u>	<u>Text ID</u>	<u>Sample Date</u>	<u>Sample Type</u>
XC219-TP01-4-ES-0.50-0.50	20071478-007	03/07/2020 17:00:00	SOLID



Client: OCB Geotechnical Limited

Project Name: 19-135

Project No: 20071478

Date Issued: 11/08/2020

Analysis Results

Project ID	20071478	
Sample ID	007	
Customer ID	XC219-TP01-4-ES-0.50-0.50	
Sample Type	LPL	SOLID
Sampling Date	03/07/2020	03/07/2020

Analysis	Method Code	MDL	Units	Accred		
>C6-C8 Aliphatic	GROHSA/BTEXHSA	0.1	mg/l	N		<0.100
>C7-C8 Aromatic	GROHSA/BTEXHSA	0.005	mg/l	N		<0.005
>C8-C10 Aliphatic	GROHSA/BTEXHSA	0.1	mg/l	N		<0.100
>C8-C10 Aromatic	GROHSA/BTEXHSA	0.02	mg/l	N		<0.020
C5-C6 Aliphatic	GROHSA/BTEXHSA	0.1	mg/l	N		<0.100
C5-C7 Aromatic	GROHSA/BTEXHSA	0.005	mg/l	N		<0.005
Total GRO	GROHSA/BTEXHSA	0.1	mg/l	U		<0.100
Free Cyanide	SFAPI	0.02	mg/l	U		<0.02
Arsenic as As	ICPMSW (Dissolved)	0.001	mg/l	U		<0.001
Cadmium as Cd	ICPMSW (Dissolved)	0.00002	mg/l	U		<0.00002
Total Chromium as Cr	ICPMSW (Dissolved)	0.001	mg/l	U		<0.001
Copper as Cu	ICPMSW (Dissolved)	0.001	mg/l	U		<0.001
Lead as Pb	ICPMSW (Dissolved)	0.001	mg/l	U		<0.001
Mercury as Hg	ICPMSW (Dissolved)	0.00003	mg/l	U		<0.00003
Nickel as Ni	ICPMSW (Dissolved)	0.001	mg/l	U		<0.001
Selenium as Se	ICPMSW (Dissolved)	0.001	mg/l	U		<0.001
Vanadium as V	ICPMSW (Dissolved)	0.001	mg/l	U		<0.001
Zinc as Zn	ICPMSW (Dissolved)	0.002	mg/l	U		0.003
Barium as Ba	ICPWATVAR (Dissolved)	0.01	mg/l	U		<0.01
Beryllium as Be	ICPWATVAR (Dissolved)	0.01	mg/l	N		<0.01
Boron as B	ICPWATVAR (Dissolved)	0.01	mg/l	U		<0.01
Benzene	BTEXHSA	5	µg/l	N		<5
Ethylbenzene	BTEXHSA	5	µg/l	N		<5
m/p-Xylene	BTEXHSA	10	µg/l	N		<10
o-Xylene	BTEXHSA	5	µg/l	N		<5





Client: OCB Geotechnical Limited

Project Name: 19-135

Project No: 20071478

Date Issued: 11/08/2020

Analysis Results

Analysis	Method Code	MDL	Units	Accred	Project ID	Sample ID	Customer ID	Sample Type	Sampling Date
					20071478	007	XC219-TP01-4-ES-0.50-0.50	LPL SOLID	03/07/2020 03/07/2020
Toluene	BTEXHSA	5	µg/l	N					
Acenaphthene	PAHMSW	0.01	µg/l	U					<5
Acenaphthylene	PAHMSW	0.01	µg/l	U					<0.02
Anthracene	PAHMSW	0.01	µg/l	U					<0.02
Benzo[a]anthracene	PAHMSW	0.01	µg/l	U					<0.02
Benzo[a]pyrene	PAHMSW	0.01	µg/l	U					<0.02
Benzo[b]fluoranthene	PAHMSW	0.01	µg/l	U					<0.02
Benzo[g,h,i]perylene	PAHMSW	0.01	µg/l	U					<0.02
Benzo[k]fluoranthene	PAHMSW	0.01	µg/l	U					<0.02
Chrysene	PAHMSW	0.01	µg/l	U					<0.02
Dibenzo[a,h]anthracene	PAHMSW	0.01	µg/l	U					<0.02
Fluoranthene	PAHMSW	0.01	µg/l	U					<0.02
Fluorene	PAHMSW	0.01	µg/l	U					<0.02
Indeno[1,2,3-cd]pyrene	PAHMSW	0.01	µg/l	U					<0.02*
Naphthalene	PAHMSW	0.01	µg/l	U					0.22
Phenanthrene	PAHMSW	0.01	µg/l	U					<0.02
Pyrene	PAHMSW	0.01	µg/l	U					<0.02
Total PAH 16	PAHMSW	0.16	µg/l	U					<0.47
>C10-C12 (Aliphatic)	TPHFID (Aliphatic)	0.01	mg/l	U					0.14
>C12-C16 (Aliphatic)	TPHFID (Aliphatic)	0.01	mg/l	U					<0.02
>C16-C21 (Aliphatic)	TPHFID (Aliphatic)	0.01	mg/l	U					0.05
>C21-C35 (Aliphatic)	TPHFID (Aliphatic)	0.01	mg/l	U					0.05
>C35-C44 (Aliphatic)	TPHFID (Aliphatic)	0.01	mg/l	N					<0.02
Total TPH (Aliphatic)	TPHFID (Aliphatic)	0.01	mg/l	U					<0.02
>C10-C12 (Aromatic)	TPHFID (Aromatic)	0.01	mg/l	U					<0.02





Client: OCB Geotechnical Limited

Project Name: 19-135

Project No: 20071478

Date Issued: 11/08/2020

Analysis Results

Analysis	Method Code	MDL	Units	Accred	Project ID	Sample ID	Customer ID	Sample Type	Sampling Date
>C12-C16 (Aromatic)	TPHFID (Aromatic)	0.01	mg/l	U	20071478	007	XC219-TP01-4-ES-0.50-0.50	LPL	03/07/2020
>C16-C21 (Aromatic)	TPHFID (Aromatic)	0.01	mg/l	U				SOLID	03/07/2020
>C21-C35 (Aromatic)	TPHFID (Aromatic)	0.01	mg/l	U					
>C35-C44 (Aromatic)	TPHFID (Aromatic)	0.01	mg/l	N					
Total TPH (Aromatic)	TPHFID (Aromatic)	0.01	mg/l	U					
Benzene	VOCHSAW	1	µg/l	N					
Ethylbenzene	VOCHSAW	1	µg/l	N					
m and p-Xylene	VOCHSAW	1	µg/l	N					
MTBE	VOCHSAW	1	µg/l	N					
o-Xylene	VOCHSAW	1	µg/l	N					
Toluene	VOCHSAW	1	µg/l	N					
Equivalent Weight of Dry Material (kg)	Leachate Preparation CEN 10:1		kg	N					0.090
Fraction above 4mm (%)	Leachate Preparation CEN 10:1		%	N					0
Fraction of non-crushable material (%)	Leachate Preparation CEN 10:1		%	N					0
Volume of Water for 10:1 Leach (ltr)	Leachate Preparation CEN 10:1		l	N					0.865
Weight of Sample Leached (kg)	Leachate Preparation CEN 10:1		kg	N					0.125





Client: OCB Geotechnical Limited

Project Name: 19-135

Project No: 20071478

Date Issued: 11/08/2020

<u>Deviating Sample Report</u>			Incorrect Container	Incorrect Label	Headspace	Incorrect/No Preservative	No Sampling Date	Holding Time	Handling Time
Sample Reference	Text ID	Reported Name							

Analysis Method

<u>Analysis</u>	<u>Analysis Type</u>	<u>Analysis Method</u>
BTEXHSA	ORGANIC	UNFILTERED
GROHSA	ORGANIC	UNFILTERED
ICPMSW (Dissolved)	METALS	FILTERED
ICPWATVAR (Dissolved)	METALS	FILTERED
Leachate Preparation CEN 10:1	PHYS	As Received
PAHMSW	ORGANIC	FILTERED
SFAPI	INORGANIC	FILTERED
TPHFID (Aliphatic)	ORGANIC	FILTERED
TPHFID (Aromatic)	ORGANIC	FILTERED
VOCHSAW	ORGANIC	UNFILTERED



Client: OCB Geotechnical Limited

Project Name: 19-135

Project No: 20071478

Date Issued: 11/08/2020

Additional Information

This report refers to samples as received, and SOCOTEC Uk Ltd takes no responsibility for accuracy or competence of sampling by others.

Results within this report relate only to the samples tested.

In the accreditation column of analysis report the codes are as follows:

- U = UKAS accredited analysis
- M = MCERT accredited analysis
- N = Unaccredited analysis

Any units marked with ^ signify results are reported on a dry weight basis of 105° c

All Air Dried and Ground Samples (ADG) are oven dried at less than 35° c.

This report shall not be reproduced except in full and with approval from the laboratory.

Opinions and interpretations given are outside the scope of our UKAS accreditation.

Any samples marked with * are not covered by our scope of UKAS accreditation, if applicable further report notes have been added.

Any solid samples where the Major Constituents are not one of the following (Sand, Silt, Clay, Made Ground) are not one of our accredited matrix types.

Any samples marked with ‡ have had MCERTS accreditation removed for this result

Any samples marked with a tick in the deviant table is deviant for the specific reason.

Any samples reported as IS, NA, ND mean the following:

- IS = Insufficient Sample to complete analysis
- NA = Sample is not amenable for the required analysis
- ND = Results cannot be determined

Our deviating sample report does not include deviancy information for Subcontracted analysis. Please see the report from the Subcontracted lab for information regarding any deviancies for this analysis.

End of Certificate of Analysis



2183

Final Report

Report No.: 20-07190-1

Initial Date of Issue: 11-Mar-2020

Client: Environmental Laboratory Services Ltd

Client Address: Acorn Business Campus
Mahon Industrial Park
Blackrock
Cork
Ireland

Contact(s): Emer Kearney
Results

Project: Soil Testing

Quotation No.: Q20-19728 **Date Received:** 05-Mar-2020

Order No.: 6881 **Date Instructed:** 05-Mar-2020

No. of Samples: 2

Turnaround (Wkdays): 5 **Results Due:** 11-Mar-2020

Date Approved: 11-Mar-2020

Approved By:

Details: Darrell Hall, Director

Project: Soil Testing

Client: Environmental Laboratory Services Ltd		Chemtest Job No.:		20-07190	20-07190		
Quotation No.: Q20-19728 Order No.: 6881		Chemtest Sample ID.:		981247	981248		
		Client Sample Ref.:		176306/001	176306/002		
		Client Sample ID.:		1.0m	0.05m		
		Sample Location:		TP02	TP02		
		Sample Type:		SOIL	SOIL		
		Date Sampled:		17-Feb-2020	17-Feb-2020		
Determinand	Accred.	SOP	Type	Units	LOD		
pH	U	1010	10:1		N/A	8.7	8.1
Cyanide (Free)	U	1300	10:1	mg/l	0.050	< 0.050	< 0.050
Arsenic (Dissolved)	U	1450	10:1	µg/l	1.0	< 1.0	< 1.0
Boron (Dissolved)	U	1450	10:1	µg/l	20	< 20	< 20
Barium (Dissolved)	U	1450	10:1	µg/l	5.0	< 5.0	< 5.0
Beryllium (Dissolved)	U	1450	10:1	µg/l	1.0	< 1.0	< 1.0
Cadmium (Dissolved)	U	1450	10:1	µg/l	0.080	< 0.080	< 0.080
Chromium (Dissolved)	U	1450	10:1	µg/l	1.0	< 1.0	< 1.0
Copper (Dissolved)	U	1450	10:1	µg/l	1.0	1.1	1.9
Mercury (Dissolved)	U	1450	10:1	µg/l	0.50	< 0.50	< 0.50
Nickel (Dissolved)	U	1450	10:1	µg/l	1.0	< 1.0	< 1.0
Lead (Dissolved)	U	1450	10:1	µg/l	1.0	< 1.0	< 1.0
Selenium (Dissolved)	U	1450	10:1	µg/l	1.0	< 1.0	< 1.0
Vanadium (Dissolved)	U	1450	10:1	µg/l	1.0	< 1.0	< 1.0
Zinc (Dissolved)	U	1450	10:1	µg/l	1.0	2.2	< 1.0
Aliphatic TPH >C5-C6	N	1675	10:1	µg/l	0.10	[B] < 0.10	[B] < 0.10
Aliphatic TPH >C6-C8	N	1675	10:1	µg/l	0.10	[B] < 0.10	[B] < 0.10
Aliphatic TPH >C8-C10	N	1675	10:1	µg/l	0.10	[B] < 0.10	[B] < 0.10
Aliphatic TPH >C10-C12	N	1675	10:1	µg/l	0.10	[B] < 0.10	[B] < 0.10
Aliphatic TPH >C12-C16	N	1675	10:1	µg/l	0.10	[B] < 0.10	[B] < 0.10
Aliphatic TPH >C16-C21	N	1675	10:1	µg/l	0.10	[B] < 0.10	[B] < 0.10
Aliphatic TPH >C21-C35	N	1675	10:1	µg/l	0.10	[B] < 0.10	[B] < 0.10
Aliphatic TPH >C35-C44	N	1675	10:1	µg/l	0.10	[B] < 0.10	[B] < 0.10
Total Aliphatic Hydrocarbons	N	1675	10:1	µg/l	5.0	[B] < 5.0	[B] < 5.0
Aromatic TPH >C5-C7	N	1675	10:1	µg/l	0.10	[B] < 0.10	[B] < 0.10
Aromatic TPH >C7-C8	N	1675	10:1	µg/l	0.10	[B] < 0.10	[B] < 0.10
Aromatic TPH >C8-C10	N	1675	10:1	µg/l	0.10	[B] < 0.10	[B] < 0.10
Aromatic TPH >C10-C12	N	1675	10:1	µg/l	0.10	[B] < 0.10	[B] < 0.10
Aromatic TPH >C12-C16	N	1675	10:1	µg/l	0.10	[B] < 0.10	[B] < 0.10
Aromatic TPH >C16-C21	N	1675	10:1	µg/l	0.10	[B] < 0.10	[B] < 0.10
Aromatic TPH >C21-C35	N	1675	10:1	µg/l	0.10	[B] < 0.10	[B] < 0.10
Aromatic TPH >C35-C44	N	1680	10:1	µg/l	50.00	[B] < 50	[B] < 50
Total Aromatic Hydrocarbons	N	1675	10:1	µg/l	5.0	[B] < 5.0	[B] < 5.0
Total Petroleum Hydrocarbons	N	1675	10:1	µg/l	10	[B] < 10	[B] < 10
Benzene	U	1760	10:1	µg/l	1.0	[B] < 1.0	[B] < 1.0
Toluene	U	1760	10:1	µg/l	1.0	[B] < 1.0	[B] < 1.0
Ethylbenzene	U	1760	10:1	µg/l	1.0	[B] < 1.0	[B] < 1.0
m & p-Xylene	U	1760	10:1	µg/l	1.0	[B] < 1.0	[B] < 1.0

Project: Soil Testing

Client: Environmental Laboratory Services Ltd		Chemtest Job No.:		20-07190	20-07190		
Quotation No.: Q20-19728 Order No.: 6881		Chemtest Sample ID.:		981247	981248		
		Client Sample Ref.:		176306/001	176306/002		
		Client Sample ID.:		1.0m	0.05m		
		Sample Location:		TP02	TP02		
		Sample Type:		SOIL	SOIL		
		Date Sampled:		17-Feb-2020	17-Feb-2020		
Determinand	Accred.	SOP	Type	Units	LOD		
o-Xylene	U	1760	10:1	µg/l	1.0	[B] < 1.0	[B] < 1.0
Methyl Tert-Butyl Ether	N	1760	10:1	µg/l	1.0	[B] < 1.0	[B] < 1.0
Naphthalene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10
Acenaphthylene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10
Acenaphthene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10
Fluorene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10
Phenanthrene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10
Anthracene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10
Fluoranthene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10
Pyrene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10
Benzo[a]anthracene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10
Chrysene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10
Benzo[b]fluoranthene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10
Benzo[k]fluoranthene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10
Benzo[a]pyrene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10
Indeno(1,2,3-c,d)Pyrene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10
Dibenz(a,h)Anthracene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10
Benzo[g,h,i]perylene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10
Total Of 16 PAH's	U	1800	10:1	µg/l	2.0	< 2.0	< 2.0

Deviations

In accordance with UKAS Policy on Deviating Samples TPS 63. Chemtest have a procedure to ensure 'upon receipt of each sample a competent laboratory shall assess whether the sample is suitable with regard to the requested test(s)'. This policy and the respective holding times applied, can be supplied upon request. The reason a sample is declared as deviating is detailed below. Where applicable the analysis remains UKAS/MCERTs accredited but the results may be compromised.

Sample:	Sample Ref:	Sample ID:	Sample Location:	Sampled Date:	Deviation Code(s):	Containers Received:
981247	176306/001	1	TP02	17-Feb-2020	B	Amber Glass 250ml
981247	176306/001	1	TP02	17-Feb-2020	B	Plastic Tub 500g
981248	176306/002	2	TP02	17-Feb-2020	B	Amber Glass 250ml
981248	176306/002	2	TP02	17-Feb-2020	B	Plastic Tub 500g

SOP	Title	Parameters included	Method summary
1010	pH Value of Waters	pH	pH Meter
1300	Cyanides & Thiocyanate in Waters	Free (or easy liberatable) Cyanide; total Cyanide; complex Cyanide; Thiocyanate	Continuous Flow Analysis.
1450	Metals in Waters by ICP-MS	Metals, including: Antimony; Arsenic; Barium; Beryllium; Boron; Cadmium; Chromium; Cobalt; Copper; Lead; Manganese; Mercury; Molybdenum; Nickel; Selenium; Tin; Vanadium; Zinc	Filtration of samples followed by direct determination by inductively coupled plasma mass spectrometry (ICP-MS).
1675	TPH Aliphatic/Aromatic split in Waters by GC-FID(cf. Texas Method 1006 / TPH CWG)	Aliphatics: >C5–C6, >C6–C8, >C8–C10, >C10–C12, >C12–C16, >C16–C21, >C21–C35, >C35–C44 Aromatics: >C5–C7, >C7–C8, >C8–C10, >C10–C12, >C12–C16, >C16–C21, >C21–C35, >C35–C44	Pentane extraction / GCxGC FID detection
1680	Extractable Petroleum Hydrocarbons	Aliphatics: >C5–C6, >C6–C8, >C8–C10*, >C10–C12*, >C12–C16*, >C16–C21*, >C21–C35*, >C35–C44 Aromatics: >C5–C7, >C7–C8, >C8–C10*, >C10–C12*, >C12–C16*, >C16–C21*, >C21–C35*, >C35–C44	Dichloromethane extraction / GCxGC FID detection
1760	Volatile Organic Compounds (VOCs) in Waters by Headspace GC-MS	Volatile organic compounds, including BTEX and halogenated Aliphatic/Aromatics. (cf. USEPA Method 8260)	Automated headspace gas chromatographic (GC) analysis of water samples with mass spectrometric (MS) detection of volatile organic compounds.
1800	Speciated Polynuclear Aromatic Hydrocarbons (PAH) in Waters by GC-MS	Acenaphthene; Acenaphthylene; Anthracene; Benzo[a]Anthracene; Benzo[a]Pyrene; Benzo[b]Fluoranthene; Benzo[ghi]Perylene; Benzo[k]Fluoranthene; Chrysene; Dibenz[ah]Anthracene; Fluoranthene; Fluorene; Indeno[123cd]Pyrene; Naphthalene; Phenanthrene; Pyrene	Pentane extraction / GCMS detection
2030	Moisture and Stone Content of Soils(Requirement of MCERTS)	Moisture content	Determination of moisture content of soil as a percentage of its as received mass obtained at <37°C.
640	Characterisation of Waste (Leaching C10)	Waste material including soil, sludges and granular waste	Compliance Test for Leaching of Granular Waste Material and Sludge

Report Information

Key

- U UKAS accredited
- M MCERTS and UKAS accredited
- N Unaccredited
- S This analysis has been subcontracted to a UKAS accredited laboratory that is accredited for this analysis
- SN This analysis has been subcontracted to a UKAS accredited laboratory that is not accredited for this analysis
- T This analysis has been subcontracted to an unaccredited laboratory
- I/S Insufficient Sample
- U/S Unsuitable Sample
- N/E not evaluated
- < "less than"
- > "greater than"

Comments or interpretations are beyond the scope of UKAS accreditation

The results relate only to the items tested

Uncertainty of measurement for the determinands tested are available upon request

None of the results in this report have been recovery corrected

All results are expressed on a dry weight basis

The following tests were analysed on samples as received and the results subsequently corrected to a dry weight basis TPH, BTEX, VOCs, SVOCs, PCBs, Phenols

For all other tests the samples were dried at < 37°C prior to analysis

All Asbestos testing is performed at the indicated laboratory

Issue numbers are sequential starting with 1 all subsequent reports are incremented by 1

Sample Deviation Codes

- A - Date of sampling not supplied
- B - Sample age exceeds stability time (sampling to extraction)
- C - Sample not received in appropriate containers
- D - Broken Container
- E - Insufficient Sample (Applies to LOI in Trommel Fines Only)

Sample Retention and Disposal

All soil samples will be retained for a period of 45 days from the date of receipt

All water samples will be retained for 14 days from the date of receipt

Charges may apply to extended sample storage

If you require extended retention of samples, please email your requirements to:

customerservices@chemtest.com



2183

Final Report

Report No.: 20-07165-1

Initial Date of Issue: 12-Mar-2020

Client: Environmental Laboratory Services Ltd

Client Address: Acorn Business Campus
Mahon Industrial Park
Blackrock
Cork
Ireland

Contact(s): Emer Kearney
Results

Project: Soil Samples

Quotation No.: Q20-19728 **Date Received:** 05-Mar-2020

Order No.: 6897 **Date Instructed:** 05-Mar-2020

No. of Samples: 4

Turnaround (Wkdays): 5 **Results Due:** 11-Mar-2020

Date Approved: 12-Mar-2020

Approved By:

Details: Darrell Hall, Director

Project: Soil Samples

Client: Environmental Laboratory Services Ltd		Chemtest Job No.:		20-07165	20-07165			20-07165	20-07165
Quotation No.: Q20-19728 Order No.: 6897		Chemtest Sample ID.:		981120	981121			981124	981125
		Client Sample Ref.:		176540/001	176540/002			176540/005	176540/006
		Client Sample ID.:		1	2			5	6
		Sample Location:		XC219-CPRC04	XC219-CPRC04			XC219-CP01	XC219-CP01
		Sample Type:		SOIL	SOIL			SOIL	SOIL
		Top Depth (m):		0.05	1.00			0.05	1.00
		Date Sampled:		20-Feb-2020	20-Feb-2020			27-Feb-2020	28-Feb-2020
Determinand	Accred.	SOP	Type	Units	LOD				
pH	U	1010	10:1		N/A	8.9	8.8	8.9	8.8
Cyanide (Free)	U	1300	10:1	mg/l	0.050	< 0.050	< 0.050	< 0.050	< 0.050
Arsenic (Dissolved)	U	1450	10:1	µg/l	1.0	1.0	< 1.0	< 1.0	< 1.0
Boron (Dissolved)	U	1450	10:1	µg/l	20	< 20	< 20	< 20	< 20
Barium (Dissolved)	U	1450	10:1	µg/l	5.0	< 5.0	< 5.0	7.3	< 5.0
Beryllium (Dissolved)	U	1450	10:1	µg/l	1.0	< 1.0	< 1.0	< 1.0	< 1.0
Cadmium (Dissolved)	U	1450	10:1	µg/l	0.080	< 0.080	< 0.080	< 0.080	< 0.080
Chromium (Dissolved)	U	1450	10:1	µg/l	1.0	< 1.0	< 1.0	< 1.0	< 1.0
Copper (Dissolved)	U	1450	10:1	µg/l	1.0	1.0	< 1.0	1.2	1.2
Mercury (Dissolved)	U	1450	10:1	µg/l	0.50	< 0.50	< 0.50	0.66	< 0.50
Nickel (Dissolved)	U	1450	10:1	µg/l	1.0	< 1.0	< 1.0	< 1.0	< 1.0
Lead (Dissolved)	U	1450	10:1	µg/l	1.0	1.0	< 1.0	< 1.0	< 1.0
Selenium (Dissolved)	U	1450	10:1	µg/l	1.0	< 1.0	< 1.0	2.1	1.4
Vanadium (Dissolved)	U	1450	10:1	µg/l	1.0	< 1.0	< 1.0	< 1.0	< 1.0
Zinc (Dissolved)	U	1450	10:1	µg/l	1.0	1.1	< 1.0	< 1.0	< 1.0
Aliphatic TPH >C5-C6	N	1675	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Aliphatic TPH >C6-C8	N	1675	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Aliphatic TPH >C8-C10	N	1675	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Aliphatic TPH >C10-C12	N	1675	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Aliphatic TPH >C12-C16	N	1675	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	28
Aliphatic TPH >C16-C21	N	1675	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	350
Aliphatic TPH >C21-C35	N	1675	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	3300
Aliphatic TPH >C35-C44	N	1675	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Total Aliphatic Hydrocarbons	N	1675	10:1	µg/l	5.0	< 5.0	< 5.0	< 5.0	3700
Aromatic TPH >C5-C7	N	1675	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Aromatic TPH >C7-C8	N	1675	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Aromatic TPH >C8-C10	N	1675	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Aromatic TPH >C10-C12	N	1675	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Aromatic TPH >C12-C16	N	1675	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Aromatic TPH >C16-C21	N	1675	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Aromatic TPH >C21-C35	N	1675	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Aromatic TPH >C35-C44	N	1680	10:1	µg/l	50.00	< 50	< 50	< 50	< 50
Total Aromatic Hydrocarbons	N	1675	10:1	µg/l	5.0	< 5.0	< 5.0	< 5.0	< 5.0
Total Petroleum Hydrocarbons	N	1675	10:1	µg/l	10	< 10	< 10	< 10	3700
Benzene	U	1760	10:1	µg/l	1.0	< 1.0	< 1.0	< 1.0	< 1.0
Toluene	U	1760	10:1	µg/l	1.0	< 1.0	< 1.0	< 1.0	< 1.0
Ethylbenzene	U	1760	10:1	µg/l	1.0	< 1.0	< 1.0	< 1.0	< 1.0

Project: Soil Samples

Client: Environmental Laboratory Services Ltd		Chemtest Job No.:		20-07165	20-07165			20-07165	20-07165
Quotation No.: Q20-19728 Order No.: 6897		Chemtest Sample ID.:		981120	981121			981124	981125
		Client Sample Ref.:		176540/001	176540/002			176540/005	176540/006
		Client Sample ID.:		1	2			5	6
		Sample Location:		XC219-CPRC04	XC219-CPRC04			XC219-CP01	XC219-CP01
		Sample Type:		SOIL	SOIL			SOIL	SOIL
		Top Depth (m):		0.05	1.00			0.05	1.00
		Date Sampled:		20-Feb-2020	20-Feb-2020			27-Feb-2020	28-Feb-2020
Determinand	Accred.	SOP	Type	Units	LOD				
m & p-Xylene	U	1760	10:1	µg/l	1.0	< 1.0	< 1.0	< 1.0	< 1.0
o-Xylene	U	1760	10:1	µg/l	1.0	< 1.0	< 1.0	< 1.0	< 1.0
Methyl Tert-Butyl Ether	N	1760	10:1	µg/l	1.0	< 1.0	< 1.0	< 1.0	< 1.0
Naphthalene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Acenaphthylene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Acenaphthene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Fluorene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Phenanthrene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Anthracene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Fluoranthene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Pyrene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Benzo[a]anthracene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Chrysene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Benzo[b]fluoranthene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Benzo[k]fluoranthene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Benzo[a]pyrene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Indeno(1,2,3-c,d)Pyrene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Dibenz(a,h)Anthracene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Benzo[g,h,i]perylene	U	1800	10:1	µg/l	0.10	< 0.10	< 0.10	< 0.10	< 0.10
Total Of 16 PAH's	U	1800	10:1	µg/l	2.0	< 2.0	< 2.0	< 2.0	< 2.0

SOP	Title	Parameters included	Method summary
1010	pH Value of Waters	pH	pH Meter
1300	Cyanides & Thiocyanate in Waters	Free (or easy liberatable) Cyanide; total Cyanide; complex Cyanide; Thiocyanate	Continuous Flow Analysis.
1450	Metals in Waters by ICP-MS	Metals, including: Antimony; Arsenic; Barium; Beryllium; Boron; Cadmium; Chromium; Cobalt; Copper; Lead; Manganese; Mercury; Molybdenum; Nickel; Selenium; Tin; Vanadium; Zinc	Filtration of samples followed by direct determination by inductively coupled plasma mass spectrometry (ICP-MS).
1675	TPH Aliphatic/Aromatic split in Waters by GC-FID(cf. Texas Method 1006 / TPH CWG)	Aliphatics: >C5–C6, >C6–C8, >C8–C10, >C10–C12, >C12–C16, >C16–C21, >C21–C35, >C35–C44 Aromatics: >C5–C7, >C7–C8, >C8–C10, >C10–C12, >C12–C16, >C16–C21, >C21–C35, >C35–C44	Pentane extraction / GCxGC FID detection
1680	Extractable Petroleum Hydrocarbons	Aliphatics: >C5–C6, >C6–C8, >C8–C10*, >C10–C12*, >C12–C16*, >C16–C21*, >C21–C35*, >C35–C44 Aromatics: >C5–C7, >C7–C8, >C8–C10*, >C10–C12*, >C12–C16*, >C16–C21*, >C21–C35*, >C35–C44	Dichloromethane extraction / GCxGC FID detection
1760	Volatile Organic Compounds (VOCs) in Waters by Headspace GC-MS	Volatile organic compounds, including BTEX and halogenated Aliphatic/Aromatics. (cf. USEPA Method 8260)	Automated headspace gas chromatographic (GC) analysis of water samples with mass spectrometric (MS) detection of volatile organic compounds.
1800	Speciated Polynuclear Aromatic Hydrocarbons (PAH) in Waters by GC-MS	Acenaphthene; Acenaphthylene; Anthracene; Benzo[a]Anthracene; Benzo[a]Pyrene; Benzo[b]Fluoranthene; Benzo[ghi]Perylene; Benzo[k]Fluoranthene; Chrysene; Dibenz[ah]Anthracene; Fluoranthene; Fluorene; Indeno[123cd]Pyrene; Naphthalene; Phenanthrene; Pyrene	Pentane extraction / GCMS detection
2030	Moisture and Stone Content of Soils(Requirement of MCERTS)	Moisture content	Determination of moisture content of soil as a percentage of its as received mass obtained at <37°C.
640	Characterisation of Waste (Leaching C10)	Waste material including soil, sludges and granular waste	Compliance Test for Leaching of Granular Waste Material and Sludge

Report Information

Key

- U UKAS accredited
- M MCERTS and UKAS accredited
- N Unaccredited
- S This analysis has been subcontracted to a UKAS accredited laboratory that is accredited for this analysis
- SN This analysis has been subcontracted to a UKAS accredited laboratory that is not accredited for this analysis
- T This analysis has been subcontracted to an unaccredited laboratory
- I/S Insufficient Sample
- U/S Unsuitable Sample
- N/E not evaluated
- < "less than"
- > "greater than"

Comments or interpretations are beyond the scope of UKAS accreditation

The results relate only to the items tested

Uncertainty of measurement for the determinands tested are available upon request

None of the results in this report have been recovery corrected

All results are expressed on a dry weight basis

The following tests were analysed on samples as received and the results subsequently corrected to a dry weight basis TPH, BTEX, VOCs, SVOCs, PCBs, Phenols

For all other tests the samples were dried at < 37°C prior to analysis

All Asbestos testing is performed at the indicated laboratory

Issue numbers are sequential starting with 1 all subsequent reports are incremented by 1

Sample Deviation Codes

- A - Date of sampling not supplied
- B - Sample age exceeds stability time (sampling to extraction)
- C - Sample not received in appropriate containers
- D - Broken Container
- E - Insufficient Sample (Applies to LOI in Trommel Fines Only)

Sample Retention and Disposal

All soil samples will be retained for a period of 45 days from the date of receipt

All water samples will be retained for 14 days from the date of receipt

Charges may apply to extended sample storage

If you require extended retention of samples, please email your requirements to:

customerservices@chemtest.com

Appendix K

Geophysical Survey Report

XC219 Buttevant Level Crossing
Co. Cork

Geophysical Survey

Report Status: Final

MGX Project Number: 6508

MGX File Ref: 6508f-005.doc

9th November 2020

Confidential Report To:

OCB Geotechnical

Unit 11
Carrigogna
Midleton
Co. Cork

**Report submitted by :
Minerex Geophysics Limited**

Unit F4, Maynooth Business Campus
Maynooth, Co. Kildare, W23X7Y5
Ireland
Tel.: 01-6510030
Email: info@mgx.ie

Issued by:

Author: Hartmut Krahn (Senior Geophysicist)

Reviewer: John Connaughton (Geophysicist)



Subsurface Geophysical Investigations

EXECUTIVE SUMMARY

1. Minerex Geophysics Ltd. (MGX) carried out a geophysical survey consisting of 2D-Resistivity profiles at the proposed bridge development at the Buttevant Level Crossing XC219, Co Cork.
2. The main objectives of the survey were to determine the ground conditions and to check for the presence of karst features and karstified rock.
3. The ground model presented here shows clay-rich overburden over karstifiable limestone. The limestone is described as weathered karstified limestone and fresh compact limestone.
4. The interpretation shows that the rock quality is generally better and the rock is shallower on the east side of the railway. On the west side the rock is more weathered and karstified and also generally deeper.
5. Core holes 6 and 7 were targeted here on the west side where profiles R1 to R4 cross each other. This area seems quite complex, contains the clay-filled cavity found in core hole 3 and also might contain further karst features. The core hole show deep weathered or karstified rock.
6. At the eastern end of R6 from 85 to 106 m distance some localised weathered karstified limestone has been interpreted.
7. At the end of profiles R3 and R4 (105 m distance) could be the transition to the better limestone interpreted on the eastern side of the railway. Bore hole 8 was done here and it still shows some weathered rock but also generally better RQD values.
8. 2D-Resistivity profiles across the railway line could be carried out to image the area close to the railway line and below it
9. This final report was reviewed after targeted core hole information became available.

CONTENTS

1. INTRODUCTION.....	1
1.1 Background.....	1
1.2 Objectives.....	1
1.3 Site Description.....	1
1.4 Geology	1
1.5 Report	2
2. GEOPHYSICAL SURVEY	3
2.1 Methodology	3
2.2 2D-Resistivity	3
2.3 Site Work	4
3. RESULTS AND INTERPRETATION	5
3.1 2D-Resistivity	5
4. CONCLUSIONS AND RECOMMENDATIONS	7
5. REFERENCES	8

List of Tables, Maps and Figures:

Title	Pages	Document Reference
Table 1: Geophysical Survey Locations and Acquisition Parameters	In text	In text
Table 2: Summary of Interpretation	In text	In text
Map 1: Geophysical Survey Location Map	1 x A3	6508f_MapsFigs.dwg
Figure 1a: Models of Geophysical Survey	1 x A3	6508f_MapsFigs.dwg
Figure 1a: Models of Geophysical Survey	1 x A3	6508f_MapsFigs.dwg
Figure 2a: Interpretation of Geophysical Survey	1 x A3	6508f_MapsFigs.dwg
Figure 2b: Interpretation of Geophysical Survey	1 x A3	6508f_MapsFigs.dwg

1. INTRODUCTION

1.1 Background

Minerex Geophysics Ltd. (MGX) carried out a geophysical survey at the XC219 Buttevant Level Crossing as a part of the Cork Line Level Crossings Project. It is proposed to replace the level crossing by a road-over-rail bridge. The survey was commissioned by OCB Geotechnical.

The role of geophysics as a non-destructive fast method is to allow later targeted direct investigations. Those results can be used to improve the initial results and interpretation.

The survey was aimed both at investigating the ground conditions and identifying any possible karst features.

Recommendations for targeted borehole were made after the draft report, and the results of targeted boreholes, where they were done, are included in this final report versions.

1.2 Objectives

The main objectives of the geophysical survey were:

- To determine the ground conditions under the site
- To detect lateral changes within the geological layers
- To detect possible karst features and karstified rock

1.3 Site Description

The site is located at the Level Crossing to the west of Buttevant, Co. Cork. The survey area is on both sides of the railway in relatively level fields. On the east side of the railway is a yard with gravel surface cover, on the west side is a derelict railway station building and a strip of protected vegetation.

1.4 Geology

Several cable percussive and rotary core holes had been carried out before this survey and they describe the geology as gravelly clay over limestone bedrock. The limestone shows sign of karstification, especially at core hole 3 where a clay filled cavity was found. The boreholes are shown on Map 1 and the abbreviated boreholes logs are indicated on the figures.

The bedrock geological map (GSI, 2020) indicates that the site is underlain by the Hazelwood Limestone Formation, described as pale-grey massive mud-grade limestone. This formation is liable to karstification and karst features have been mapped in the general area of Buttevant.

The main fault direction in the area is S to N and WSW to ENE though no fault has been mapped under the site.

1.5 Report

This report includes the results and interpretation of the geophysical survey. Maps, figures and tables are included to illustrate the results of the survey. More detailed descriptions of geophysical methods and measurements can be found in GSEG (2002), Milsom (1989) and Reynolds (1997).

The digital map provided by the client was used for reference as the background map (Map 1).

The interpretative nature and the non-invasive survey methods must be taken into account when considering the results of this survey and Minerex Geophysics Limited, while using appropriate practice to execute, interpret and present the data, give no guarantees in relation to the existing subsurface.

2. GEOPHYSICAL SURVEY

2.1 Methodology

The methodology was outlined in the tender documents and consisted of 2D-Resistivity profiles on the lines given by the engineers.

The survey locations are indicated on Map 1. The profiles and parameters are tabulated in Table 1 below.

All geophysical surveys are acquired, processed and reported in accordance with British Standards BS 5930:1999 +A2:2010 'Code of Practice for Site Investigations'.

Table 1: Geophysical Survey Locations and Acquisition Parameters

Profile Name	Electrode Spacing/m	Number of Electrodes	Profile Length/m
R1	3	36	105
R2	3	32	93
R3	3	41	120
R4	3	42	123
R5	3	36	105
R6	3	43	126
SUM			672

2.2 2D-Resistivity

2D-Resistivity profiles were surveyed with electrode spacing of 3 m, up to 43 electrodes per set-up and a maximum length of 126 m per profile. The readings were taken with a Tigre Resistivity Meter, Imager Cables, stainless steel electrodes, laptop and ImagerPro acquisition software.

During 2D-Resistivity surveying data is acquired in the form of linear profiles using a suite of metal electrodes. A current is injected into the ground via a pair of electrodes while a potential difference is measured across a second pair of electrodes. This allows for the recording of the apparent resistivity in a two-dimensional arrangement below the profile. The data is inverted after the survey to obtain a model of subsurface resistivities. The generated model resistivity values and their spatial distribution can then be related to typical values for different geological materials.

2D-Resistivity has previously proven zones of anomalous or karstified rock with lateral extents of 5 m and more.

2.3 Site Work

The data acquisition was carried out on the 18th of June 2020. The weather conditions were variable throughout the acquisition period. Health and safety standards were adhered to at all times. The electrode locations were surveyed with a Carlson NR3 RTK-GPS to accuracy < 0.05 m.

3. RESULTS AND INTERPRETATION

The interpretation of geophysical data was carried out utilising the known response of geophysical measurements, typical physical parameters for subsurface features that may underlay the site, and the experience of the authors. The interpretation is based solely on the 2D-Resistivity data as the only method carried out.

Ground investigation results were available and the abbreviated borehole logs are indicated on the sections. Boreholes provide accurate information for specific locations while geophysics provides a broader interpretation over a large volume of ground. The overburden is shown as 'Clay' which is the main component. Rock core descriptions with an RQD value < 65 are abbreviated as 'Weathered Limestone' and better rock with higher RQD values is shown as 'Limestone'.

3.1 2D-Resistivity

The 2D-Resistivity data was positioned and inverted with the RES2DINV inversion package. The programme uses a smoothness constrained least-squares inversion method to produce a 2D model of the subsurface model resistivities from the recorded apparent resistivity values. Three variations of the least squares method are available and for this project the Jacobian Matrix was recalculated for the first three iterations, then a Quasi-Newton approximation was used for subsequent iterations. Each dataset was inverted using seven iterations resulting in a typical RMS error of <3.6%. The resulting models were colour contoured with the same resistivity scale for all profiles and they are displayed as cross sections (Figures 1a and 1b).

Resistivities are characteristic for certain overburden and rock types. If there is a high content of clay minerals (which are electrically conductive) then the overburden resistivity will be lower than if there is a high content of clastic grains like sand or gravel. The purer the clay and the lower the sand/gravel content the lower the resistivity. The water content in the overburden also influences the resistivities but generally the clay content has a larger effect.

Karstified rock is defined in this report as a formerly intact clean limestone rock, liable to karstification, that has been partially dissolved by water over long geological time scales and where the cavities and voids have either remained empty (filled by air) or became filled by overburden sediment (clay, silt, sand), weathering product of the broken rock itself or water. This process would lead to a reduction of the resistivity of the overall rock and therefore karstified rock has a lower resistivity than intact clean limestone rock. This is generally indicated by lower resistivities embedded within high resistivity at depth. Only air-filled cavities would have a higher resistivity than the limestone itself.

Water strikes in the bore holes were generally between 2 and 4 m bgl therefore water levels are expected above the rock or close to the top of the rock. This means that open cavities within the rock would be filled

with water rather than air. This would result in a reduction of resistivities within water-filled cavities while an air-filled cavity would increase the resistivity.

The bedrock resistivities on this site are generally high, indicating that the limestone is liable to karstification. Karstified rock is typically identified by low resistivities within a high resistivity limestone bedrock.

The resistivities cover a range typical for materials from clay rich overburden to fresh compact unweathered limestone (high resistivities). The ranges and gradients have been taken into consideration for the interpretation. Low resistivity values (<250 to 500 Ohmm) and a shallow gradient typically indicate overburden with high clay content. Lower values at depth (< 1000 Ohmm) show weathered karstified bedrock. High resistivities (>1000 Ohmm) indicate fresh compact limestone.

The primary purpose of the resistivity survey is to propose targeted core holes. The interpretation below is done by following roughly criteria like resistivities and gradients, but the interpretation does not represent an exact ground condition. 2D-Resistivity only measures one parameter of the subsurface while some materials such as gravelly clay in overburden and a mix of rock and clay in weathered karstified rock can have the similar resistivities. Changes in the subsurface geology oblique to the direction of a profile leads to a "3D" result on a 2D model. This can be seen by contradictions in intersecting profiles. The fit between R5 and R6 on the eastern side of the railway is good which indicates little change in the geology around the profiles as well as across them, while the differences at the crossing on the western side show more geological complexity which is considered during the interpretation.

The 2D-Resistivity survey shows generally unweathered fresh limestone to the east of the railway with some exceptions such as an area near the end of Profile R6, while lower resistivities at depth to the west of the railway bridge, particularly at the start of profiles R1, R3 and R4 indicate a more weathered, karstified limestone. Figures 2a and 2b show an interpretation based solely on the 2D-Resistivity survey. Additional geotechnical locations are proposed on the maps and figures and are concentrated on areas where karstified rock may be present. Boreholes 4 and 5 show fresh limestone within the high resistivity area and it would be anticipated that additional borehole within the high resistivity areas would produce similar results.

Table 2: Summary of Interpretation

Layer	General Resistivity Range (Ohmm)	Interpretation
1	<250 to 500 and gradient	Clay-rich Overburden
2	< 1000	Weathered karstified Limestone
3	>1000	Fresh compact Limestone


4. CONCLUSIONS AND RECOMMENDATIONS

The following conclusions and recommendations are made:

- The geophysical survey indicates clay-rich overburden over karstifiable limestone.
- The depth to rock is generally shallower on the east side of the railway than on the west side.
- Resistivities within the limestone indicate more karstification and weathering on the west side of the railway and a generally better rock on the eastern side.
- The area where profiles R1 to R4 cross each other seems to be the most geologically complex and disturbed area. This is where core hole 3 has found a clay-filled cavity from 9.90 to 11.3 m depth. This was not directly detected by the resistivity profiles but it is expected that more similar karst features exist in this area. Core holes 6 and 7 were targeted here and indicate deep weathered bedrock which could be also described as karstified rock.
- On profile R6 at the eastern end from 85 to 106 m distance low resistivity indicates weathered karstified rock and a core hole was recommended here in the draft report.
- There is an increase to high resistivities at the end of profiles R3 and R4 (105 m distance) and this could show the transition to the better limestone interpreted on the eastern side of the railway. Bore hole 8 was done here and it still shows some weathered rock but also generally better RQD values.
- It is recommended to carry out 2D-Resistivity profiles across the railway line. By feeding the resistivity cables under the rails this can be done while maintaining the train schedule and with only one person accessing the railway line.
- This final report version was reviewed after some targeted boreholes were carried out.


5. REFERENCES

1. **GSEG 2002.** Geophysics in Engineering Investigations. Geological Society Engineering Geology Special Publication 19, London, 2002.
2. **GSI, 2020.** Online Bedrock Geological Map of Ireland. Geological Survey of Ireland 2019.
3. **Milsom, 1989.** Field Geophysics. John Wiley and Sons.
4. **Reynolds, 1997.** An Introduction to Applied and Environmental Geophysics. John Wiley and Son.

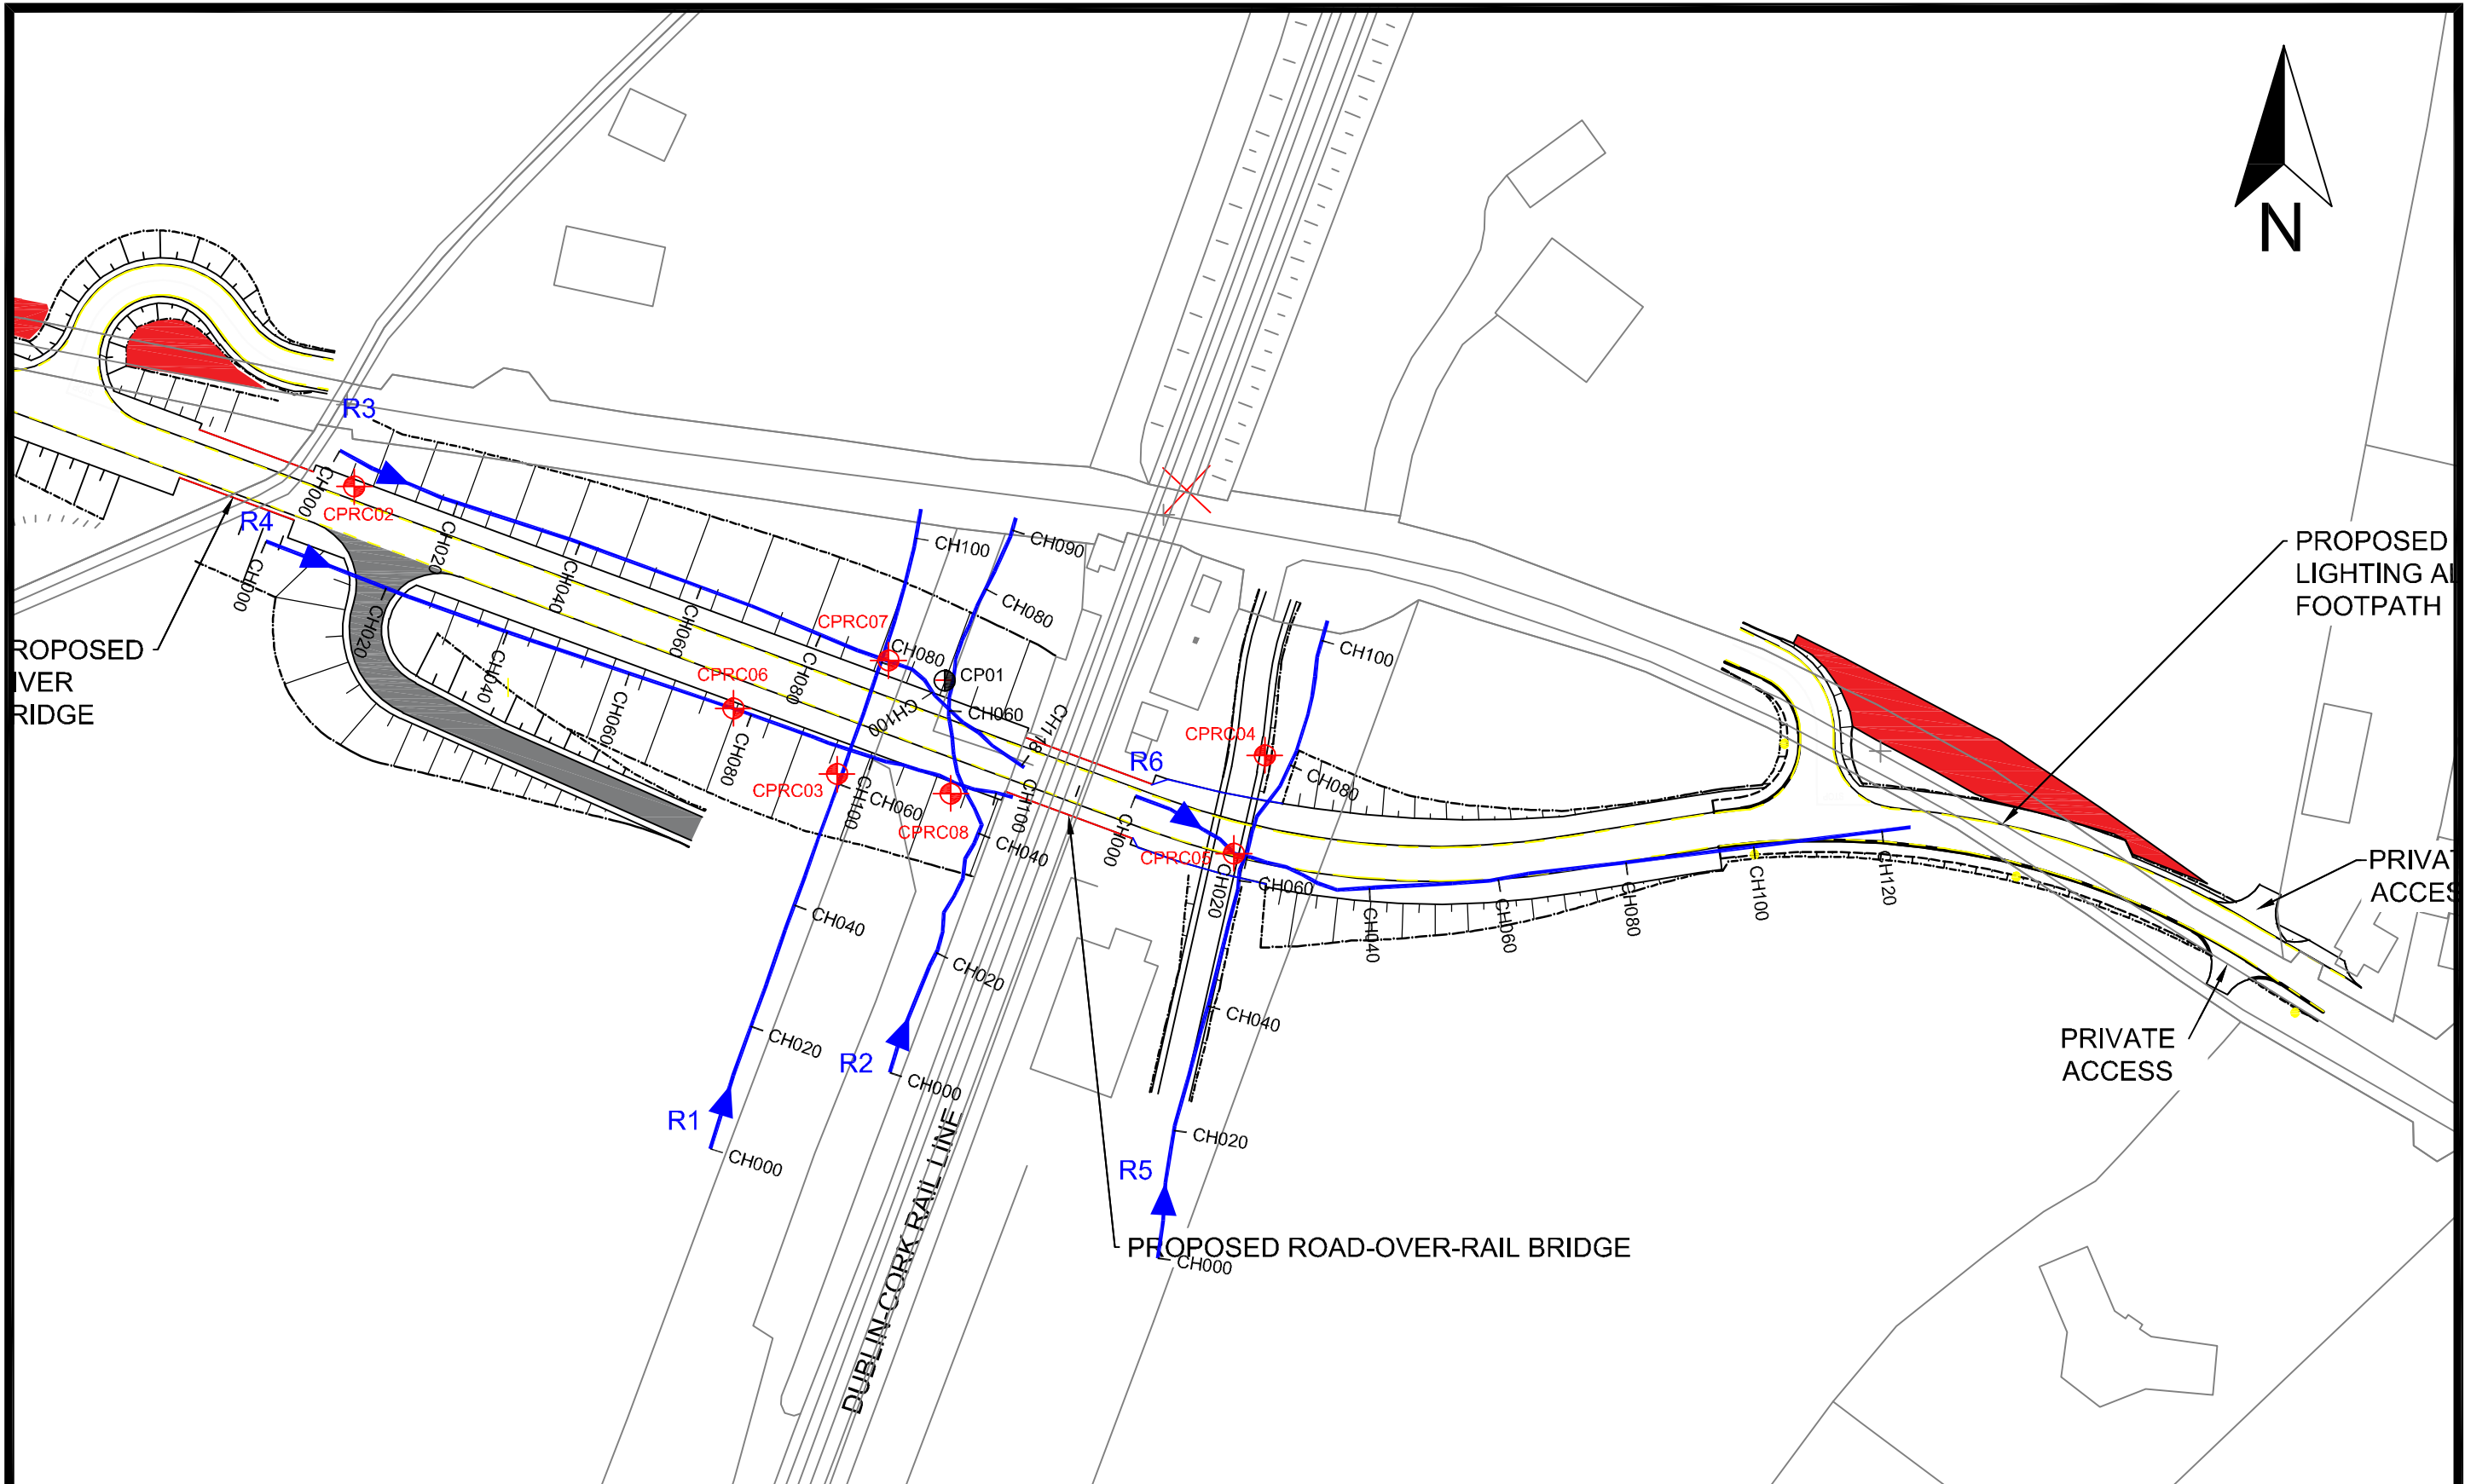


<p>Unit F4, Maynooth Business Campus Maynooth, Co. Kildare Tel. (01) 6510030 Email: info@mgx.ie Web: www.mgx.ie</p>	CLIENT	OCB Geotechnical	SCALE:	1:1000 @ A3	LEGEND: Geophysical Survey Locations: R2 2D-Resistivity Profile CH020 Distance along Profile	Direct Ground Investigation Locations: XC219-CPRC03 Borehole
	PROJECT	Buttevant Level Crossing XC219 Geophysical Survey	PROJECT:	6508		
	TITLE	Map 1: Geophysical Survey Location Map	DRAWN:	HK		
			DATE:	9/11/2020		
		MGX FILE:	6508f_MapsFigs.dwg			
		STATUS:	Final			


2D-Resistivity Profile R1 Model

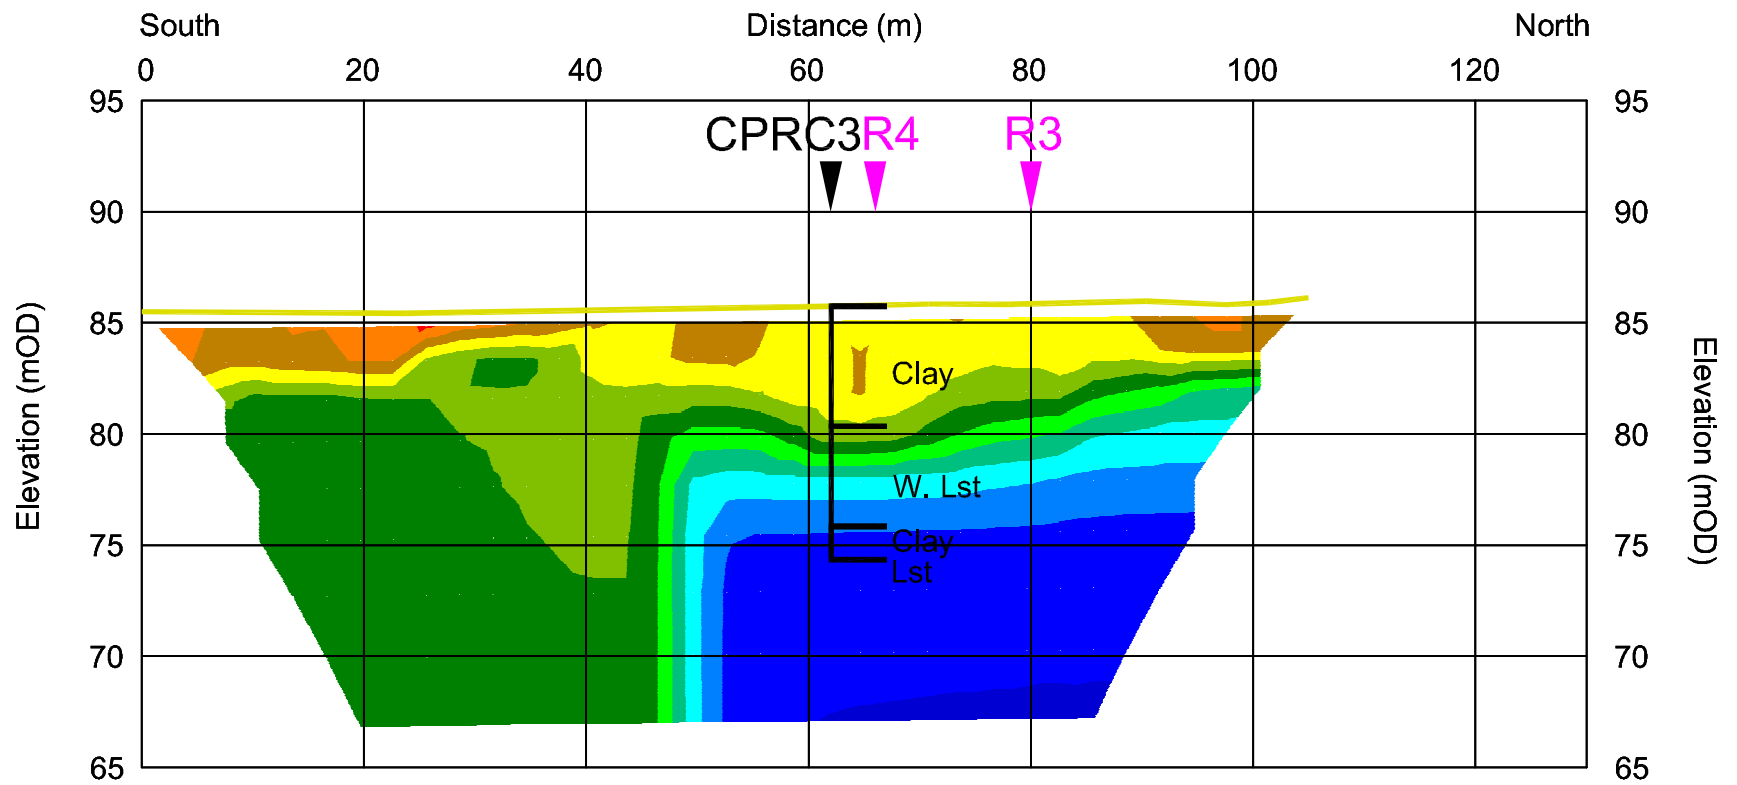

2D-Resistivity Profile R2 Model

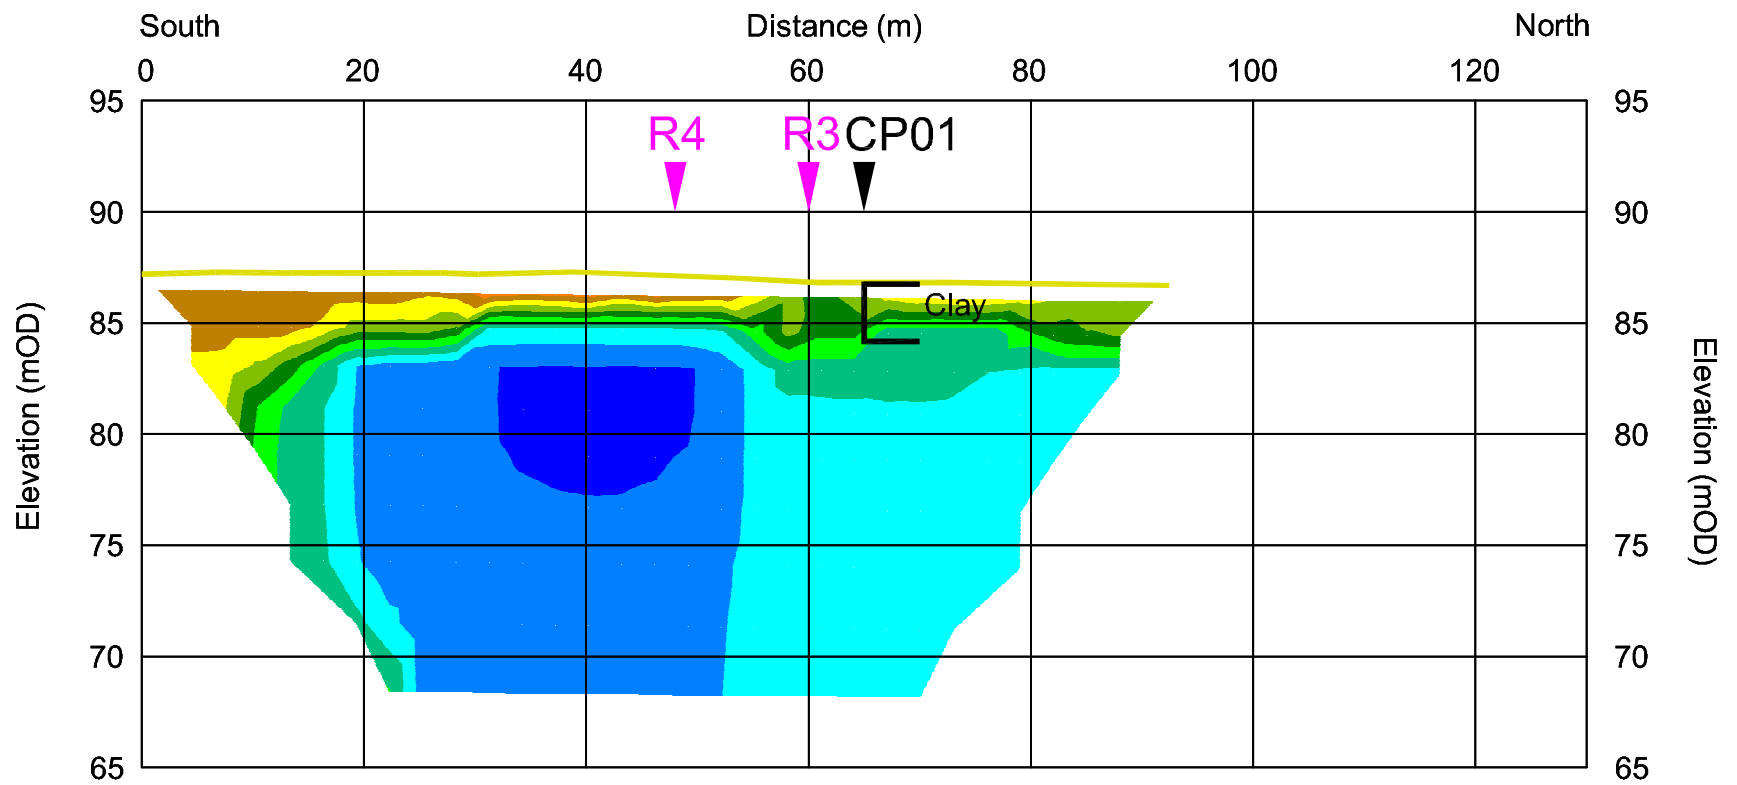

2D-Resistivity Profile R3 Model

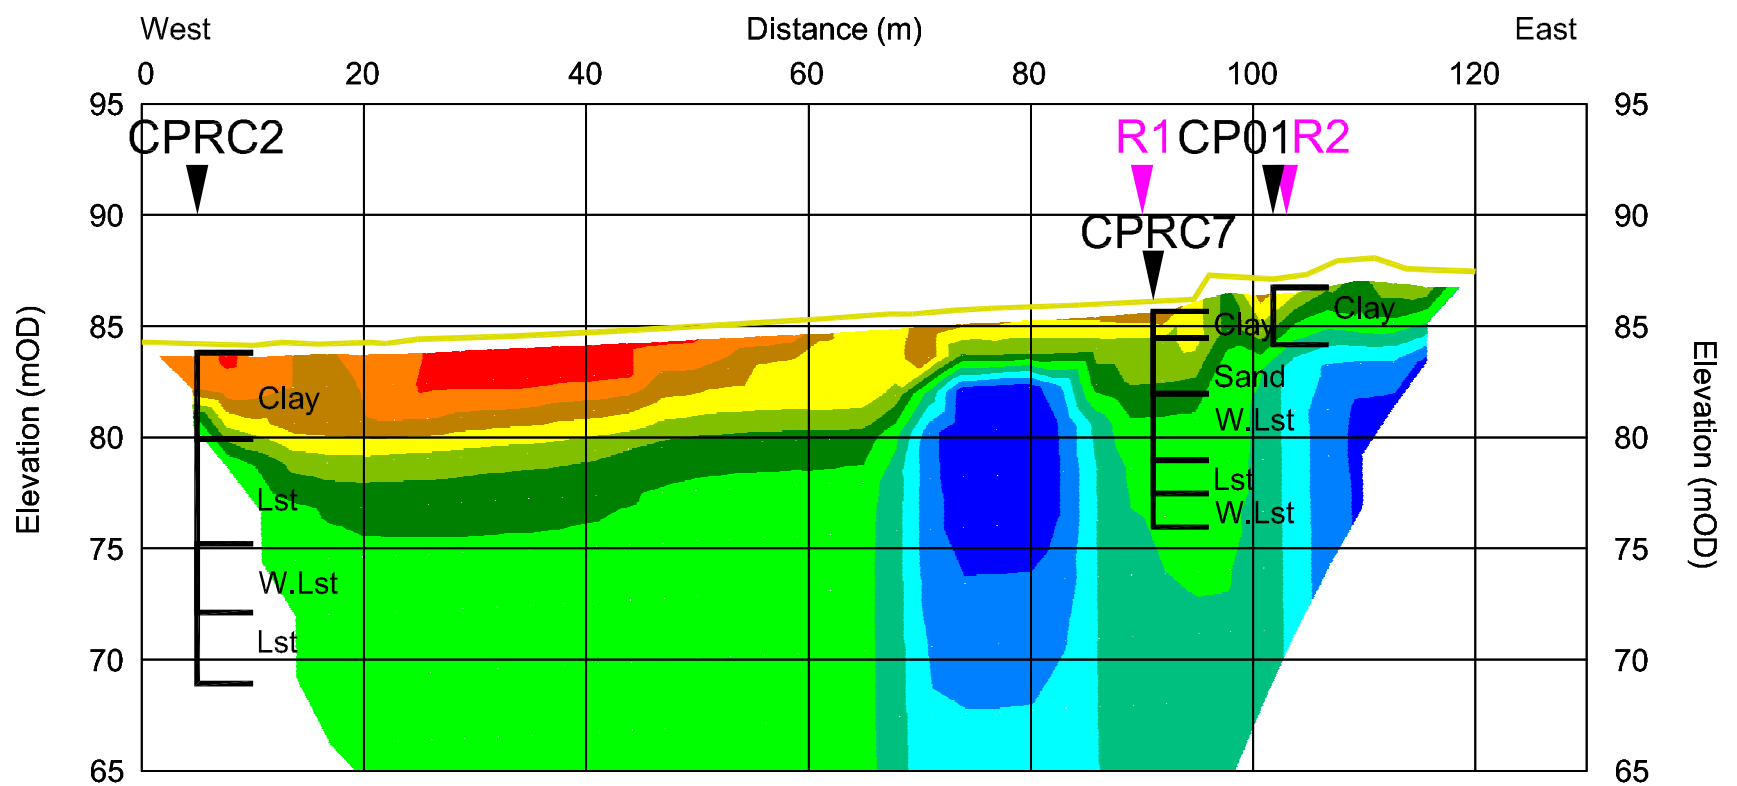

Minerex
Geophysics Limited
Unit F4, Maynooth Business Campus
Maynooth, Co. Kildare
Tel. (01) 6510030
Email: info@mgx.ie
Web: www.mgx.ie

CLIENT OCB Geotechnical
PROJECT Buttevant Railway Crossing XC219 Geophysical Survey
TITLE Figure 1a: Models of Geophysical Survey

SCALE: NTS @ A3, VE x 2
PROJECT: 6508
DRAWN: HK
DATE: 9/11/2020
MGX FILE: 6508f_MapsFigs.dwg
STATUS: Final


LEGEND: Resistivities (Ohmm) for 2D-Resistivity Model

31.3	62.5	125	250	500	1000	2000	4000
------	------	-----	-----	-----	------	------	------


▲ R5 Profile Crossing
 ▼ CPRC5 Borehole

Abbreviated GI Logs:
 Cl Clay
 W. Ls Weathered Ls
 Ls Limestone


2D-Resistivity Profile R4 Model

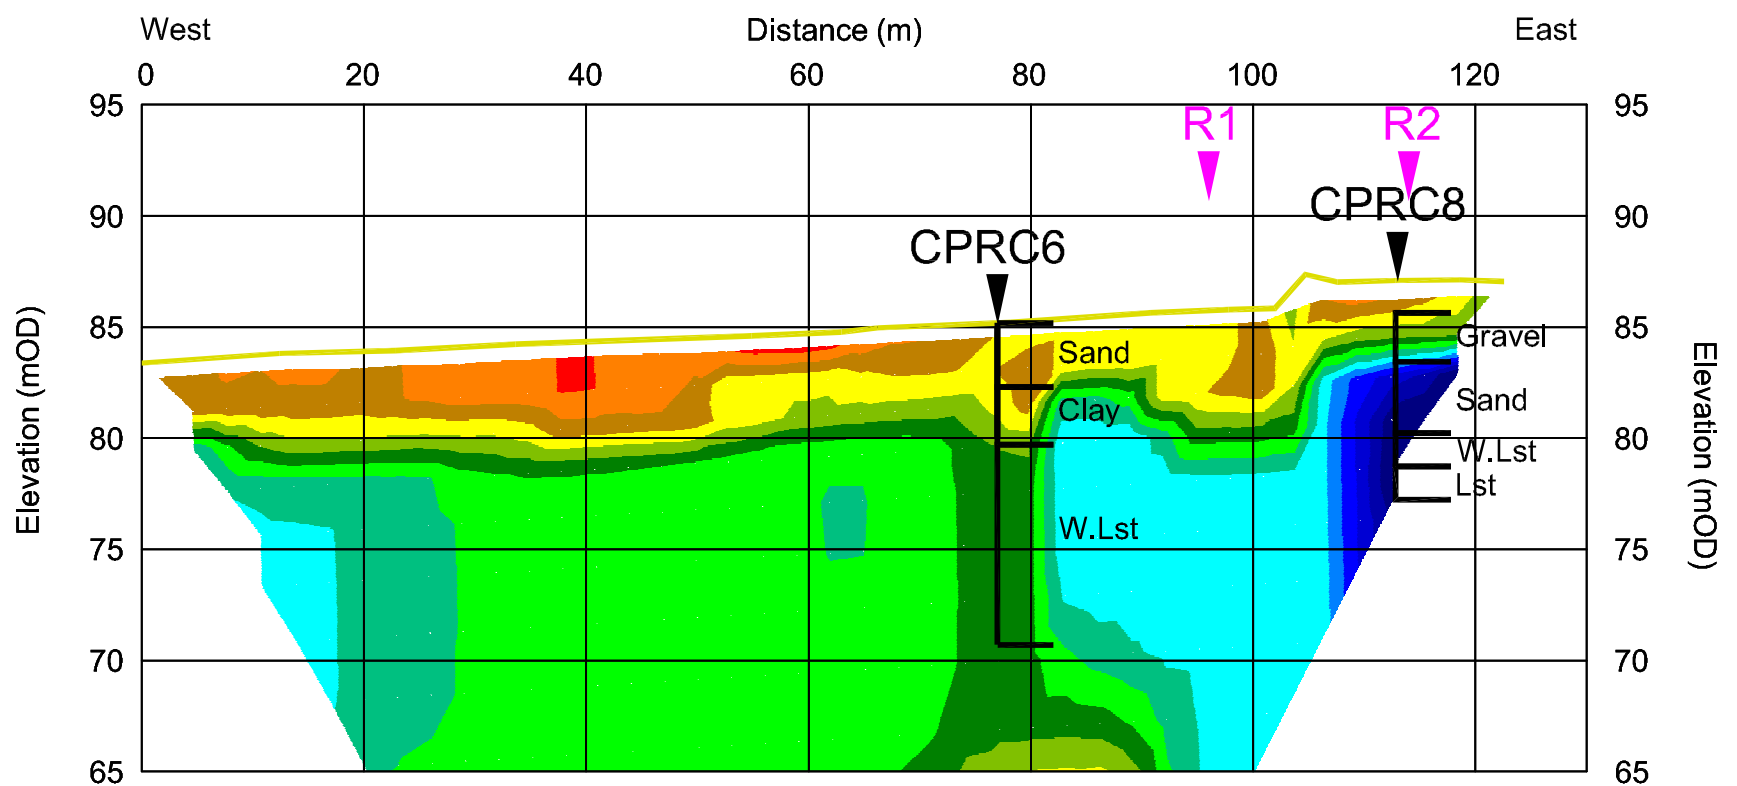

2D-Resistivity Profile R5 Model

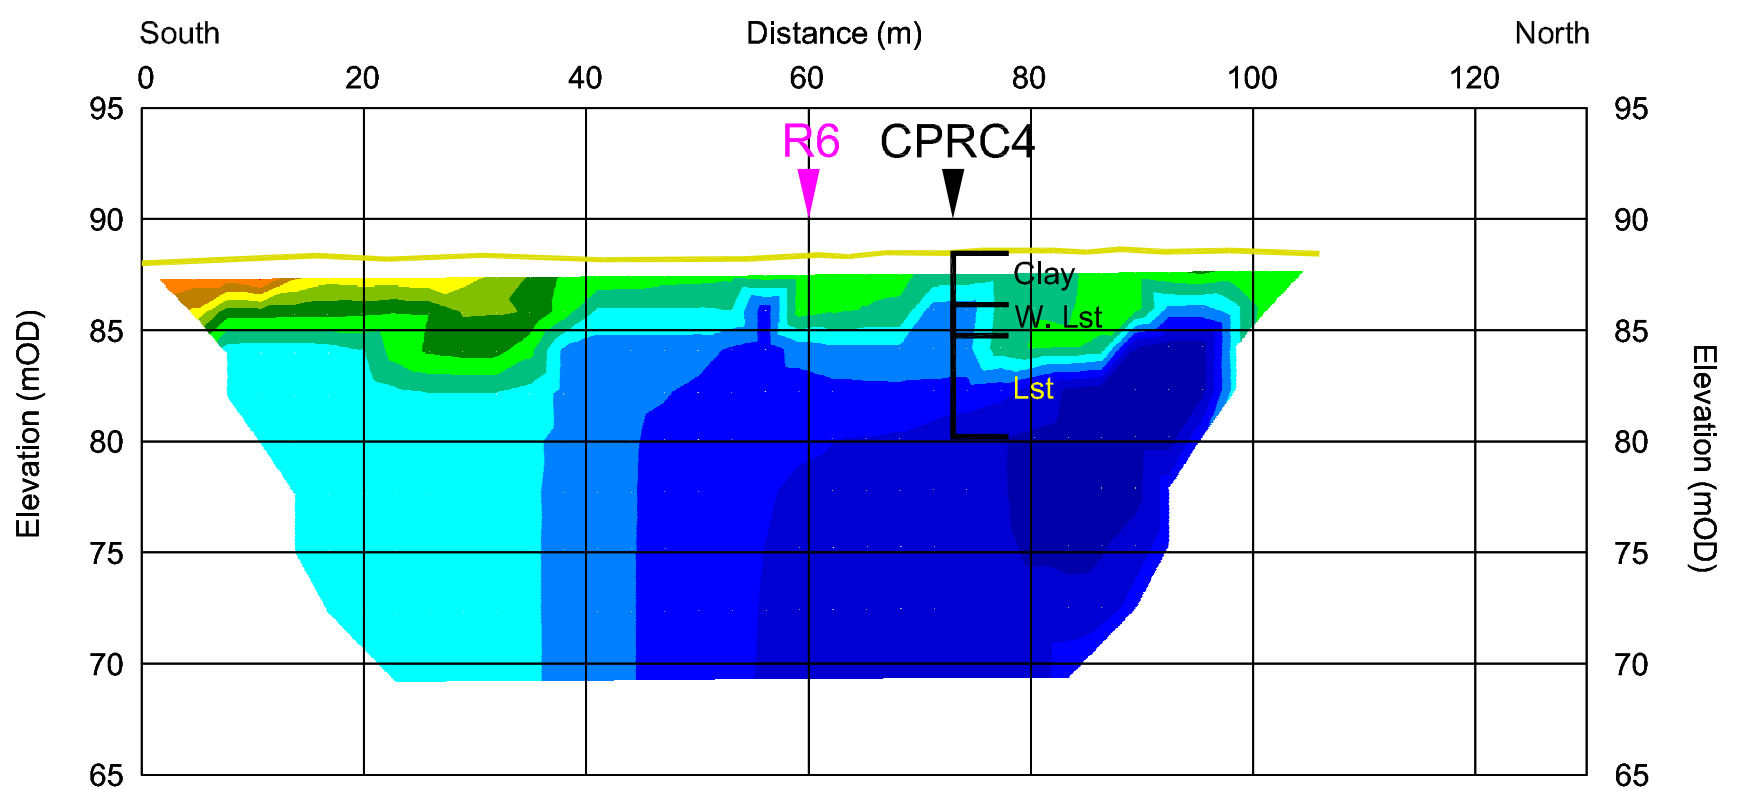

2D-Resistivity Profile R6 Model

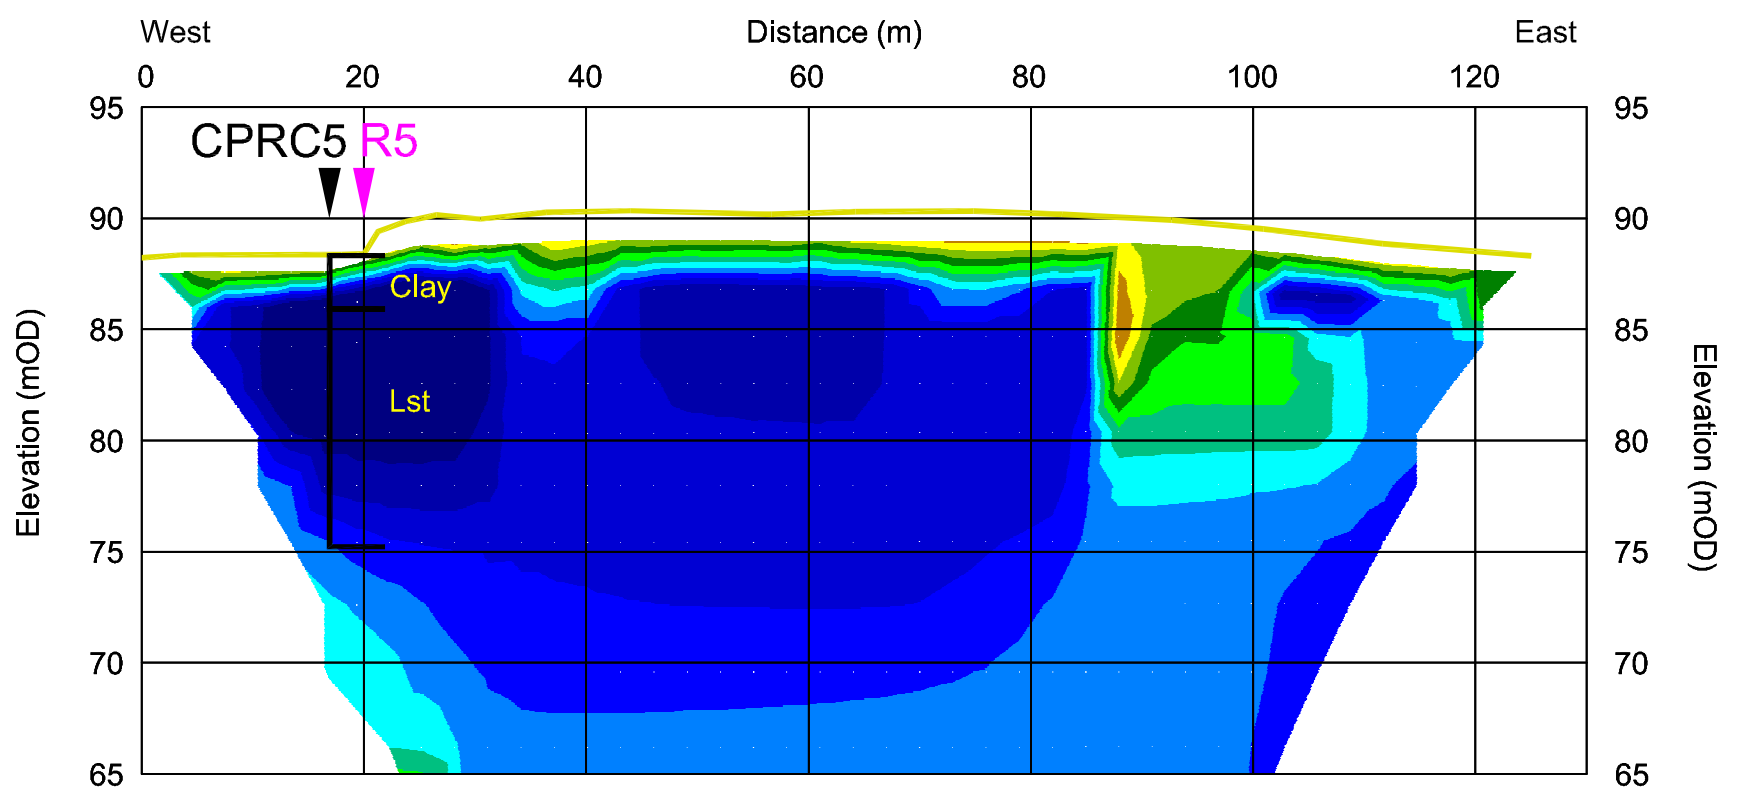


Minerex
Geophysics Limited
Unit F4, Maynooth Business Campus
Maynooth, Co. Kildare
Tel. (01) 6510030
Email: info@mgx.ie
Web: www.mgx.ie

CLIENT: OCB Geotechnical
PROJECT: Buttevant Railway Crossing XC219 Geophysical Survey
TITLE: Figure 1b: Models of Geophysical Survey


SCALE: NTS @ A3, VE x 2
PROJECT: 6508
DRAWN: HK
DATE: 9/11/2020
MGX FILE: 6508f_MapsFigs.dwg
STATUS: Final

LEGEND: Resistivities (Ohmm) for 2D-Resistivity Model
31.3 62.5 125 250 500 1000 2000 4000
R5 Profile Crossing
CPRC5 Borehole
Abbreviated GI Logs:
Cl Clay
W. Ls Weathered Ls
Ls Limestone


2D-Resistivity Profile R1 Interpretation

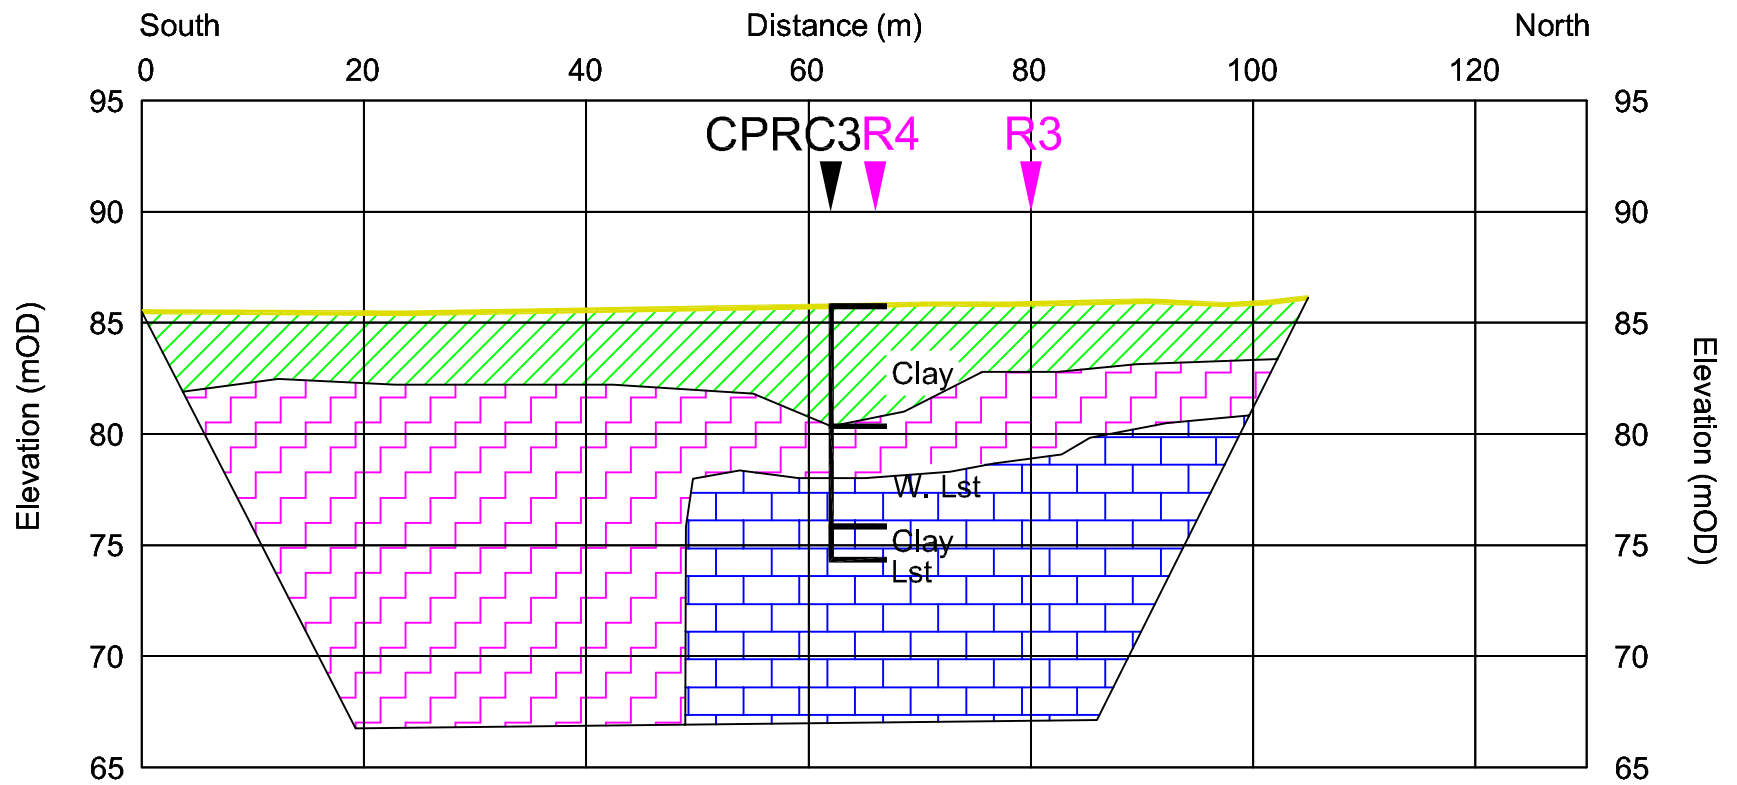


2D-Resistivity Profile R2 Interpretation

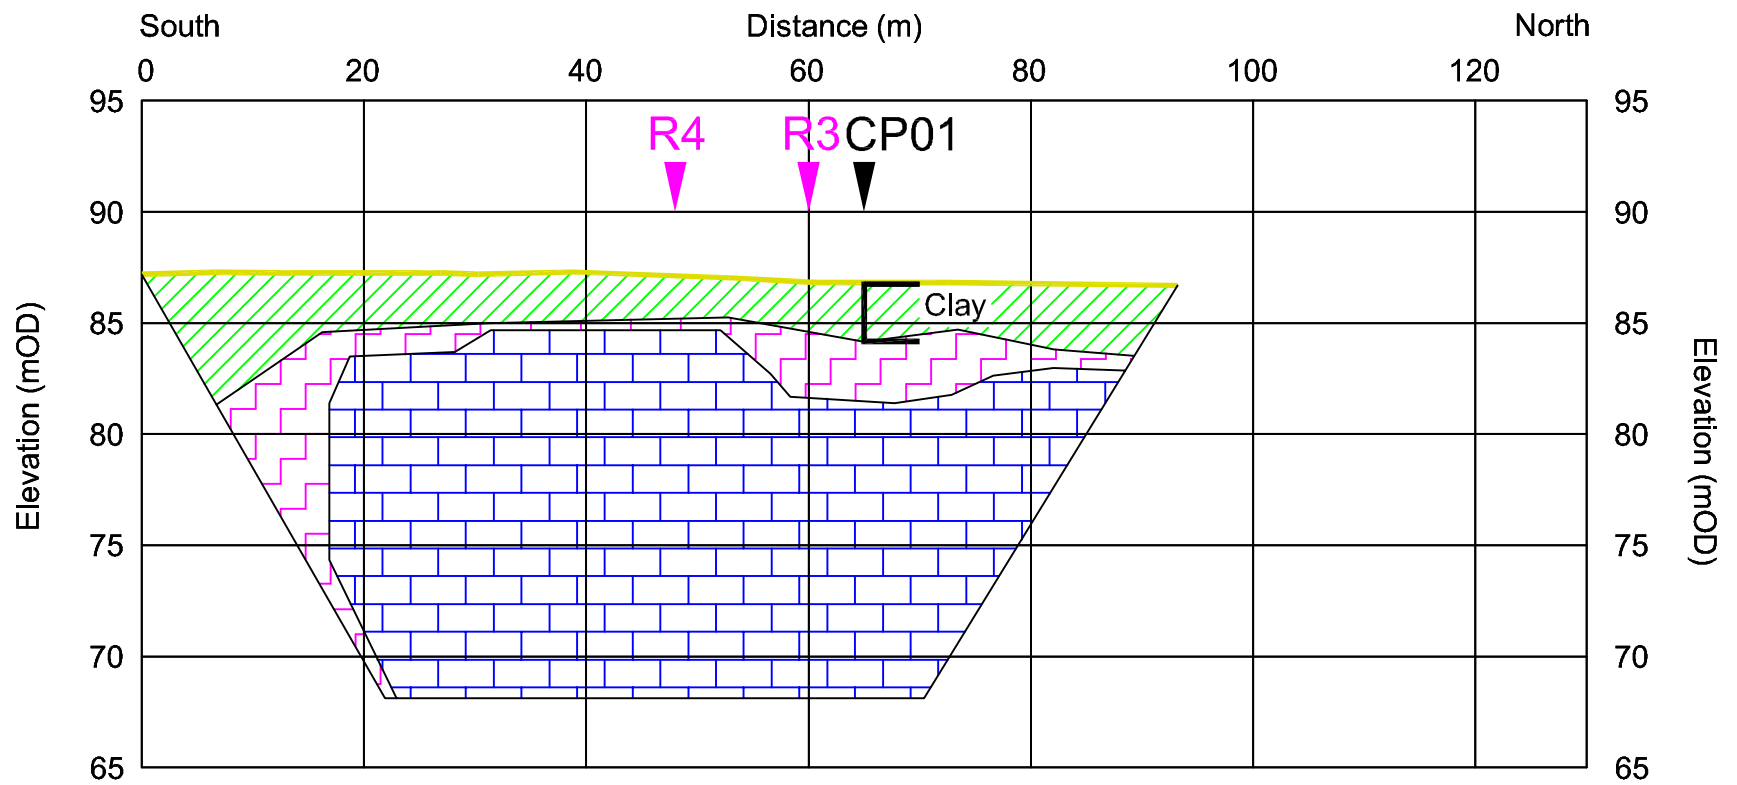


2D-Resistivity Profile R3 Interpretation

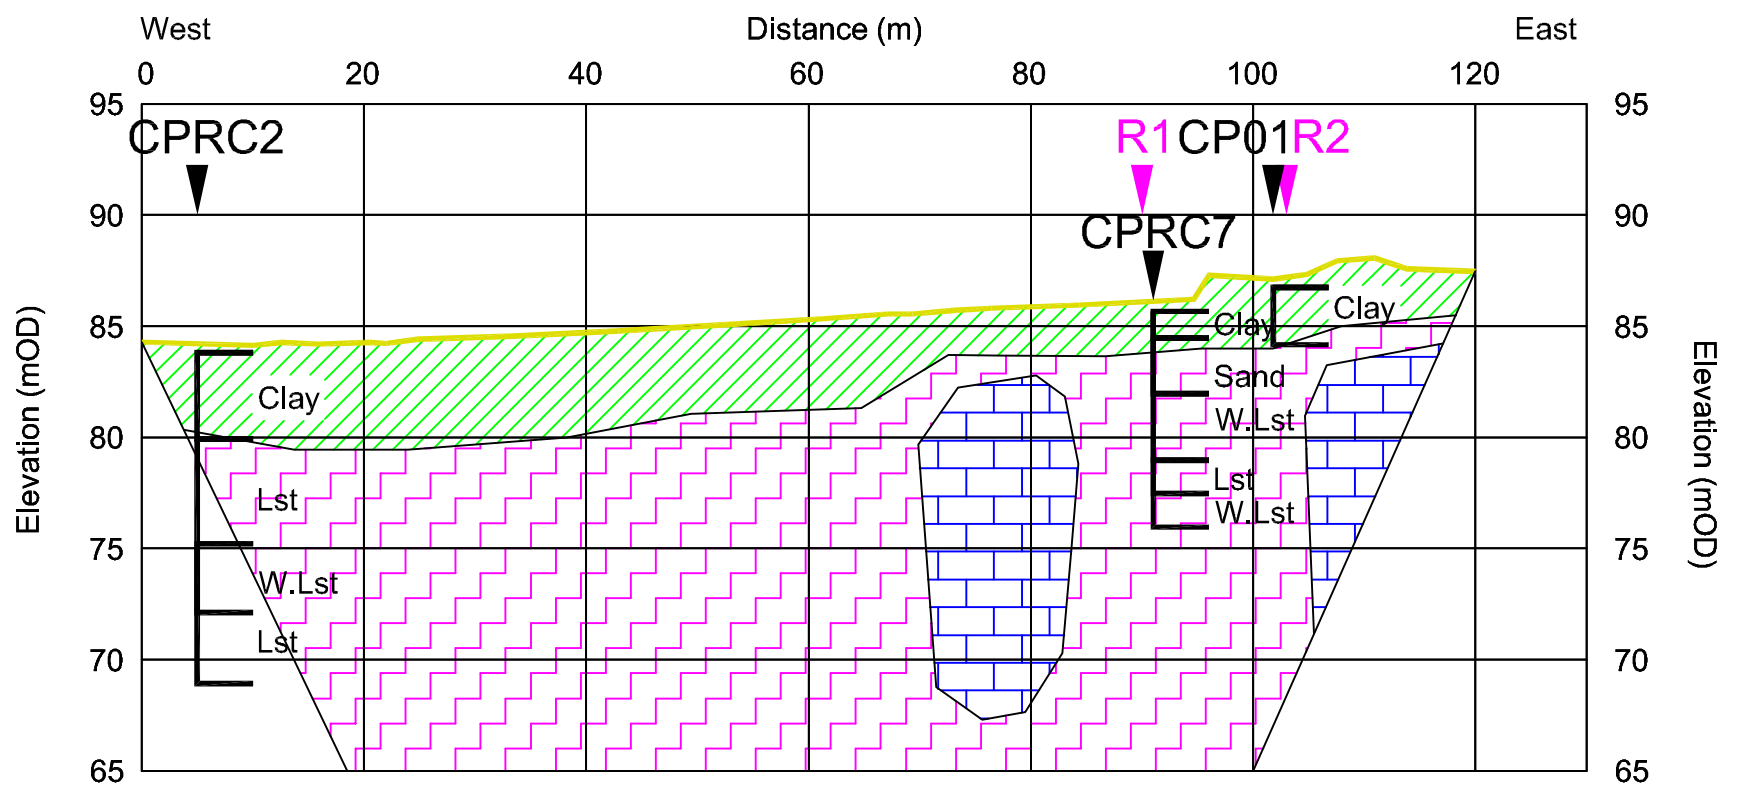


2D-Resistivity Profile R4 Interpretation

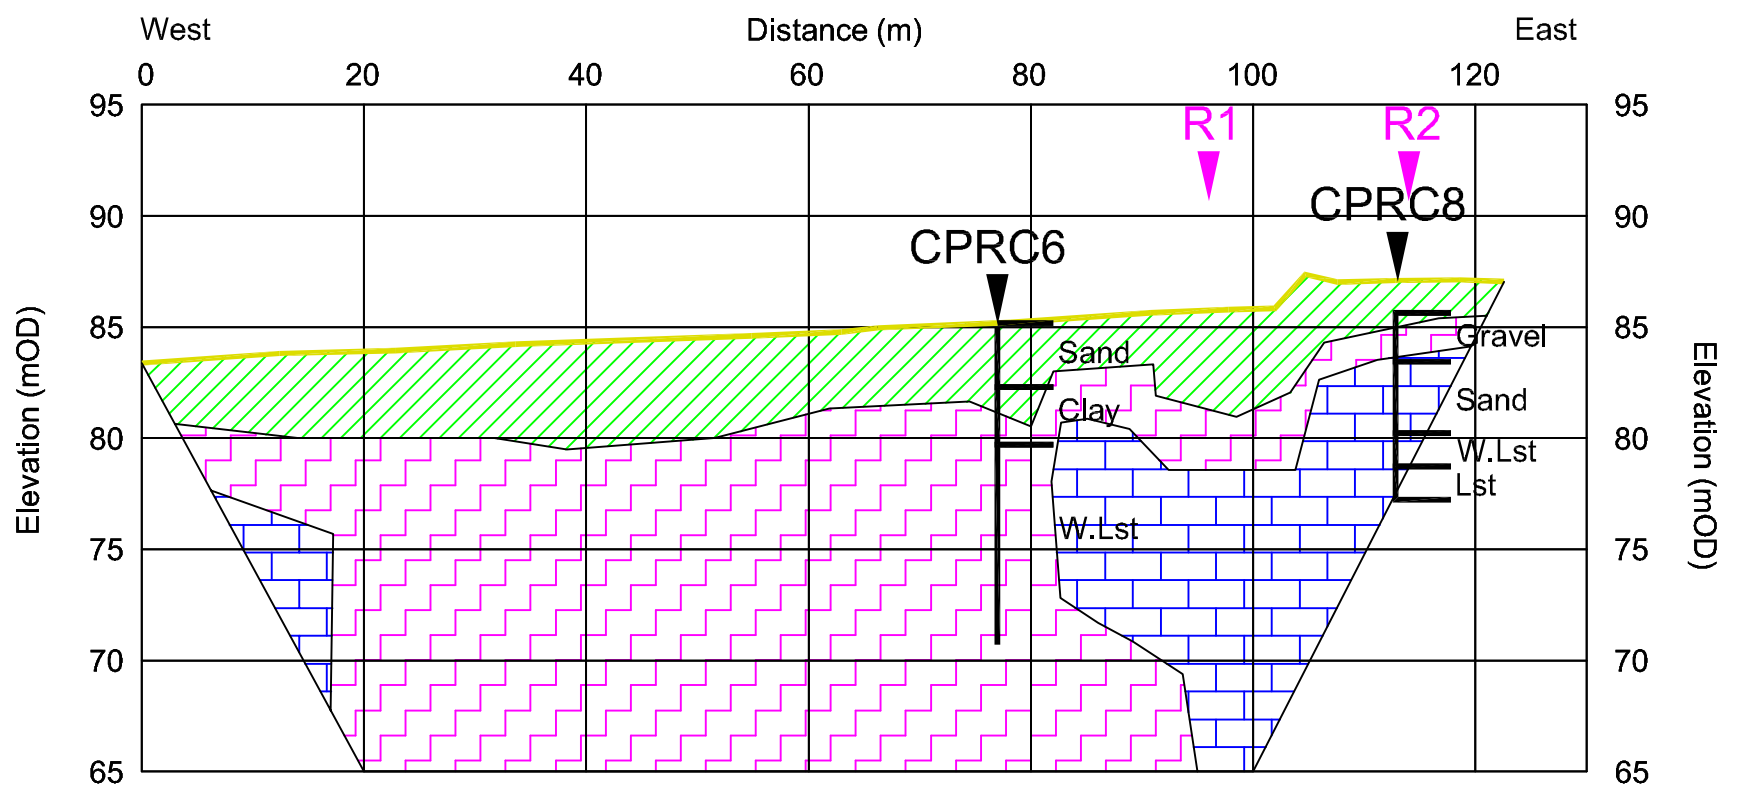

2D-Resistivity Profile R5 Interpretation

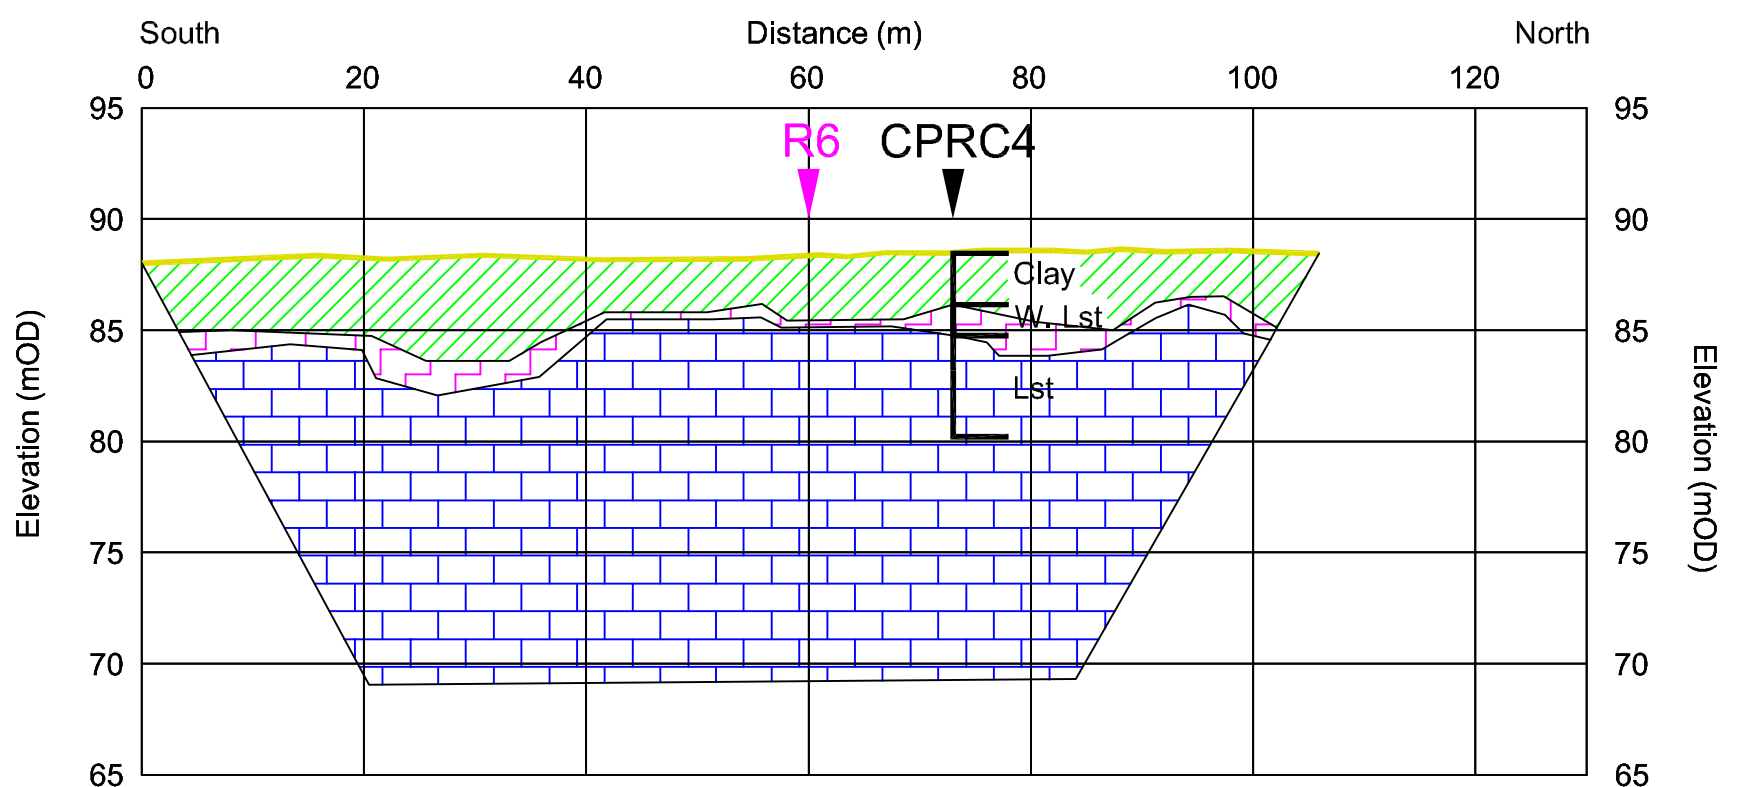

2D-Resistivity Profile R6 Interpretation

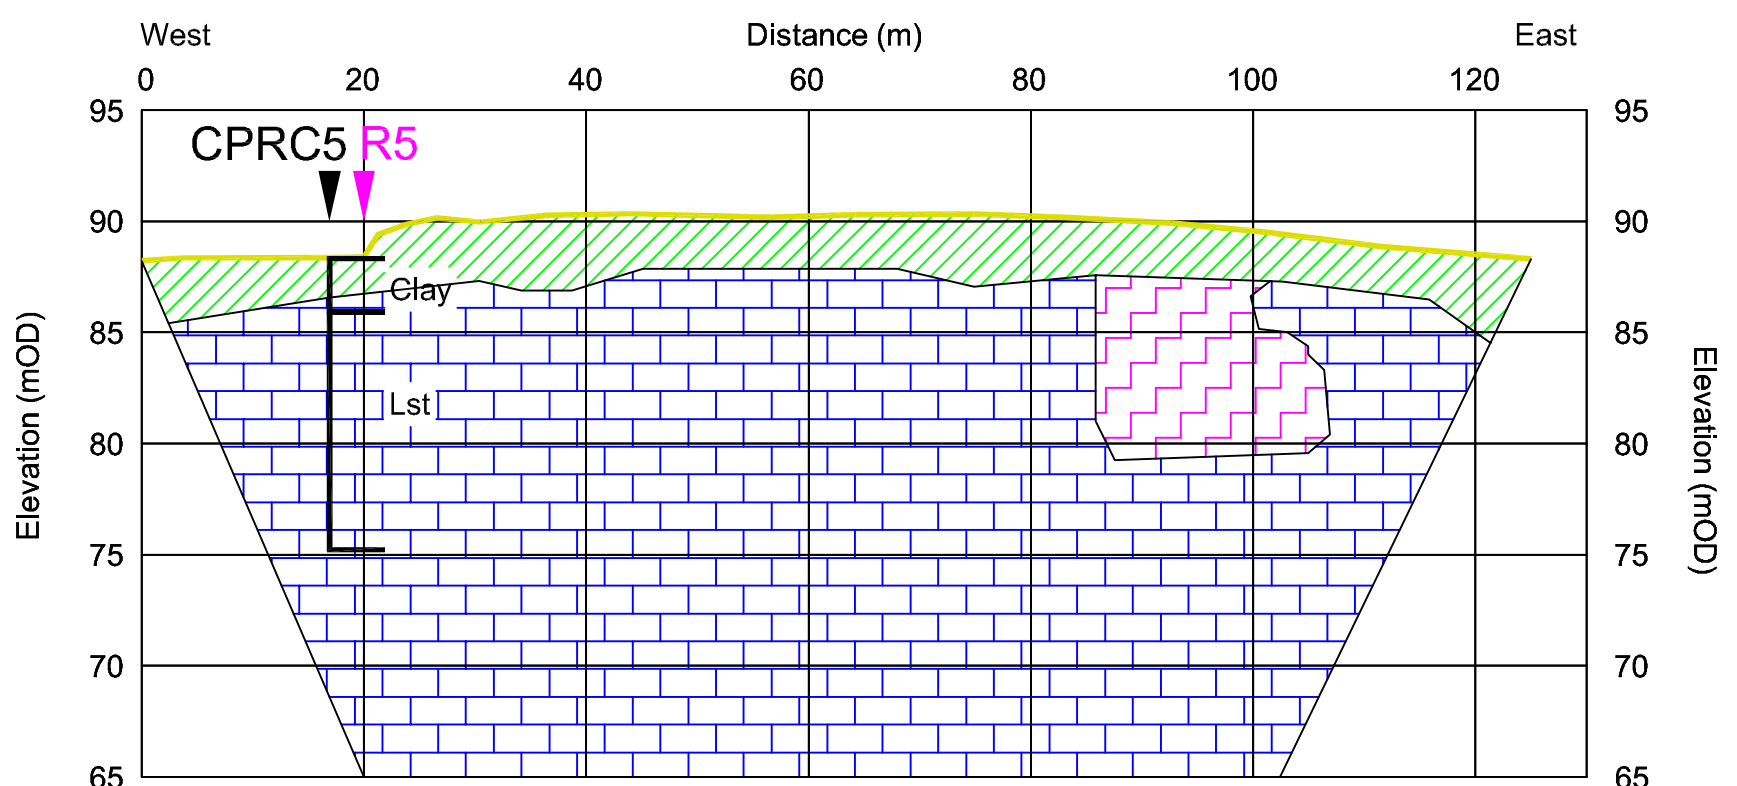


Appendix L

Pre & Post Site Condition Photographs



Iarnród Éireann
 Cork Line Level Crossings
 XC219 (19-135-5)

	XC219
	Pre Works Site Photographs
Client:	Iarnród Éireann
Engineer:	Jacob's
Date:	2020

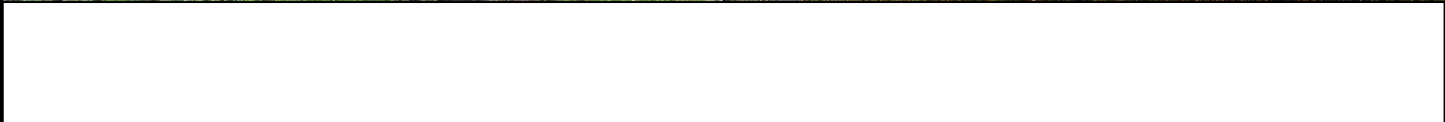

Iarnród Éireann
Cork Line Level Crossings
XC219 (19-135-5)

	XC219
	Pre Works Site Photographs
Client:	Iarnród Éireann
Engineer:	Jacob's
Date:	2020




Iarnród Éireann
Cork Line Level Crossings
XC219 (19-135-5)

	XC219
	Pre Works Site Photographs
Client:	Iarnród Éireann
Engineer:	Jacob's
Date:	2020



Iarnród Éireann
Cork Line Level Crossings
XC219 (19-135-5)

	XC219
	Pre Works Site Photographs
Client:	Iarnród Éireann
Engineer:	Jacob's
Date:	2020

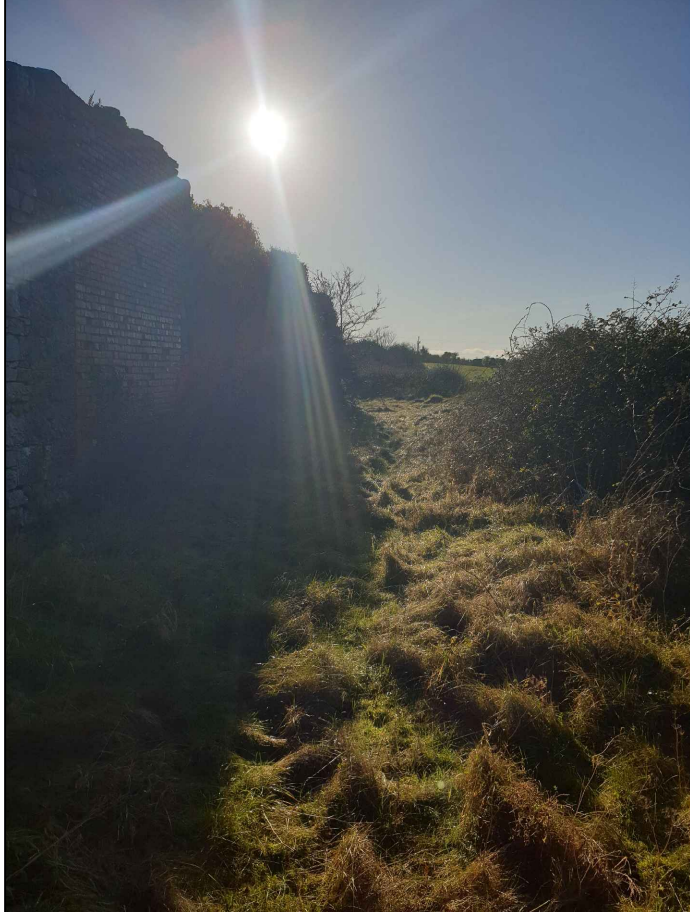


Iarnród Éireann
 Cork Line Level Crossings
 XC219 (19-135-5)

	XC219
	Pre Works Site Photographs
Client:	Iarnród Éireann
Engineer:	Jacob's
Date:	2020



Iarnród Éireann
Cork Line Level Crossings
XC219 (19-135-5)

	XC219
	Post Works Site Photographs
Client:	Iarnród Éireann
Engineer:	Jacob's
Date:	2020

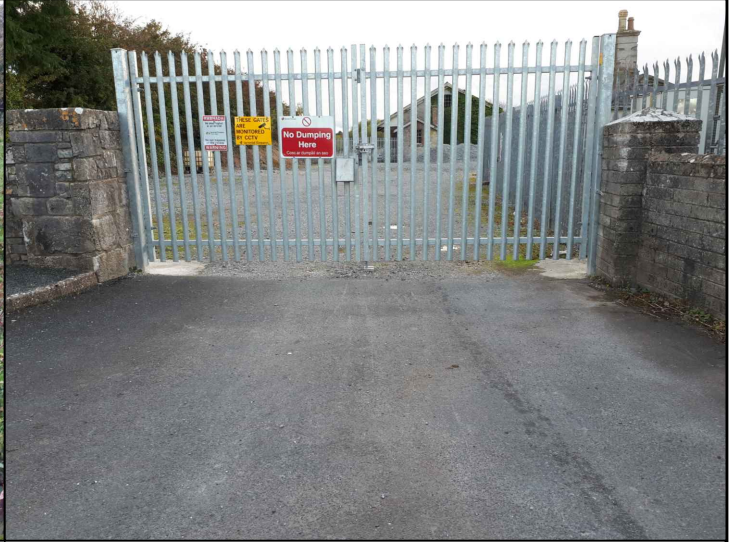

Iarnród Éireann
 Cork Line Level Crossings
 XC219 (19-135-5)

	XC219
	Post Works Site Photographs
Client:	Iarnród Éireann
Engineer:	Jacob's
Date:	2020



Iarnród Éireann
Cork Line Level Crossings
XC219 (19-135-5)

	XC219
	Post Works Site Photographs
Client:	Iarnród Éireann
Engineer:	Jacob's
Date:	2020



Iarnród Éireann
Cork Line Level Crossings
XC219 (19-135-5)

	XC219
	Post Works Site Photographs
Client:	Iarnród Éireann
Engineer:	Jacob's
Date:	2020