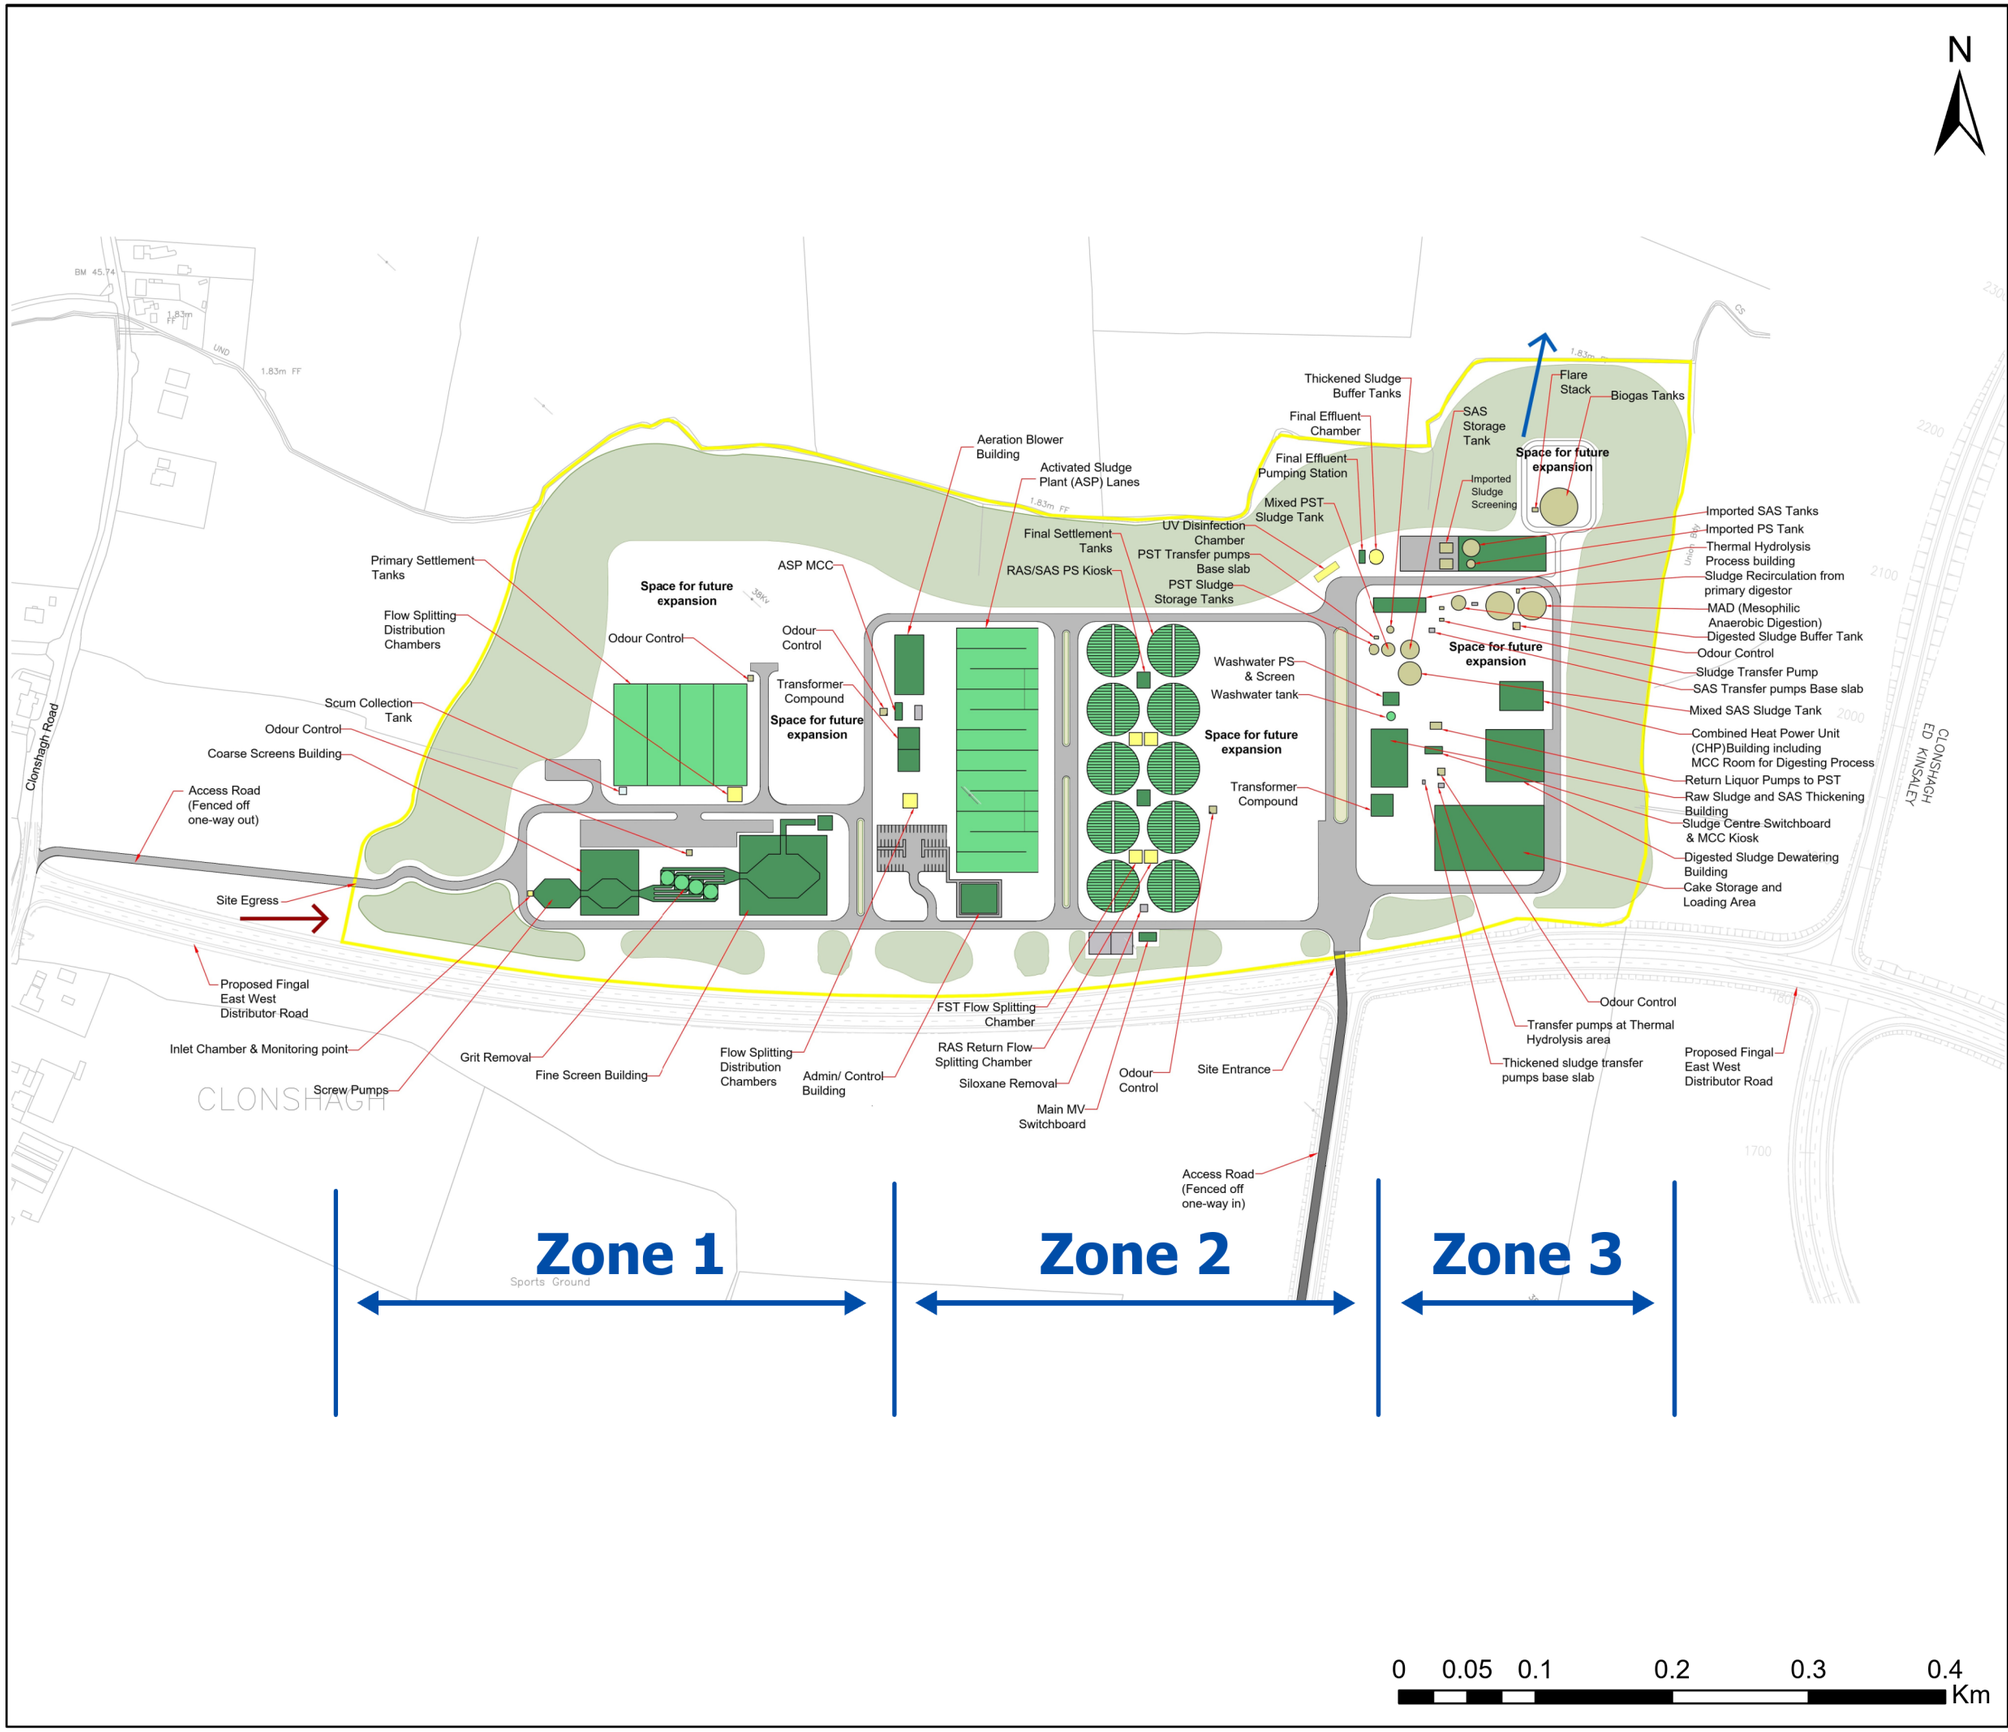

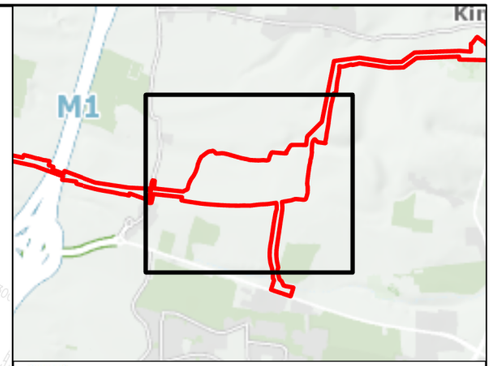

Legend:

- Proposed Landtake
- Proposed Incoming Raw Sewage Main
- Proposed Outgoing Final Effluent Main
- Proposed Chamber
- Proposed Tank
- Proposed Building
- Proposed Sludge Plant
- Proposed Handstanding and Plant
- Proposed Access (within site perimeter)

Notes:
1. This drawing is not to be scaled. Figured dimensions only to be taken.
2. The Prcoess type and arrangement shown requires confirmation by outline design.
3. 38kV Power line passes through the proposed land boundary. It is assumed that the power line to be re-routed around site boundary.
4. All earthworks shall be at a maximum slope of 1V : 2H. 5. All tanks shall be covered with GRP clam shell covers. 6. All drawings to be checked by the Contractor on Site.
7. Engineer to be informed by the Contractor of any discrepancies before any work commences.
8. All levels shown relate to Ordnance Survey datum at Malin Head, the geographic coordinate system is to Irish Transverse Mercator (ITM).

© OpenStreetMap (and) contributors, CC-BY-SA
Service Layer- basemap_premium: © Ordnance Survey Ireland
World Ocean Base: GSI, Esri, Garmin, NaturalVue

Greater Dublin Drainage

Rev.	Date	Purpose of revision	Drawn	Check'd	Rev'd	Appr'd
0	13/10/2023	Final	LB	SMG	SMG	JB

Jacobs

Client: Uisce Éireann Irish Water

Project: Greater Dublin Drainage Project

Drawing Title: Figure 4.1 - Zonal Arrangement at the Proposed Wastewater Treatment Plant

Drawing Status: **Final**

Scale @A3: DO NOT SCALE

Jacobs No. 321120AP

Filepath: \\gbloh0vs01\GIS\Proj\B321060CC_GDD\ArcGIS\003_Cumulative_Impact_Assessment\Cumulative_Impact_Assessment.aprx

Drawing No. 321120AP-EIARAddendum-0401

This drawing is not to be used in whole in or part other than for the intended purpose and project as defined on this drawing. Refer to the contract for full terms and conditions.