




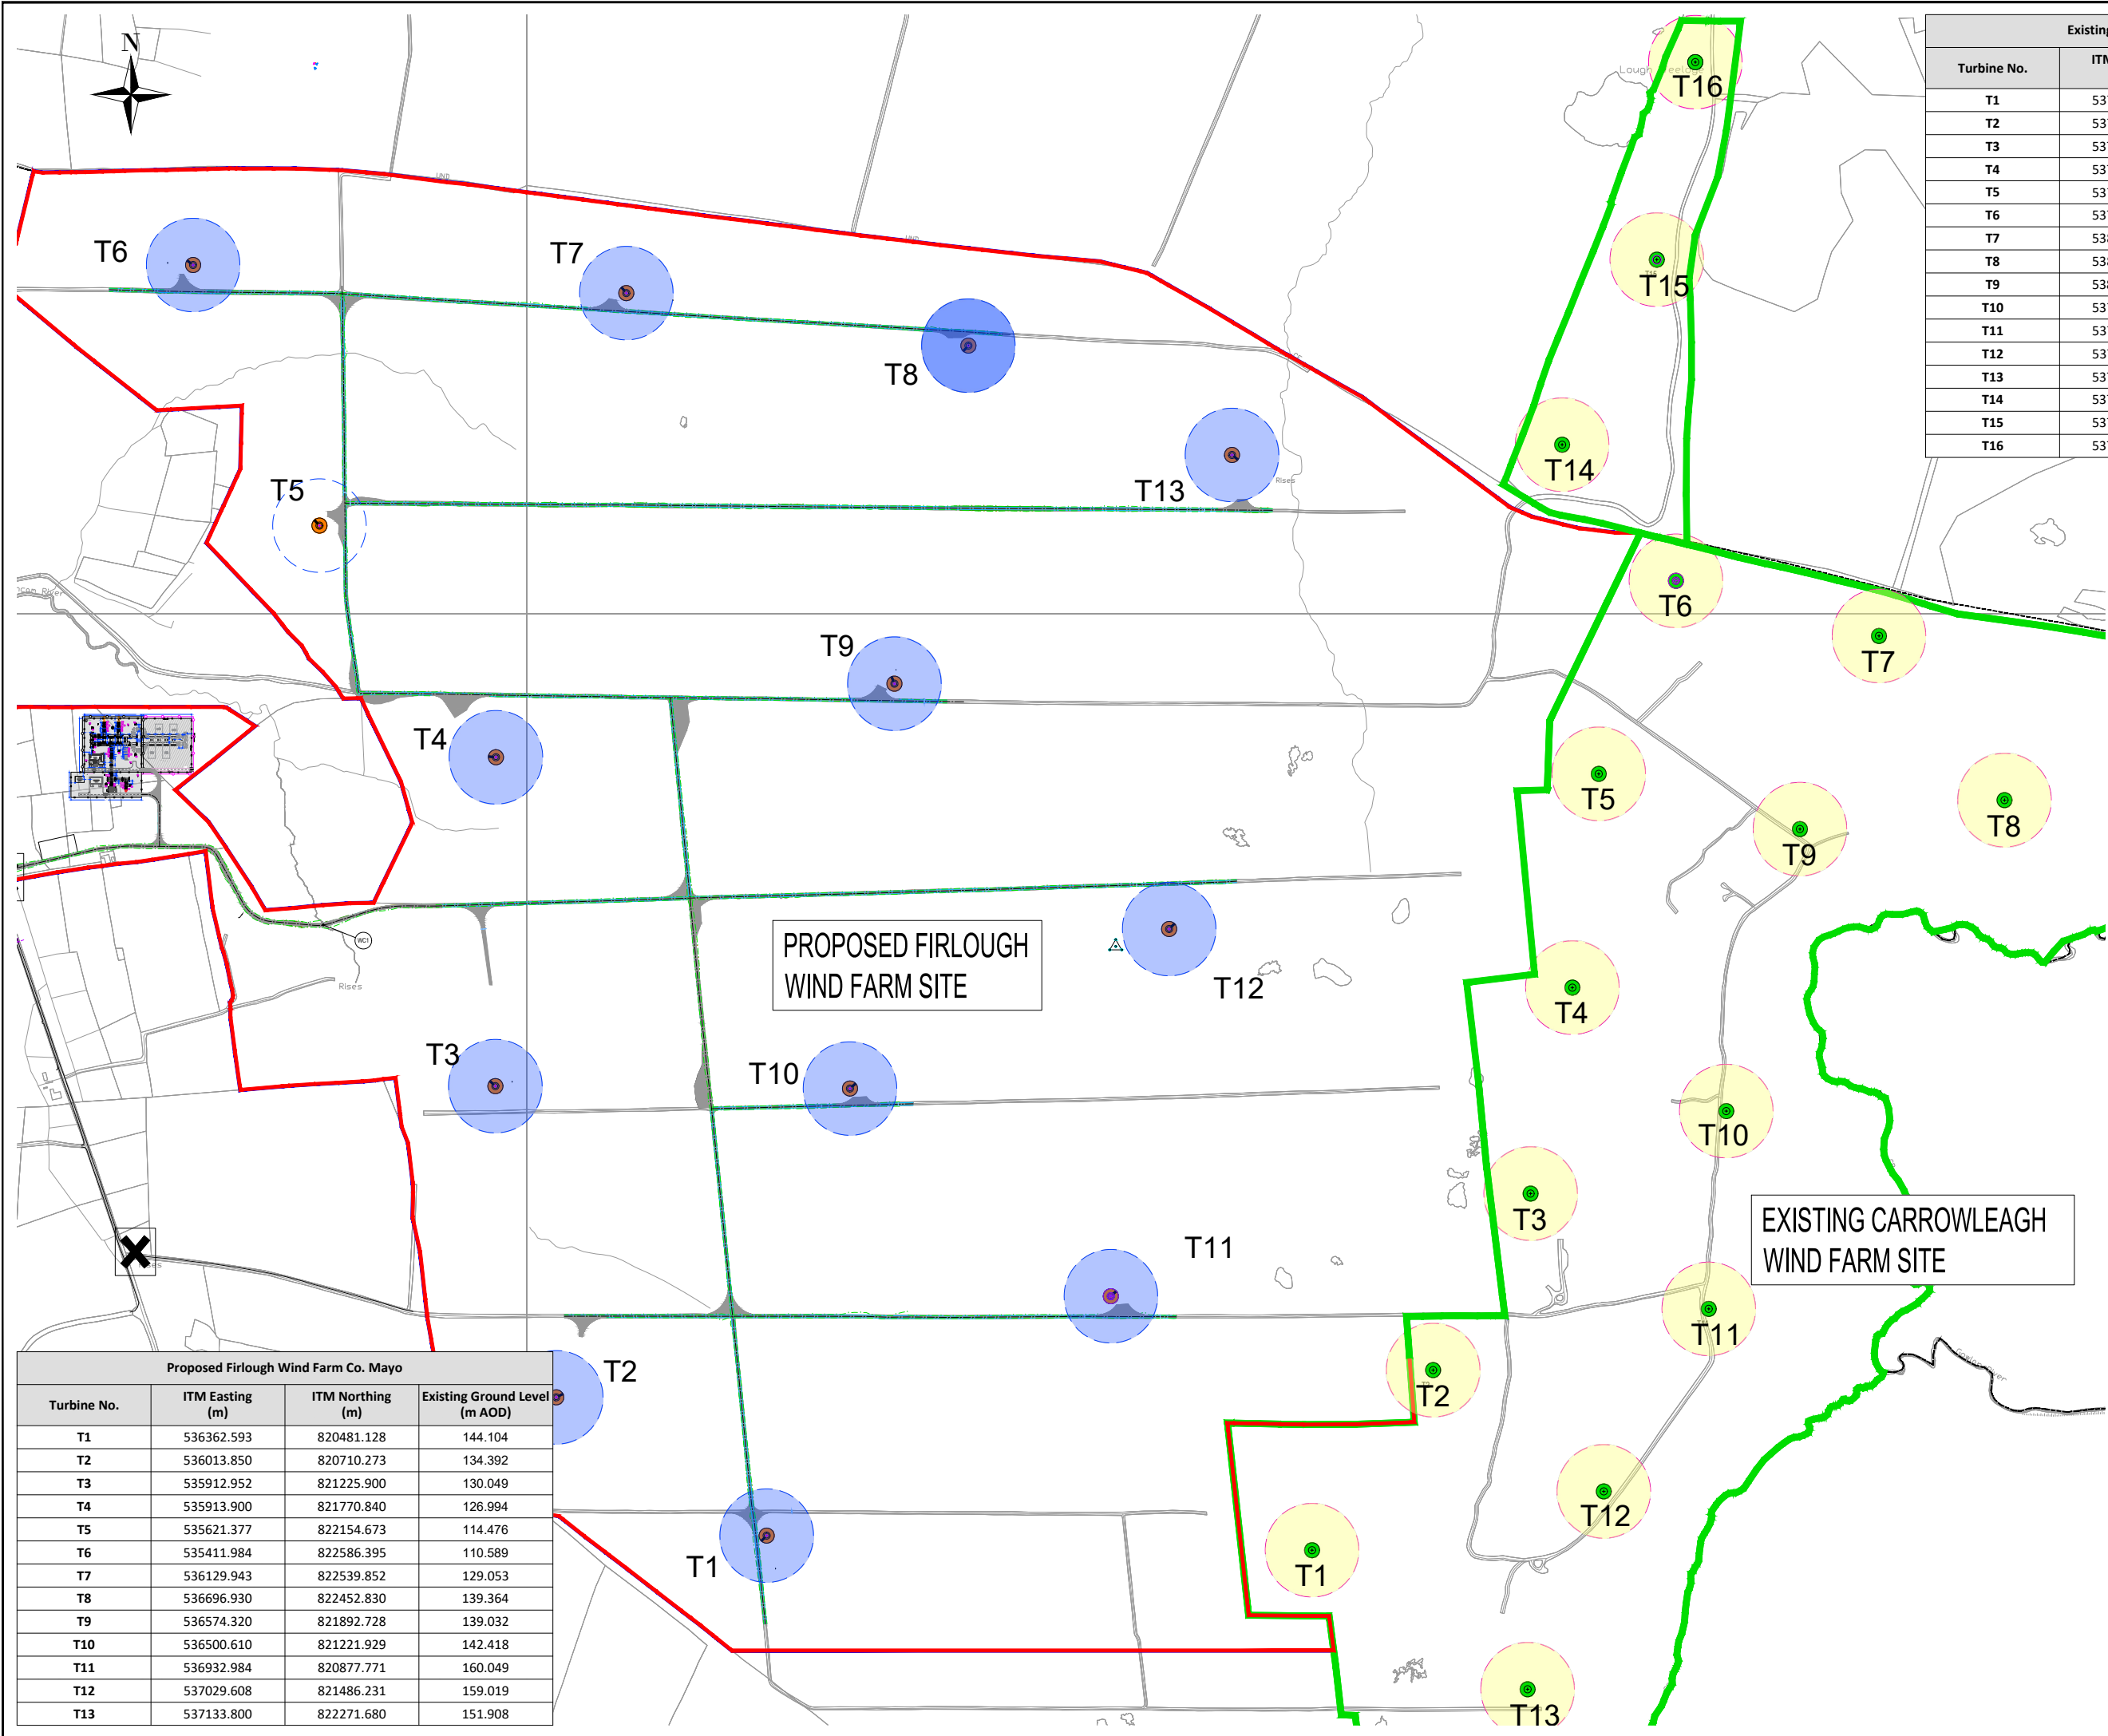

Existing Carrowleagh Wind Farm Co. Mayo			
Turbine No.	ITM Easting (m)	ITM Northing (m)	Existing Ground Level (m AOD)
T1	537266.382	820456.949	172.200
T2	537467.125	820755.373	173.000
T3	537628.698	821047.904	169.300
T4	537697.858	821389.113	167.700
T5	537741.589	821743.250	160.600
T6	537869.526	822063.250	149.700
T7	538206.067	821971.863	150.700
T8	538414.167	821699.741	154.700
T9	538075.080	821651.802	156.700
T10	537952.899	821184.522	164.200
T11	537923.893	820856.862	174.500
T12	537750.005	820554.389	178.100
T13	537623.664	820226.567	182.300
T14	537680.946	822288.666	157.400
T15	537837.768	822595.240	151.300
T16	537901.650	822922.590	149.400



Proposed Firlough Wind Farm



Existing Carrowleagh Wind Farm

OS Sheets:
1250, 1251, 1319, 1320



Tailte Éireann - Surveying
Includes National Mapping Reproduced
Under Copyright to Tailte Éireann.
Licence Number CYAL 50382164

rev.	modifications	by	date

Client
Mercury Renewables (Carrowleagh) Limited

Project
Proposed Firlough Wind Farm,
Carrowleagh, Bunnyconnellan, Co. Mayo &
Proposed Hydrogen Plant, Carraun,
Castleconnor, Co. Sligo

Stage
Planning ABP Oral Hearing

Title
Proposed Firlough Wind Farm
Site Layout & Existing
Carrowleagh Wind Farm Site
Location Plan, Sheet 2 of 2

Scales
1:5,000 @ A3

Surveyed	Prepared By A.M.C.	Checked S.J.	Date 08-03-2024
----------	-----------------------	-----------------	--------------------

© COPYRIGHT OF
JENNINGS O'DONOVAN & PARTNERS
CONSULTING ENGINEERS,
FINISKLIN,
SLIGO,
IRELAND.
TEL: (0035371) 9161416.
FAX: (0035371) 9161080.
Email: info@jodireland.com
Web: www.jodireland.com



Job No. 6129	Drawing no. 6129-ABP OH-002	Revision
-----------------	--------------------------------	----------