

**LEGEND**

- RAILWAY STATIONS
- OVERBRIDGE
- UNDERBRIDGE
- RAILWAY LINE

**BUFFERS**

- 60M
- 100M
- 200M
- 300M

**ADMINISTRATIVE BOUNDARY**

- COUNTY BOUNDARY

**LICENCED FACILITIES**

- EPA LICENCED INDUSTRIAL EMISSIONS DIRECTIVE FACILITIES
- EPA LICENCED WASTE FACILITIES

**ESB**

**HIGH VOLTAGE NETWORK**

- ESB HV OH
- ESB HV UG

**MEDIUM VOLTAGE NETWORK**

- ESB MV OH
- ESB MV UG

**GAS NETWORKS IRELAND**

- HIGH PRESSURE NETWORK
- MEDIUM PRESSURE NETWORK
- LOW PRESSURE NETWORK

**ESB Data Disclaimer**  
 This map indicates the approximate location of ESB Networks Transmission (400kV, 220kV, 110kV, 38kV) and Distribution (20kV, 10kV, 230V/400V) underground cables and overhead lines in the general area of the proposed works. ESB Networks takes no responsibility for the accuracy or completeness of these maps. Low voltage (230V/400V) service cables (e.g. house services, factory/shop services, public lighting lamp services, etc.) are not included but their presence should be anticipated. The depths of underground cables must never be assumed. Additional more detailed information is available for high voltage Transmission underground cables (38kV, 110kV, 220kV, 400kV) for cables in the greater Dublin area call 01 6942957 and for all other areas call 1850 372 737. No work should be carried out in the vicinity of 38kV or higher voltage underground cables without prior consultation with ESB Networks. Before any mechanical excavation is undertaken, the actual location of all underground electricity cables must be established and verified on site, using: (a) Up-to-date map records; (b) Cable locator equipment operated in both power and radio modes; (c) Careful hand digging of trial holes using 'Safe Digging Practice'. ESB takes no responsibility and shall bear no liability in relation to any damage, injury/death or loss of supply as a result of damage or interference with its networks.

**GNI Data Disclaimer**  
 The information contained in this map concerning the location and technical designation of the gas distribution and transmission network (the 'Information') is provided 'as is' and no representation or warranty of any kind, express or implied, is made in relation to the Information and all such representations or warranties, express or implied, in relation to the Information are hereby excluded to the fullest extent permitted by law. No responsibility, liability or duty of care to you or to any other person in respect of the Information is intended, and any reliance you or any other person places on the Information is therefore strictly at your own or at their own risk. In no event will liability be accepted for any loss or damage including, without limitation, indirect or consequential loss or damage, arising out of or in connection with the use of the Information. In the event that the Information is provided by you, in whole or in part, to a third party for whatever reason you shall ensure that the disclaimer is included with the Information and brought to the attention of the third party. The actual position of the gas distribution and transmission network must be verified on site before any mechanical excavating takes place. If any mechanical excavation is proposed, hard copy maps must be requested from Bord Gáis Éireann. All work in the vicinity of the gas distribution and transmission network must be completed in accordance with the current edition of the Health & Safety Authority publication, 'Code of Practice for Avoiding Danger From Underground Services' which is available from the Health and Safety Authority (1800 28 28 80) or can be downloaded free of charge at www.hsa.ie.

Map data © OpenStreetMap contributors, Microsoft, Esri, Community Maps contributors, Map layer by Esri

Copyright © Irish Rail (2021). This drawing is confidential and the copyright in it is owned by Irish Rail. This drawing must not be either loaned, copied or otherwise reproduced in whole or in part or used for any purpose without the prior permission of Irish Rail.

© OpenStreetMap contributors

© Ordnance Survey Ireland and Government of Ireland. All O.S. data used for plans are printed under "Copyright Ordnance Survey Ireland" Survey No. 0039720 (OSI Aerial Data or OSI Lidar Data) & Survey No. 202105; MMA, 180 (OSI Vector Data). All elevations are in metres and relate to OSI Geoid Model (OSGM02) Mean Head as defined by existing Project Control. All Co-ordinates are in Irish Transverse Mercator Grid (ITM) as defined by OSI active GPS station Tallaght College (TLG).

**Notes**

- Information concerning the position of apparatus shown on this drawing is based on drawings supplied by the utility owners and/or the utility works contractor, whilst every care has been taken in the preparation of this drawing, positions should be taken as approximate and are intended for general guidance only and no representation is made by Irish Rail as to the accuracy, completeness, sufficiency or otherwise of this drawing and the position of the apparatus. The information contained herein does not purport to be comprehensive or final as the apparatus is subject to being altered and/or superseded. Recipients should not rely on this information. Any liabilities are hereby expressly disclaimed.
- The information contained herein has been provided by Irish Rail but does not purport to be comprehensive or final. Recipients should not rely on the information. Neither Irish Rail nor any of its directors, officers, employees, agents, stakeholders or advisers make any representation or warranty as to or accept any liability or responsibility, in relation to the adequacy, accuracy, reasonableness or completeness of the information provided as part of this document or any matter on which the information is based (including but not limited to loss or damage arising as a result of reliance by recipients on the information or any part of it). Any liabilities are hereby expressly dismissed.

Rev	Date	Dn	Chkd	App'd	Description
P01	30/09/2021	DM	SH	COD	
P02	11/10/2021	DM	SH	COD	
P03	10/12/2021	DM	SH	COD	

Client: **Irish Rail**

Engineering Designer: **ARUP**

Date: 20/09/2021 Scale: 1:5000 @ A1 / 1:10000 @ A3

Project Code: D-WP56 Originator Code: ARP OMS Code: 279933-00



Drawn: DM Checked: SH Approved: COD

Project Title: **DART+ COASTAL NORTH**

Drawing Title: **THIRD PARTY UTILITIES AND LICENCED FACILITIES CONSTRAINTS OPEN STREET MAP BASEMAP**

Drawing File Name: D-WP56-ARP-ZL-NL-OR-EV-01001

Sheet Number	1 of 19	Status	902	Rev	P03
--------------	---------	--------	-----	-----	-----

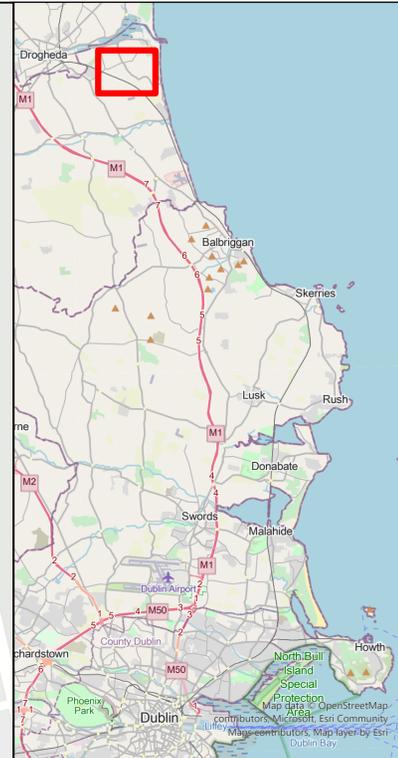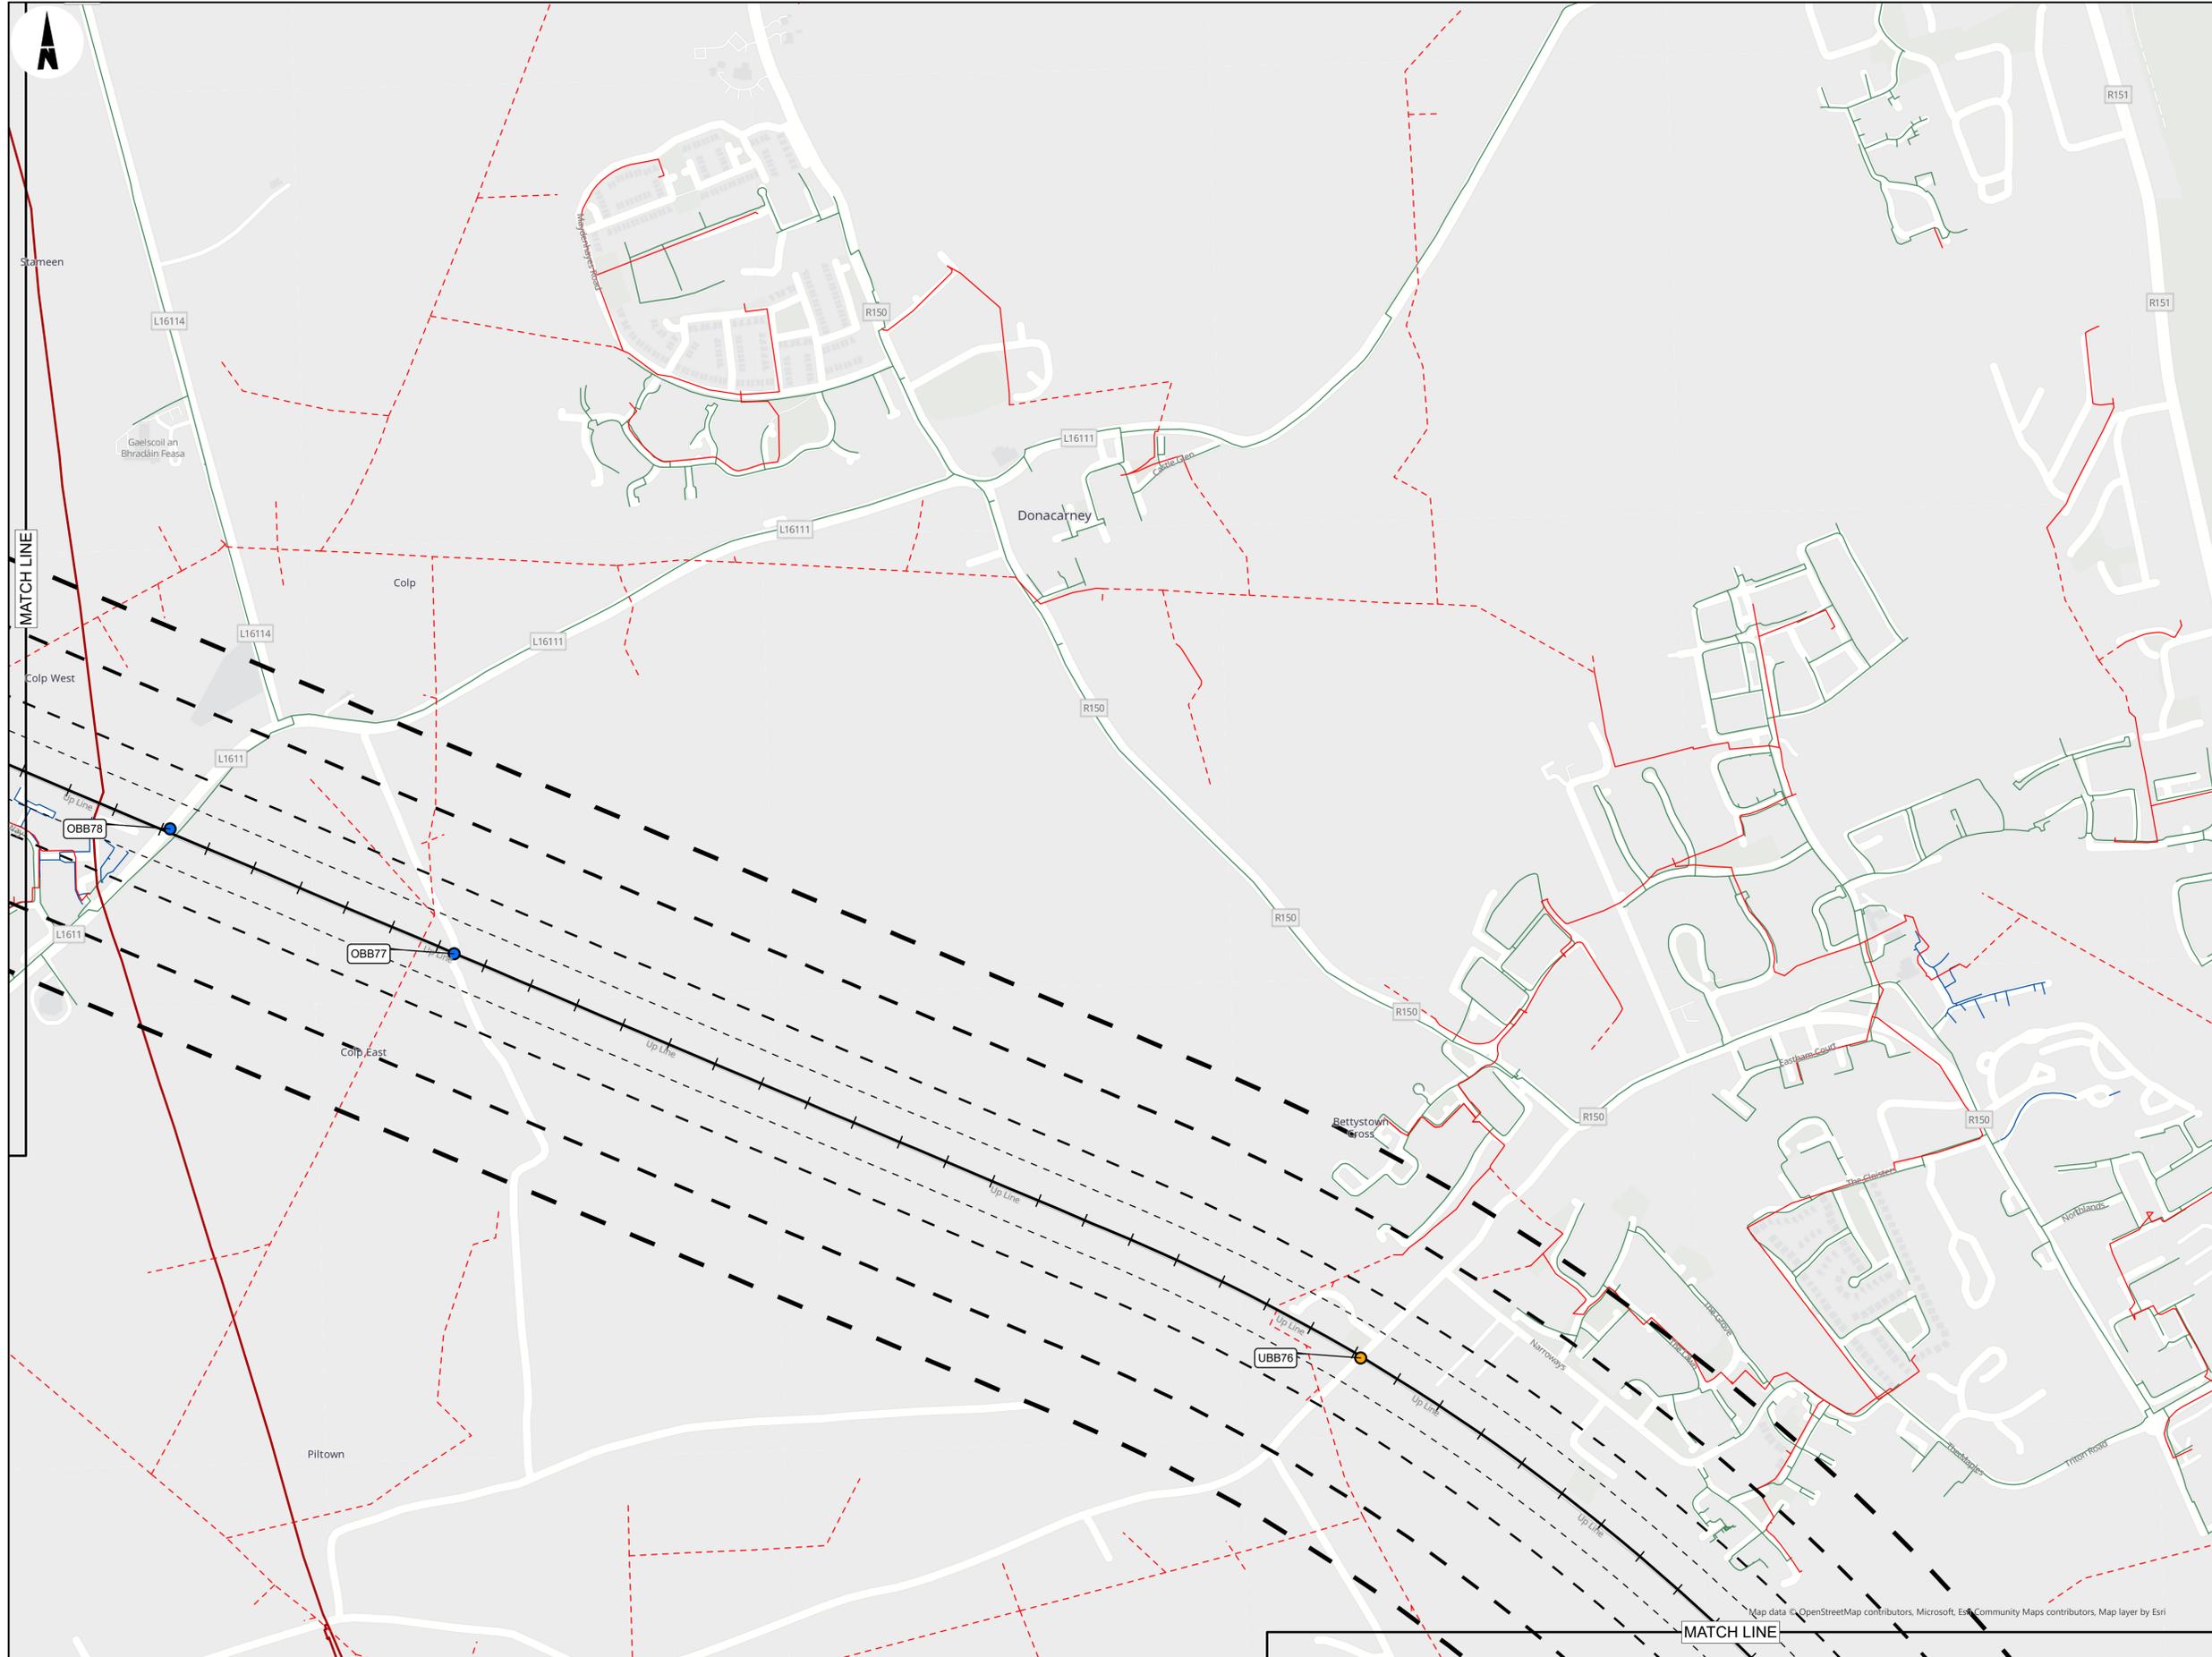

- LEGEND**
- RAILWAY STATIONS
  - BRIDGES
    - OVERBRIDGE
    - UNDERBRIDGE
  - RAILWAY LINE
  - BUFFERS
    - 60M
    - 100M
    - 200M
    - 300M
  - ADMINISTRATIVE BOUNDARY
  - COUNTY BOUNDARY
  - LICENCED FACILITIES
    - EPA LICENCED INDUSTRIAL EMISSIONS DIRECTIVE FACILITIES
    - EPA LICENCED WASTE FACILITIES
  - ESB
    - MEDIUM VOLTAGE NETWORK
      - ESB MV OH
      - ESB MV UG
    - NETWORKS IRELAND
      - HIGH PRESSURE NETWORK
      - MEDIUM PRESSURE NETWORK
      - LOW PRESSURE NETWORK

**ESB Data Disclaimer**  
 This map indicates the approximate location of ESB Networks Transmission (400kV, 220kV, 110kV, 38kV) and Distribution (20kV, 10kV, 230V/400V) underground cables and overhead lines in the general area of the proposed works. ESB Networks takes no responsibility for the accuracy or completeness of these maps. Low voltage (230V/400V) service cables (e.g. house services, factory/shop services, public lighting lamp services, etc.) are not included but their presence should be anticipated. The depths of underground cables must never be assumed. Additional more detailed information is available for high voltage Transmission underground cables (38kV, 110kV, 220kV, 400kV) for cables in the greater Dublin area call 01 6942957 and for all other areas call 1850 372 737. No work should be carried out in the vicinity of 38kV or higher voltage underground cables without prior consultation with ESB Networks. Before any mechanical excavation is undertaken, the actual location of all underground electricity cables must be established and verified on site, using: (a) Up-to-date map records; (b) Cable locator equipment operated in both power and radio modes; (c) Careful hand digging of trial holes using 'Safe Digging Practices'. Refer also to the 'HSA Code of Practice for Avoiding Danger from Underground Services'. ESB takes no responsibility and shall bear no liability in relation to any damage, injury/death or loss of supply as a result of damage or interference with its networks.

**GNI Data Disclaimer**  
 The information contained in this map concerning the location and technical designation of the gas distribution and transmission network (the 'Information') is provided 'as is' and no representation or warranty of any kind, express or implied, is made in relation to the Information and all such representations or warranties, express or implied, in relation to the Information are hereby excluded to the fullest extent permitted by law. No responsibility, liability or duty of care to you or to any other person in respect of the Information is accepted, and any reliance you or any other person places on the Information is therefore strictly at your own or at their own risk. In no event will liability be accepted for any loss or damage including, without limitation, indirect or consequential loss or damage, arising out of or in connection with the use of the Information. In the event that the Information is provided by you, in whole or in part, to a third party for whatever reason you shall ensure that the disclaimer is included with the Information and brought to the attention of the third party. The actual position of the gas distribution and transmission network must be verified on site before any mechanical excavating takes place. If any mechanical excavation is proposed, hard copy maps must be requested from Bord Gais Eireann. All work in the vicinity of the gas distribution and transmission network must be completed in accordance with the current edition of the Health & Safety Authority publication, 'Code of Practice for Avoiding Danger From Underground Services' which is available from the Health and Safety Authority (1800 28 28 80) or can be downloaded free of charge at www.hsa.ie.

Copyright © Irish Rail (2021). This drawing is confidential and the copyright in it is owned by Irish Rail. This drawing must not be either loaned, copied or otherwise reproduced in whole or in part or used for any purpose without the prior permission of Irish Rail.  
 © OpenStreetMap contributors  
 © Ordnance Survey Ireland and Government of Ireland. All O.S. data used for plans are printed under 'Copyright Ordnance Survey Ireland' Survey No. 0039720 (OSI Aerial Data or OSI Lidar Data) & Survey No. 2021/OSI/MMA\_180 (OSI Vector Data). All elevations are in metres and relate to OSI Geoid Model (OSGM02) Mean Head as defined by existing Project Control. All Co-ordinates are in Irish Transverse Mercator Grid (ITM) as defined by OSI active GPS station Tallaght College (TLG).

**Notes**  
 1. Information concerning the position of apparatus shown on this drawing is based on drawings supplied by the utility owners and/or the utility works contractor, whilst every care has been taken in the preparation of this drawing, positions should be taken as approximate and are intended for general guidance only and no representation is made by Irish Rail as to the accuracy, completeness, sufficiency or otherwise of this drawing and the position of the apparatus. The information contained herein does not purport to be comprehensive or final as the apparatus is subject to being altered and/or superseded. Recipients should not rely on this information. Any liabilities are hereby expressly disclaimed.  
 2. The information contained herein has been provided by Irish Rail but does not purport to be comprehensive or final. Recipients should not rely on the information. Neither Irish Rail nor any of its directors, officers, employees, agents, stakeholders or advisers make any representation or warranty as to or accept any liability or responsibility, in relation to, the adequacy, accuracy, reasonableness or completeness of the information provided as part of this document or any matter on which the information is based (including but not limited to loss or damage arising as a result of reliance by recipients on the information or any part of it). Any liabilities are hereby expressly disclaimed.

Rev	Date	Dn	Chkd	App'd	Description
P01	30/09/2021	DM	SH	COD	
P02	11/10/2021	DM	SH	COD	
P03	10/12/2021	DM	SH	COD	

Client: **Irish Rail**

Engineering Designer: **ARUP**

Date: 20/09/2021 Scale: 1:5000 @ A1 / 1:10000 @ A3

Project Code: D-WP56 Originator Code: ARP OMS Code: 279933-00



Drawn: DM Checked: SH Approved: COD

Project Title: **DART+ COASTAL NORTH**

Drawing Title: **CONSTRAINTS REPORT**  
 THIRD PARTY UTILITIES AND LICENCED FACILITIES CONSTRAINTS  
 OPEN STREET MAP BASEMAP

Drawing File Name: D-WP56-ARP-ZZ-NL-OR-EV-001002

Sheet Number	Status	Rev
2 of 19	902	P03

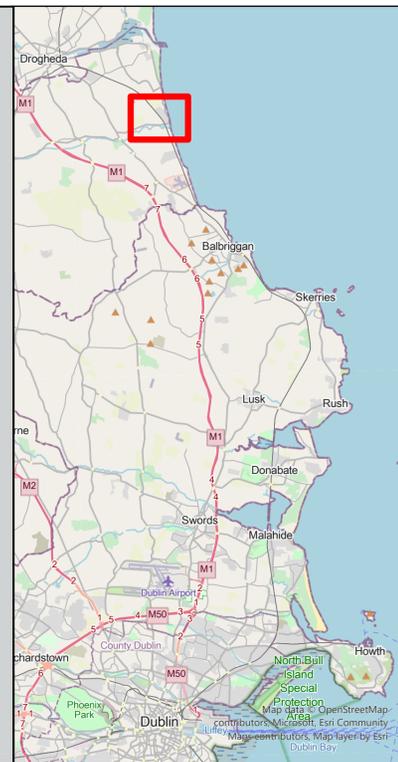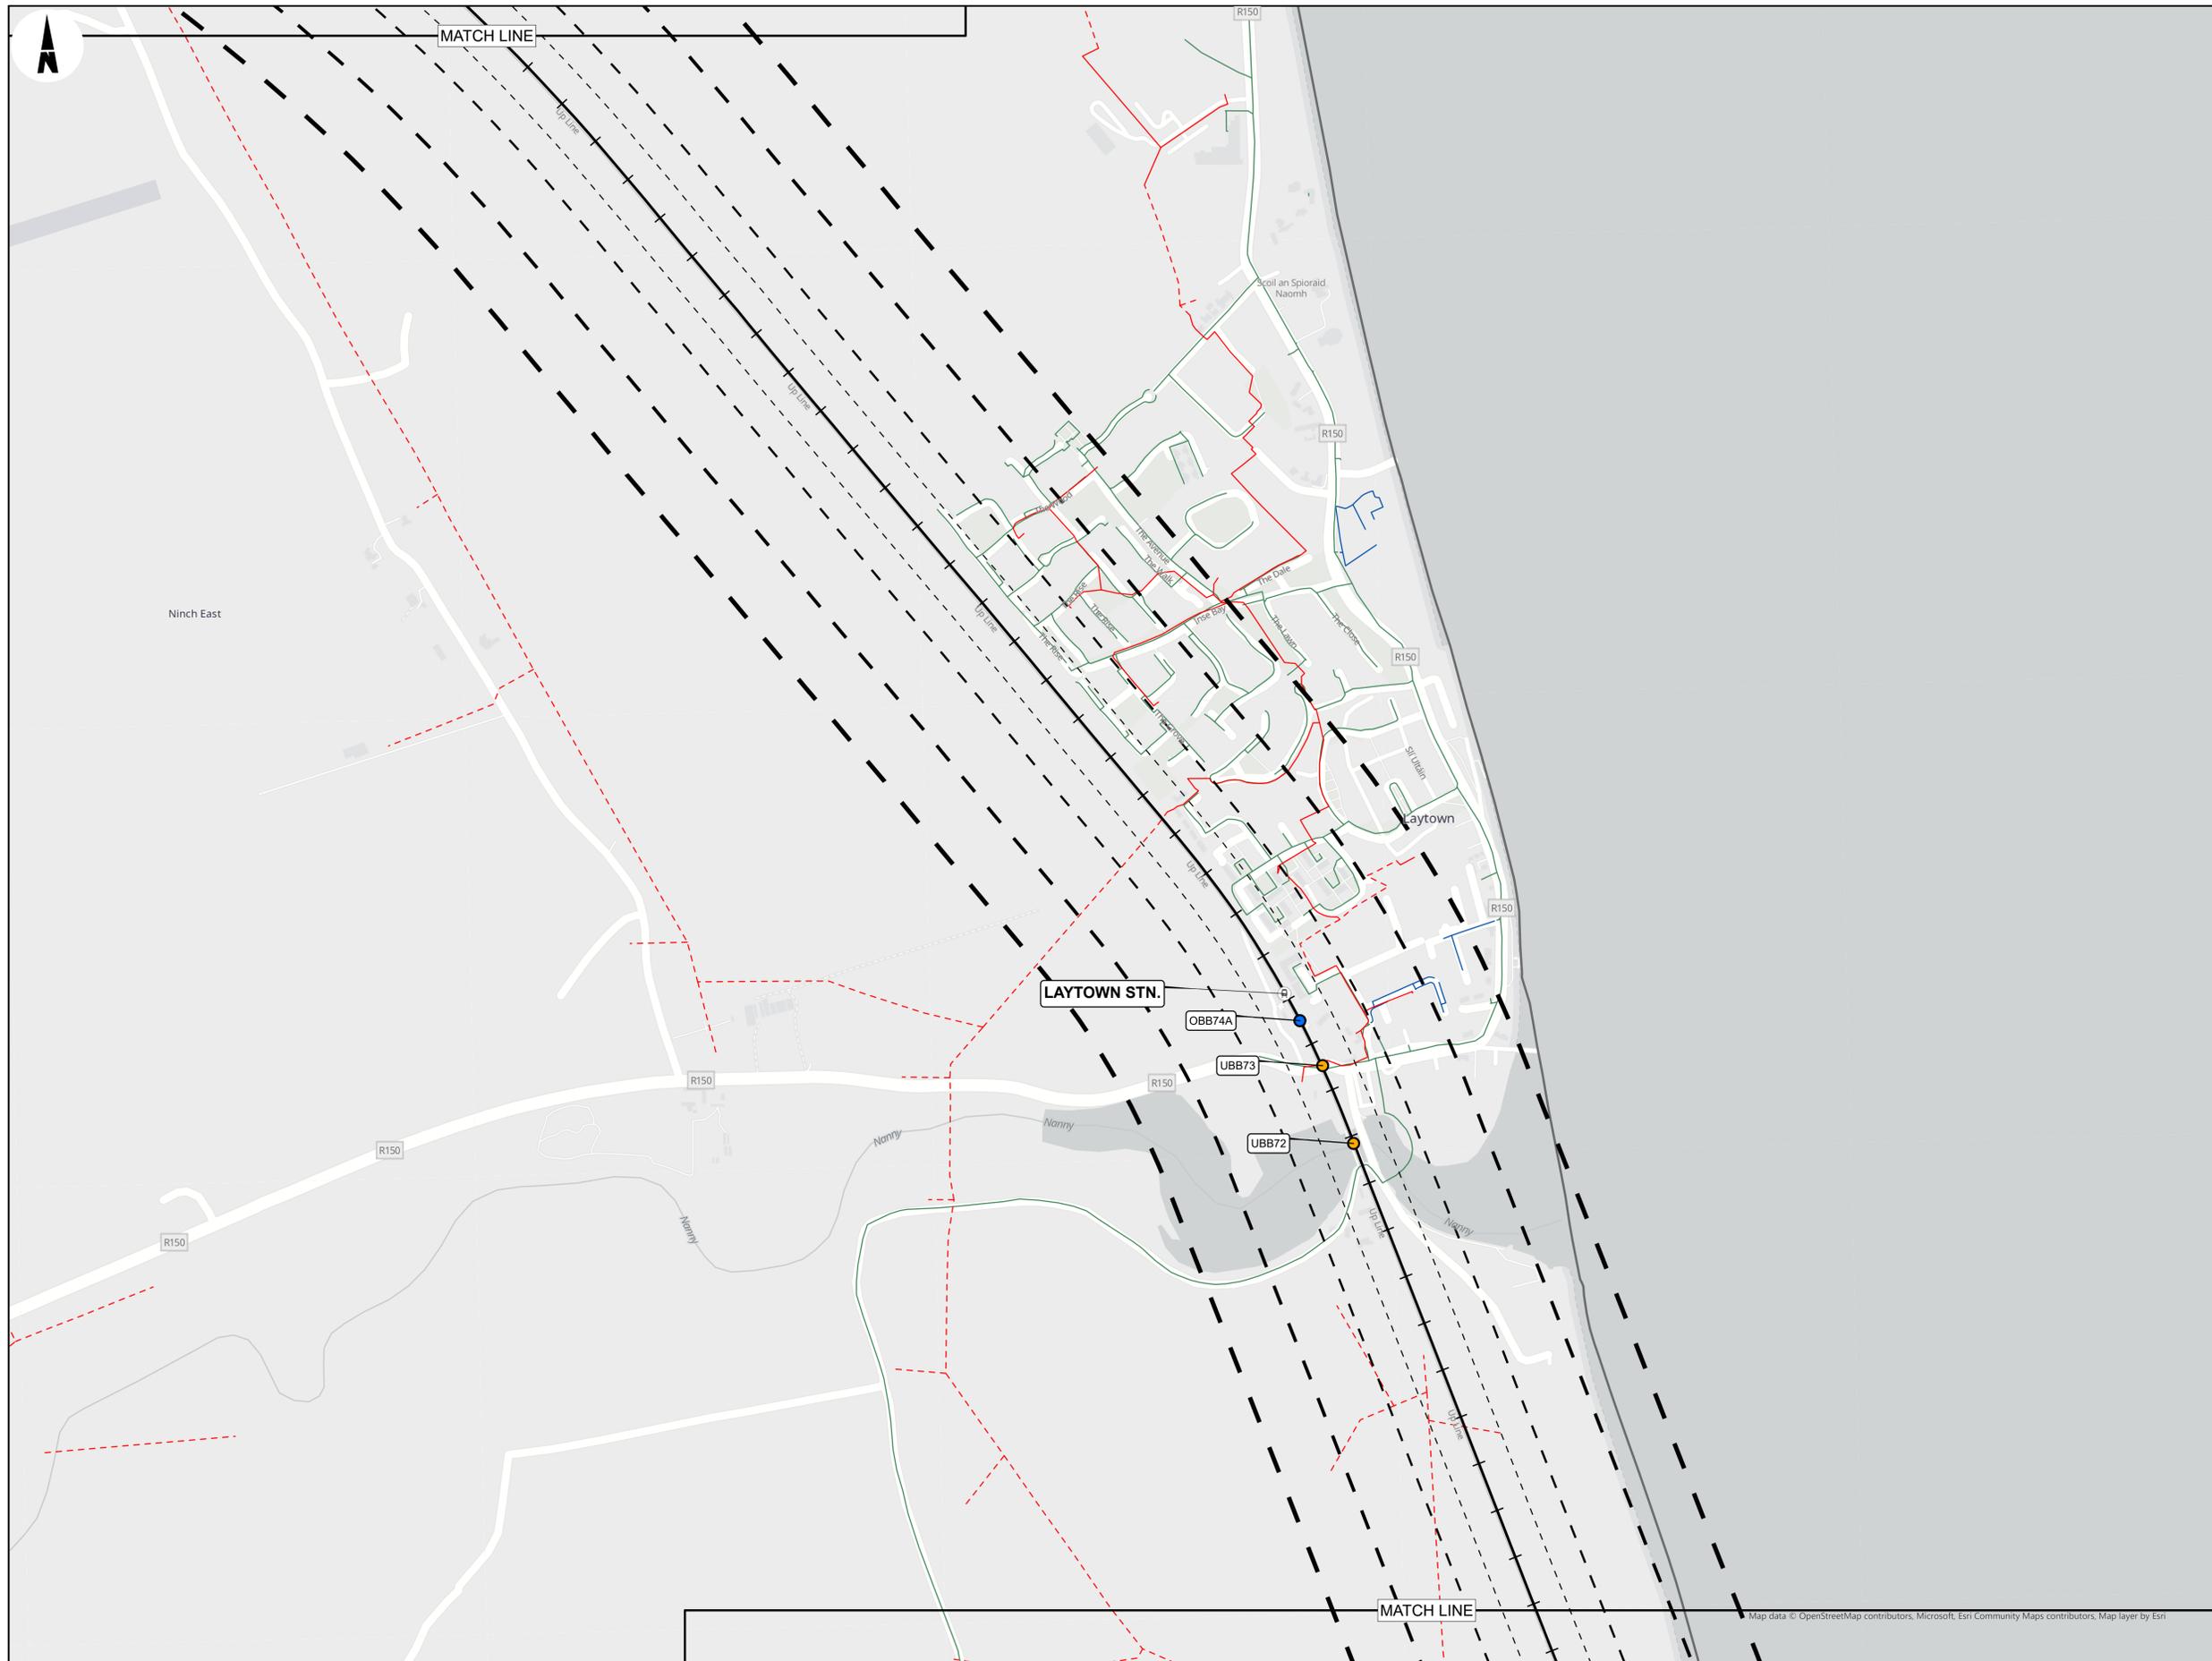

- LEGEND**
- RAILWAY STATIONS
  - BRIDGES**
    - OVERBRIDGE
    - UNDERBRIDGE
  - RAILWAY LINE
  - BUFFERS**
    - 60M
    - 100M
    - 200M
    - 300M
  - ADMINISTRATIVE BOUNDARY
  - COUNTY BOUNDARY
  - LICENCED FACILITIES**
    - EPA LICENCED INDUSTRIAL EMISSIONS DIRECTIVE FACILITIES
    - EPA LICENCED WASTE FACILITIES
  - ESB**
  - MEDIUM VOLTAGE NETWORK**
    - ESB MV OH
    - ESB MV UG
  - GAS NETWORKS IRELAND**
    - MEDIUM PRESSURE NETWORK
    - LOW PRESSURE NETWORK

**ESB Data Disclaimer**  
 This map indicates the approximate location of ESB Networks Transmission (400kV, 220kV, 110kV, 38kV) and Distribution (20kV, 10kV, 230V/400V) underground cables and overhead lines in the general area of the proposed works. ESB Networks takes no responsibility for the accuracy or completeness of these maps. Low voltage (230V/400V) service cables (e.g. house services, factory/shop services, public lighting lamp services, etc.) are not included but their presence should be anticipated. The depths of underground cables must never be assumed. Additional more detailed information is available for high voltage Transmission underground cables (38kV, 110kV, 220kV, 400kV) for cables in the greater Dublin area call 01 6942957 and for all other areas call 1850 372 737. No work should be carried out in the vicinity of 38kV or higher voltage underground cables without prior consultation with ESB Networks. Before any mechanical excavation is undertaken, the actual location of all underground electricity cables must be established and verified on site, using: (a) Up-to-date map records; (b) Cable locator equipment operated in both power and radio modes; (c) Careful hand digging of trial holes using 'Safe Digging Practice'. Refer also to the 'HSA Code of Practice for Avoiding Danger from Underground Services'. ESB takes no responsibility and shall bear no liability in relation to any damage, injury/death or loss of supply as a result of damage or interference with its networks.

**GNI Data Disclaimer**  
 The information contained in this map concerning the location and technical designation of the gas distribution and transmission network (the 'Information') is provided 'as is' and no representation or warranty of any kind, express or implied, is made in relation to the Information and all such representations or warranties, express or implied, in relation to the Information are hereby excluded to the fullest extent permitted by law. No responsibility, liability or duty of care to you or to any other person in respect of the Information is accepted, and any reliance you or any other person places on the Information is therefore strictly at your own or at their own risk. In no event will liability be accepted for any loss or damage including, without limitation, indirect or consequential loss or damage, arising out of or in connection with the use of the Information. In the event that the Information is provided by you, in whole or in part, to a third party for whatever reason you shall ensure that the disclaimer is included with the Information and brought to the attention of the third party. The actual position of the gas distribution and transmission network must be verified on site before any mechanical excavating takes place. If any mechanical excavation is proposed, hard copy maps must be requested from Bord Gais Eireann. All work in the vicinity of the gas distribution and transmission network must be completed in accordance with the current edition of the Health & Safety Authority publication, 'Code of Practice for Avoiding Danger From Underground Services' which is available from the Health and Safety Authority (1800 28 28 80) or can be downloaded free of charge at www.hsa.ie.

Copyright © Irish Rail (2021). This drawing is confidential and the copyright in it is owned by Irish Rail. This drawing must not be either loaned, copied or otherwise reproduced in whole or in part or used for any purpose without the prior permission of Irish Rail.

© Ordnance Survey Ireland and Government of Ireland. All O.S. data used for plans are printed under "Copyright Ordnance Survey Ireland" Survey No. 0039720 (OSI Aerial Data or OSI Lidar Data) & Survey No. 2021/OSI/MMA\_180 (OSI Vector Data). All elevations are in metres and relate to OSI Geoid Model (OSGM02) Malin Head as defined by existing Project Control. All Co-ordinates are in Irish Transverse Mercator Grid (ITM) as defined by OSI active GPS station Tallaght College (TLTG).

**Notes**

- Information concerning the position of apparatus shown on this drawing is based on drawings supplied by the utility owners and/or the utility works contractor, whilst every care has been taken in the preparation of this drawing, positions should be taken as approximate and are intended for general guidance only and no representation is made by Irish Rail as to the accuracy, completeness, sufficiency or otherwise of this drawing and the position of the apparatus. The information contained herein does not purport to be comprehensive or final as the apparatus is subject to being altered and/or superseded. Recipients should not rely on this information. Any liabilities are hereby expressly disclaimed.
- The information contained herein has been provided by Irish Rail but does not purport to be comprehensive or final. Recipients should not rely on the information. Neither Irish Rail nor any of its directors, officers, employees, agents, stakeholders or advisers make any representation or warranty as to or accept any liability or responsibility, in relation to, the adequacy, accuracy, reasonableness or completeness of the information provided as part of this document or any matter on which the information is based (including but not limited to loss or damage arising as a result of reliance by recipients on the information or any part of it). Any liabilities are hereby expressly dismissed.

Rev	Date	Dn	Chkd	App'd	Description
P01	30/09/2021	DM	SH	COD	
P02	11/10/2021	DM	SH	COD	
P03	10/12/2021	DM	SH	COD	

Client: **larnród Éireann Irish Rail**

Engineering Designer: **ARUP**

Date: 20/09/2021 Scale: 1:5000 @ A1 / 1:10000 @ A3

Project Code: D+WP56 Originator Code: ARP

Drawn: DM Checked: SH Approved: COD



QMS Code: 279933-00

Project Title: **DART+ COASTAL NORTH**

Drawing Title: **CONSTRAINTS REPORT THIRD PARTY UTILITIES AND LICENCED FACILITIES CONSTRAINTS OPEN STREET MAP BASEMAP**

Drawing File Name: D+WP56-ARP-ZZ-NL-OR-EV-001003

Sheet Number	Status	Rev
3 of 19	902	P03

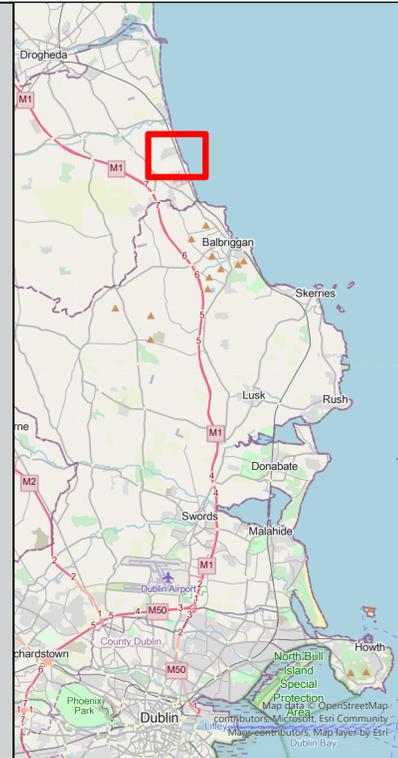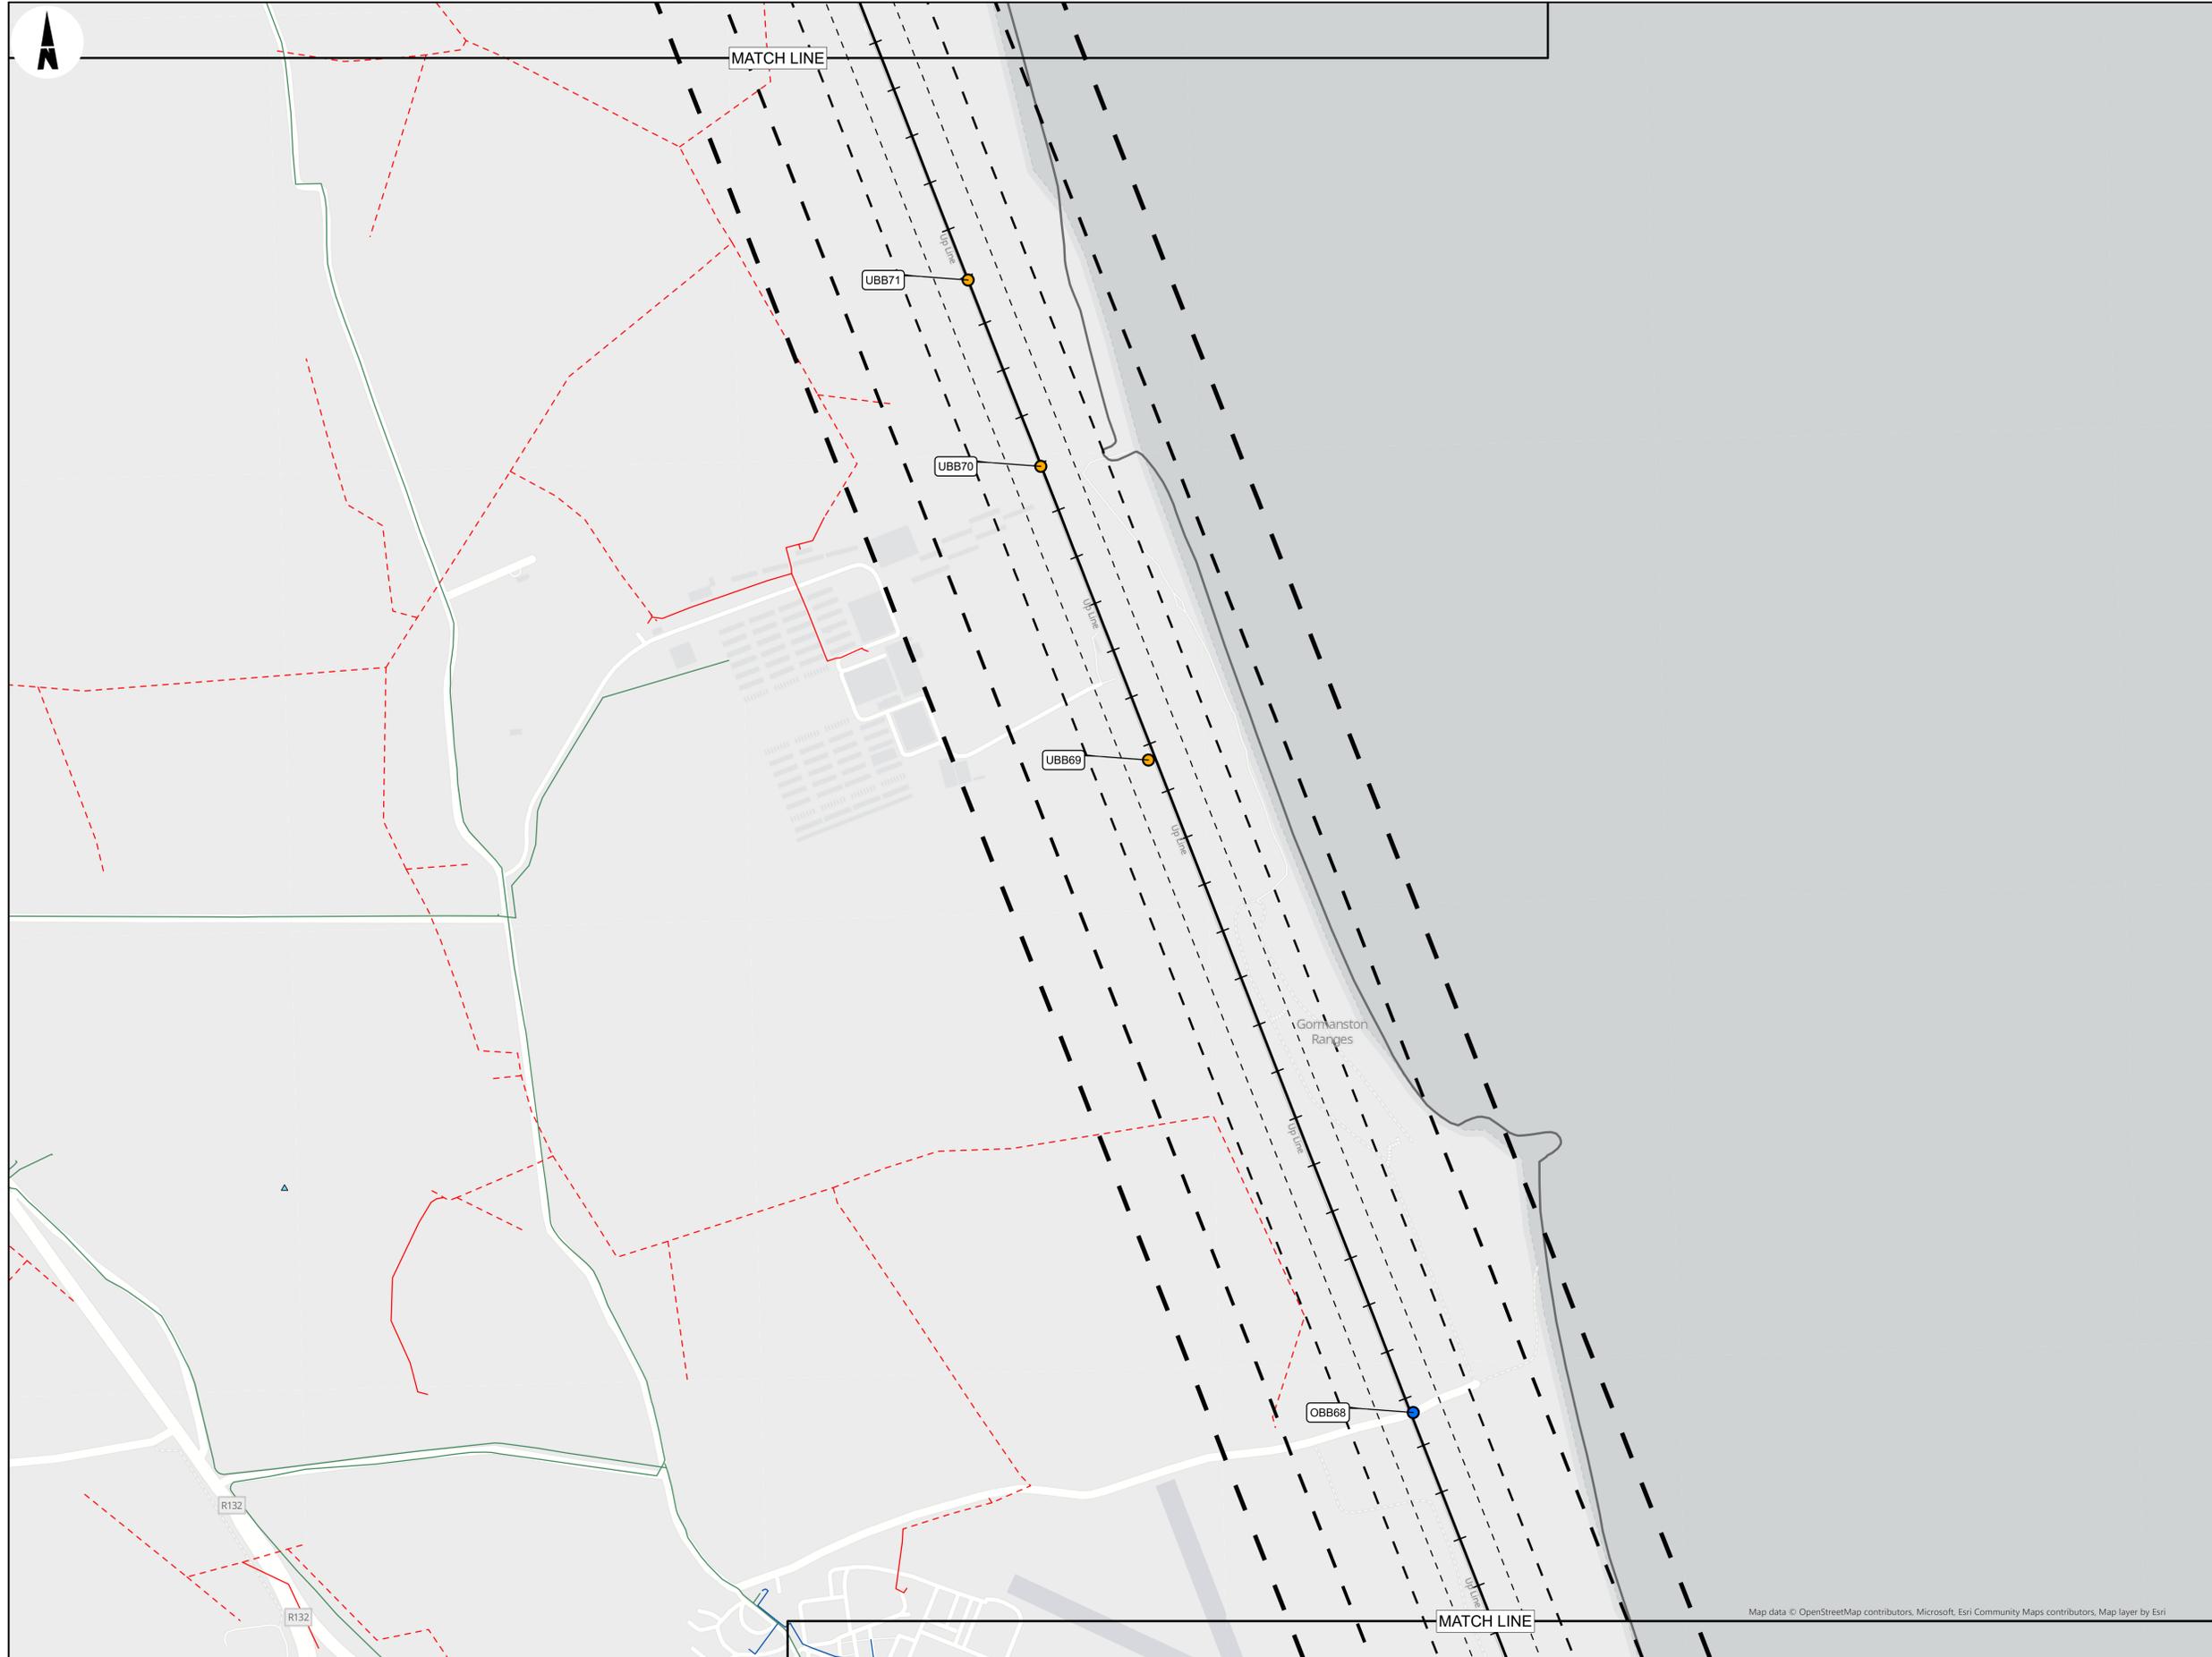

- LEGEND**
- RAILWAY STATIONS
  - BRIDGES
    - OVERBRIDGE
    - UNDERBRIDGE
  - RAILWAY LINE
  - BUFFERS
    - 60M
    - 100M
    - 200M
    - 300M
  - ADMINISTRATIVE BOUNDARY
  - COUNTY BOUNDARY
  - LICENCED FACILITIES
    - EPA LICENCED INDUSTRIAL EMISSIONS DIRECTIVE FACILITIES
    - EPA LICENCED WASTE FACILITIES
  - ESB
    - MEDIUM VOLTAGE NETWORK
      - ESS MV OH
      - ESS MV UG
    - GAS NETWORKS IRELAND
      - MEDIUM PRESSURE NETWORK
      - LOW PRESSURE NETWORK

**ESB Data Disclaimer**  
 This map indicates the approximate location of ESB Networks Transmission (400kV, 220kV, 110kV, 38kV) and Distribution (20kV, 10kV, 230V/400V) underground cables and overhead lines in the general area of the proposed works. ESB Networks takes no responsibility for the accuracy or completeness of these maps. Low voltage (230V/400V) service cables (e.g. house services, factory/shop services, public lighting lamp services, etc.) are not included but their presence should be anticipated. The depths of underground cables must never be assumed. Additional more detailed information is available for high voltage Transmission underground cables (38kV, 110kV, 220kV, 400kV) for cables in the greater Dublin area call 01 6942957 and for all other areas call 1850 372 737. No work should be carried out in the vicinity of 38kV or higher voltage underground cables without prior consultation with ESB Networks. Before any mechanical excavation is undertaken, the actual location of all underground electricity cables must be established and verified on site, using: (a) Up-to-date map records; (b) Cable locator equipment operated in both power and radio modes; (c) Careful hand digging of trial holes using 'Safe Digging Practice'. Refer also to the 'HSA Code of Practice for Avoiding Danger from Underground Services'. ESB takes no responsibility and shall bear no liability in relation to any damage, injury/death or loss of supply as a result of damage or interference with its networks.

**GNI Data Disclaimer**  
 The information contained in this map concerning the location and technical designation of the gas distribution and transmission network (the 'Information') is provided 'as is' and no representation or warranty of any kind, express or implied, is made in relation to the Information and all such representations or warranties, express or implied, in relation to the Information are hereby excluded to the fullest extent permitted by law. No responsibility, liability or duty of care to you or to any other person in respect of the Information is accepted, and any reliance you or any other person places on the Information is therefore strictly at your own or at their own risk. In no event will liability be accepted for any loss or damage including, without limitation, indirect or consequential loss or damage, arising out of or in connection with the use of the Information. In the event that the Information is provided by you, in whole or in part, to a third party for whatever reason you shall ensure that the disclaimer is included with the Information and brought to the attention of the third party. The actual position of the gas distribution and transmission network must be verified on site before any mechanical excavating takes place. If any mechanical excavation is proposed, hard copy maps must be requested from Bord Gáis Éireann. All work in the vicinity of the gas distribution and transmission network must be completed in accordance with the current edition of the Health & Safety Authority publication, 'Code of Practice for Avoiding Danger From Underground Services' which is available from the Health and Safety Authority (1860 28 88 88) or can be downloaded free of charge at www.hsa.ie.

Copyright © Irish Rail (2021). This drawing is confidential and the copyright in it is owned by Irish Rail. This drawing must not be either loaned, copied or otherwise reproduced in whole or in part or used for any purpose without the prior permission of Irish Rail.

© Ordnance Survey Ireland and Government of Ireland. All O.S. data used for plans are printed under "Copyright Ordnance Survey Ireland" Survey No. 0039720 (OSI Aerial Data or OSI Lids Data) & Survey No. 2021/OSI/MMA\_180 (OSI Vector Data). All elevations are in metres and relate to OSI Geoid Model (OSGM02) Malin Head as defined by existing Project Control. All Co-ordinates are in Irish Transverse Mercator Grid (ITM) as defined by OSI active GPS station Tallaght College (TLTG).

**Notes**

- Information concerning the position of apparatus shown on this drawing is based on drawings supplied by the utility owners and/or the utility works contractor, whilst every care has been taken in the preparation of this drawing, positions should be taken as approximate and are intended for general guidance only and no representation is made by Irish Rail as to the accuracy, completeness, sufficiency or otherwise of this drawing and the position of the apparatus. The information contained herein does not purport to be comprehensive or final as the apparatus is subject to being altered and/or superseded. Recipients should not rely on this information. Any liabilities are hereby expressly disclaimed.
- The information contained herein has been provided by Irish Rail but does not purport to be comprehensive or final. Recipients should not rely on the information. Neither Irish Rail nor any of its directors, officers, employees, agents, stakeholders or advisers make any representation or warranty as to or accept any liability or responsibility, in relation to, the adequacy, accuracy, reasonableness or completeness of the information provided as part of this document or any matter on which the information is based (including but not limited to loss or damage arising as a result of reliance by recipients on the information or any part of it). Any liabilities are hereby expressly dismissed.

Rev	Date	Dn	Chkd	App'd	Description
P01	30/09/2021	DM	SH	COD	
P02	11/10/2021	DM	SH	COD	
P03	10/12/2021	DM	SH	COD	

Client: **larnród Éireann Irish Rail**

Engineering Designer: **ARUP**

Date: 20/09/2021 Scale: 1:5000 @ A1 / 1:10000 @ A3

Project Code: D+WP56 Originator Code: ARP

Drawn: DM Checked: SH Approved: COD



OMS Code: 279933-00

Project Title: **DART+ COASTAL NORTH**

Drawing Title: **CONSTRAINTS REPORT THIRD PARTY UTILITIES AND LICENCED FACILITIES CONSTRAINTS OPEN STREET MAP BASEMAP**

Drawing File Name: D+WP56-ARP-ZZ-NL-OR-EV-001004

Sheet Number	Status	Rev
4 of 19	902	P03

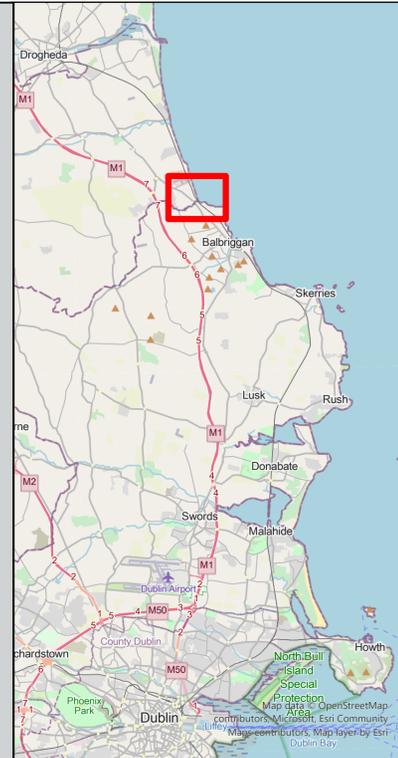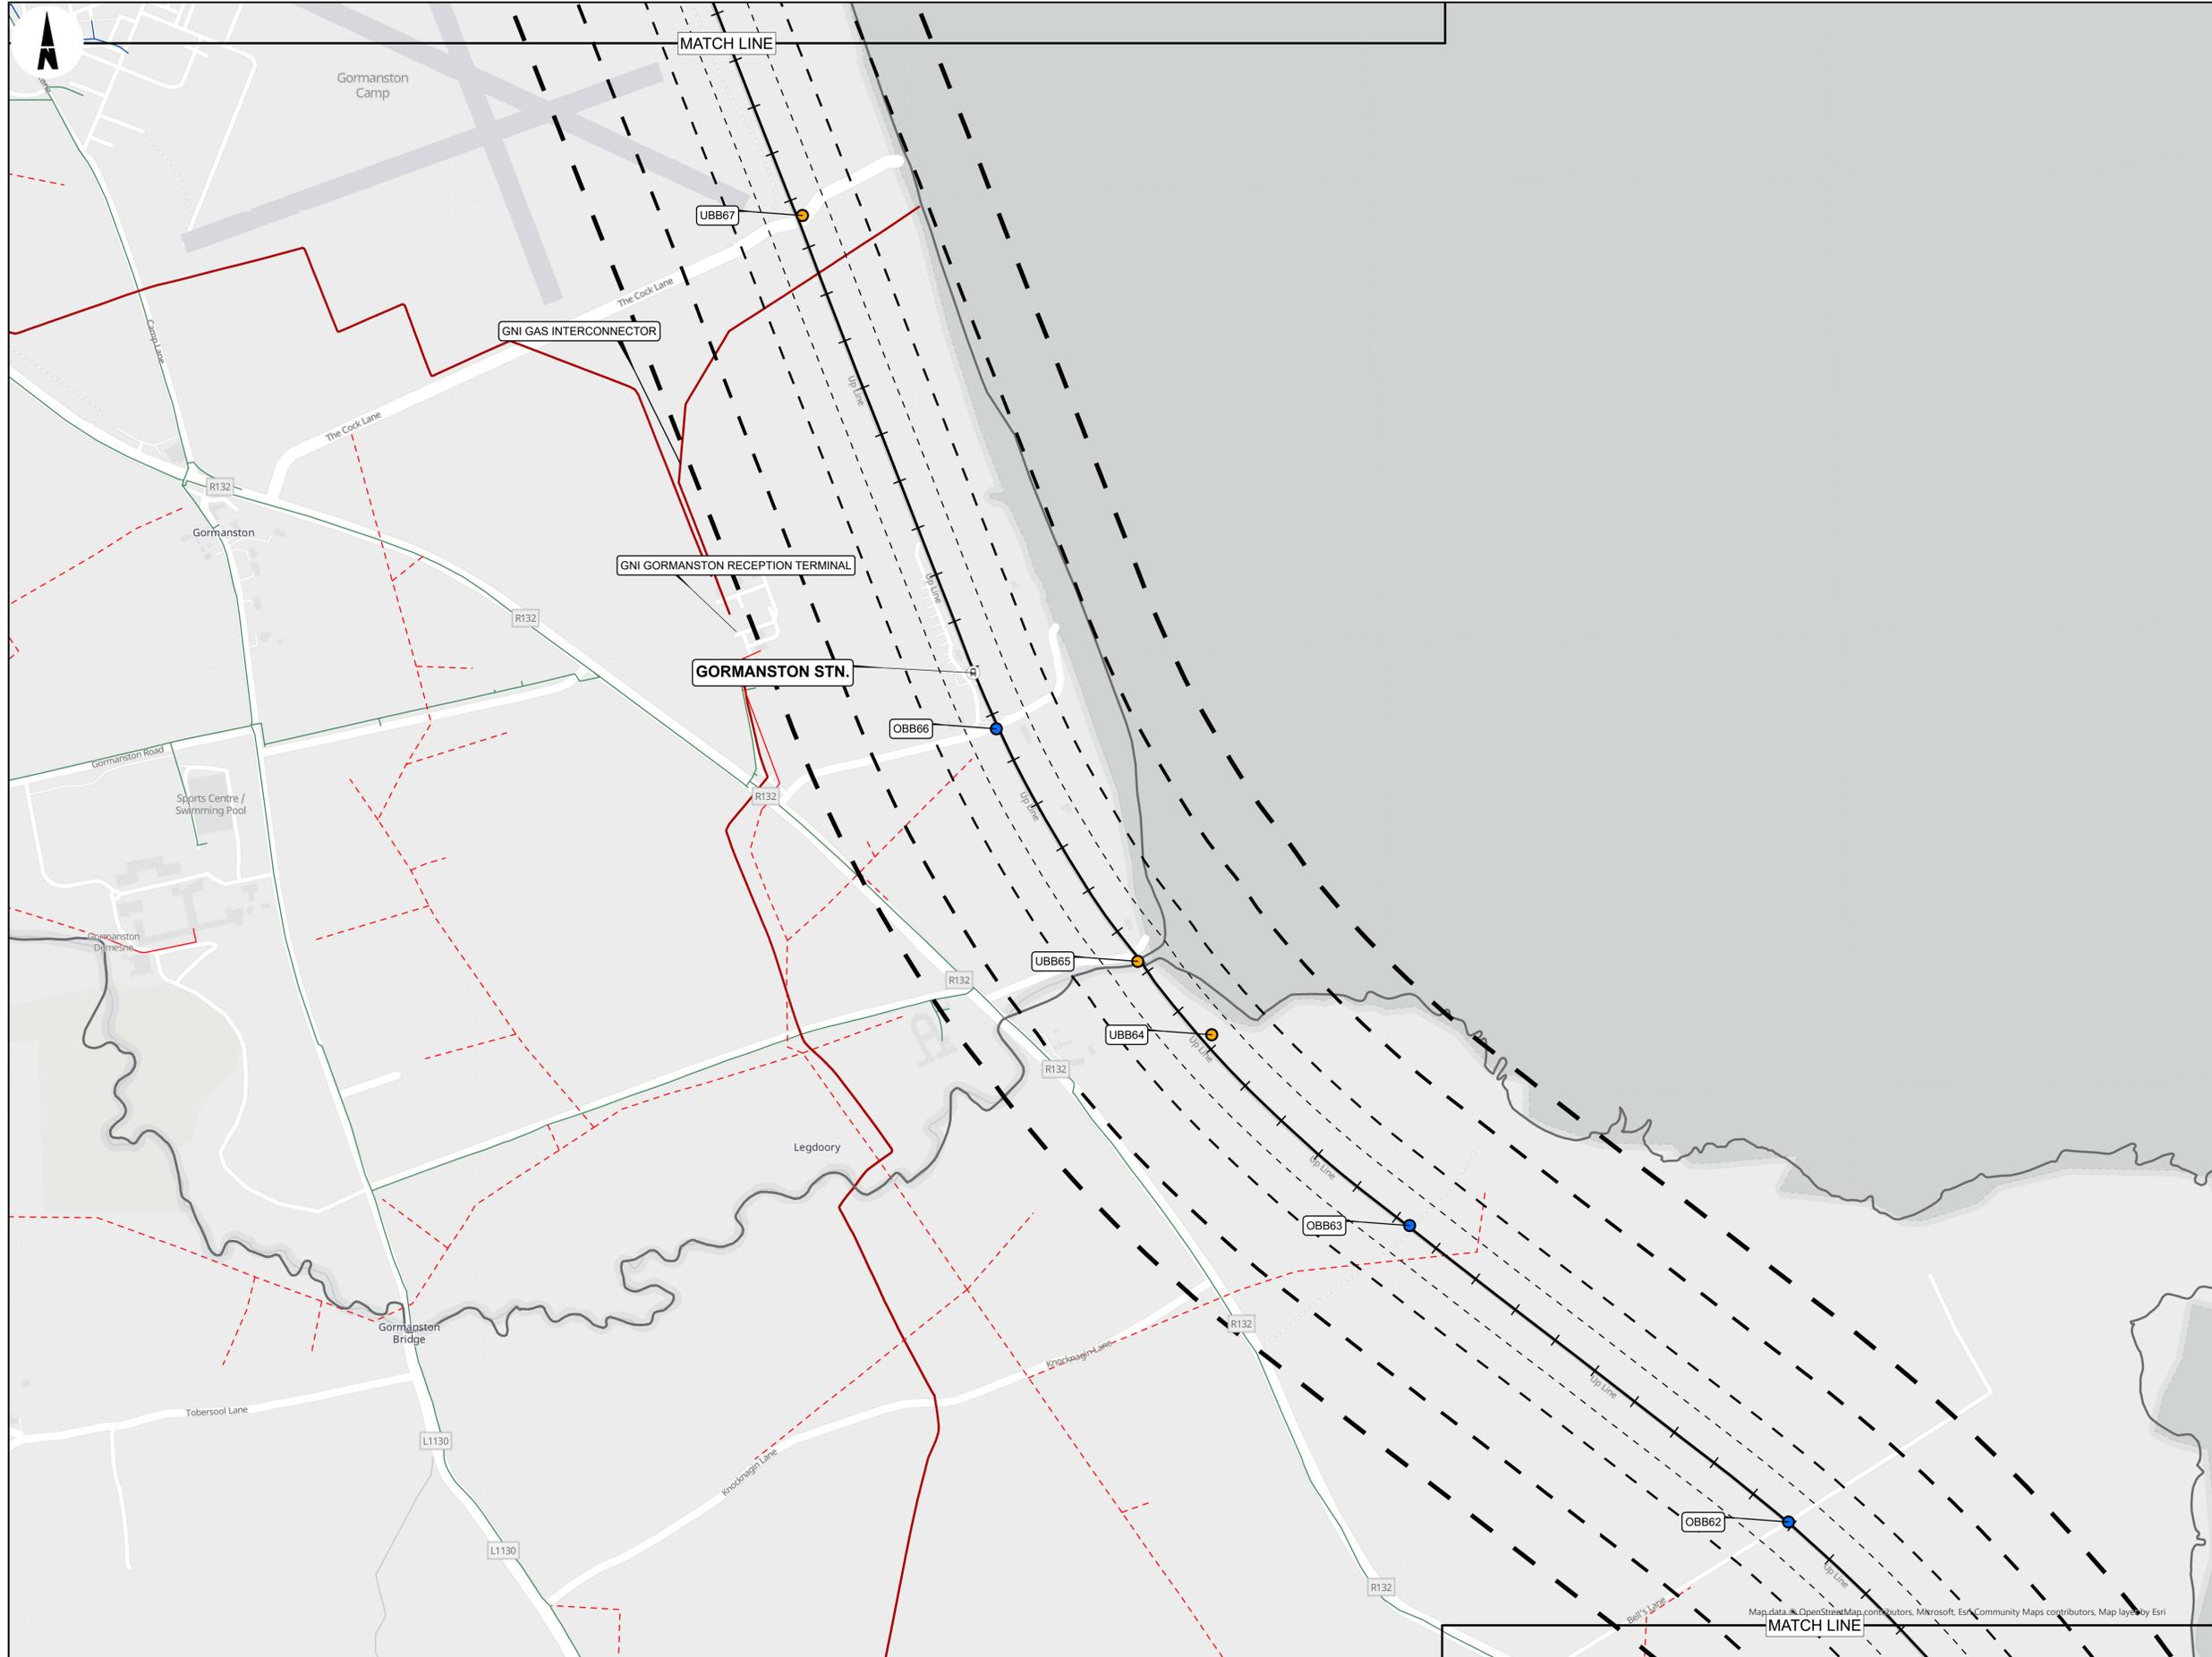

- LEGEND**
- RAILWAY STATIONS
  - BRIDGES
    - OVERBRIDGE
    - UNDERBRIDGE
  - RAILWAY LINE
  - BUFFERS
    - 60M
    - 100M
    - 200M
    - 300M
  - ADMINISTRATIVE BOUNDARY
  - COUNTY BOUNDARY
  - LICENCED FACILITIES
    - EPA LICENCED INDUSTRIAL EMISSIONS DIRECTIVE FACILITIES
    - EPA LICENCED WASTE FACILITIES
  - ESB
    - MEDIUM VOLTAGE NETWORK
      - ESB MV OH
      - ESB MV UG
    - GAS NETWORKS IRELAND
      - HIGH PRESSURE NETWORK
      - MEDIUM PRESSURE NETWORK
      - LOW PRESSURE NETWORK

**ESB Data Disclaimer**  
 This map indicates the approximate location of ESB Networks Transmission (400kV, 220kV, 110kV, 38kV) and Distribution (20kV, 10kV, 230V/400V) underground cables and overhead lines in the general area of the proposed works. ESB Networks takes no responsibility for the accuracy or completeness of these maps. Low voltage (230V/400V) service cables (e.g. house services, factory/shop services, public lighting lamp services, etc.) are not included but their presence should be anticipated. The depths of underground cables must never be assumed. Additional more detailed information is available for high voltage Transmission underground cables (38kV, 110kV, 220kV, 400kV) for cables in the greater Dublin area call 01 6942957 and for all other areas call 1850 372 737. No work should be carried out in the vicinity of 38kV or higher voltage underground cables without prior consultation with ESB Networks. Before any mechanical excavation is undertaken, the actual location of all underground electricity cables must be established and verified on site, using: (a) Up-to-date map records; (b) Cable locator equipment operated in both power and radio modes; (c) Careful hand digging of trial holes using 'Safe Digging Practice'. Refer also to the 'HSA Code of Practice for Avoiding Danger from Underground Services'. ESB takes no responsibility and shall bear no liability in relation to any damage, injury/death or loss of supply as a result of damage or interference with its networks.

**GNI Data Disclaimer**  
 The information contained in this map concerning the location and technical designation of the gas distribution and transmission network (the 'Information') is provided 'as is' and no representation or warranty of any kind, express or implied, is made in relation to the Information and all such representations or warranties, express or implied, in relation to the Information are hereby excluded to the fullest extent permitted by law. No responsibility, liability or duty of care to you or to any other person in respect of the Information is accepted, and any reliance you or any other person places on the Information is therefore strictly at your own or at their own risk. In no event will liability be accepted for any loss or damage including, without limitation, indirect or consequential loss or damage, arising out of or in connection with the use of the Information. In the event that the Information is provided by you, in whole or in part, to a third party for whatever reason you shall ensure that the disclaimer is included with the Information and brought to the attention of the third party. The actual position of the gas distribution and transmission network must be verified on site before any mechanical excavating takes place. If any mechanical excavation is proposed, hard copy maps must be requested from Bord Gáis Éireann. All work in the vicinity of the gas distribution and transmission network must be completed in accordance with the current edition of the Health & Safety Authority publication, 'Code of Practice for Avoiding Danger From Underground Services' which is available from the Health and Safety Authority (1866 28 88 88) or can be downloaded free of charge at www.hsa.ie.

Copyright  
 © Irish Rail (2021). This drawing is confidential and the copyright in it is owned by Irish Rail. This drawing must not be either loaned, copied or otherwise reproduced in whole or in part or used for any purpose without the prior permission of Irish Rail.  
 © OpenStreetMap contributors  
 © Ordnance Survey Ireland and Government of Ireland. All O.S. data used for plans are printed under "Copyright Ordnance Survey Ireland" Survey No. 0039720 (OSI Aerial Data or OSI Lids Data) & Survey No. 2021/OSI/MMA\_180 (OSI Vector Data). All elevations are in metres and relate to OSI Geoid Model (OSGM02) Malin Head as defined by existing Project Control. All Co-ordinates are in Irish Transverse Mercator Grid (ITM) as defined by OSI active GPS station Tallaght College (TLTG).

Notes  
 1. Information concerning the position of apparatus shown on this drawing is based on drawings supplied by the utility owners and/or the utility works contractor, whilst every care has been taken in the preparation of this drawing, positions should be taken as approximate and are intended for general guidance only and no representation is made by Irish Rail as to the accuracy, completeness, sufficiency or otherwise of this drawing and the position of the apparatus. The information contained herein does not purport to be comprehensive or final as the apparatus is subject to being altered and/or superseded. Recipients should not rely on this information. Any liabilities are hereby expressly disclaimed.  
 2. The information contained herein has been provided by Irish Rail but does not purport to be comprehensive or final. Recipients should not rely on the information. Neither Irish Rail nor any of its directors, officers, employees, agents, stakeholders or advisers make any representation or warranty as to or accept any liability or responsibility, in relation to, the adequacy, accuracy, reasonableness or completeness of the information provided as part of this document or any matter on which the information is based (including but not limited to loss or damage arising as a result of reliance by recipients on the information or any part of it). Any liabilities are hereby expressly dismissed.

Rev	Date	Dn	Chkd	App'd	Description
P01	30/09/2021	DM	SH	COD	
P02	11/10/2021	DM	SH	COD	
P03	10/12/2021	DM	SH	COD	

Client: **Irish Rail**

Engineering Designer: **ARUP**

Date: 20/09/2021 Scale: 1:5000 @ A1 / 1:10000 @ A3

Project Code: D+WP56 Originator Code: ARP

Drawn: DM Checked: SH Approved: COD



QMS Code: 279933-00

Project Title: **DART+ COASTAL NORTH**

Drawing Title: **THIRD PARTY UTILITIES AND LICENCED FACILITIES CONSTRAINTS OPEN STREET MAP BASEMAP**

Drawing File Name: D+WP56-ARP-ZZ-NL-OR-EV-001005

Sheet Number	Status	Rev
6 of 19	902	P03

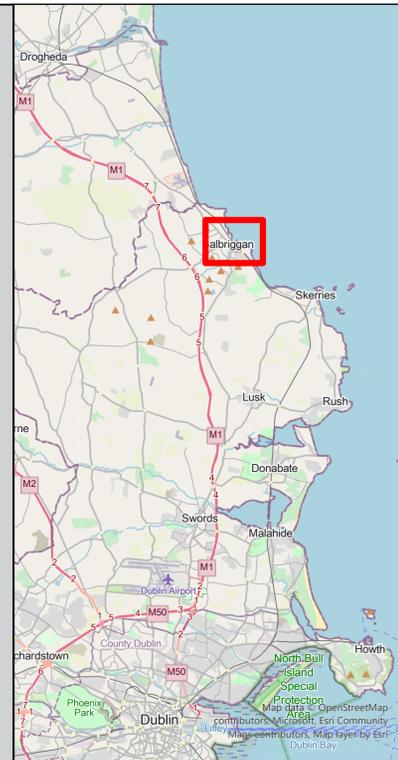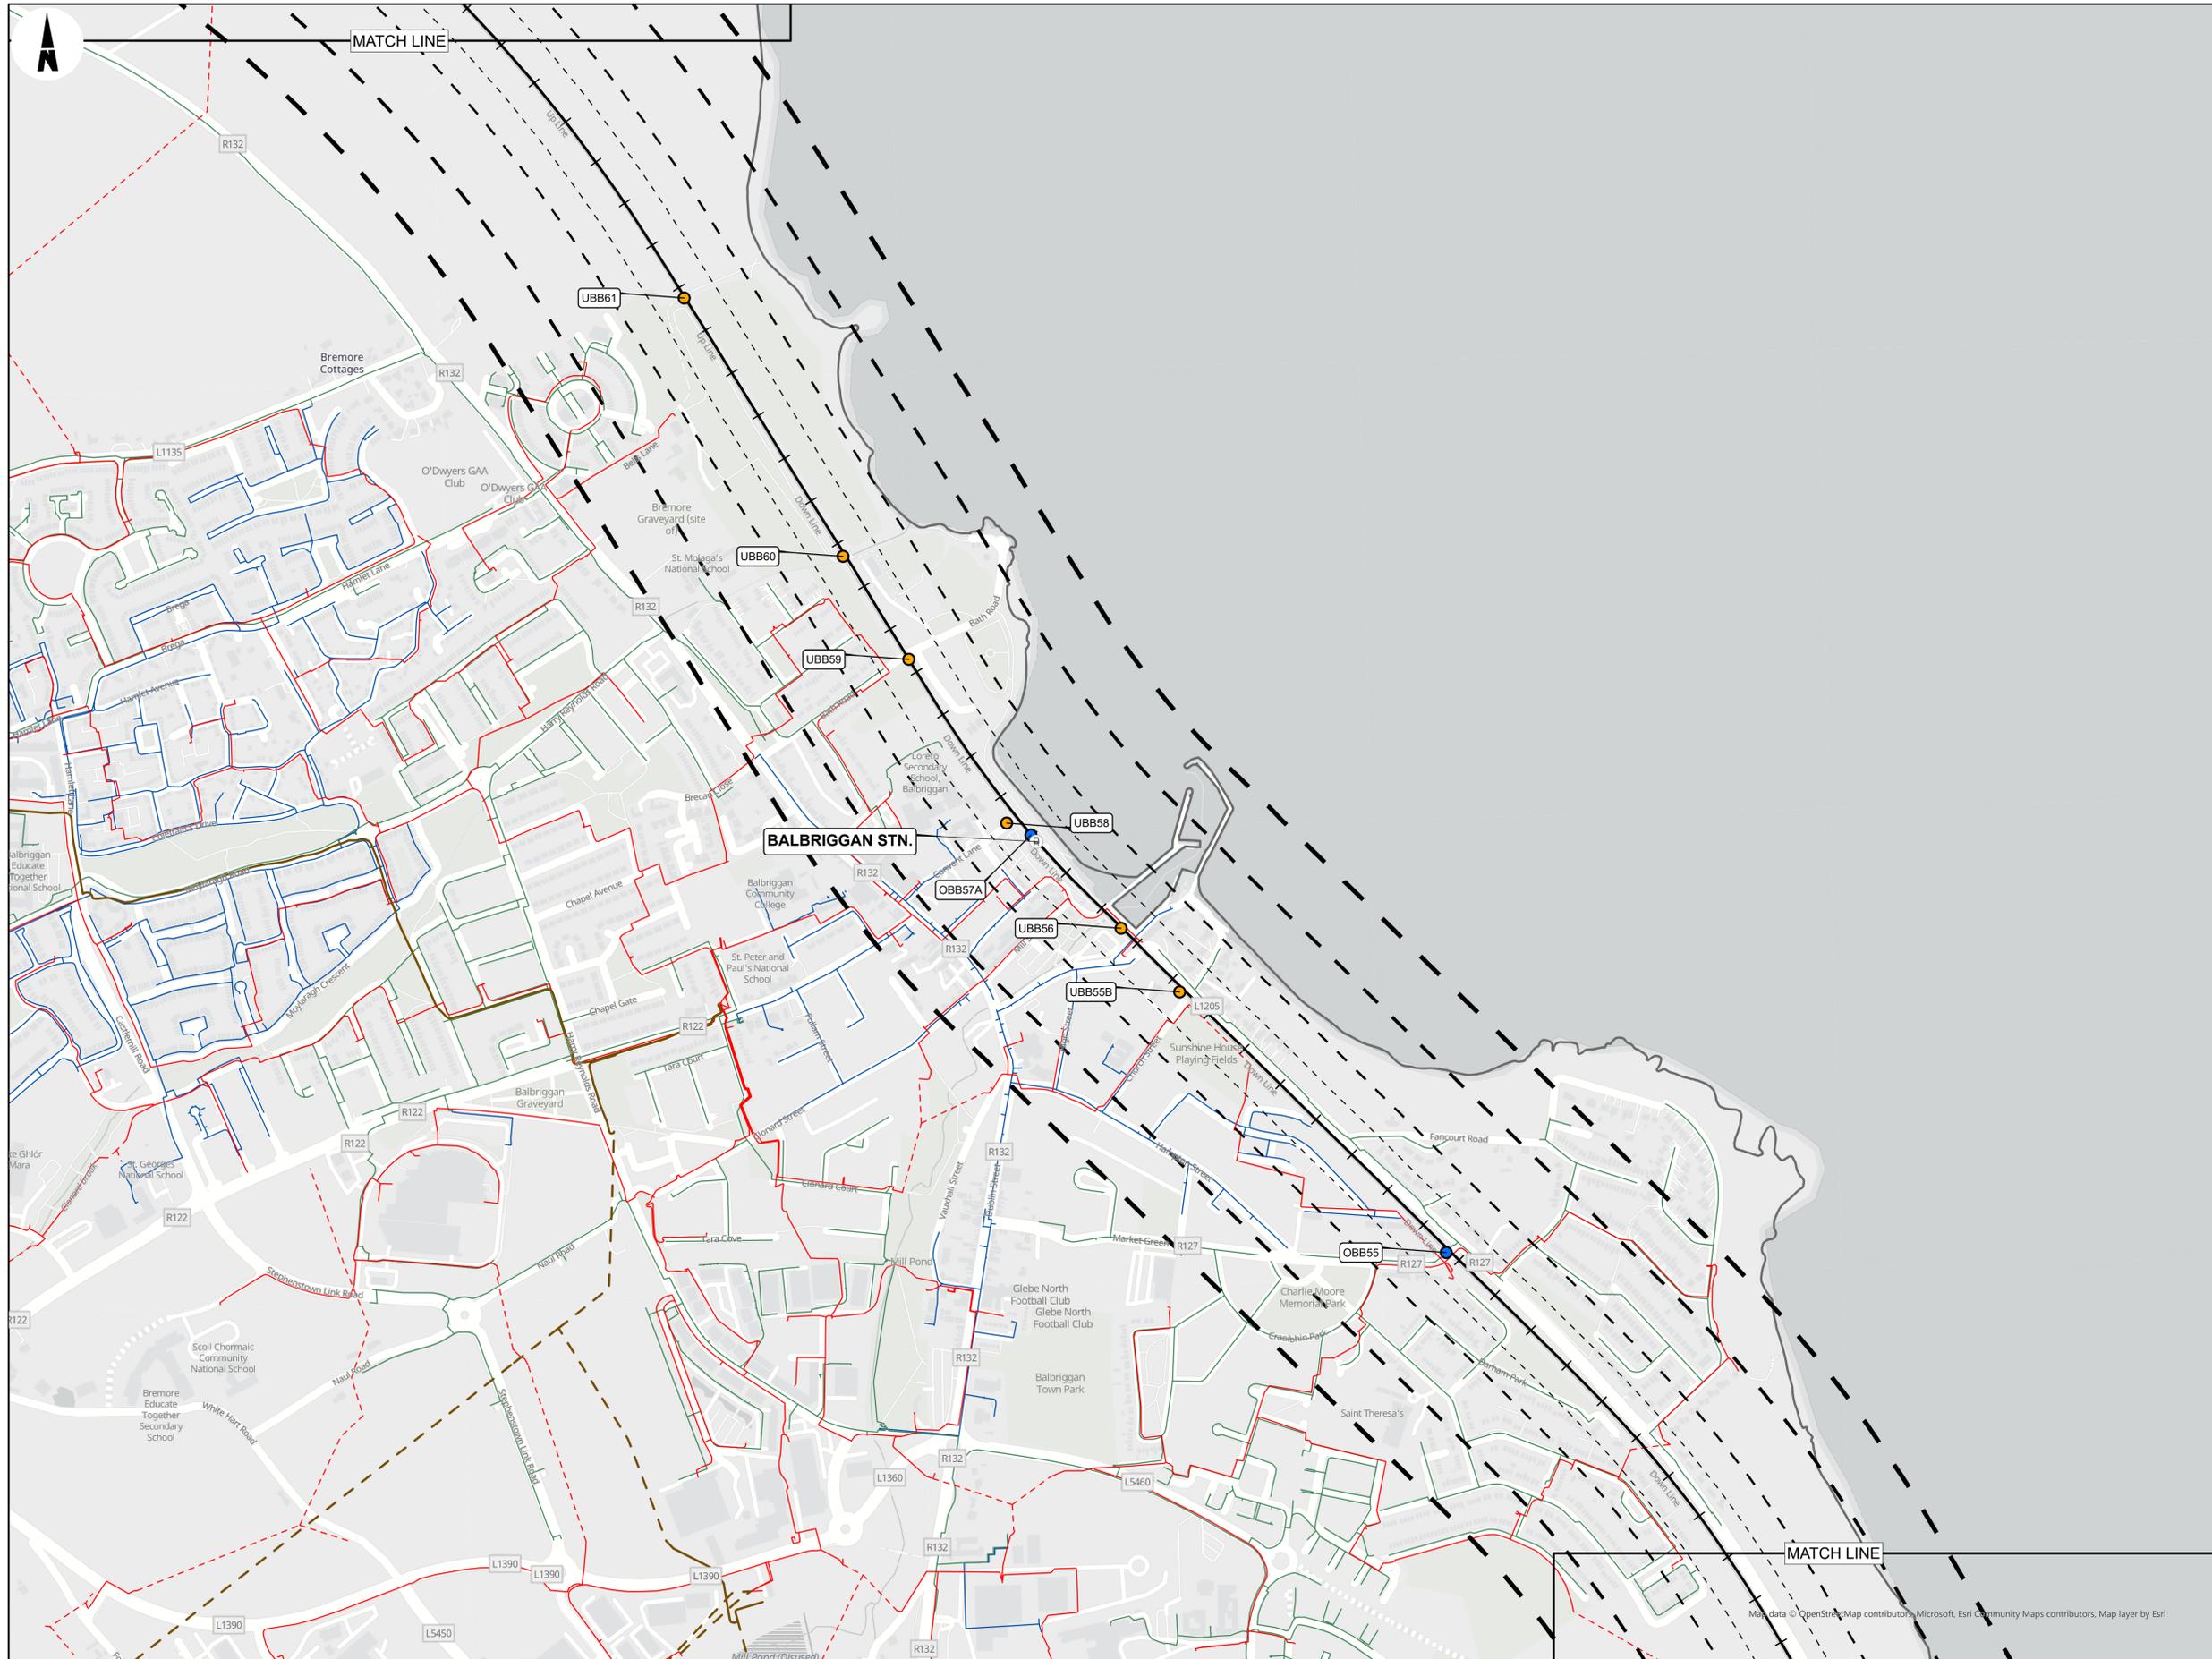

- LEGEND**
- RAILWAY STATIONS
  - BRIDGES
    - OVERBRIDGE
    - UNDERBRIDGE
  - RAILWAY LINE
  - BUFFERS
    - 60M
    - 100M
    - 200M
    - 300M
  - ADMINISTRATIVE BOUNDARY
  - COUNTY BOUNDARY
  - LICENCED FACILITIES
    - EPA LICENCED INDUSTRIAL EMISSIONS DIRECTIVE FACILITIES
    - EPA LICENCED WASTE FACILITIES
  - HIGH VOLTAGE NETWORK
    - ESB HV OH
    - ESB HV UG
  - MEDIUM VOLTAGE NETWORK
    - ESB MV OH
    - ESB MV UG
  - GAS NETWORKS IRELAND
    - MEDIUM PRESSURE NETWORK
    - LOW PRESSURE NETWORK

**ESB Data Disclaimer**  
 This map indicates the approximate location of ESB Networks Transmission (400kV, 220kV, 110kV, 38kV) and Distribution (20kV, 10kV, 230V/400V) underground cables and overhead lines in the general area of the proposed works. ESB Networks takes no responsibility for the accuracy or completeness of these maps. Low voltage (230V/400V) service cables (e.g. house services, factory/shop services, public lighting lamp services, etc.) are not included but their presence should be anticipated. The depths of underground cables must never be assumed. Additional more detailed information is available for high voltage Transmission underground cables (38kV, 110kV, 220kV, 400kV) for cables in the greater Dublin area call 01 6942857 and for all other areas call 1850 372 737. No work should be carried out in the vicinity of 38kV or higher voltage underground cables without prior consultation with ESB Networks. Before any mechanical excavation is undertaken, the actual location of all underground electricity cables must be established and verified on site, using: (a) Up-to-date map records; (b) Cable locator equipment operated in both power and radio modes; (c) Careful hand digging of trial holes using 'Safe Digging Practice'. Refer also to the 'HSA Code of Practice for Avoiding Danger from Underground Services'. ESB takes no responsibility and shall bear no liability in relation to any damage, injury/death or loss of supply as a result of damage or interference with its networks.

**GNI Data Disclaimer**  
 The information contained in this map concerning the location and technical designation of the gas distribution and transmission network (the 'Information') is provided 'as is' and no representation or warranty of any kind, express or implied, is made in relation to the Information and all such representations or warranties, express or implied, in relation to the Information are hereby excluded to the fullest extent permitted by law. No responsibility, liability or duty of care to you or to any other person in respect of the Information is accepted, and any reliance you or any other person places on the Information is therefore strictly at your own or at their own risk. In no event will liability be accepted for any loss or damage including, without limitation, indirect or consequential loss or damage, arising out of or in connection with the use of the Information. In the event that the Information is provided by you, in whole or in part, to a third party for whatever reason you shall ensure that the disclaimer is included with the Information and brought to the attention of the third party. The actual position of the gas distribution and transmission network must be verified on site before any mechanical excavating takes place. If any mechanical excavation is proposed, hard copy maps must be requested from Bord Gáis Éireann. All work in the vicinity of the gas distribution and transmission network must be completed in accordance with the current edition of the Health & Safety Authority publication, 'Code of Practice for Avoiding Danger From Underground Services' which is available from the Health and Safety Authority (1800 28 28 80) or can be downloaded free of charge at www.hsa.ie.

Copyright © Irish Rail (2021). This drawing is confidential and the copyright in it is owned by Irish Rail. This drawing must not be either loaned, copied or otherwise reproduced in whole or in part or used for any purpose without the prior permission of Irish Rail.  
 © OpenStreetMap contributors  
 © Ordnance Survey Ireland and Government of Ireland. All O.S. data used for plans are printed under "Copyright Ordnance Survey Ireland" Survey No. 0039720 (OSI Aerial Data or OSI Lidar Data) & Survey No. 2021/OSI/MMA\_180 (OSI Vector Data). All elevations are in metres and relate to OSI Geoid Model (OSGM02) Mean Head as defined by existing Project Control. All Co-ordinates are in Irish Transverse Mercator Grid (ITM) as defined by OSI active GPS station Tallaght College (TLG).

**Notes**  
 1. Information concerning the position of apparatus shown on this drawing is based on drawings supplied by the utility owners and/or the utility works contractor, whilst every care has been taken in the preparation of this drawing, positions should be taken as approximate and are intended for general guidance only and no representation is made by Irish Rail as to the accuracy, completeness, sufficiency or otherwise of this drawing and the position of the apparatus. The information contained herein does not purport to be comprehensive or final as the apparatus is subject to being altered and/or superseded. Recipients should not rely on this information. Any liabilities are hereby expressly disclaimed.  
 2. The information contained herein has been provided by Irish Rail but does not purport to be comprehensive or final. Recipients should not rely on the information. Neither Irish Rail nor any of its directors, officers, employees, agents, stakeholders or advisers make any representation or warranty as to or accept any liability or responsibility, in relation to, the adequacy, accuracy, reasonableness or completeness of the information provided as part of this document or any matter on which the information is based (including but not limited to loss or damage arising as a result of reliance by recipients on the information or any part of it). Any liabilities are hereby expressly dismissed.

Rev	Date	Dn	Chkd	App'd	Description
P01	30/09/2021	DM	SH	COD	
P02	11/10/2021	DM	SH	COD	
P03	10/12/2021	DM	SH	COD	

Client: **Irish Rail**

Date: 20/09/2021 | Scale: 1:5000 @ A1 | 1:10000 @ A3

Project Code: D-WP56 | Originator Code: ARP

Engineering Designer: **ARUP**

Drawn: DM | Checked: SH | Approved: COD



QMS Code: 279933-00

Project Title: **DART+ COASTAL NORTH**

Drawing Title: **THIRD PARTY UTILITIES AND LICENCED FACILITIES CONSTRAINTS OPEN STREET MAP BASEMAP**

Drawing File Name: D-WP56-ARP-ZZ-NL-OR-EV-001006

Sheet Number	Status	Rev
6 of 19	902	P03

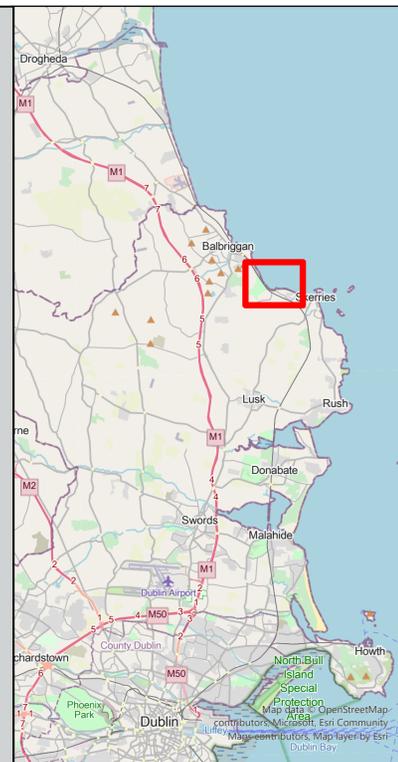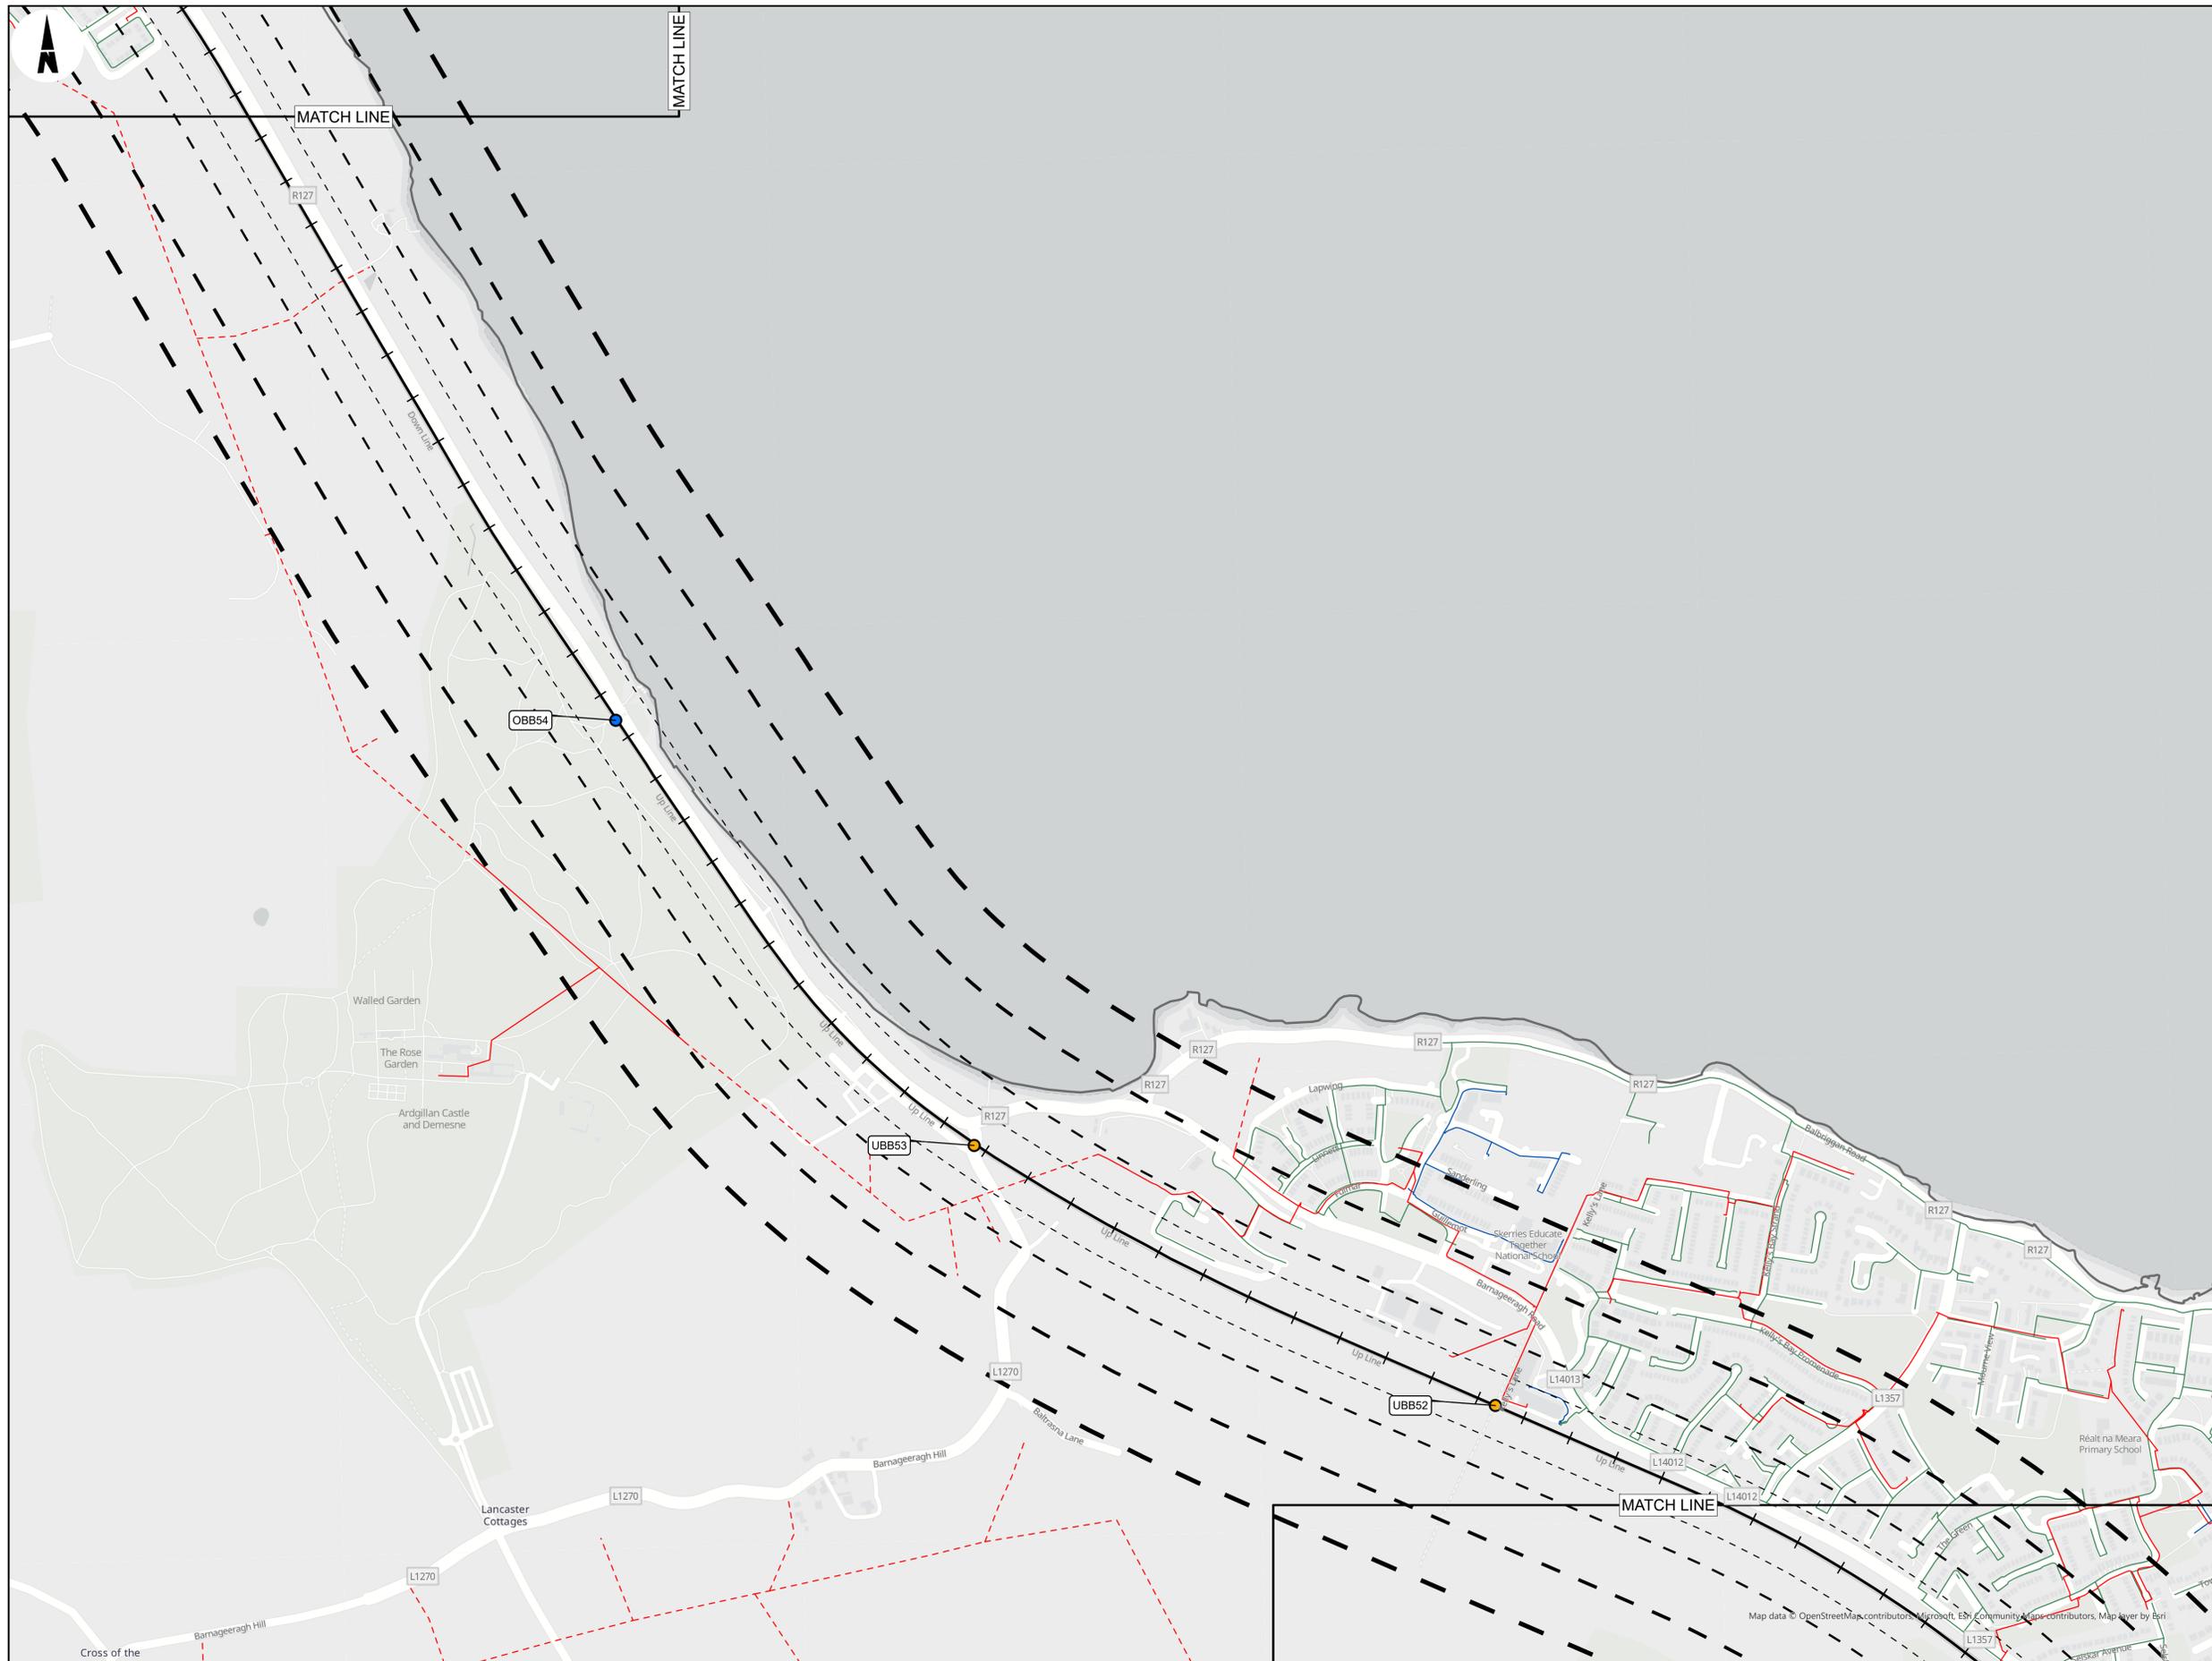

- LEGEND**
- RAILWAY STATIONS
  - BRIDGES**
    - OVERBRIDGE
    - UNDERBRIDGE
  - RAILWAY LINE
  - BUFFERS**
    - 60M
    - 100M
    - 200M
    - 300M
  - ADMINISTRATIVE BOUNDARY
  - COUNTY BOUNDARY
  - LICENCED FACILITIES**
    - EPA LICENCED INDUSTRIAL EMISSIONS DIRECTIVE FACILITIES
    - EPA LICENCED WASTE FACILITIES
  - ESB**
  - MEDIUM VOLTAGE NETWORK**
    - ESB MV OH
    - ESB MV UG
  - GAS NETWORKS IRELAND**
    - MEDIUM PRESSURE NETWORK
    - LOW PRESSURE NETWORK

**ESB Data Disclaimer**  
 This map indicates the approximate location of ESB Networks Transmission (400kV, 220kV, 110kV, 38kV) and Distribution (20kV, 10kV, 230V/400V) underground cables and overhead lines in the general area of the proposed works. ESB Networks takes no responsibility for the accuracy or completeness of these maps. Low voltage (230V/400V) service cables (e.g. house services, factory/shop services, public lighting lamp services, etc.) are not included but their presence should be anticipated. The depths of underground cables must never be assumed. Additional more detailed information is available for high voltage Transmission underground cables (38kV, 110kV, 220kV, 400kV) for cables in the greater Dublin area call 01 6942957 and for all other areas call 1850 372 737. No work should be carried out in the vicinity of 38kV or higher voltage underground cables without prior consultation with ESB Networks. Before any mechanical excavation is undertaken, the actual location of all underground electricity cables must be established and verified on site, using: (a) Up-to-date map records; (b) Cable locator equipment operated in both power and radio modes; (c) Careful hand digging of trial holes using 'Safe Digging Practice'. Refer also to the 'HSA Code of Practice for Avoiding Danger from Underground Services'. ESB takes no responsibility and shall bear no liability in relation to any damage, injury/death or loss of supply as a result of damage or interference with its networks.

**GNi Data Disclaimer**  
 The information contained in this map concerning the location and technical designation of the gas distribution and transmission network (the 'Information') is provided 'as is' and no representation or warranty of any kind, express or implied, is made in relation to the Information and all such representations or warranties, express or implied, in relation to the Information are hereby excluded to the fullest extent permitted by law. No responsibility, liability or duty of care to you or to any other person in respect of the Information is accepted, and any reliance you or any other person places on the Information is therefore strictly at your own or at their own risk. In no event will liability be accepted for any loss or damage including, without limitation, indirect or consequential loss or damage, arising out of or in connection with the use of the Information. In the event that the Information is provided by you, in whole or in part, to a third party for whatever reason you shall ensure that the disclaimer is included with the Information and brought to the attention of the third party. The actual position of the gas distribution and transmission network must be verified on site before any mechanical excavating takes place. If any mechanical excavation is proposed, hard copy maps must be requested from Bord Gáis Éireann. All work in the vicinity of the gas distribution and transmission network must be completed in accordance with the current edition of the Health & Safety Authority publication, 'Code of Practice for Avoiding Danger From Underground Services' which is available from the Health and Safety Authority (1850 28 38 89) or can be downloaded free of charge at www.hsa.ie.

Copyright © Irish Rail (2021). This drawing is confidential and the copyright in it is owned by Irish Rail. This drawing must not be either loaned, copied or otherwise reproduced in whole or in part or used for any purpose without the prior permission of Irish Rail.  
 © OpenStreetMap contributors  
 © Ordnance Survey Ireland and Government of Ireland. All O.S. data used for plans are printed under "Copyright Ordnance Survey Ireland" Survey No. 0039720 (OSI Aerial Data or OSI Lidar Data) & Survey No. 2021/OSI/MMA\_180 (OSI Vector Data). All elevations are in metres and relate to OSI Geoid Model (OSGM02) Malin Head as defined by existing Project Control. All Co-ordinates are in Irish Transverse Mercator Grid (ITM) as defined by OSI active GPS station Tallaght College (TLG).

**Notes**  
 1. Information concerning the position of apparatus shown on this drawing is based on drawings supplied by the utility owners and/or the utility works contractor, whilst every care has been taken in the preparation of this drawing, positions should be taken as approximate and are intended for general guidance only and no representation is made by Irish Rail as to the accuracy, completeness, sufficiency or otherwise of this drawing and the position of the apparatus. The information contained herein does not purport to be comprehensive or final as the apparatus is subject to being altered and/or superseded. Recipients should not rely on this information. Any liabilities are hereby expressly disclaimed.  
 2. The information contained herein has been provided by Irish Rail but does not purport to be comprehensive or final. Recipients should not rely on the information. Neither Irish Rail nor any of its directors, officers, employees, agents, stakeholders or advisers make any representation or warranty as to or accept any liability or responsibility, in relation to, the adequacy, accuracy, reasonableness or completeness of the information provided as part of this document or any matter on which the information is based (including but not limited to loss or damage arising as a result of reliance by recipients on the information or any part of it). Any liabilities are hereby expressly dismissed.

Rev	Date	Dn	Chkd	App'd	Description
P01	30/09/2021	DM	SH	COD	
P02	11/10/2021	DM	SH	COD	
P03	10/12/2021	DM	SH	COD	

Client: **Irish Rail**

Engineering Designer: **ARUP**

Date: 20/09/2021 Scale: 1:5000 @ A1, 1:10000 @ A3

Project Code: D-WP56 Originator Code: ARP

QMS Code: 279933-00

Drawn: DM, Checked: SH, Approved: COD

Project Title: **DART+ COASTAL NORTH**



Drawing Title: **THIRD PARTY UTILITIES AND LICENCED FACILITIES CONSTRAINTS OPEN STREET MAP BASEMAP**

Drawing File Name: D-WP56-ARP-ZZ-NL-DR-EV-001007

Sheet Number: 7 of 19

Status: 902

Rev: P03

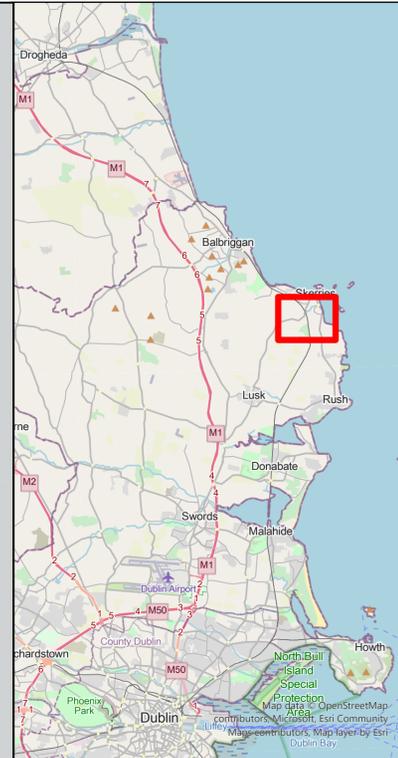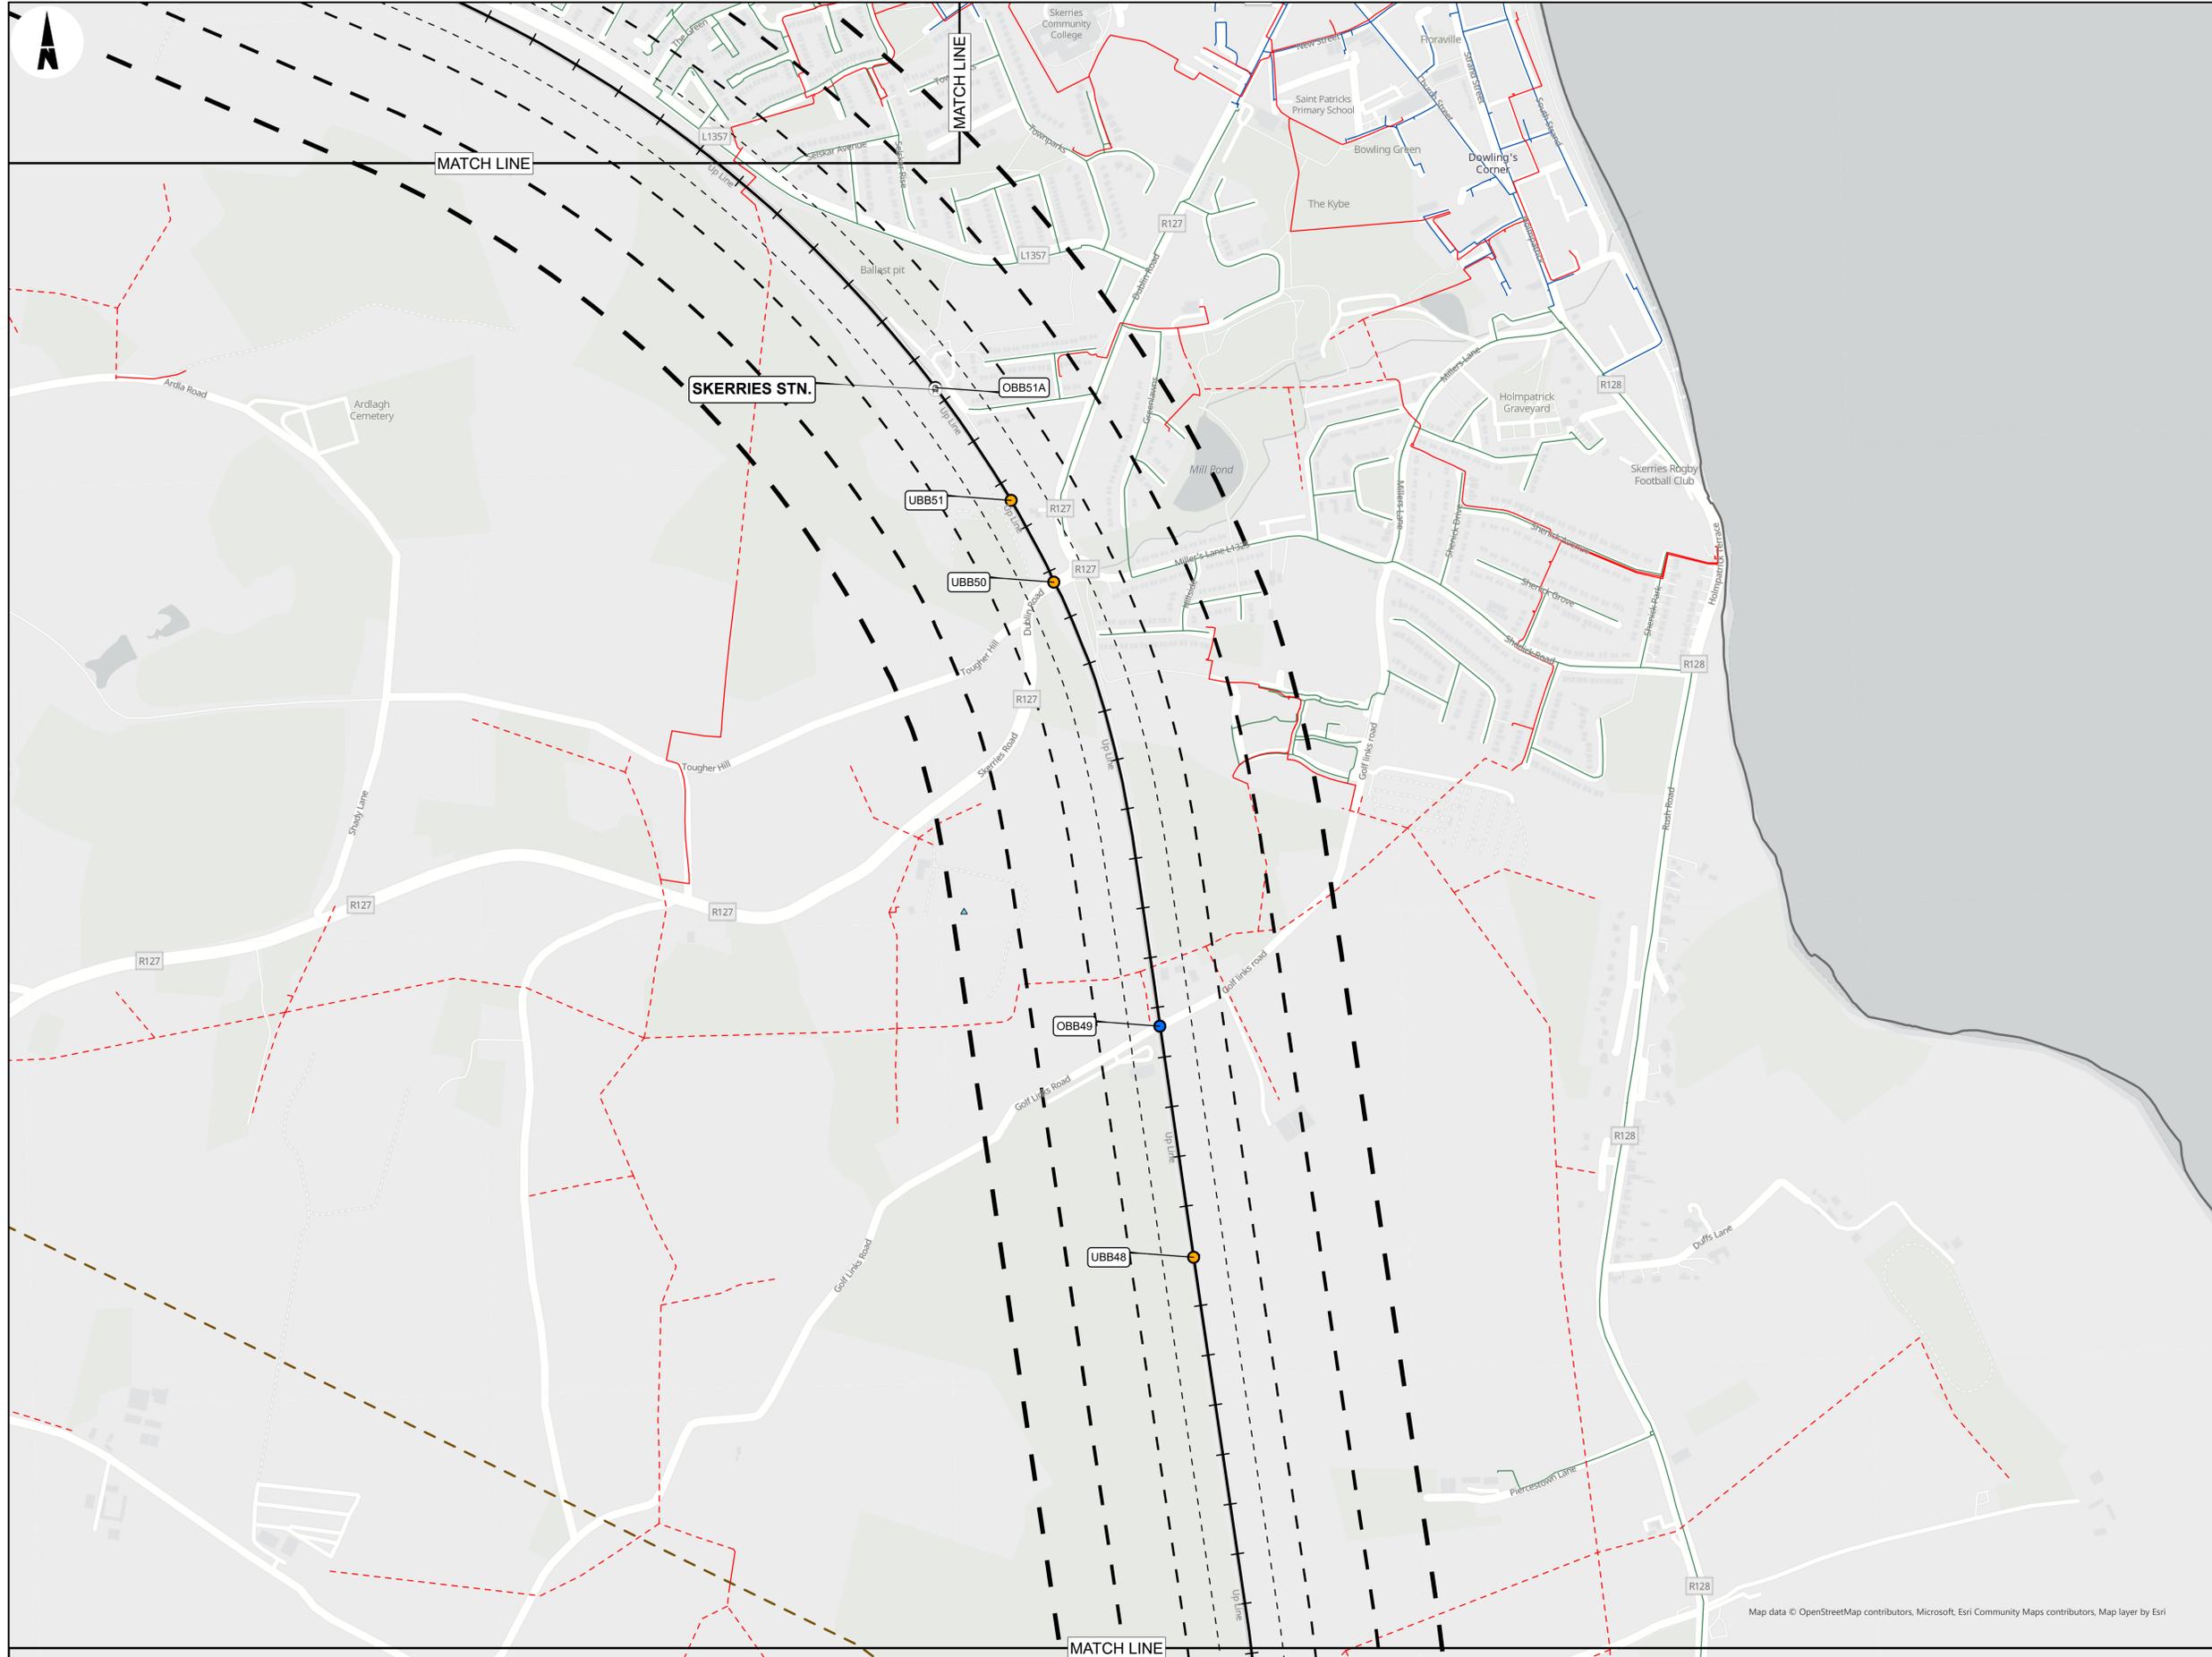

- LEGEND**
- RAILWAY STATIONS
  - BRIDGES
    - OVERBRIDGE
    - UNDERBRIDGE
  - RAILWAY LINE
  - BUFFERS
    - 60M
    - 100M
    - 200M
    - 300M
  - ADMINISTRATIVE BOUNDARY
  - COUNTY BOUNDARY
  - LICENCED FACILITIES
    - EPA LICENCED INDUSTRIAL EMISSIONS DIRECTIVE FACILITIES
    - EPA LICENCED WASTE FACILITIES
  - ESB
    - HIGH VOLTAGE NETWORK
      - ESB HV OH
    - MEDIUM VOLTAGE NETWORK
      - ESB MV OH
      - ESB MV UG
  - GAS NETWORKS IRELAND
    - MEDIUM PRESSURE NETWORK
    - LOW PRESSURE NETWORK

**ESB Data Disclaimer**  
 This map indicates the approximate location of ESB Networks Transmission (400kV, 220kV, 110kV, 38kV) and Distribution (20kV, 10kV, 230V/400V) underground cables and overhead lines in the general area of the proposed works. ESB Networks takes no responsibility for the accuracy or completeness of these maps. Low voltage (230V/400V) service cables (e.g. house services, factory/shop services, public lighting lamp services, etc.) are not included but their presence should be anticipated. The depths of underground cables must never be assumed. Additional more detailed information is available for high voltage Transmission underground cables (38kV, 110kV, 220kV, 400kV) for cables in the greater Dublin area call 01 6942957 and for all other areas call 1850 372 737. No work should be carried out in the vicinity of 38kV or higher voltage underground cables without prior consultation with ESB Networks. Before any mechanical excavation is undertaken, the actual location of all underground electricity cables must be established and verified on site, using: (a) Up-to-date map records; (b) Cable locator equipment operated in both power and radio modes; (c) Careful hand digging of trial holes using 'Safe Digging Practice'. Refer also to the 'HSA Code of Practice for Avoiding Danger from Underground Services'. ESB takes no responsibility and shall bear no liability in relation to any damage, injury/death or loss of supply as a result of damage or interference with its networks.

**GNI Data Disclaimer**  
 The information contained in this map concerning the location and technical designation of the gas distribution and transmission network (the 'Information') is provided 'as is' and no representation or warranty of any kind, express or implied, is made in relation to the Information and all such representations or warranties, express or implied, in relation to the Information are hereby excluded to the fullest extent permitted by law. No responsibility, liability or duty of care to you or to any other person in respect of the Information is accepted, and any reliance you or any other person places on the Information is therefore strictly at your own or at their own risk. In no event will liability be accepted for any loss or damage including, without limitation, indirect or consequential loss or damage, arising out of or in connection with the use of the Information. In the event that the Information is provided by you, in whole or in part, to a third party for whatever reason you shall ensure that the disclaimer is included with the Information and brought to the attention of the third party. The actual position of the gas distribution and transmission network must be verified on site before any mechanical excavating takes place. If any mechanical excavation is proposed, hard copy maps must be requested from Bord Gais Eireann. All work in the vicinity of the gas distribution and transmission network must be completed in accordance with the current edition of the Health & Safety Authority publication, 'Code of Practice for Avoiding Danger From Underground Services' which is available from the Health and Safety Authority (1866 28 38 80) or can be downloaded free of charge at www.hsa.ie.

Map data © OpenStreetMap contributors, Microsoft, Esri Community Maps contributors, Map layer by Esri

Copyright © Irish Rail (2021). This drawing is confidential and the copyright in it is owned by Irish Rail. This drawing must not be either loaned, copied or otherwise reproduced in whole or in part or used for any purpose without the prior permission of Irish Rail.

© OpenStreetMap contributors

© Ordnance Survey Ireland and Government of Ireland. All O.S. data used for plans are printed under "Copyright Ordnance Survey Ireland" Survey No. 0039720 (OSI Aerial Data or OSI Lidar Data) & Survey No. 202105; MMA, 180 (OSI Vector Data). All elevations are in metres and relate to OSI Geoid Model (OSGM02) Malin Head as defined by existing Project Control. All Co-ordinates are in Irish Transverse Mercator Grid (ITM) as defined by OSI active GPS station Tallaght College (TLG).

**Notes**

- Information concerning the position of apparatus shown on this drawing is based on drawings supplied by the utility owners and/or the utility works contractor, whilst every care has been taken in the preparation of this drawing, positions should be taken as approximate and are intended for general guidance only and no representation is made by Irish Rail as to the accuracy, completeness, sufficiency or otherwise of this drawing and the position of the apparatus. The information contained herein does not purport to be comprehensive or final as the apparatus is subject to being altered and/or superseded. Recipients should not rely on this information. Any liabilities are hereby expressly disclaimed.
- The information contained herein has been provided by Irish Rail but does not purport to be comprehensive or final. Recipients should not rely on the information. Neither Irish Rail nor any of its directors, officers, employees, agents, stakeholders or advisers make any representation or warranty as to or accept any liability or responsibility, in relation to, the adequacy, accuracy, reasonableness or completeness of the information provided as part of this document or any matter on which the information is based (including but not limited to loss or damage arising as a result of reliance by recipients on the information or any part of it). Any liabilities are hereby expressly dismissed.



Rev	Date	Dn	Chkd	App'd	Description
P01	30/09/2021	DM	SH	COD	
P02	11/10/2021	DM	SH	COD	
P03	10/12/2021	DM	SH	COD	

Client: **larnród Éireann Irish Rail**

Engineering Designer: **ARUP**

Date: 20/09/2021 | Scale: 1:5000 @ A1 | 1:10000 @ A3

Project Code: D+WP56 | Originator Code: ARP | OMS Code: 279933-00



Drawn: DM | Checked: SH | Approved: COD

Project Title: **DART+ COASTAL NORTH**

Drawing Title: **CONSTRAINTS REPORT  
THIRD PARTY UTILITIES AND LICENCED FACILITIES CONSTRAINTS  
OPEN STREET MAP BASEMAP**

Drawing File Name: D+WP56-ARP-ZZ-LNR-EV-001008

Sheet Number	Status	Rev
8 of 19	902	P03

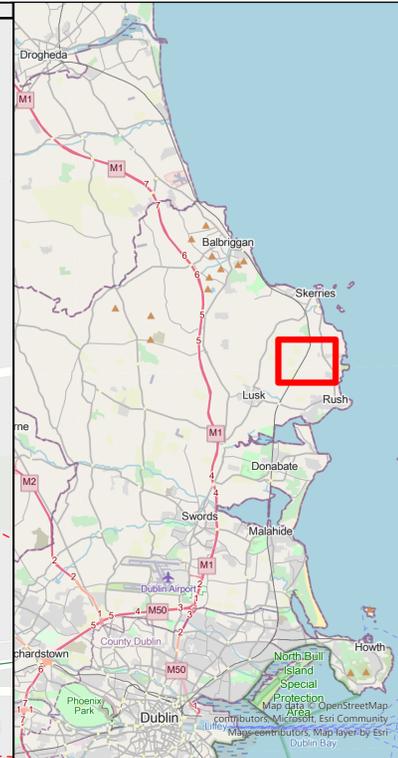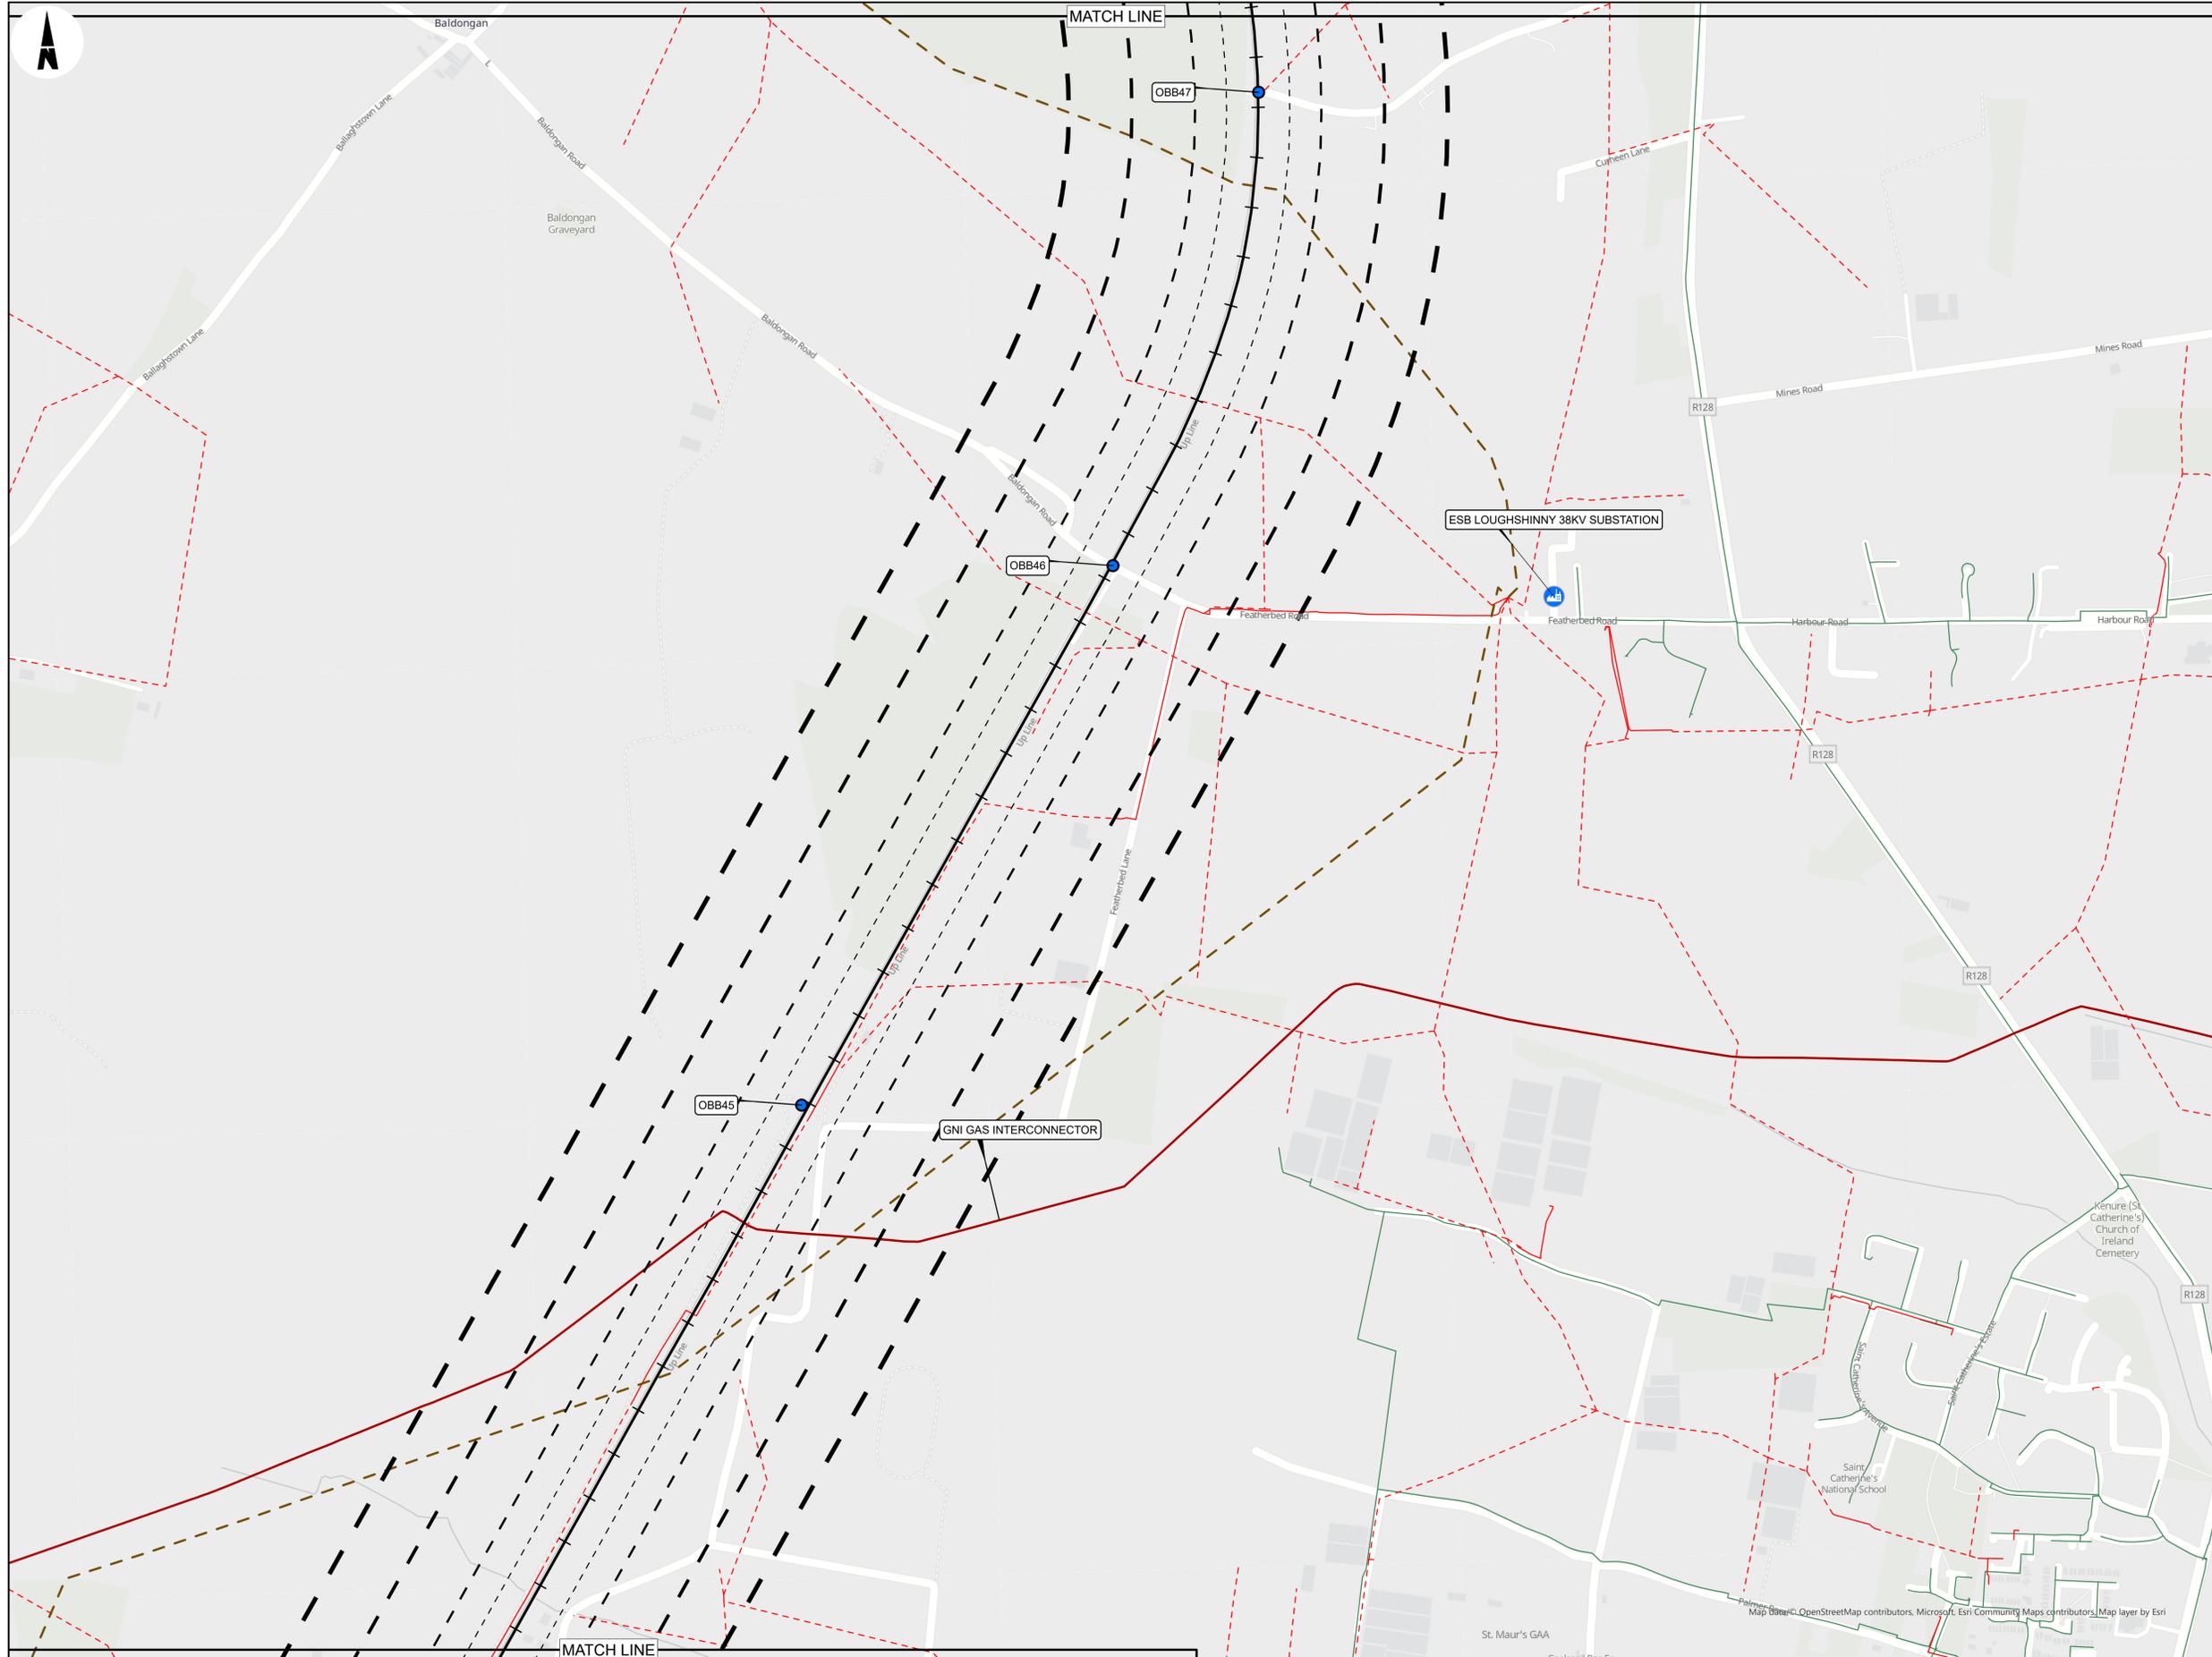

- LEGEND**
- RAILWAY STATIONS
  - BRIDGES
    - OVERBRIDGE
    - UNDERBRIDGE
  - RAILWAY LINE
  - BUFFERS
    - 50M
    - 100M
    - 200M
    - 300M
  - ADMINISTRATIVE BOUNDARY
  - COUNTY BOUNDARY
  - LICENCED FACILITIES
    - EPA LICENCED INDUSTRIAL EMISSIONS DIRECTIVE FACILITIES
    - EPA LICENCED WASTE FACILITIES
  - ESB
    - ESB HV OH
    - ESB MV OH
    - ESB MV UG
  - GAS NETWORKS IRELAND
    - HIGH PRESSURE NETWORK
    - MEDIUM PRESSURE NETWORK

**ESB Data Disclaimer**  
 This map indicates the approximate location of ESB Networks Transmission (400kV, 220kV, 110kV, 38kV) and Distribution (20kV, 10kV, 230V/400V) underground cables and overhead lines in the general area of the proposed works. ESB Networks takes no responsibility for the accuracy or completeness of these maps. Low voltage (230V/400V) service cables (e.g. house services, factory/shop services, public lighting lamp services, etc.) are not included but their presence should be anticipated. The depths of underground cables must never be assumed. Additional more detailed information is available for high voltage Transmission underground cables (38kV, 110kV, 220kV, 400kV) for cables in the greater Dublin area call 01 6942957 and for all other areas call 1850 372 737. No work should be carried out in the vicinity of 38kV or higher voltage underground cables without prior consultation with ESB Networks. Before any mechanical excavation is undertaken, the actual location of all underground electricity cables must be established and verified on site, using: (a) Up-to-date map records; (b) Cable locator equipment operated in both power and radio modes; (c) Careful hand digging of trial holes using 'Safe Digging Practice'. Refer also to the 'HSA Code of Practice for Avoiding Danger from Underground Services'. ESB takes no responsibility and shall bear no liability in relation to any damage, injury/death or loss of supply as a result of damage or interference with its networks.

**GNI Data Disclaimer**  
 The information contained in this map concerning the location and technical designation of the gas distribution and transmission network (the 'Information') is provided 'as is' and no representation or warranty of any kind, express or implied, is made in relation to the Information and all such representations or warranties, express or implied, in relation to the Information are hereby excluded to the fullest extent permitted by law. No responsibility, liability or duty of care to you or to any other person in respect of the Information is accepted, and any reliance you or any other person places on the Information is therefore strictly at your own or at their own risk. In no event will liability be accepted for any loss or damage including, without limitation, indirect or consequential loss or damage, arising out of or in connection with the use of the Information. In the event that the Information is provided by you, in whole or in part, to a third party for whatever reason you shall ensure that the disclaimer is included with the Information and brought to the attention of the third party. The actual position of the gas distribution and transmission network must be verified on site before any mechanical excavating takes place. If any mechanical excavation is proposed, hard copy maps must be requested from Bord Gais Eireann. All work in the vicinity of the gas distribution and transmission network must be completed in accordance with the current edition of the Health & Safety Authority publication, 'Code of Practice for Avoiding Danger From Underground Services' which is available from the Health and Safety Authority (1850 28 28 80) or can be downloaded free of charge at www.hsa.ie.

Copyright © Irish Rail (2021). This drawing is confidential and the copyright in it is owned by Irish Rail. This drawing must not be either loaned, copied or otherwise reproduced in whole or in part or used for any purpose without the prior permission of Irish Rail.

© Ordnance Survey Ireland and Government of Ireland. All O.S. data used for plans are printed under "Copyright Ordnance Survey Ireland" Survey No. 0039720 (OSI Aerial Data or OSI Lidar Data) & Survey No. 2021/OSI/MMA\_180 (OSI Vector Data). All elevations are in metres and relate to OSI Geoid Model (OSGM02) Malin Head as defined by existing Project Control. All Co-ordinates are in Irish Transverse Mercator Grid (ITM) as defined by OSI active GPS station Tallaght College (TLTG).

**Notes**

- Information concerning the position of apparatus shown on this drawing is based on drawings supplied by the utility owners and/or the utility works contractor, whilst every care has been taken in the preparation of this drawing, positions should be taken as approximate and are intended for general guidance only and no representation is made by Irish Rail as to the accuracy, completeness, sufficiency or otherwise of this drawing and the position of the apparatus. The information contained herein does not purport to be comprehensive or final as the apparatus is subject to being altered and/or superseded. Recipients should not rely on this information. Any liabilities are hereby expressly disclaimed.
- The information contained herein has been provided by Irish Rail but does not purport to be comprehensive or final. Recipients should not rely on the information. Neither Irish Rail nor any of its directors, officers, employees, agents, stakeholders or advisers make any representation or warranty as to or accept any liability or responsibility, in relation to, the adequacy, accuracy, reasonableness or completeness of the information provided as part of this document or any matter on which the information is based (including but not limited to loss or damage arising as a result of reliance by recipients on the information or any part of it). Any liabilities are hereby expressly dismissed.

**DART+ Coastal North**

**NTA**  
 Údarás Náisiúnta Iompartha  
 National Transport Authority

**Tionscadal Éireann Project Ireland 2040**

Rev	Date	Dn	Chkd	App'd	Description
P01	30/09/2021	DM	SH	COD	
P02	11/10/2021	DM	SH	COD	
P03	10/12/2021	DM	SH	COD	

Client: **larnród Éireann Irish Rail**

Engineering Designer: **ARUP**

Date: 20/09/2021 Scale: 1:5000 @ A1 1:10000 @ A3

Project Code: D+WP56 Originator Code: ARP

Drawn: DM Checked: SH Approved: COD

OMS Code: 279933-00

Project Title: **DART+ COASTAL NORTH**



Drawing Title: **THIRD PARTY UTILITIES AND LICENCED FACILITIES CONSTRAINTS OPEN STREET MAP BASEMAP**

Drawing File Name: D+WP56-ARP-ZZ-NL-OR-EV-001009

Sheet Number: 9 of 19

Status: 902

Rev: P03

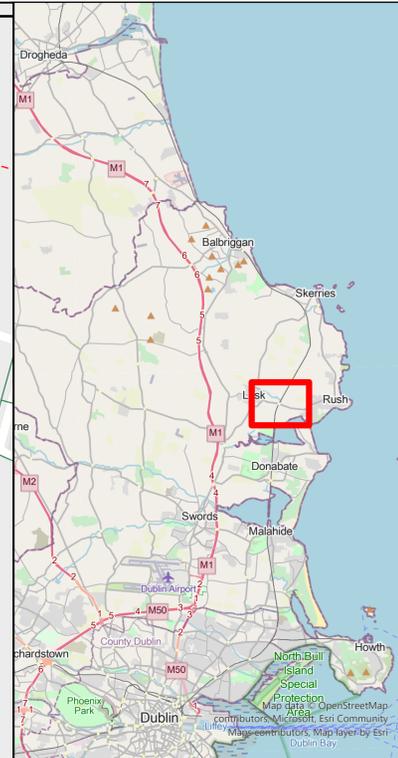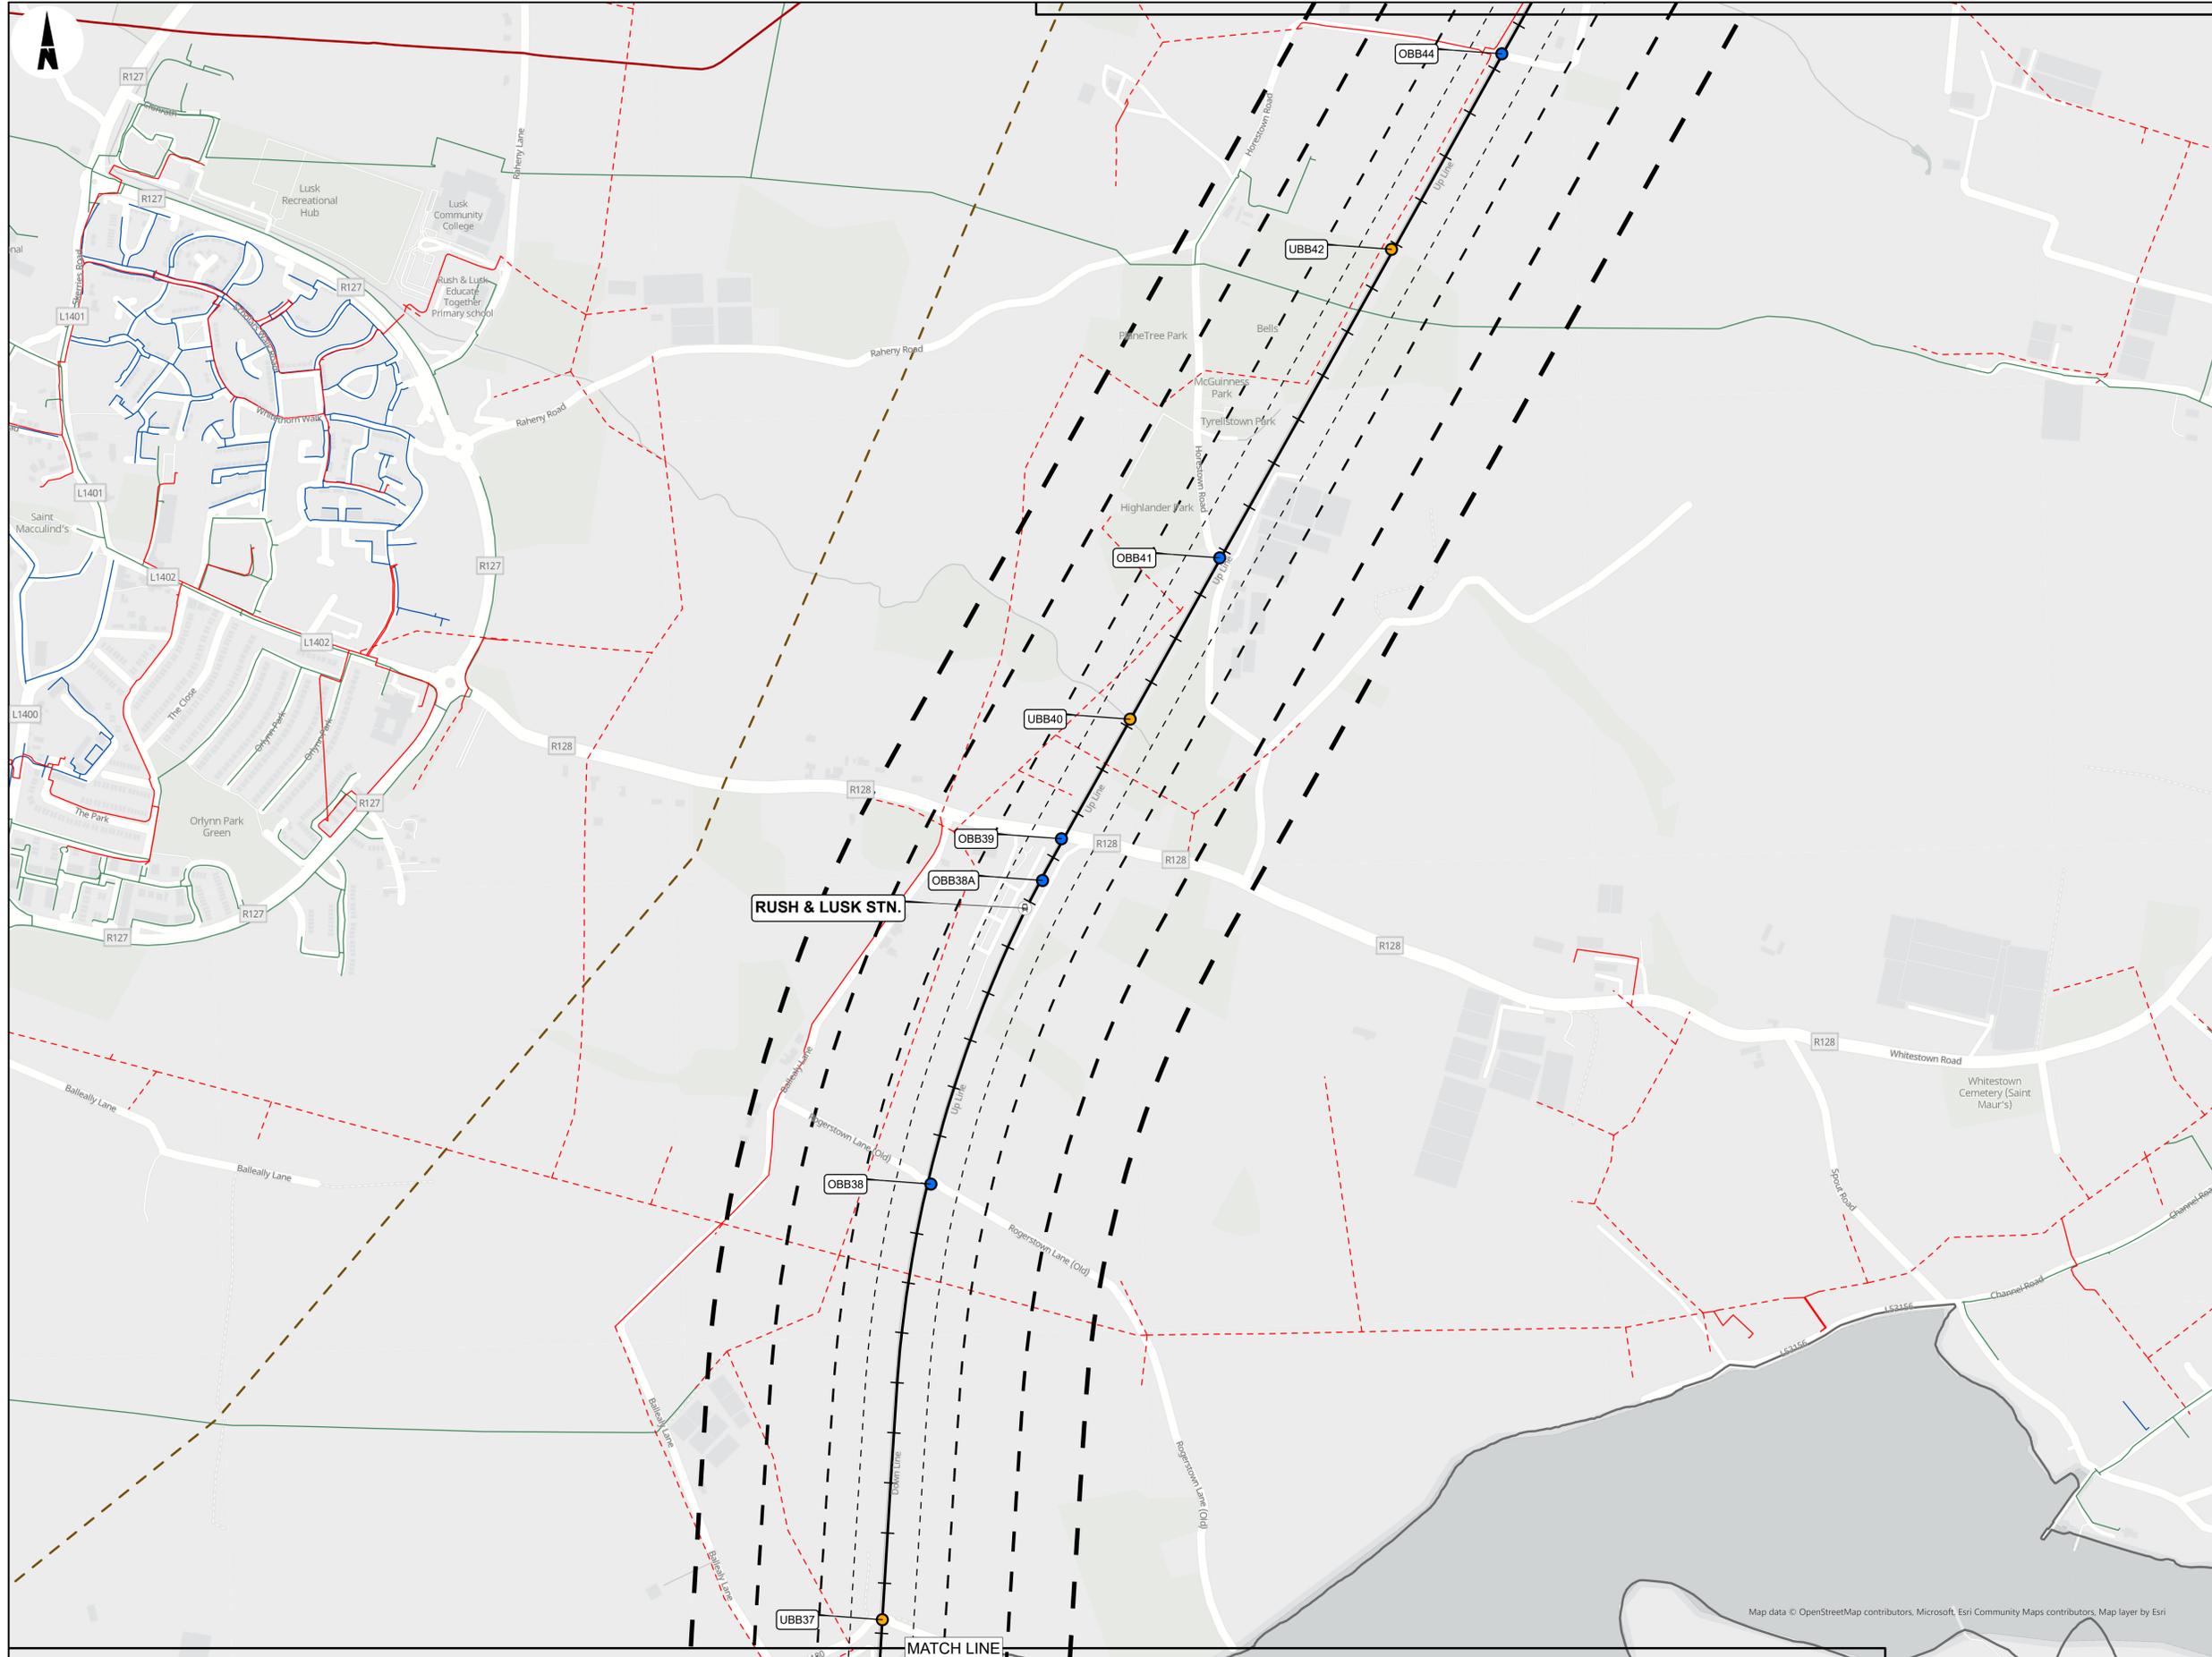

**LEGEND**

- RAILWAY STATIONS
- BRIDGES
  - OVERBRIDGE
  - UNDERBRIDGE
- RAILWAY LINE
- BUFFERS
  - 60M
  - 100M
  - 200M
  - 300M
- ADMINISTRATIVE BOUNDARY
- COUNTY BOUNDARY
- LICENCED FACILITIES
  - EPA LICENCED INDUSTRIAL EMISSIONS DIRECTIVE FACILITIES
  - EPA LICENCED WASTE FACILITIES
- ESB
  - HIGH VOLTAGE NETWORK
    - ESB HV OH
  - MEDIUM VOLTAGE NETWORK
    - ESB MV OH
    - ESB MV UG
  - GAS NETWORKS IRELAND
    - HIGH PRESSURE NETWORK
    - MEDIUM PRESSURE NETWORK
    - LOW PRESSURE NETWORK

**ESB Data Disclaimer**  
 This map indicates the approximate location of ESB Networks Transmission (400kV, 220kV, 110kV, 38kV) and Distribution (20kV, 10kV, 230V/400V) underground cables and overhead lines in the general area of the proposed works. ESB Networks takes no responsibility for the accuracy or completeness of these maps. Low voltage (230V/400V) service cables (e.g. house services, factory/shop services, public lighting lamp services, etc.) are not included but their presence should be anticipated. The depths of underground cables must never be assumed. Additional more detailed information is available for high voltage Transmission underground cables (38kV, 110kV, 220kV, 400kV) for cables in the greater Dublin area call 01 6942957 and for all other areas call 1850 372 737. No work should be carried out in the vicinity of 38kV or higher voltage underground cables without prior consultation with ESB Networks. Before any mechanical excavation is undertaken, the actual location of all underground electricity cables must be established and verified on site, using: (a) Up-to-date map records; (b) Cable locator equipment operated in both power and radio modes; (c) Careful hand digging of trial holes using 'Safe Digging Practice'. Refer also to the 'HSA Code of Practice for Avoiding Danger from Underground Services'. ESB takes no responsibility and shall bear no liability in relation to any damage, injury/death or loss of supply as a result of damage or interference with its networks.

**GNI Data Disclaimer**  
 The information contained in this map concerning the location and technical designation of the gas distribution and transmission network (the 'Information') is provided 'as is' and no representation or warranty of any kind, express or implied, is made in relation to the Information and all such representations or warranties, express or implied, in relation to the Information are hereby excluded to the fullest extent permitted by law. No responsibility, liability or duty of care to you or to any other person in respect of the Information is accepted, and any reliance you or any other person places on the Information is therefore strictly at your own or at their own risk. In no event will liability be accepted for any loss or damage including, without limitation, indirect or consequential loss or damage, arising out of or in connection with the use of the Information. In the event that the Information is provided by you, in whole or in part, to a third party for whatever reason you shall ensure that the disclaimer is included with the Information and brought to the attention of the third party. The actual position of the gas distribution and transmission network must be verified on site before any mechanical excavating takes place. If any mechanical excavation is proposed, hard copy maps must be requested from Bort Gais Éireann. All work in the vicinity of the gas distribution and transmission network must be completed in accordance with the current edition of the Health & Safety Authority publication, 'Code of Practice for Avoiding Danger From Underground Services' which is available from the Health and Safety Authority (1 866 28 38 89) or can be downloaded free of charge at www.hsa.ie.

Map data © OpenStreetMap contributors, Microsoft, Esri Community Maps contributors, Map layer by Esri

Copyright © Irish Rail (2021). This drawing is confidential and the copyright in it is owned by Irish Rail. This drawing must not be either loaned, copied or otherwise reproduced in whole or in part or used for any purpose without the prior permission of Irish Rail.

© OpenStreetMap contributors

© Ordnance Survey Ireland and Government of Ireland. All O.S. data used for plans are printed under "Copyright Ordnance Survey Ireland" Survey No. 0039720 (OSI Aerial Data or OSI Lidar Data) & Survey No. 2021/OSI/MMA\_180 (OSI Vector Data). All elevations are in metres and relate to OSI Geoid Model (OSGM02) Mean Head as defined by existing Project Control. All Co-ordinates are in Irish Transverse Mercator Grid (ITM) as defined by OSI active GPS station Tallaght College (TLG).

**Notes**

- Information concerning the position of apparatus shown on this drawing is based on drawings supplied by the utility owners and/or the utility works contractor, whilst every care has been taken in the preparation of this drawing, positions should be taken as approximate and are intended for general guidance only and no representation is made by Irish Rail as to the accuracy, completeness, sufficiency or otherwise of this drawing and the position of the apparatus. The information contained herein does not purport to be comprehensive or final as the apparatus is subject to being altered and/or superseded. Recipients should not rely on this information. Any liabilities are hereby expressly disclaimed.
- The information contained herein has been provided by Irish Rail but does not purport to be comprehensive or final. Recipients should not rely on the information. Neither Irish Rail nor any of its directors, officers, employees, agents, stakeholders or advisers make any representation or warranty as to or accept any liability or responsibility, in relation to, the adequacy, accuracy, reasonableness or completeness of the information provided as part of this document or any matter on which the information is based (including but not limited to loss or damage arising as a result of reliance by recipients on the information or any part of it). Any liabilities are hereby expressly dismissed.

**DART+ Coastal North**

**NTA**  
 Údarás Náisiúnta Iompartha  
 National Transport Authority

**Tionscadal Éireann**  
 Project Ireland  
**2040**

Rev	Date	Drn	Chk'd	App'd	Description
P01	30/09/2021	DM	SH	COD	
P02	11/10/2021	DM	SH	COD	
P03	10/12/2021	DM	SH	COD	

Client: **Irish Rail**

Engineering Designer: **ARUP**

Date: 20/09/2021 Scale: 1:5000 @ A1 1:10000 @ A3

Project Code: D+WP56 Originator Code: ARP OMS Code: 279933-00



Drawn: DM Checked: SH Approved: COD

Project Title: **DART+ COASTAL NORTH**

Drawing Title: **THIRD PARTY UTILITIES AND LICENCED FACILITIES CONSTRAINTS OPEN STREET MAP BASEMAP**

Drawing File Name: D+WP56-ARP-ZZ-NL-OR-EV-001010

Sheet Number: 10 of 19 Status: 902 Rev: P03

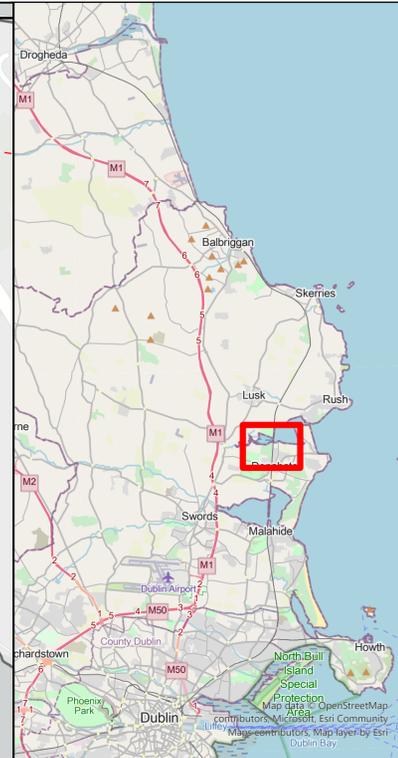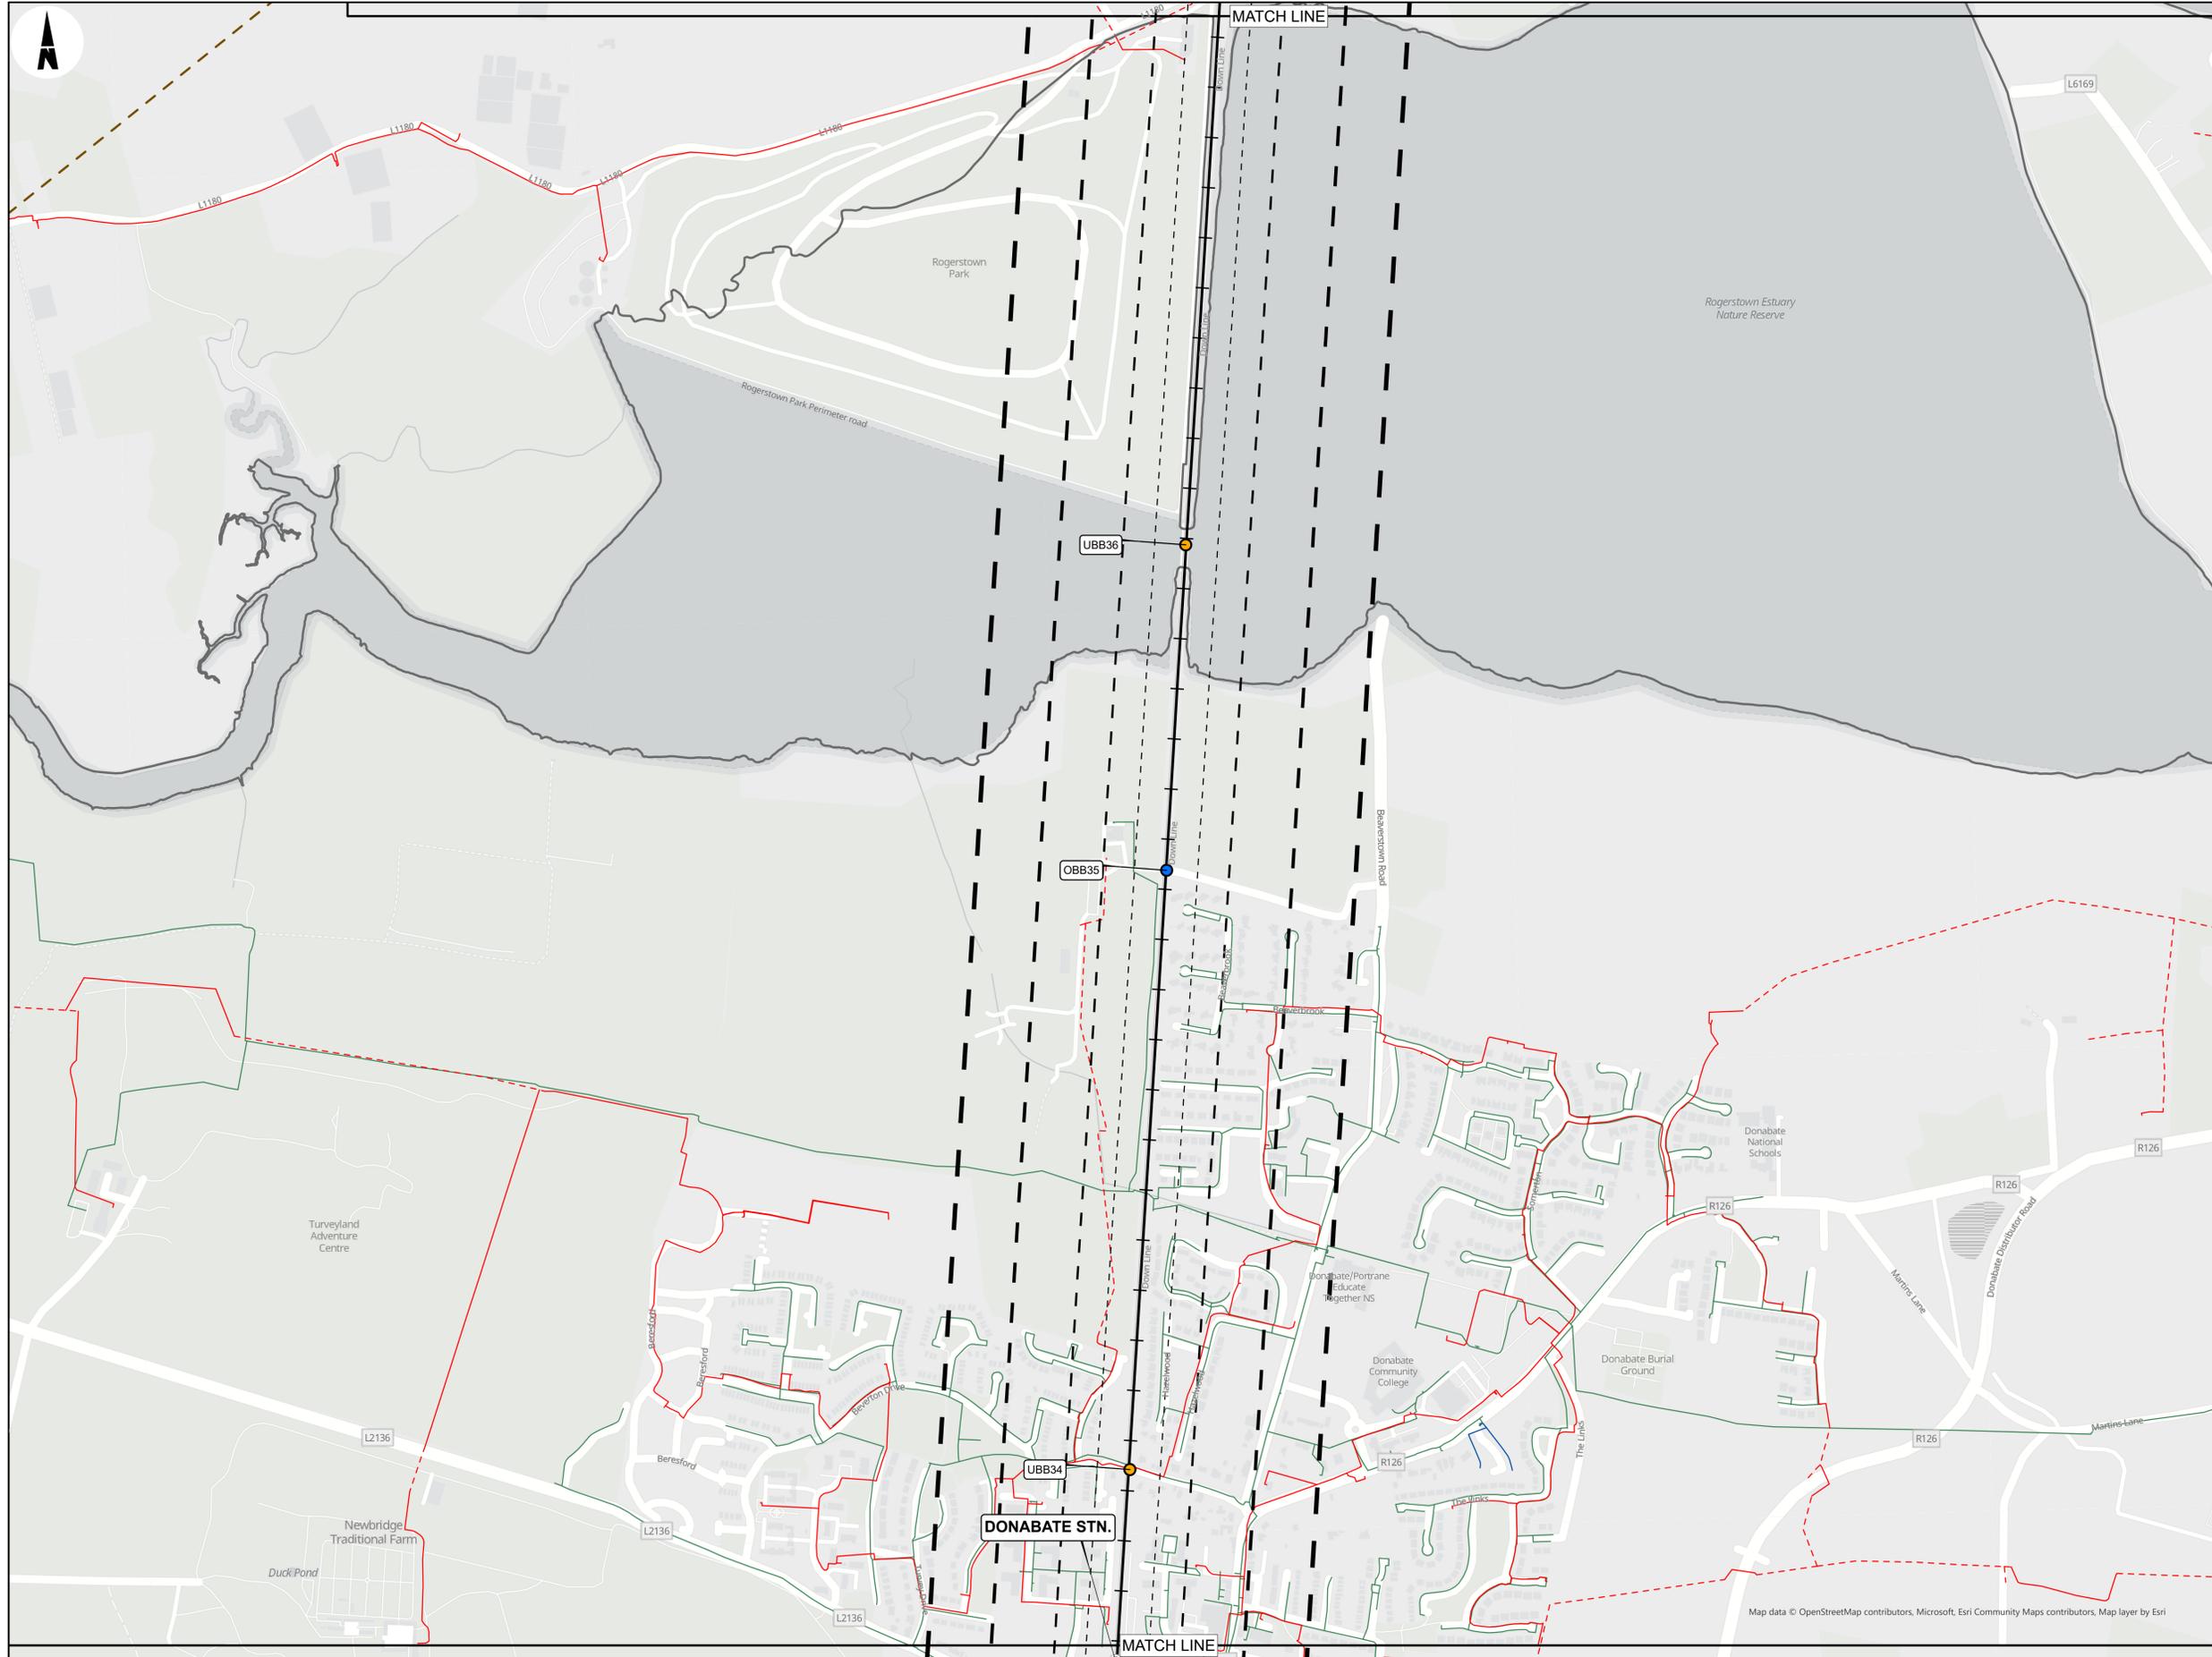

- LEGEND**
- RAILWAY STATIONS
  - BRIDGES
    - OVERBRIDGE
    - UNDERBRIDGE
  - RAILWAY LINE
  - BUFFERS
    - 60M
    - 100M
    - 200M
    - 300M
  - ADMINISTRATIVE BOUNDARY
  - COUNTY BOUNDARY
  - LICENCED FACILITIES
    - EPA LICENCED INDUSTRIAL EMISSIONS DIRECTIVE FACILITIES
    - EPA LICENCED WASTE FACILITIES
  - ESB
    - HIGH VOLTAGE NETWORK
      - ESB HV OH
    - MEDIUM VOLTAGE NETWORK
      - ESB MV OH
      - ESB MV UG
  - GAS NETWORKS IRELAND
    - MEDIUM PRESSURE NETWORK
    - LOW PRESSURE NETWORK

**ESB Data Disclaimer**  
 This map indicates the approximate location of ESB Networks Transmission (400kV, 220kV, 110kV, 38kV) and Distribution (20kV, 10kV, 230V/400V) underground cables and overhead lines in the general area of the proposed works. ESB Networks takes no responsibility for the accuracy or completeness of these maps. Low voltage (230V/400V) service cables (e.g. house services, factory/shop services, public lighting lamp services, etc.) are not included but their presence should be anticipated. The depths of underground cables must never be assumed. Additional more detailed information is available for high voltage Transmission underground cables (38kV, 110kV, 220kV, 400kV) for cables in the greater Dublin area call 01 6942957 and for all other areas call 1850 372 737. No work should be carried out in the vicinity of 38kV or higher voltage underground cables without prior consultation with ESB Networks. Before any mechanical excavation is undertaken, the actual location of all underground electricity cables must be established and verified on site, using: (a) Up-to-date map records; (b) Cable locator equipment operated in both power and radio modes; (c) Careful hand digging of trial holes using 'Safe Digging Practice'. Refer also to the 'HSA Code of Practice for Avoiding Danger from Underground Services'. ESB takes no responsibility and shall bear no liability in relation to any damage, injury/death or loss of supply as a result of damage or interference with its networks.

**GNi Data Disclaimer**  
 The information contained in this map concerning the location and technical designation of the gas distribution and transmission network (the 'Information') is provided 'as is' and no representation or warranty of any kind, express or implied, is made in relation to the Information and all such representations or warranties, express or implied, in relation to the Information are hereby excluded to the fullest extent permitted by law. No responsibility, liability or duty of care to you or to any other person in respect of the Information is accepted, and any reliance you or any other person places on the Information is therefore strictly at your own or at their own risk. In no event will liability be accepted for any loss or damage including, without limitation, indirect or consequential loss or damage, arising out of or in connection with the use of the Information. In the event that the Information is provided by you, in whole or in part, to a third party for whatever reason you shall ensure that the disclaimer is included with the Information and brought to the attention of the third party. The actual position of the gas distribution and transmission network must be verified on site before any mechanical excavating takes place. If any mechanical excavation is proposed, hard copy maps must be requested from Bord Gais Eireann. All work in the vicinity of the gas distribution and transmission network must be completed in accordance with the current edition of the Health & Safety Authority publication, 'Code of Practice for Avoiding Danger From Underground Services' which is available from the Health and Safety Authority (1866 28 38 80) or can be downloaded free of charge at www.hsa.ie.

Map data © OpenStreetMap contributors, Microsoft, Esri Community Maps contributors, Map layer by Esri

Copyright © Irish Rail (2021). This drawing is confidential and the copyright in it is owned by Irish Rail. This drawing must not be either loaned, copied or otherwise reproduced in whole or in part or used for any purpose without the prior permission of Irish Rail.

© OpenStreetMap contributors

© Ordnance Survey Ireland and Government of Ireland. All O.S. data used for plans are printed under 'Copyright Ordnance Survey Ireland' Survey No. 0039720 (OSI Aerial Data or OSI Lidar Data) & Survey No. 2021/OSI/MMA\_180 (OSI Vector Data). All elevations are in metres and relate to OSI Geoid Model (OSGM02) Mean Head as defined by existing Project Control. All Co-ordinates are in Irish Transverse Mercator Grid (ITM) as defined by OSI active GPS station Tallaght College (TLG).

**Notes**

- Information concerning the position of apparatus shown on this drawing is based on drawings supplied by the utility owners and/or the utility works contractor, whilst every care has been taken in the preparation of this drawing, positions should be taken as approximate and are intended for general guidance only and no representation is made by Irish Rail as to the accuracy, completeness, sufficiency or otherwise of this drawing and the position of the apparatus. The information contained herein does not purport to be comprehensive or final as the apparatus is subject to being altered and/or superseded. Recipients should not rely on this information. Any liabilities are hereby expressly disclaimed.
- The information contained herein has been provided by Irish Rail but does not purport to be comprehensive or final. Recipients should not rely on the information. Neither Irish Rail nor any of its directors, officers, employees, agents, stakeholders or advisers make any representation or warranty as to or accept any liability or responsibility, in relation to, the adequacy, accuracy, reasonableness or completeness of the information provided as part of this document or any matter on which the information is based (including but not limited to loss or damage arising as a result of reliance by recipients on the information or any part of it). Any liabilities are hereby expressly dismissed.

Rev	Date	Dn	Chkd	App'd	Description
P01	30/09/2021	DM	SH	COD	
P02	11/10/2021	DM	SH	COD	
P03	10/12/2021	DM	SH	COD	

Client: **larnród Éireann Irish Rail**

Engineering Designer: **ARUP**

Date: 20/09/2021 | Scale: 1:5000 @ A1 | 1:10000 @ A3

Project Code: D-WP56 | Originator Code: ARP | OMS Code: 279933-00



Drawn: DM | Checked: SH | Approved: COD

Project Title: **DART+ COASTAL NORTH**

Drawing Title: **CONSTRAINTS REPORT  
THIRD PARTY UTILITIES AND LICENCED FACILITIES CONSTRAINTS  
OPEN STREET MAP BASEMAP**

Drawing File Name: D-WP56-ARP-ZZ-NL-OR-EV-001011

Sheet Number	11 of 19	Status	902	Rev	P03
--------------	----------	--------	-----	-----	-----

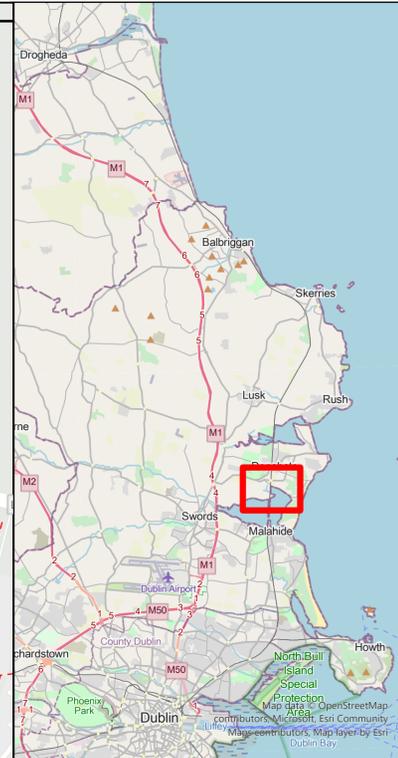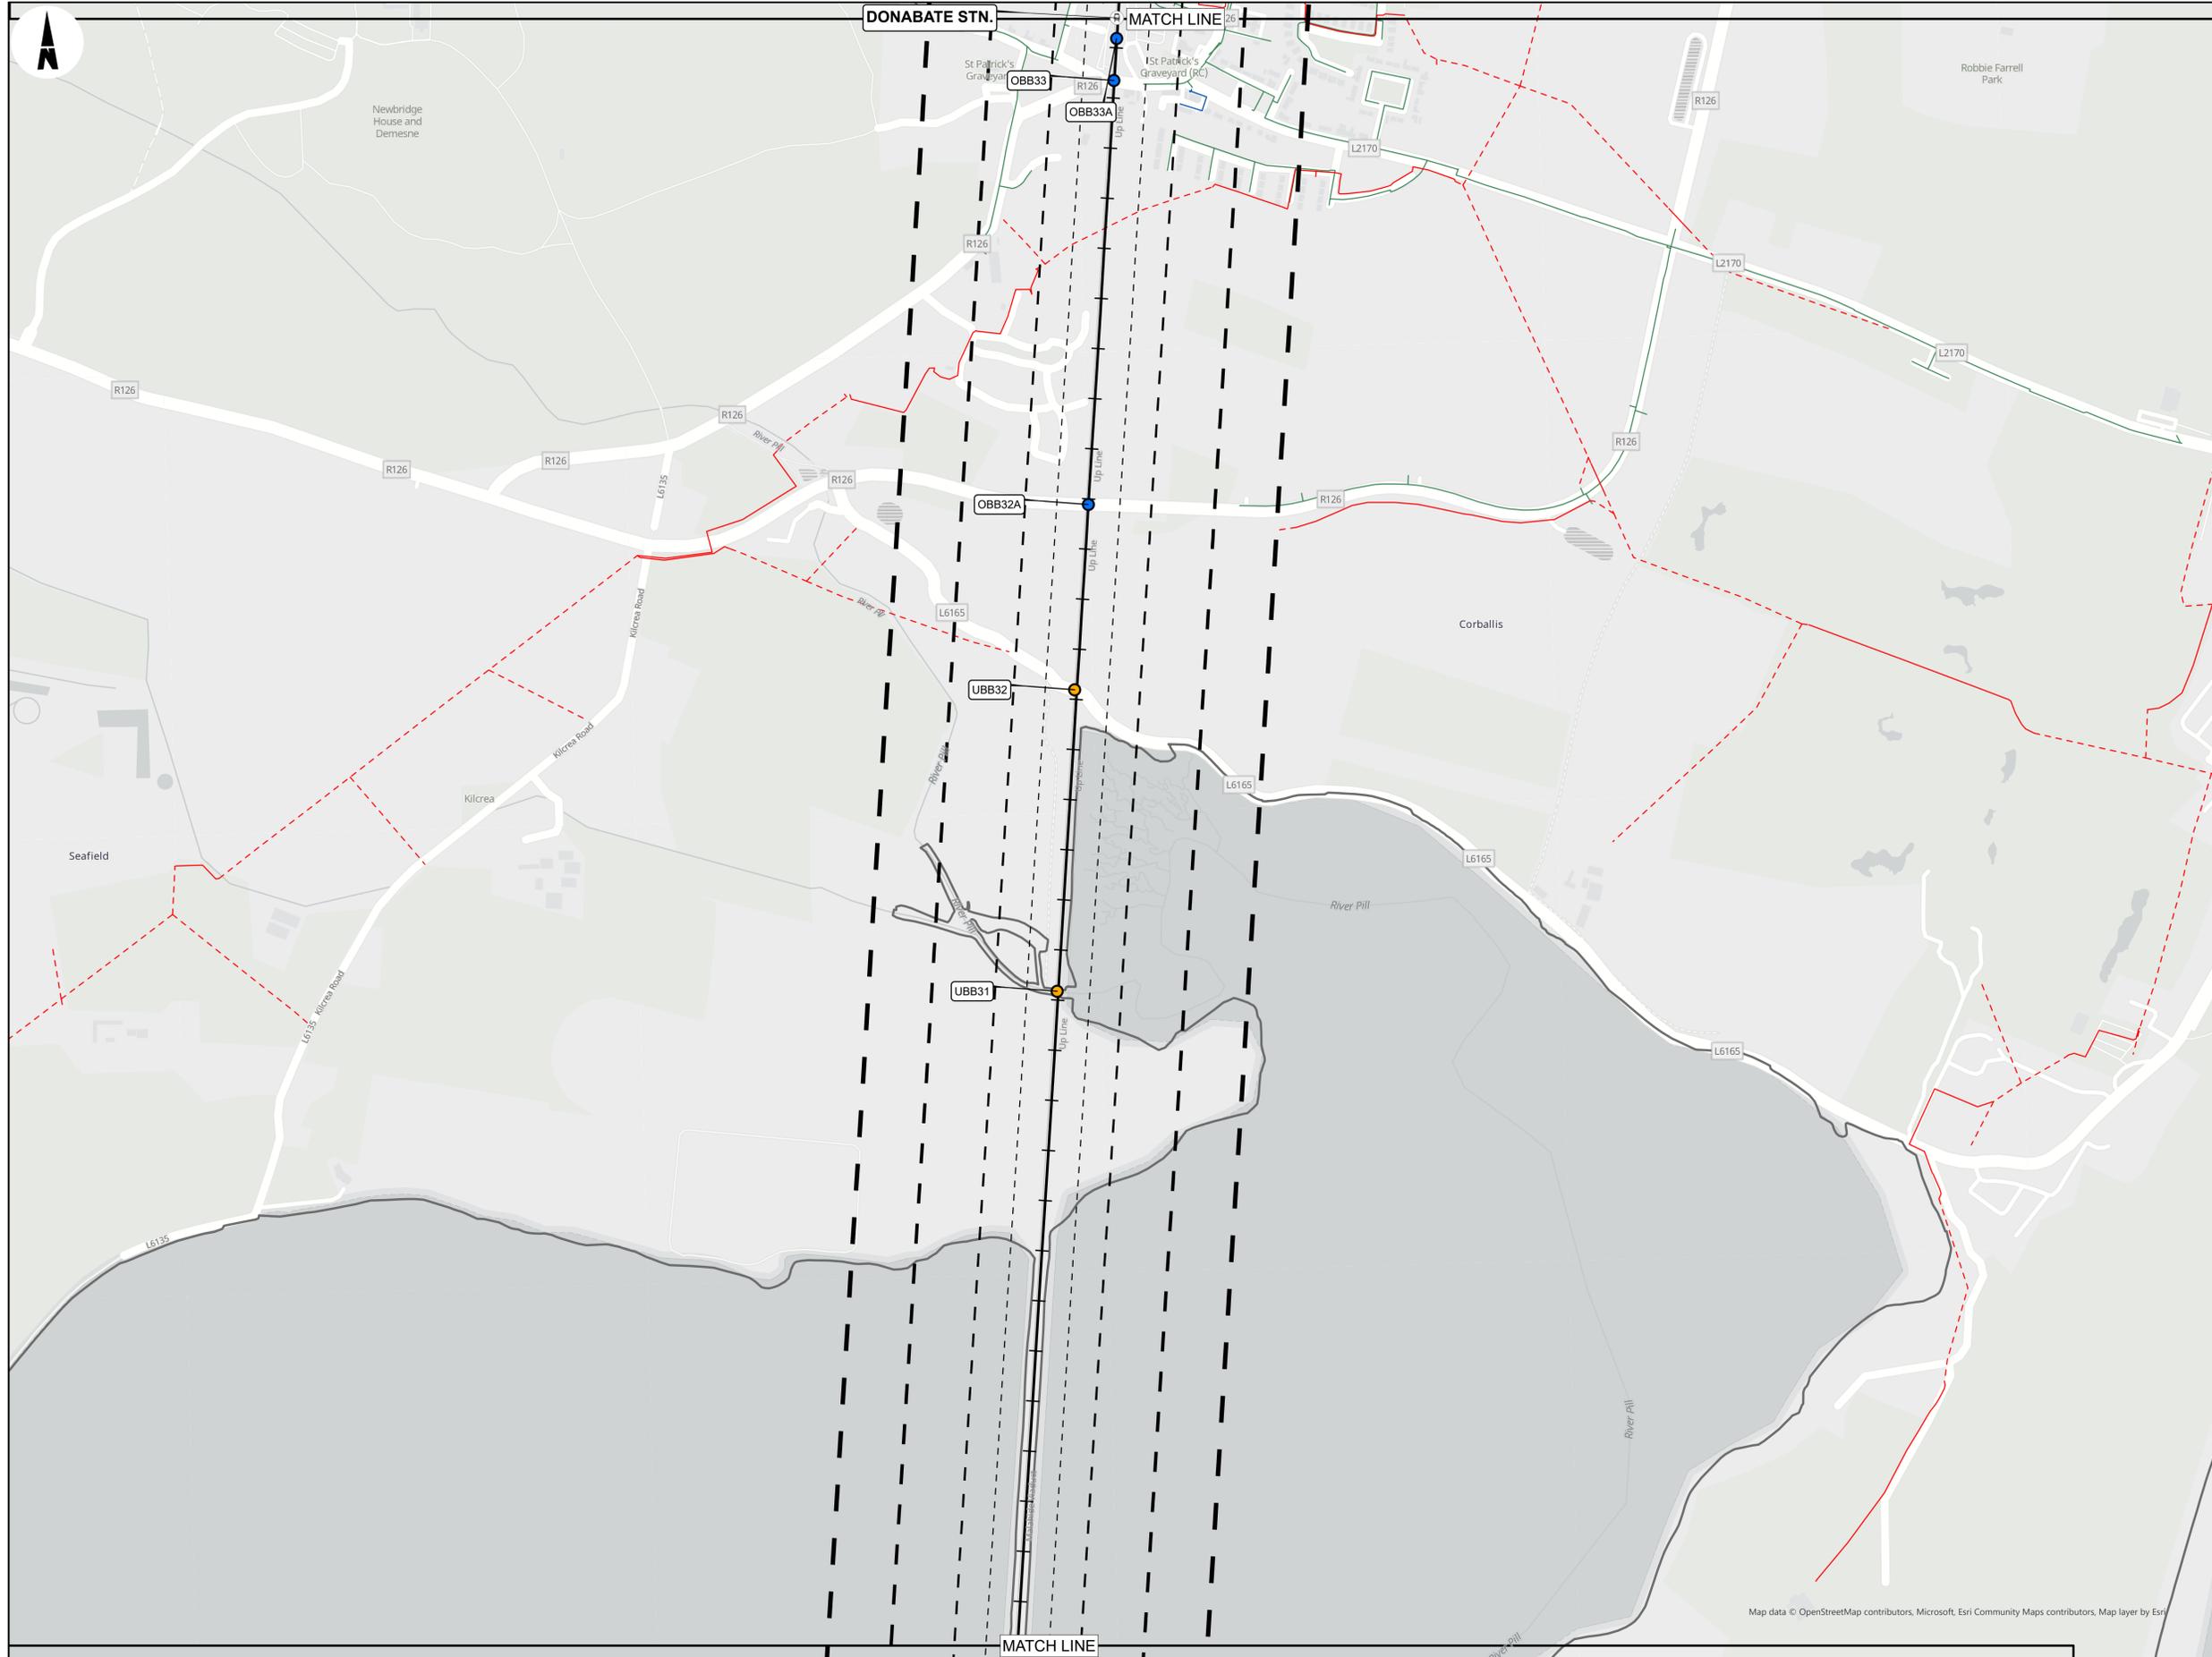

- LEGEND**
- RAILWAY STATIONS
  - BRIDGES
    - OVERBRIDGE
    - UNDERBRIDGE
  - RAILWAY LINE
  - BUFFERS
    - 60M
    - 100M
    - 200M
    - 300M
  - ADMINISTRATIVE BOUNDARY
  - COUNTY BOUNDARY
  - LICENCED FACILITIES
    - EPA LICENCED INDUSTRIAL EMISSIONS DIRECTIVE FACILITIES
    - EPA LICENCED WASTE FACILITIES
  - ESB
    - MEDIUM VOLTAGE NETWORK
      - ESB MV OH
      - ESB MV UG
  - GAS NETWORKS IRELAND
    - MEDIUM PRESSURE NETWORK
    - LOW PRESSURE NETWORK

**ESB Data Disclaimer**  
 This map indicates the approximate location of ESB Networks Transmission (400kV, 220kV, 110kV, 38kV) and Distribution (20kV, 10kV, 230V/400V) underground cables and overhead lines in the general area of the proposed works. ESB Networks takes no responsibility for the accuracy or completeness of these maps. Low voltage (230V/400V) service cables (e.g. house services, factory/shop services, public lighting lamp services, etc.) are not included but their presence should be anticipated. The depths of underground cables must never be assumed. Additional more detailed information is available for high voltage Transmission underground cables (38kV, 110kV, 220kV, 400kV) - for cables in the greater Dublin area call 01 6942957 and for all other areas call 1850 372 737. No work should be carried out in the vicinity of 38kV or higher voltage underground cables without prior consultation with ESB Networks. Before any mechanical excavation is undertaken, the actual location of all underground electricity cables must be established and verified on site, using: (a) Up-to-date map records; (b) Cable locator equipment operated in both power and radio modes; (c) Careful hand digging of trial holes using 'Safe Digging Practice'. Refer also to the 'HSA Code of Practice for Avoiding Danger from Underground Services'. ESB takes no responsibility and shall bear no liability in relation to any damage, injury/death or loss of supply as a result of damage or interference with its networks.

**GNI Data Disclaimer**  
 The information contained in this map concerning the location and technical designation of the gas distribution and transmission network (the 'Information') is provided 'as is' and no representation or warranty of any kind, express or implied, is made in relation to the Information and all such representations or warranties, express or implied, in relation to the Information are hereby excluded to the fullest extent permitted by law. No responsibility, liability or duty of care to you or to any other person in respect of the Information is accepted, and any reliance you or any other person places on the Information is therefore strictly at your own or at their own risk. In no event will liability be accepted for any loss or damage including, without limitation, indirect or consequential loss or damage, arising out of or in connection with the use of the Information. In the event that the Information is provided by you, in whole or in part, to a third party for whatever reason you shall ensure that the disclaimer is included with the Information and brought to the attention of the third party. The actual position of the gas distribution and transmission network must be verified on site before any mechanical excavating takes place. If any mechanical excavation is proposed, hard copy maps must be requested from Bord Gais Eireann. All work in the vicinity of the gas distribution and transmission network must be completed in accordance with the current edition of the Health & Safety Authority publication, 'Code of Practice for Avoiding Danger From Underground Services' which is available from the Health and Safety Authority (1866 28 88 88) or can be downloaded free of charge at www.hsa.ie.

Copyright © Irish Rail (2021). This drawing is confidential and the copyright in it is owned by Irish Rail. This drawing must not be either loaned, copied or otherwise reproduced in whole or in part or used for any purpose without the prior permission of Irish Rail.

© Ordnance Survey Ireland and Government of Ireland. All O.S. data used for plans are printed under "Copyright Ordnance Survey Ireland" Survey No. 0039720 (OSI Aerial Data or OSI Lidar Data) & Survey No. 202105; MMA, 180 (OSI Vector Data). All elevations are in metres and relate to OSI Geoid Model (OSGM02) Malin Head as defined by existing Project Control. All Co-ordinates are in Irish Transverse Mercator Grid (ITM) as defined by OSI active GPS station Tallaght College (TLTG).

**Notes**

- Information concerning the position of apparatus shown on this drawing is based on drawings supplied by the utility owners and/or the utility works contractor, whilst every care has been taken in the preparation of this drawing, positions should be taken as approximate and are intended for general guidance only and no representation is made by Irish Rail as to the accuracy, completeness, sufficiency or otherwise of this drawing and the position of the apparatus. The information contained herein does not purport to be comprehensive or final as the apparatus is subject to being altered and/or superseded. Recipients should not rely on this information. Any liabilities are hereby expressly disclaimed.
- The information contained herein has been provided by Irish Rail but does not purport to be comprehensive or final. Recipients should not rely on the information. Neither Irish Rail nor any of its directors, officers, employees, agents, stakeholders or advisers make any representation or warranty as to or accept any liability or responsibility. In relation to the adequacy, accuracy, reasonableness or completeness of the information provided as part of this document or any matter on which the information is based (including but not limited to loss or damage arising as a result of reliance by recipients on the information or any part of it), Any liabilities are hereby expressly dismissed.

Rev	Date	Dn	Chkd	App'd	Description
P01	30/09/2021	DM	SH	COD	
P02	11/10/2021	DM	SH	COD	
P03	10/12/2021	DM	SH	COD	

Client: **larnród Éireann Irish Rail**

Engineering Designer: **ARUP**



Date: 20/09/2021 Scale: 1:5000 @ A1, 1:10000 @ A3

Project Code: D+WP56 Originator Code: ARP

Drawn: DM Checked: SH Approved: COD

QMS Code: 279933-00

Project Title: <b>DART+ COASTAL NORTH</b>			
Drawing Title: <b>THIRD PARTY UTILITIES AND LICENCED FACILITIES CONSTRAINTS OPEN STREET MAP BASEMAP</b>			
Drawing File Name: D+WP56-ARP-ZZ-NL-OR-EV-001012	Sheet Number: 12 of 19	Status: 902	Rev: P03

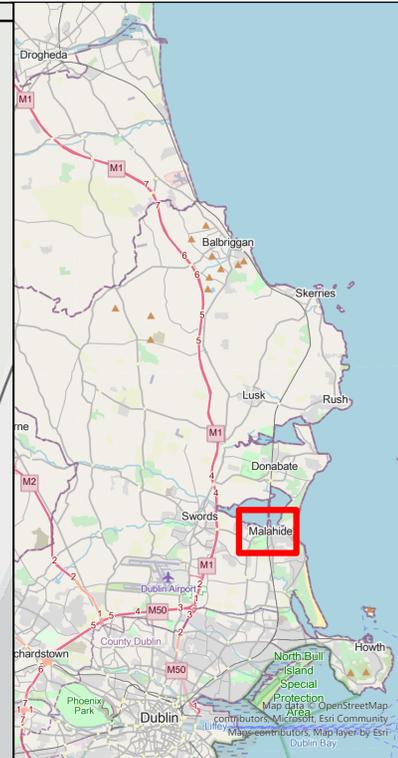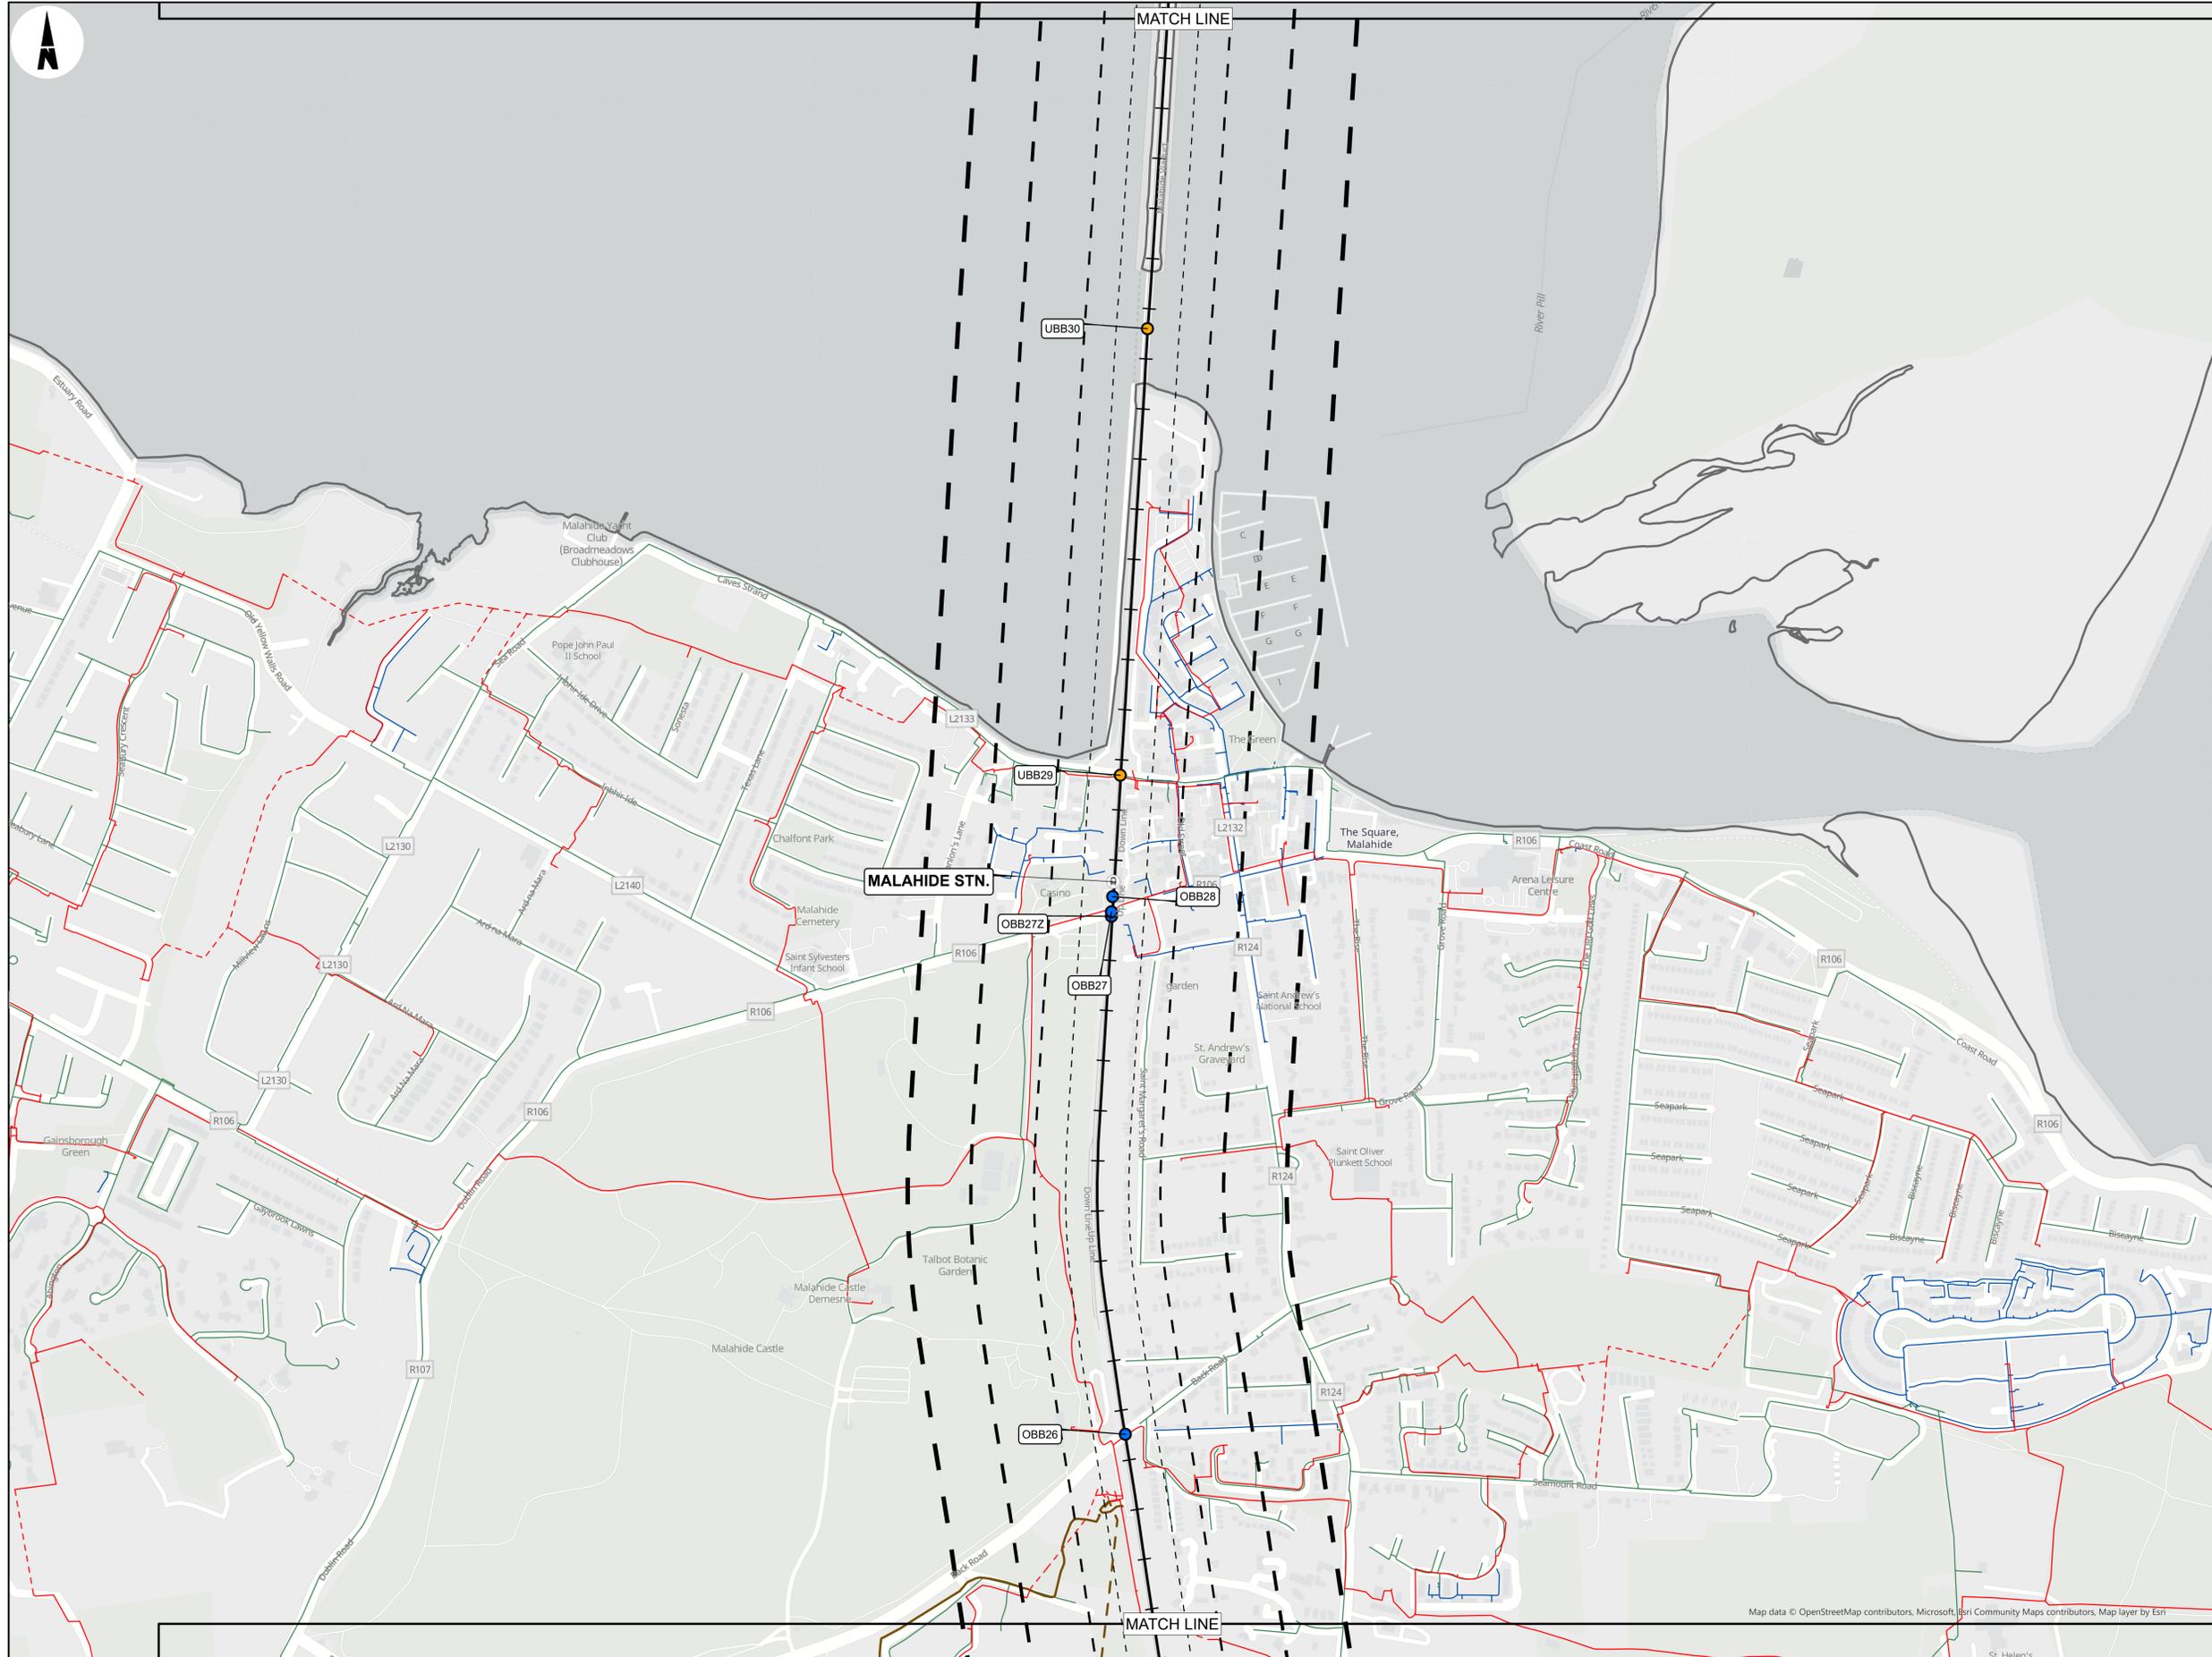

**LEGEND**

- RAILWAY STATIONS
- BRIDGES
  - OVERBRIDGE
  - UNDERBRIDGE
- RAILWAY LINE
- BUFFERS
  - 60M
  - 100M
  - 200M
  - 300M
- ADMINISTRATIVE BOUNDARY
- COUNTY BOUNDARY
- LICENCED FACILITIES
  - EPA LICENCED INDUSTRIAL EMISSIONS DIRECTIVE FACILITIES
  - EPA LICENCED WASTE FACILITIES
- ESB
  - HIGH VOLTAGE NETWORK
    - ESB HV OH
    - ESB HV UG
  - MEDIUM VOLTAGE NETWORK
    - ESB MV OH
    - ESB MV UG
  - GAS NETWORKS IRELAND
    - MEDIUM PRESSURE NETWORK
    - LOW PRESSURE NETWORK

**ESB Data Disclaimer**  
 This map indicates the approximate location of ESB Networks Transmission (400kV, 220kV, 110kV, 38kV) and Distribution (20kV, 10kV, 230V/400V) underground cables and overhead lines in the general area of the proposed works. ESB Networks takes no responsibility for the accuracy or completeness of these maps. Low voltage (230V/400V) service cables (e.g. house services, factory/shop services, public lighting lamp services, etc.) are not included but their presence should be anticipated. The depths of underground cables must never be assumed. Additional more detailed information is available for high voltage Transmission underground cables (38kV, 110kV, 220kV, 400kV) - for cables in the greater Dublin area call 01 6942957 and for all other areas call 1850 372 737. No work should be carried out in the vicinity of 38kV or higher voltage underground cables without prior consultation with ESB Networks. Before any mechanical excavation is undertaken, the actual location of all underground electricity cables must be established and verified on site, using: (a) Up-to-date map records; (b) Cable locator equipment operated in both power and radio modes; (c) Careful hand digging of trial holes using 'Safe Digging Practice'. Refer also to the 'HSA Code of Practice for Avoiding Danger from Underground Services'. ESB takes no responsibility and shall bear no liability in relation to any damage, injury/death or loss of supply as a result of damage or interference with its networks.

**GNI Data Disclaimer**  
 The information contained in this map concerning the location and technical designation of the gas distribution and transmission network (the 'Information') is provided 'as is' and no representation or warranty of any kind, express or implied, is made in relation to the Information and all such representations or warranties, express or implied, in relation to the Information are hereby excluded to the fullest extent permitted by law. No responsibility, liability or duty of care to you or to any other person in respect of the Information is accepted, and any reliance you or any other person places on the Information is therefore strictly at your own or at their own risk. In no event will liability be accepted for any loss or damage including, without limitation, indirect or consequential loss or damage, arising out of or in connection with the use of the Information. In the event that the Information is provided by you, in whole or in part, to a third party for whatever reason you shall ensure that the disclaimer is included with the Information and brought to the attention of the third party. The actual position of the gas distribution and transmission network must be verified on site before any mechanical excavating takes place. If any mechanical excavation is proposed, hard copy maps must be requested from Bord Gais Eireann. All work in the vicinity of the gas distribution and transmission network must be completed in accordance with the current edition of the Health & Safety Authority publication, 'Code of Practice for Avoiding Danger From Underground Services' which is available from the Health and Safety Authority (1866 26 86) or can be downloaded free of charge at www.hsa.ie.

Map data © OpenStreetMap contributors, Microsoft, Esri Community Maps contributors, Map layer by Esri

Copyright © Irish Rail (2021). This drawing is confidential and the copyright in it is owned by Irish Rail. This drawing must not be either loaned, copied or otherwise reproduced in whole or in part or used for any purpose without the prior permission of Irish Rail.

© OpenStreetMap contributors

© Ordnance Survey Ireland and Government of Ireland. All O.S. data used for plans are printed under "Copyright Ordnance Survey Ireland" Survey No. 0039720 (OSI Aerial Data or OSI Lidar Data) & Survey No. 2021/OSI/MMA\_180 (OSI Vector Data). All elevations are in metres and relate to OSI Geoid Model (OSGM02) Malin Head as defined by existing Project Control. All Co-ordinates are in Irish Transverse Mercator Grid (ITM) as defined by OSI active GPS station Tallaght College (TLTG).

Notes

- Information concerning the position of apparatus shown on this drawing is based on drawings supplied by the utility owners and/or the utility works contractor, whilst every care has been taken in the preparation of this drawing, positions should be taken as approximate and are intended for general guidance only and no representation is made by Irish Rail as to the accuracy, completeness, sufficiency or otherwise of this drawing and the position of the apparatus. The information contained herein does not purport to be comprehensive or final as the apparatus is subject to being altered and/or superseded. Recipients should not rely on this information. Any liabilities are hereby expressly disclaimed.
- The information contained herein has been provided by Irish Rail but does not purport to be comprehensive or final. Recipients should not rely on the information. Neither Irish Rail nor any of its directors, officers, employees, agents, stakeholders or advisers make any representation or warranty as to or accept any liability or responsibility, in relation to, the adequacy, accuracy, reasonableness or completeness of the information provided as part of this document or any matter on which the information is based (including but not limited to loss or damage arising as a result of reliance by recipients on the information or any part of it). Any liabilities are hereby expressly disclaimed.

Rev	Date	Dn	Chkd	App'd	Description
P01	30/09/2021	DM	SH	COD	
P02	11/10/2021	DM	SH	COD	
P03	10/12/2021	DM	SH	COD	

Client: **larnród Éireann Irish Rail**

Engineering Designer: **ARUP**

Date: 20/09/2021 Scale: 1:5000 @ A1 1:10000 @ A3

Project Code: D+WP56 Originator Code: ARP

Drawn: DM Checked: SH Approved: COD



OMS Code: 279933-00

Project Title: **DART+ COASTAL NORTH**

Drawing Title: **THIRD PARTY UTILITIES AND LICENCED FACILITIES CONSTRAINTS OPEN STREET MAP BASEMAP**

Drawing File Name: D+WP56-ARP-ZZ-NL-OR-EV-001013

Sheet Number: 13 of 19 Status: 902 Rev: P03

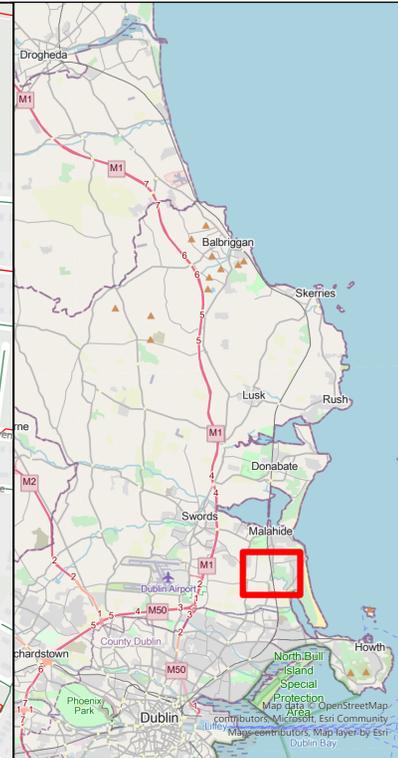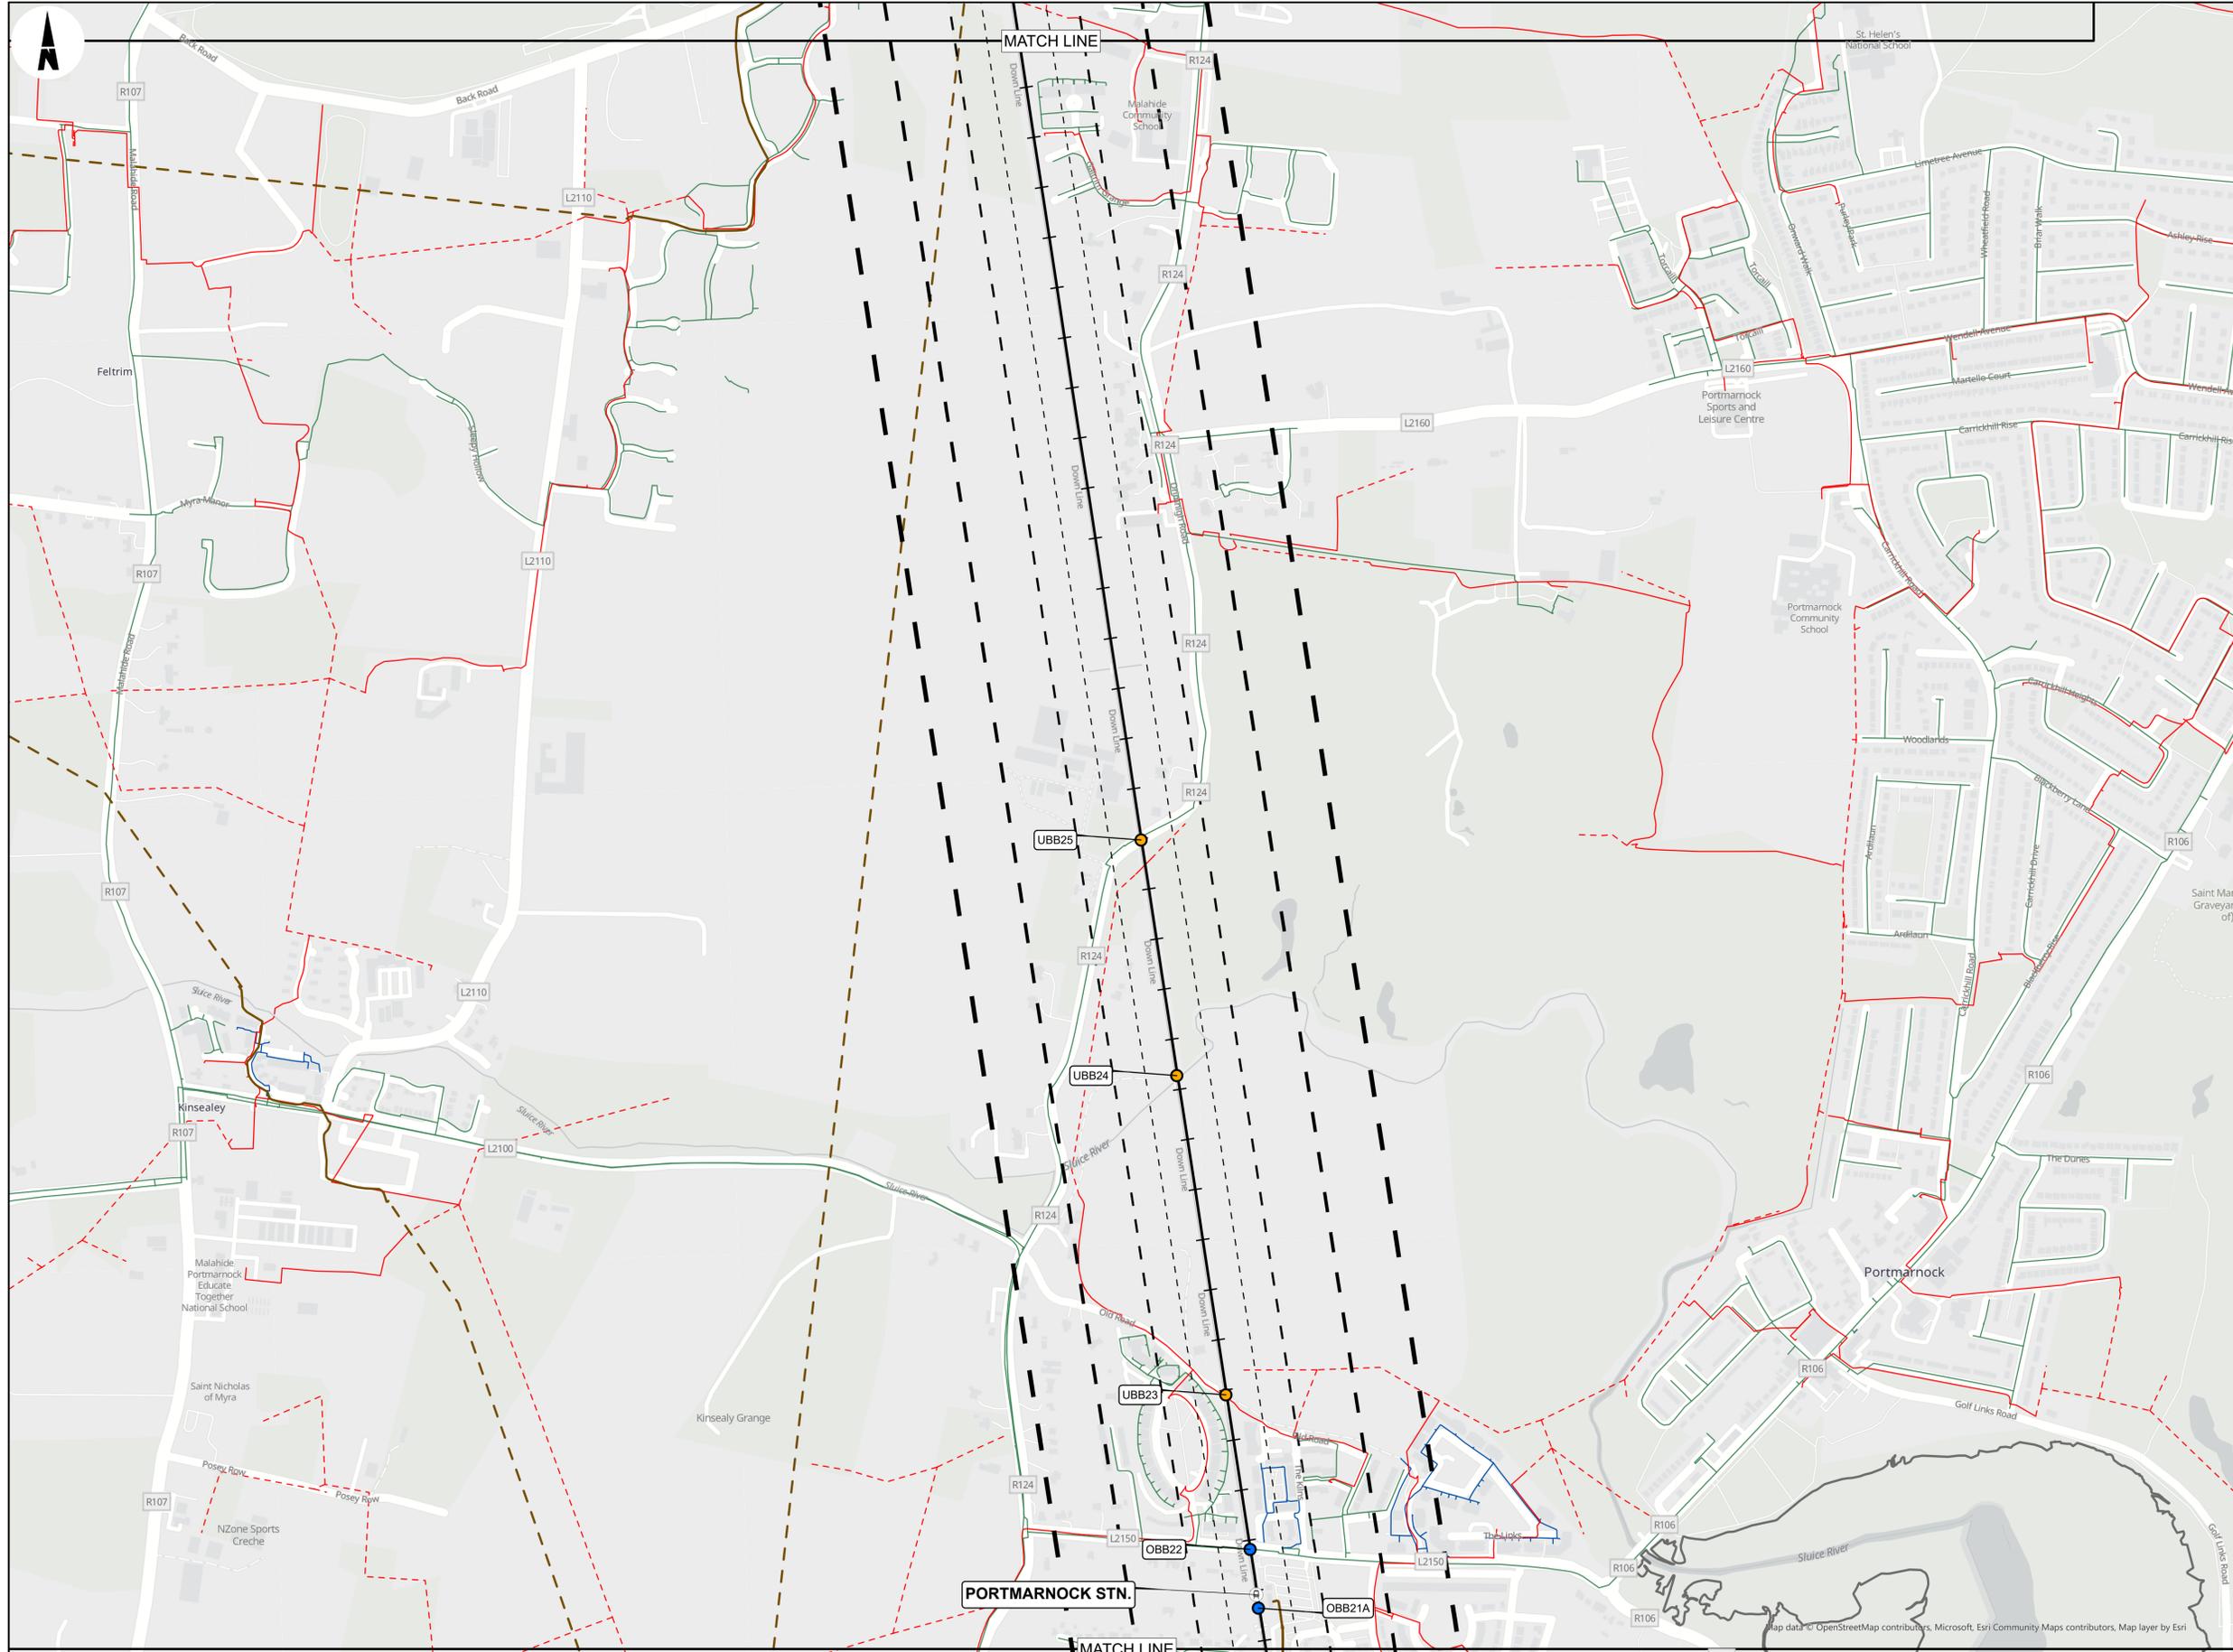

- LEGEND**
- RAILWAY STATIONS
  - OVERBRIDGE
  - UNDERBRIDGE
  - RAILWAY LINE
  - BUFFERS**
    - 60M
    - 100M
    - 200M
    - 300M
  - ADMINISTRATIVE BOUNDARY
  - COUNTY BOUNDARY
  - LICENCED FACILITIES**
    - EPA LICENCED INDUSTRIAL EMISSIONS DIRECTIVE FACILITIES
    - EPA LICENCED WASTE FACILITIES
  - ESB**
  - HIGH VOLTAGE NETWORK**
    - ESB HV OH
    - ESB HV UG
  - MEDIUM VOLTAGE NETWORK**
    - ESB MV OH
    - ESB MV UG
  - GAS NETWORKS IRELAND**
    - MEDIUM PRESSURE NETWORK
    - LOW PRESSURE NETWORK

**ESB Data Disclaimer**  
 This map indicates the approximate location of ESB Networks Transmission (400kV, 220kV, 110kV, 38kV) and Distribution (20kV, 10kV, 230V/400V) underground cables and overhead lines in the general area of the proposed works. ESB Networks takes no responsibility for the accuracy or completeness of these maps. Low voltage (230V/400V) service cables (e.g. house services, factory/shop services, public lighting lamp services, etc.) are not included but their presence should be anticipated. The depths of underground cables must never be assumed. Additional more detailed information is available for high voltage Transmission underground cables (38kV, 110kV, 220kV, 400kV) for cables in the greater Dublin area call 01 6942957 and for all other areas call 1850 372 737. No work should be carried out in the vicinity of 38kV or higher voltage underground cables without prior consultation with ESB Networks. Before any mechanical excavation is undertaken, the actual location of all underground electricity cables must be established and verified on site, using: (a) Up-to-date map records; (b) Cable locator equipment operated in both power and radio modes; (c) Careful hand digging of trial holes using 'Safe Digging Practice'. Refer also to the 'HSA Code of Practice for Avoiding Danger from Underground Services'. ESB takes no responsibility and shall bear no liability in relation to any damage, injury/death or loss of supply as a result of damage or interference with its networks.

**GNI Data Disclaimer**  
 The information contained in this map concerning the location and technical designation of the gas distribution and transmission network (the 'Information') is provided 'as is' and no representation or warranty of any kind, express or implied, is made in relation to the Information and all such representations or warranties, express or implied, in relation to the Information are hereby excluded to the fullest extent permitted by law. No responsibility, liability or duty of care to you or to any other person in respect of the Information is accepted, and any reliance you or any other person places on the Information is therefore strictly at your own or at their own risk. In no event will liability be accepted for any loss or damage including, without limitation, indirect or consequential loss or damage, arising out of or in connection with the use of the Information. If the information is provided by you, in whole or in part, to a third party for whatever reason you shall ensure that the disclaimer is included with the Information and brought to the attention of the third party. The actual position of the gas distribution and transmission network must be verified on site before any mechanical excavating takes place. If any mechanical excavation is proposed, hard copy maps must be requested from Bord Gais Eireann. All work in the vicinity of the gas distribution and transmission network must be completed in accordance with the current edition of the Health & Safety Authority publication, 'Code of Practice for Avoiding Danger From Underground Services' which is available from the Health and Safety Authority (1866 28 88 88) or can be downloaded free of charge at www.hsa.ie.

Copyright © Irish Rail (2021). This drawing is confidential and the copyright in it is owned by Irish Rail. This drawing must not be either loaned, copied or otherwise reproduced in whole or in part or used for any purpose without the prior permission of Irish Rail.  
 © OpenStreetMap contributors  
 © Ordnance Survey Ireland and Government of Ireland. All O.S. data used for plans are printed under "Copyright Ordnance Survey Ireland" Survey No. 0039720 (OSI Aerial Data or OSI Lidar Data) & Survey No. 2021/OSI/MMA\_180 (OSI Vector Data). All elevations are in metres and relate to OSI Geoid Model (OSGM02) Malin Head as defined by existing Project Control. All Co-ordinates are in Irish Transverse Mercator Grid (ITM) as defined by OSI active GPS station Tallaght College (TLTG).

**Notes**  
 1. Information concerning the position of apparatus shown on this drawing is based on drawings supplied by the utility owners and/or the utility works contractor, whilst every care has been taken in the preparation of this drawing, positions should be taken as approximate and are intended for general guidance only and no representation is made by Irish Rail as to the accuracy, completeness, sufficiency or otherwise of this drawing and the position of the apparatus. The information contained herein does not purport to be comprehensive or final as the apparatus is subject to being altered and/or superseded. Recipients should not rely on this information. Any liabilities are hereby expressly disclaimed.  
 2. The information contained herein has been provided by Irish Rail but does not purport to be comprehensive or final. Recipients should not rely on the information. Neither Irish Rail nor any of its directors, officers, employees, agents, stakeholders or advisers make any representation or warranty as to or accept any liability or responsibility, in relation to, the adequacy, accuracy, reasonableness or completeness of the information provided as part of this document or any matter on which the information is based (including but not limited to loss or damage arising as a result of reliance by recipients on the information or any part of it). Any liabilities are hereby expressly dismissed.

Rev	Date	Dn	Chkd	App'd	Description
P01	30/09/2021	DM	SH	COD	
P02	11/10/2021	DM	SH	COD	
P03	10/12/2021	DM	SH	COD	

Client: **Irish Rail**

Engineering Designer: **ARUP**

Date: 20/09/2021 Scale: 1:5000 @ A1 1:10000 @ A3

Project Code: D+WP56 Originator Code: ARP OMS Code: 279933-00



Drawn: DM Checked: SH Approved: COD

Project Title: **DART+ COASTAL NORTH**

Drawing Title: **THIRD PARTY UTILITIES AND LICENCED FACILITIES CONSTRAINTS OPEN STREET MAP BASEMAP**

Drawing File Name: D+WP56-ARP-ZZ-NL-OR-EV-001014

Sheet Number	Status	Rev
14 of 19	902	P03

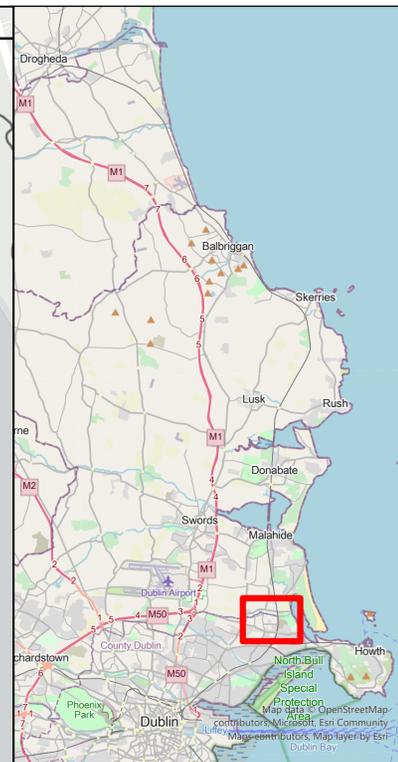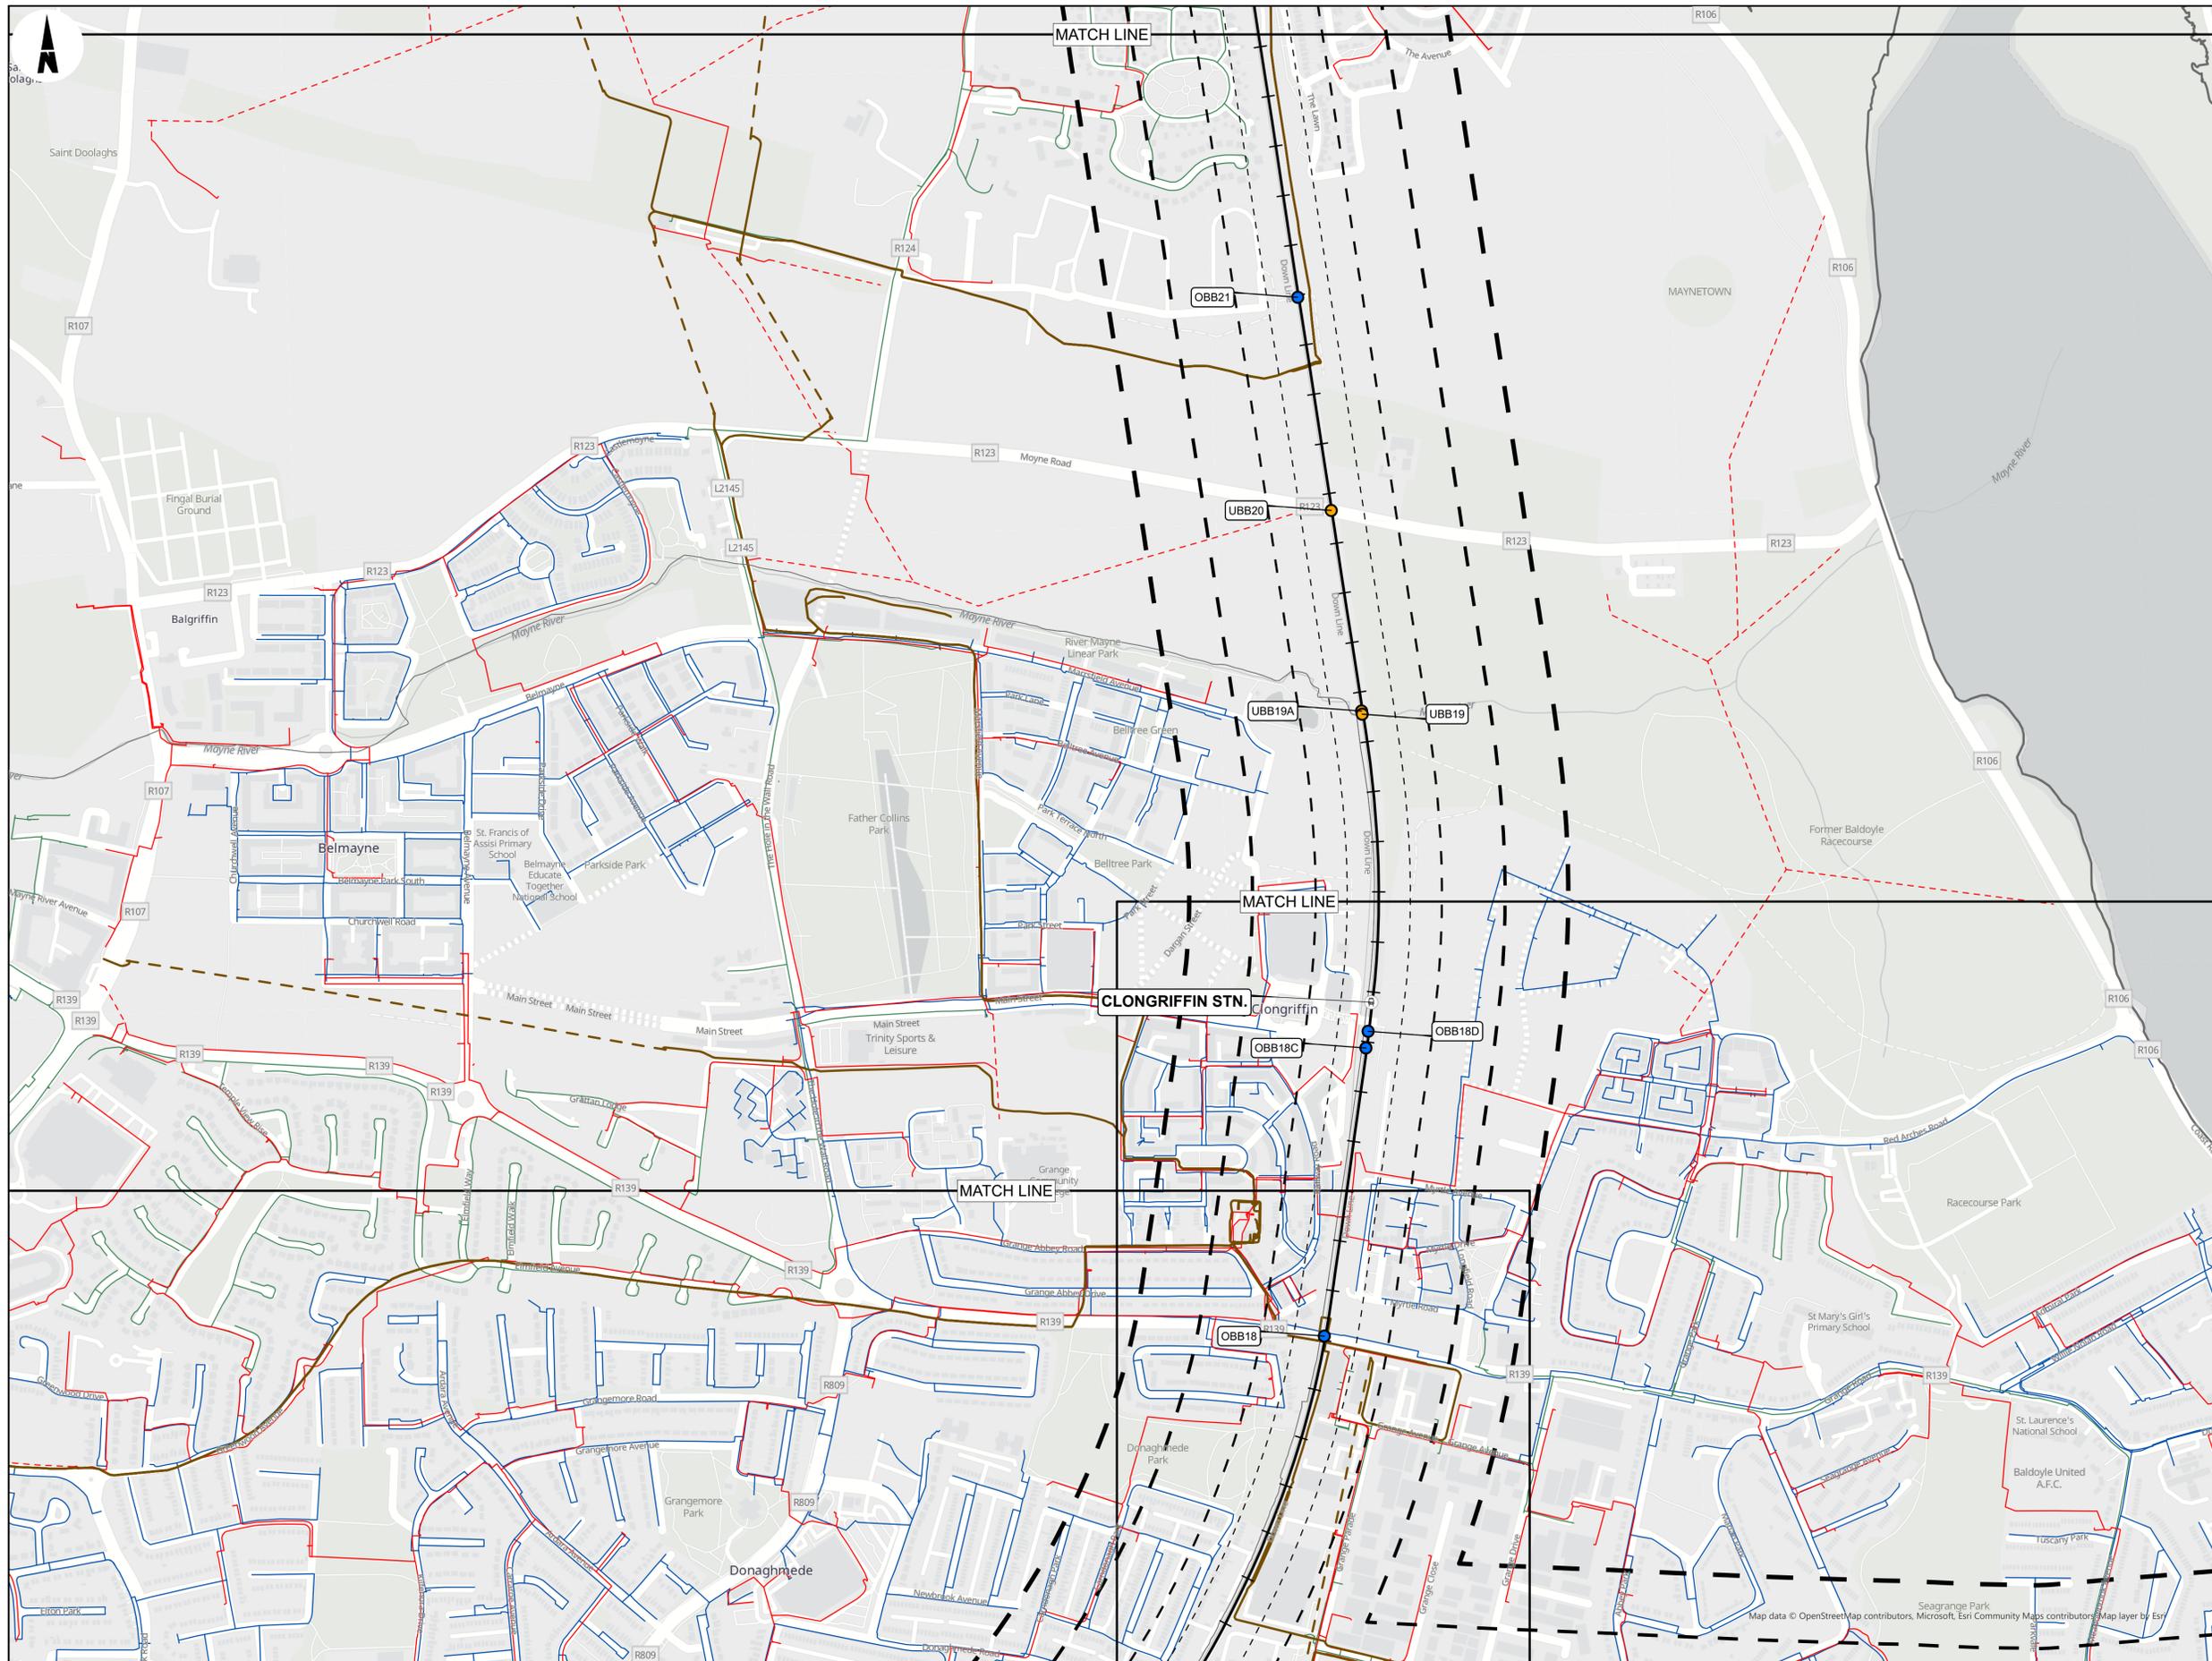

**LEGEND**

- RAILWAY STATIONS
- BRIDGES
  - OVERBRIDGE
  - UNDERBRIDGE
- RAILWAY LINE
- BUFFERS
  - 50M
  - 100M
  - 200M
  - 300M
- ADMINISTRATIVE BOUNDARY
- COUNTY BOUNDARY
- LICENCED FACILITIES
  - EPA LICENCED INDUSTRIAL EMISSIONS DIRECTIVE FACILITIES
  - EPA LICENCED WASTE FACILITIES
- ESB
  - HIGH VOLTAGE NETWORK
    - ESB HV OH
    - ESB HV UG
  - MEDIUM VOLTAGE NETWORK
    - ESB MV OH
    - ESB MV UG
  - GAS NETWORKS IRELAND
    - MEDIUM PRESSURE NETWORK
    - LOW PRESSURE NETWORK

**ESB Data Disclaimer**  
 This map indicates the approximate location of ESB Networks Transmission (400kV, 220kV, 110kV, 38kV) and Distribution (20kV, 10kV, 230V/400V) underground cables and overhead lines in the general area of the proposed works. ESB Networks takes no responsibility for the accuracy or completeness of these maps. Low voltage (230V/400V) service cables (e.g. house services, factory/shop services, public lighting lamp services, etc.) are not included but their presence should be anticipated. The depths of underground cables must never be assumed. Additional more detailed information is available for high voltage Transmission underground cables (38kV, 110kV, 220kV, 400kV) for cables in the greater Dublin area call 01 6942957 and for all other areas call 1850 372 737. No work should be carried out in the vicinity of 38kV or higher voltage underground cables without prior consultation with ESB Networks. Before any mechanical excavation is undertaken, the actual location of all underground electricity cables must be established and verified on site, using: (a) Up-to-date map records; (b) Cable locator equipment operated in both power and radio modes; (c) Careful hand digging of trial holes using 'Safe Digging Practice'. Refer also to the 'HSA Code of Practice for Avoiding Danger from Underground Services'. ESB takes no responsibility and shall bear no liability in relation to any damage, injury/death or loss of supply as a result of damage or interference with its networks.

**GNI Data Disclaimer**  
 The information contained in this map concerning the location and technical designation of the gas distribution and transmission network (the 'Information') is provided 'as is' and no representation or warranty of any kind, express or implied, is made in relation to the Information and all such representations or warranties, express or implied, in relation to the Information are hereby excluded to the fullest extent permitted by law. No responsibility, liability or duty of care to you or to any other person in respect of the Information is accepted, and any reliance you or any other person places on the Information is therefore strictly at your own or at their own risk. In no event will liability be accepted for any loss or damage including, without limitation, indirect or consequential loss or damage, arising out of or in connection with the use of the Information. In the event that the Information is provided by you, in whole or in part, to a third party for whatever reason you shall ensure that the disclaimer is included with the Information and brought to the attention of the third party. The actual position of the gas distribution and transmission network must be verified on site before any mechanical excavating takes place. If any mechanical excavation is proposed, hard copy maps must be requested from Bord Gais Eireann. All work in the vicinity of the gas distribution and transmission network must be completed in accordance with the current edition of the Health & Safety Authority publication, 'Code of Practice for Avoiding Danger From Underground Services' which is available from the Health and Safety Authority (1850 28 80) or can be downloaded free of charge at www.hsa.ie.

Map data © OpenStreetMap contributors, Microsoft, Esri Community Maps contributors, Map layer by Esri

Copyright © Irish Rail (2021). This drawing is confidential and the copyright in it is owned by Irish Rail. This drawing must not be either loaned, copied or otherwise reproduced in whole or in part or used for any purpose without the prior permission of Irish Rail.

© OpenStreetMap contributors

© Ordnance Survey Ireland and Government of Ireland. All O.S. data used for plans are printed under "Copyright Ordnance Survey Ireland" Survey No. 0039720 (OSI Aerial Data or OSI Lidar Data) & Survey No. 2021/OSI/MMA\_180 (OSI Vector Data). All elevations are in metres and relate to OSI Geoid Model (OSGM02) Mean Head as defined by existing Project Control. All Co-ordinates are in Irish Transverse Mercator Grid (ITM) as defined by OSI active GPS station Tallaght College (TLTG).

**Notes**

- Information concerning the position of apparatus shown on this drawing is based on drawings supplied by the utility owners and/or the utility works contractor, whilst every care has been taken in the preparation of this drawing, positions should be taken as approximate and are intended for general guidance only and no representation is made by Irish Rail as to the accuracy, completeness, sufficiency or otherwise of this drawing and the position of the apparatus. The information contained herein does not purport to be comprehensive or final as the apparatus is subject to being altered and/or superseded. Recipients should not rely on this information. Any liabilities are hereby expressly disclaimed.
- The information contained herein has been provided by Irish Rail but does not purport to be comprehensive or final. Recipients should not rely on the information. Neither Irish Rail nor any of its directors, officers, employees, agents, stakeholders or advisers make any representation or warranty as to or accept any liability or responsibility, in relation to, the adequacy, accuracy, reasonableness or completeness of the information provided as part of this document or any matter on which the information is based (including but not limited to loss or damage arising as a result of reliance by recipients on the information or any part of it). Any liabilities are hereby expressly dismissed.

**DART+ Coastal North**

**NTA**  
 Náisiúnta Aonúis na hÉireann  
 National Transport Authority

**Tionscadal Éireann**  
 Project Ireland 2040

Rev	Date	Dn	Chkd	App'd	Description
P01	30/09/2021	DM	SH	COD	
P02	11/10/2021	DM	SH	COD	
P03	10/12/2021	DM	SH	COD	

Client: **larnród Éireann Irish Rail**

Engineering Designer: **ARUP**

Date: 20/09/2021 Scale: 1:5000 @ A1 1:10000 @ A3

Project Code: D-WP56 Originator Code: ARP OMS Code: 279933-00



Drawn: DM Checked: SH Approved: COD

Project Title: **DART+ COASTAL NORTH**

Drawing Title: **THIRD PARTY UTILITIES AND LICENCED FACILITIES CONSTRAINTS OPEN STREET MAP BASEMAP**

Drawing File Name: D-WP56-ARP-ZL-NLR-0V-01015

Sheet Number: 15 of 19 Status: 902 Rev: P03

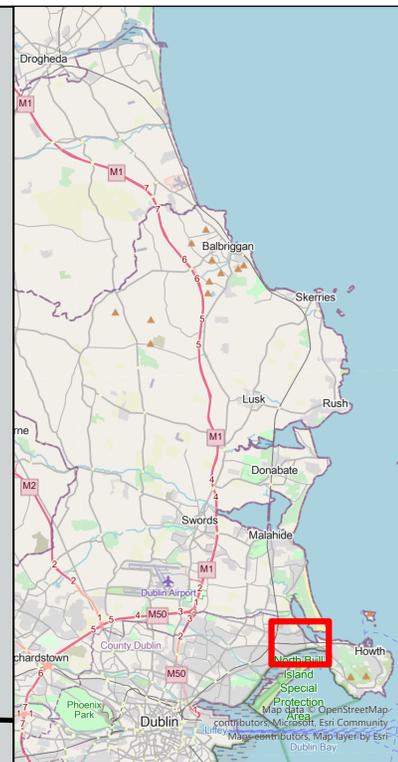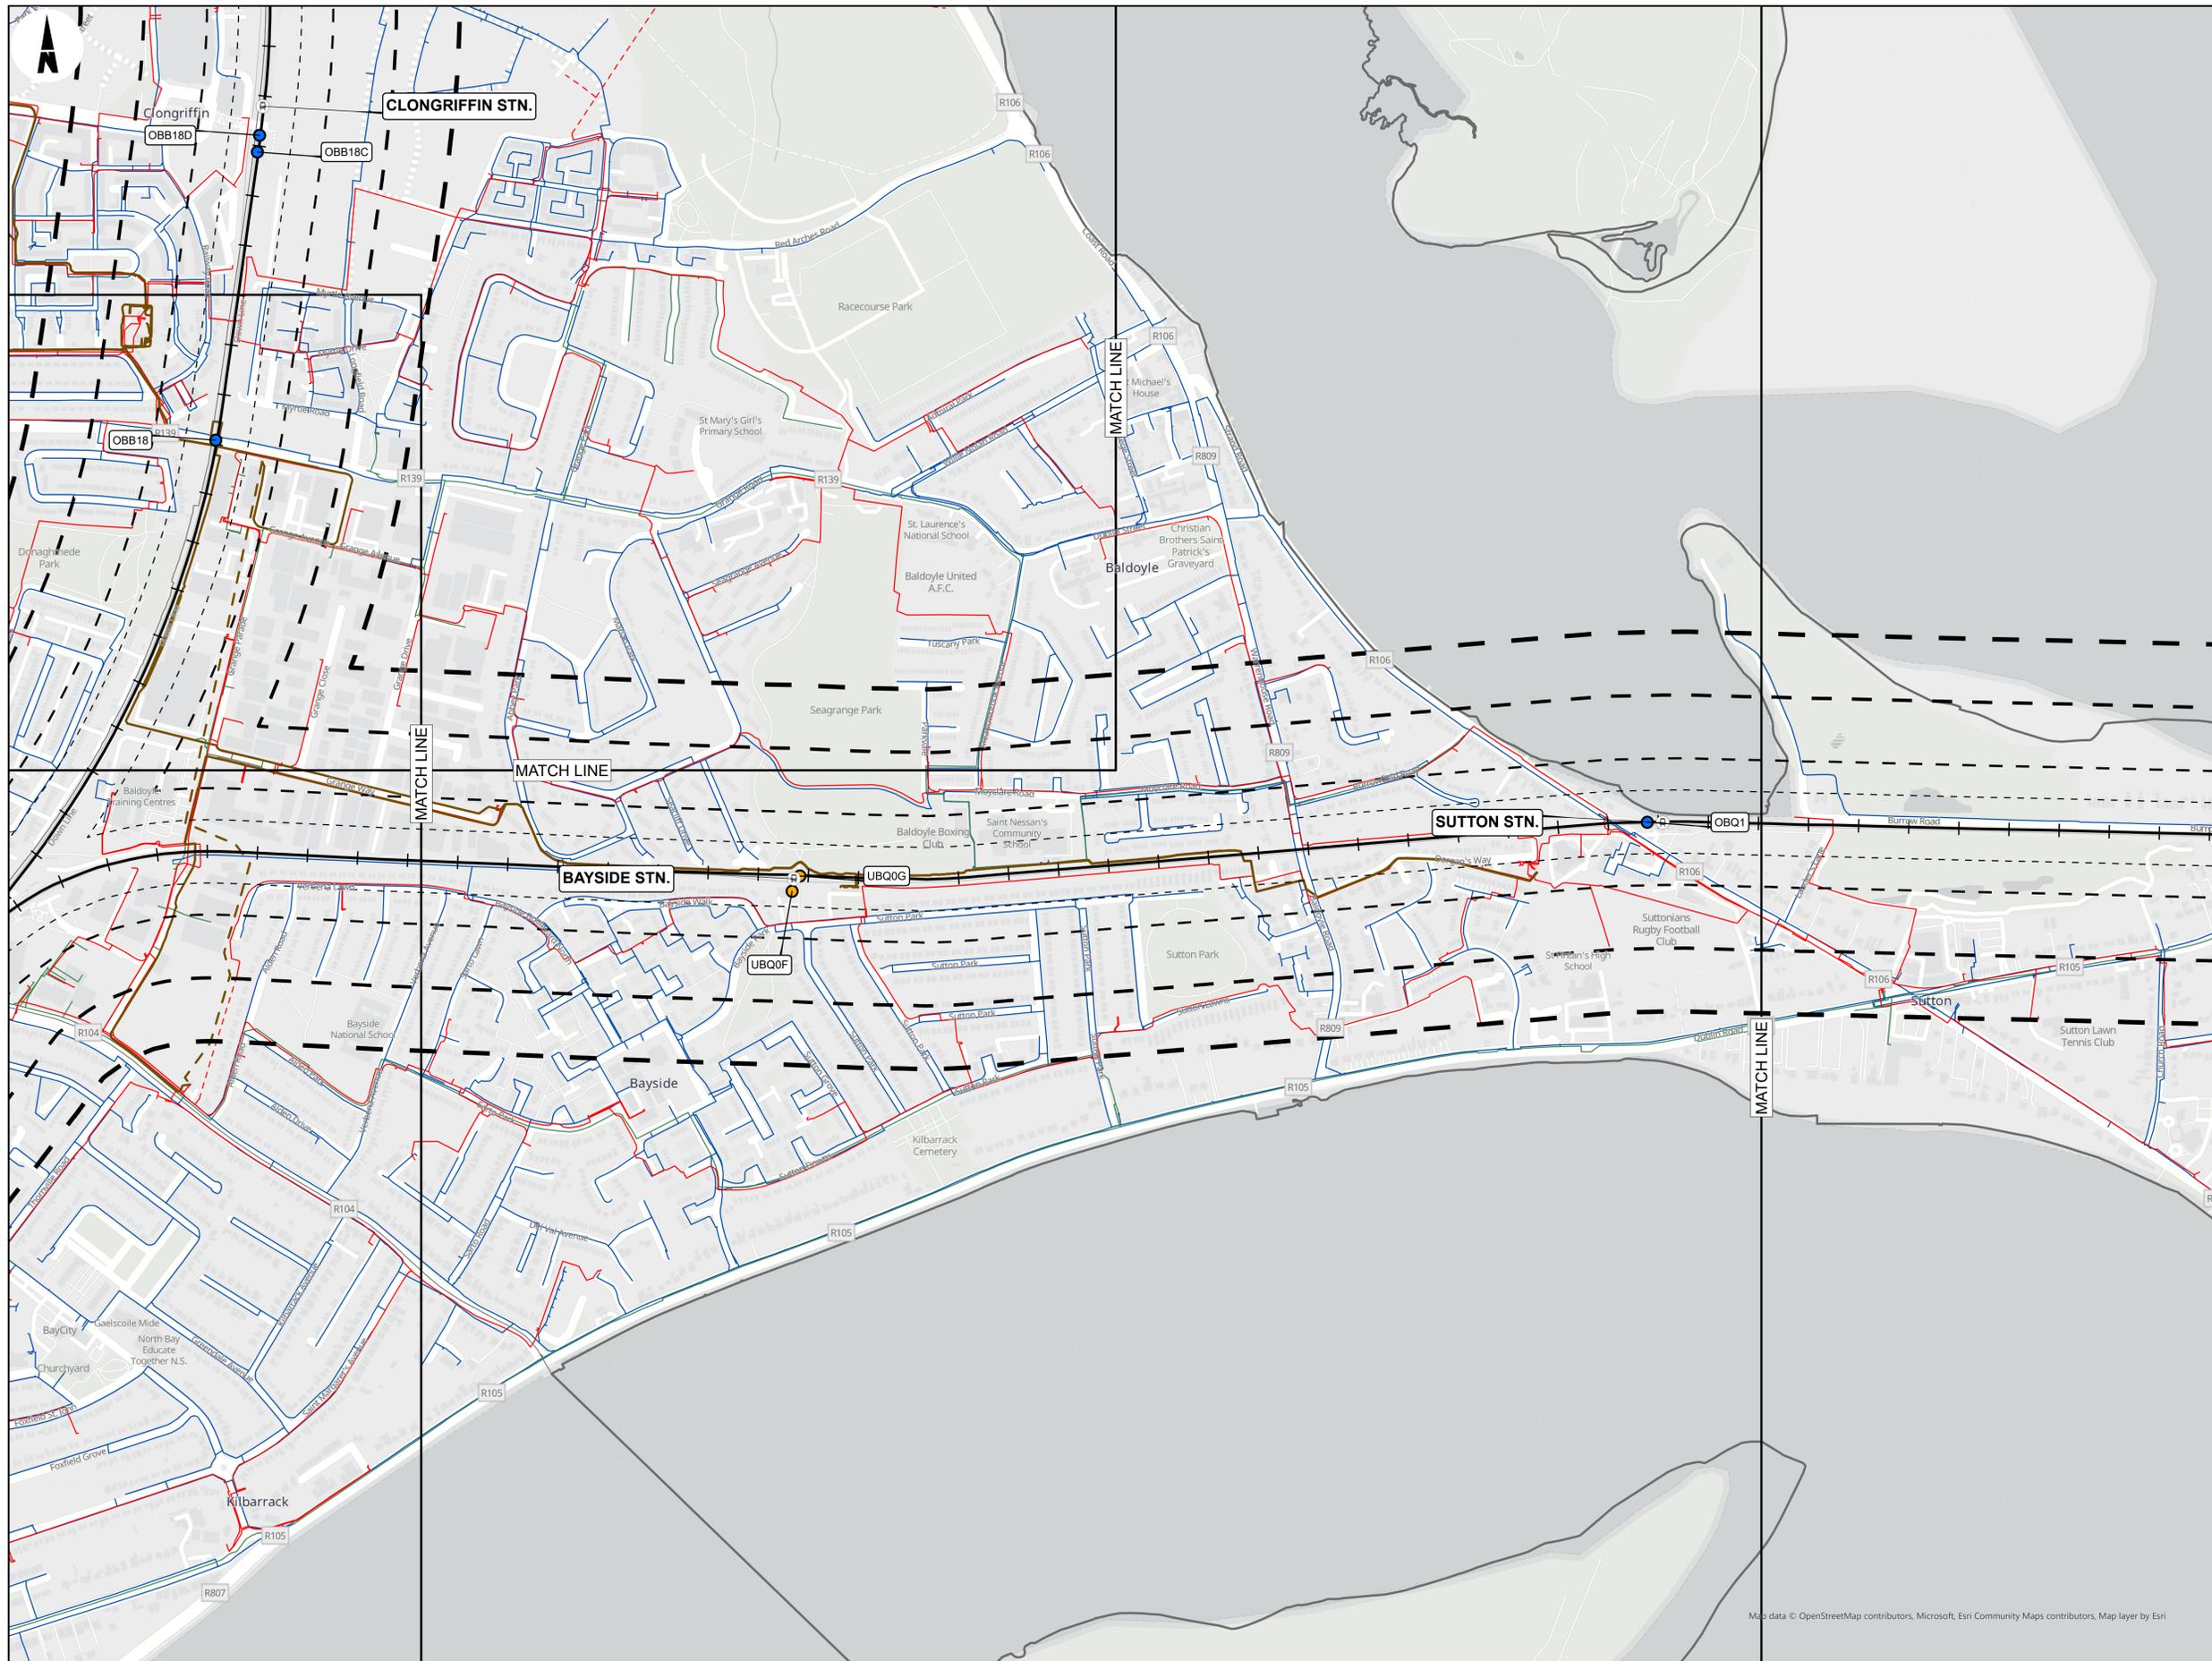

- LEGEND**
- RAILWAY STATIONS
  - BRIDGES
    - OVERBRIDGE
    - UNDERBRIDGE
  - RAILWAY LINE
  - BUFFERS
    - 50M
    - 100M
    - 200M
    - 300M
  - ADMINISTRATIVE BOUNDARY
  - COUNTY BOUNDARY
  - LICENCED FACILITIES
    - EPA LICENCED INDUSTRIAL EMISSIONS DIRECTIVE FACILITIES
    - EPA LICENCED WASTE FACILITIES
  - ESB
    - HIGH VOLTAGE NETWORK
      - ESB HV OH
      - ESB HV UG
    - MEDIUM VOLTAGE NETWORK
      - ESB MV OH
      - ESB MV UG
    - GAS NETWORKS IRELAND
      - MEDIUM PRESSURE NETWORK
      - LOW PRESSURE NETWORK

**ESB Data Disclaimer**  
 This map indicates the approximate location of ESB Networks Transmission (400kV, 220kV, 110kV, 38kV) and Distribution (20kV, 10kV, 230V/400V) underground cables and overhead lines in the general area of the proposed works. ESB Networks takes no responsibility for the accuracy or completeness of these maps. Low voltage (230V/400V) service cables (e.g. house services, factory/shop services, public lighting lamp services, etc.) are not included but their presence should be anticipated. The depths of underground cables must never be assumed. Additional more detailed information is available for high voltage Transmission underground cables (38kV, 110kV, 220kV, 400kV) for cables in the greater Dublin area call 01 6942957 and for all other areas call 1850 372 373. No work should be carried out in the vicinity of 38kV or higher voltage underground cables without prior consultation with ESB Networks. Before any mechanical excavation is undertaken, the actual location of all underground electricity cables must be established and verified on site, using: (a) Up-to-date map records; (b) Cable locator equipment operated in both power and radio modes; (c) Careful hand digging of trial holes using 'Safe Digging Practice'. Refer also to the 'HSA Code of Practice for Avoiding Danger from Underground Services'. ESB takes no responsibility and shall bear no liability in relation to any damage, injury/death or loss of supply as a result of damage or interference with its networks.

**GNI Data Disclaimer**  
 The information contained in this map concerning the location and technical designation of the gas distribution and transmission network (the 'Information') is provided 'as is' and no representation or warranty of any kind, express or implied, is made in relation to the Information and all such representations or warranties, express or implied, in relation to the Information are hereby excluded to the fullest extent permitted by law. No responsibility, liability or duty of care to you or to any other person in respect of the Information is accepted, and any reliance you or any other person places on the Information is therefore strictly at your own or at their own risk. In no event will liability be accepted for any loss or damage including, without limitation, indirect or consequential loss or damage, arising out of or in connection with the use of the Information. In the event that the Information is provided by you, in whole or in part, to a third party for whatever reason you shall ensure that the disclaimer is included with the Information and brought to the attention of the third party. The actual position of the gas distribution and transmission network must be verified on site before any mechanical excavating takes place. If any mechanical excavation is proposed, hard copy maps must be requested from Bord Gais Eireann. All work in the vicinity of the gas distribution and transmission network must be completed in accordance with the current edition of the Health & Safety Authority publication, 'Code of Practice for Avoiding Danger From Underground Services' which is available from the Health and Safety Authority (1866 28 88 88) or can be downloaded free of charge at www.hsa.ie.

Map data © OpenStreetMap contributors, Microsoft, Esri Community Maps contributors, Map layer by Esri

Copyright © Irish Rail (2021). This drawing is confidential and the copyright in it is owned by Irish Rail. This drawing must not be either loaned, copied or otherwise reproduced in whole or in part or used for any purpose without the prior permission of Irish Rail.  
 © OpenStreetMap contributors  
 © Ordnance Survey Ireland and Government of Ireland. All O.S. data used for plans are printed under 'Copyright Ordnance Survey Ireland' Survey No. 0039720 (OSI Aerial Data or OSI Lidar Data) & Survey No. 2021/OSI/MMA\_180 (OSI Vector Data). All elevations are in metres and relate to OSI Geoid Model (OSGM02) Mean Head as defined by existing Project Control. All Co-ordinates are in Irish Transverse Mercator Grid (ITM) as defined by OSI active GPS station Tallaght College (TLTG).

**Notes**  
 1. Information concerning the position of apparatus shown on this drawing is based on drawings supplied by the utility owners and/or the utility works contractor, whilst every care has been taken in the preparation of this drawing, positions should be taken as approximate and are intended for general guidance only and no representation is made by Irish Rail as to the accuracy, completeness, sufficiency or otherwise of this drawing and the position of the apparatus. The information contained herein does not purport to be comprehensive or final as the apparatus is subject to being altered and/or superseded. Recipients should not rely on this information. Any liabilities are hereby expressly disclaimed.  
 2. The information contained herein has been provided by Irish Rail but does not purport to be comprehensive or final. Recipients should not rely on this information. Neither Irish Rail nor any of its directors, officers, employees, agents, stakeholders or advisers make any representation or warranty as to or accept any liability or responsibility, in relation to, the adequacy, accuracy, reasonableness or completeness of the information provided as part of this document or any matter on which the information is based (including but not limited to loss or damage arising as a result of reliance by recipients on the information or any part of it). Any liabilities are hereby expressly dismissed.

Rev	Date	Dn	Chkd	App'd	Description
P01	30/09/2021	DM	SH	COD	
P02	11/10/2021	DM	SH	COD	
P03	10/12/2021	DM	SH	COD	

Client: **larnród Éireann Irish Rail**



Engineering Designer: **ARUP**

Date: 20/09/2021 Scale: 1:5000 @ A1, 1:10000 @ A3

Drawn	DM	Checked	SH	Approved	COD
-------	----	---------	----	----------	-----

Project Code: D+WP56 Originator Code: ARP OMS Code: 279933-00

Project Title	<b>DART+ COASTAL NORTH</b>		
Drawing Title	CONSTRAINTS REPORT THIRD PARTY UTILITIES AND LICENCED FACILITIES CONSTRAINTS OPEN STREET MAP BASEMAP		
Drawing File Name	D+WP56-ARP-ZZ-NL-OR-EV-001016	Sheet Number	16 of 19
Status	902	Rev	P03

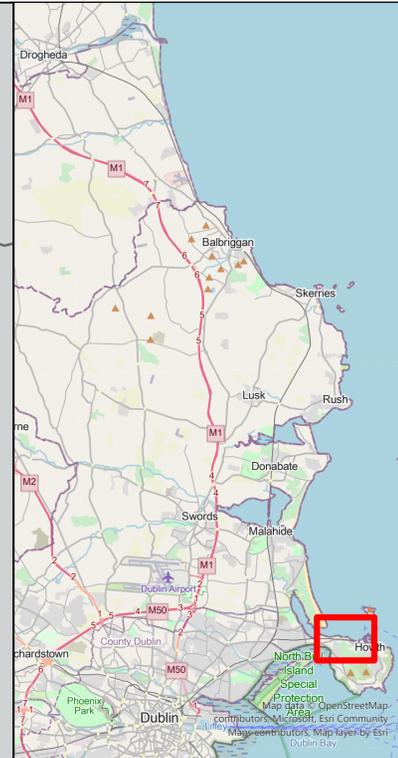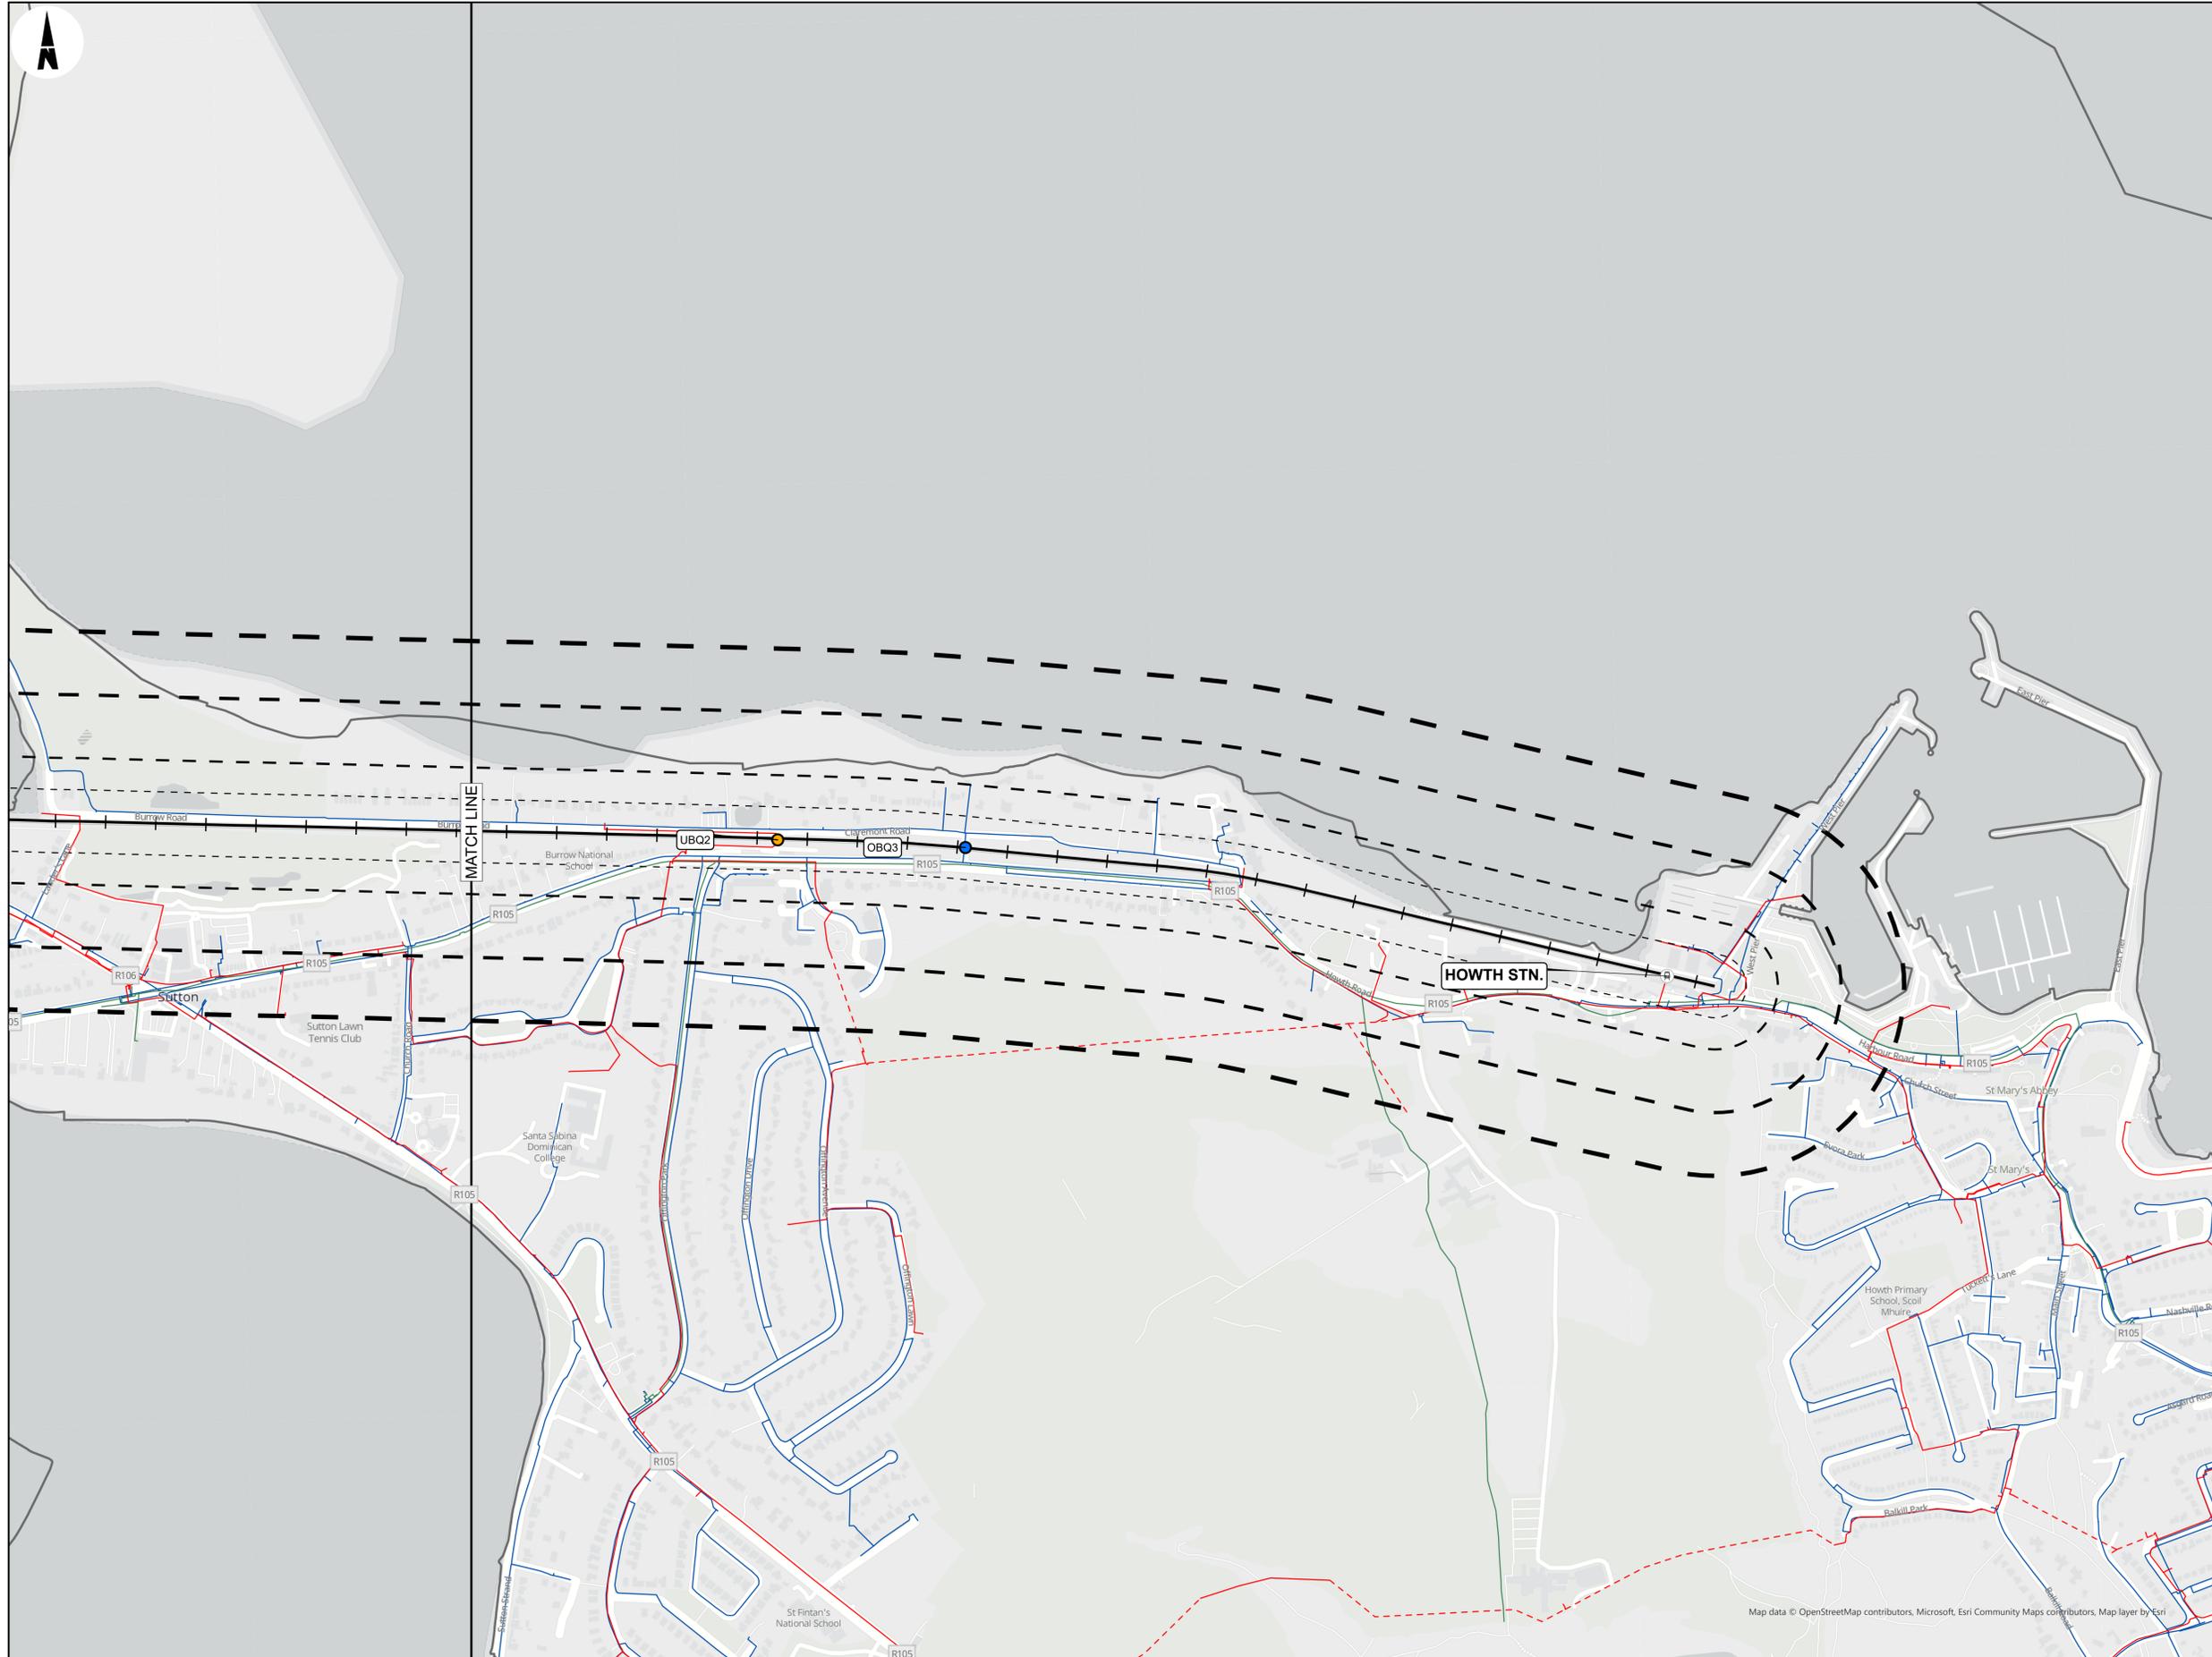

**LEGEND**

- RAILWAY STATIONS
- BRIDGES
  - OVERBRIDGE
  - UNDERBRIDGE
- RAILWAY LINE
- BUFFERS
  - 50M
  - 100M
  - 200M
  - 300M
- ADMINISTRATIVE BOUNDARY
- COUNTY BOUNDARY
- LICENCED FACILITIES
  - EPA LICENCED INDUSTRIAL EMISSIONS DIRECTIVE FACILITIES
  - EPA LICENCED WASTE FACILITIES
- ESB
- MEDIUM VOLTAGE NETWORK
  - ESB MV OH
  - ESB MV UG
- GAS NETWORKS IRELAND
  - MEDIUM PRESSURE NETWORK
  - LOW PRESSURE NETWORK

**ESB Data Disclaimer**  
 This map indicates the approximate location of ESB Networks Transmission (400kV, 220kV, 110kV, 38kV) and Distribution (20kV, 10kV, 230V/400V) underground cables and overhead lines in the general area of the proposed works. ESB Networks takes no responsibility for the accuracy or completeness of these maps. Low voltage (230V/400V) service cables (e.g. house services, factory/shop services, public lighting lamp services, etc.) are not included but their presence should be anticipated. The depths of underground cables must never be assumed. Additional more detailed information is available for high voltage Transmission underground cables (38kV, 110kV, 220kV, 400kV) for cables in the greater Dublin area call 01 6942957 and for all other areas call 1850 372 737. No work should be carried out in the vicinity of 38kV or higher voltage underground cables without prior consultation with ESB Networks. Before any mechanical excavation is undertaken, the actual location of all underground electricity cables must be established and verified on site, using: (a) Up-to-date map records; (b) Cable locator equipment operated in both power and radio modes; (c) Careful hand digging of trial holes using 'Safe Digging Practice'. Refer also to the 'HSA Code of Practice for Avoiding Danger from Underground Services'. ESB takes no responsibility and shall bear no liability in relation to any damage, injury/death or loss of supply as a result of damage or interference with its networks.

**GNI Data Disclaimer**  
 The information contained in this map concerning the location and technical designation of the gas distribution and transmission network (the 'Information') is provided 'as is' and no representation or warranty of any kind, express or implied, is made in relation to the Information and all such representations or warranties, express or implied, in relation to the Information are hereby excluded to the fullest extent permitted by law. No responsibility, liability or duty of care to you or to any other person in respect of the Information is accepted, and any reliance you or any other person places on the Information is therefore strictly at your own or at their own risk. In no event will liability be accepted for any loss or damage including, without limitation, indirect or consequential loss or damage, arising out of or in connection with the use of the Information. In the event that the Information is provided by you, in whole or in part, to a third party for whatever reason you shall ensure that the disclaimer is included with the Information and brought to the attention of the third party. The actual position of the gas distribution and transmission network must be verified on site before any mechanical excavating takes place. If any mechanical excavation is proposed, hard copy maps must be requested from Bord Gais Eireann. All work in the vicinity of the gas distribution and transmission network must be completed in accordance with the current edition of the Health & Safety Authority publication, 'Code of Practice for Avoiding Danger From Underground Services' which is available from the Health and Safety Authority (1 800 28 28 80) or can be downloaded free of charge at www.hsa.ie.

Map data © OpenStreetMap contributors, Microsoft, Esri Community Maps contributors, Map layer by Esri

Copyright © Irish Rail (2021). This drawing is confidential and the copyright in it is owned by Irish Rail. This drawing must not be either loaned, copied or otherwise reproduced in whole or in part or used for any purpose without the prior permission of Irish Rail.

© OpenStreetMap contributors

© Ordnance Survey Ireland and Government of Ireland. All O.S. data used for plans are printed under "Copyright Ordnance Survey Ireland" Survey No. 0039720 (OSI Aerial Data or OSI Lidar Data) & Survey No. 2021/OSI/MMA\_180 (OSI Vector Data). All elevations are in metres and relate to OSI Geoid Model (OSGM02) Malin Head as defined by existing Project Control. All Co-ordinates are in Irish Transverse Mercator Grid (ITM) as defined by OSI active GPS station Tallaght College (TLTG).

**Notes**

- Information concerning the position of apparatus shown on this drawing is based on drawings supplied by the utility owners and/or the utility works contractor, whilst every care has been taken in the preparation of this drawing, positions should be taken as approximate and are intended for general guidance only and no representation is made by Irish Rail as to the accuracy, completeness, sufficiency or otherwise of this drawing and the position of the apparatus. The information contained herein does not purport to be comprehensive or final as the apparatus is subject to being altered and/or superseded. Recipients should not rely on this information. Any liabilities are hereby expressly disclaimed.
- The information contained herein has been provided by Irish Rail but does not purport to be comprehensive or final. Recipients should not rely on the information. Neither Irish Rail nor any of its directors, officers, employees, agents, stakeholders or advisers make any representation or warranty as to or accept any liability or responsibility, in relation to, the adequacy, accuracy, reasonableness or completeness of the information provided as part of this document or any matter on which the information is based (including but not limited to loss or damage arising as a result of reliance by recipients on the information or any part of it). Any liabilities are hereby expressly dismissed.

Rev	Date	Dn	Chkd	App'd	Description
P01	30/09/2021	DM	SH	COD	
P02	11/10/2021	DM	SH	COD	
P03	10/12/2021	DM	SH	COD	

Client: **larnród Éireann Irish Rail**

Engineering Designer: **ARUP**

Date: 20/09/2021 Scale: 1:5000 @ A1, 1:10000 @ A3

Project Code: D+WP56 Originator Code: ARP

Drawn: DM Checked: SH Approved: COD



OMS Code: 279933-00

Project Title: **DART+ COASTAL NORTH**

Drawing Title: **THIRD PARTY UTILITIES AND LICENCED FACILITIES CONSTRAINTS OPEN STREET MAP BASEMAP**

Drawing File Name: D+WP56-ARP-ZZ-NL-OR-EV-001017

Sheet Number: 17 of 19 Status: 902 Rev: P03

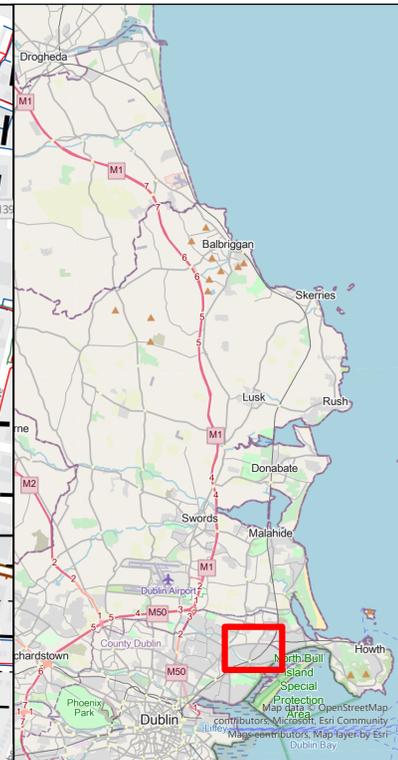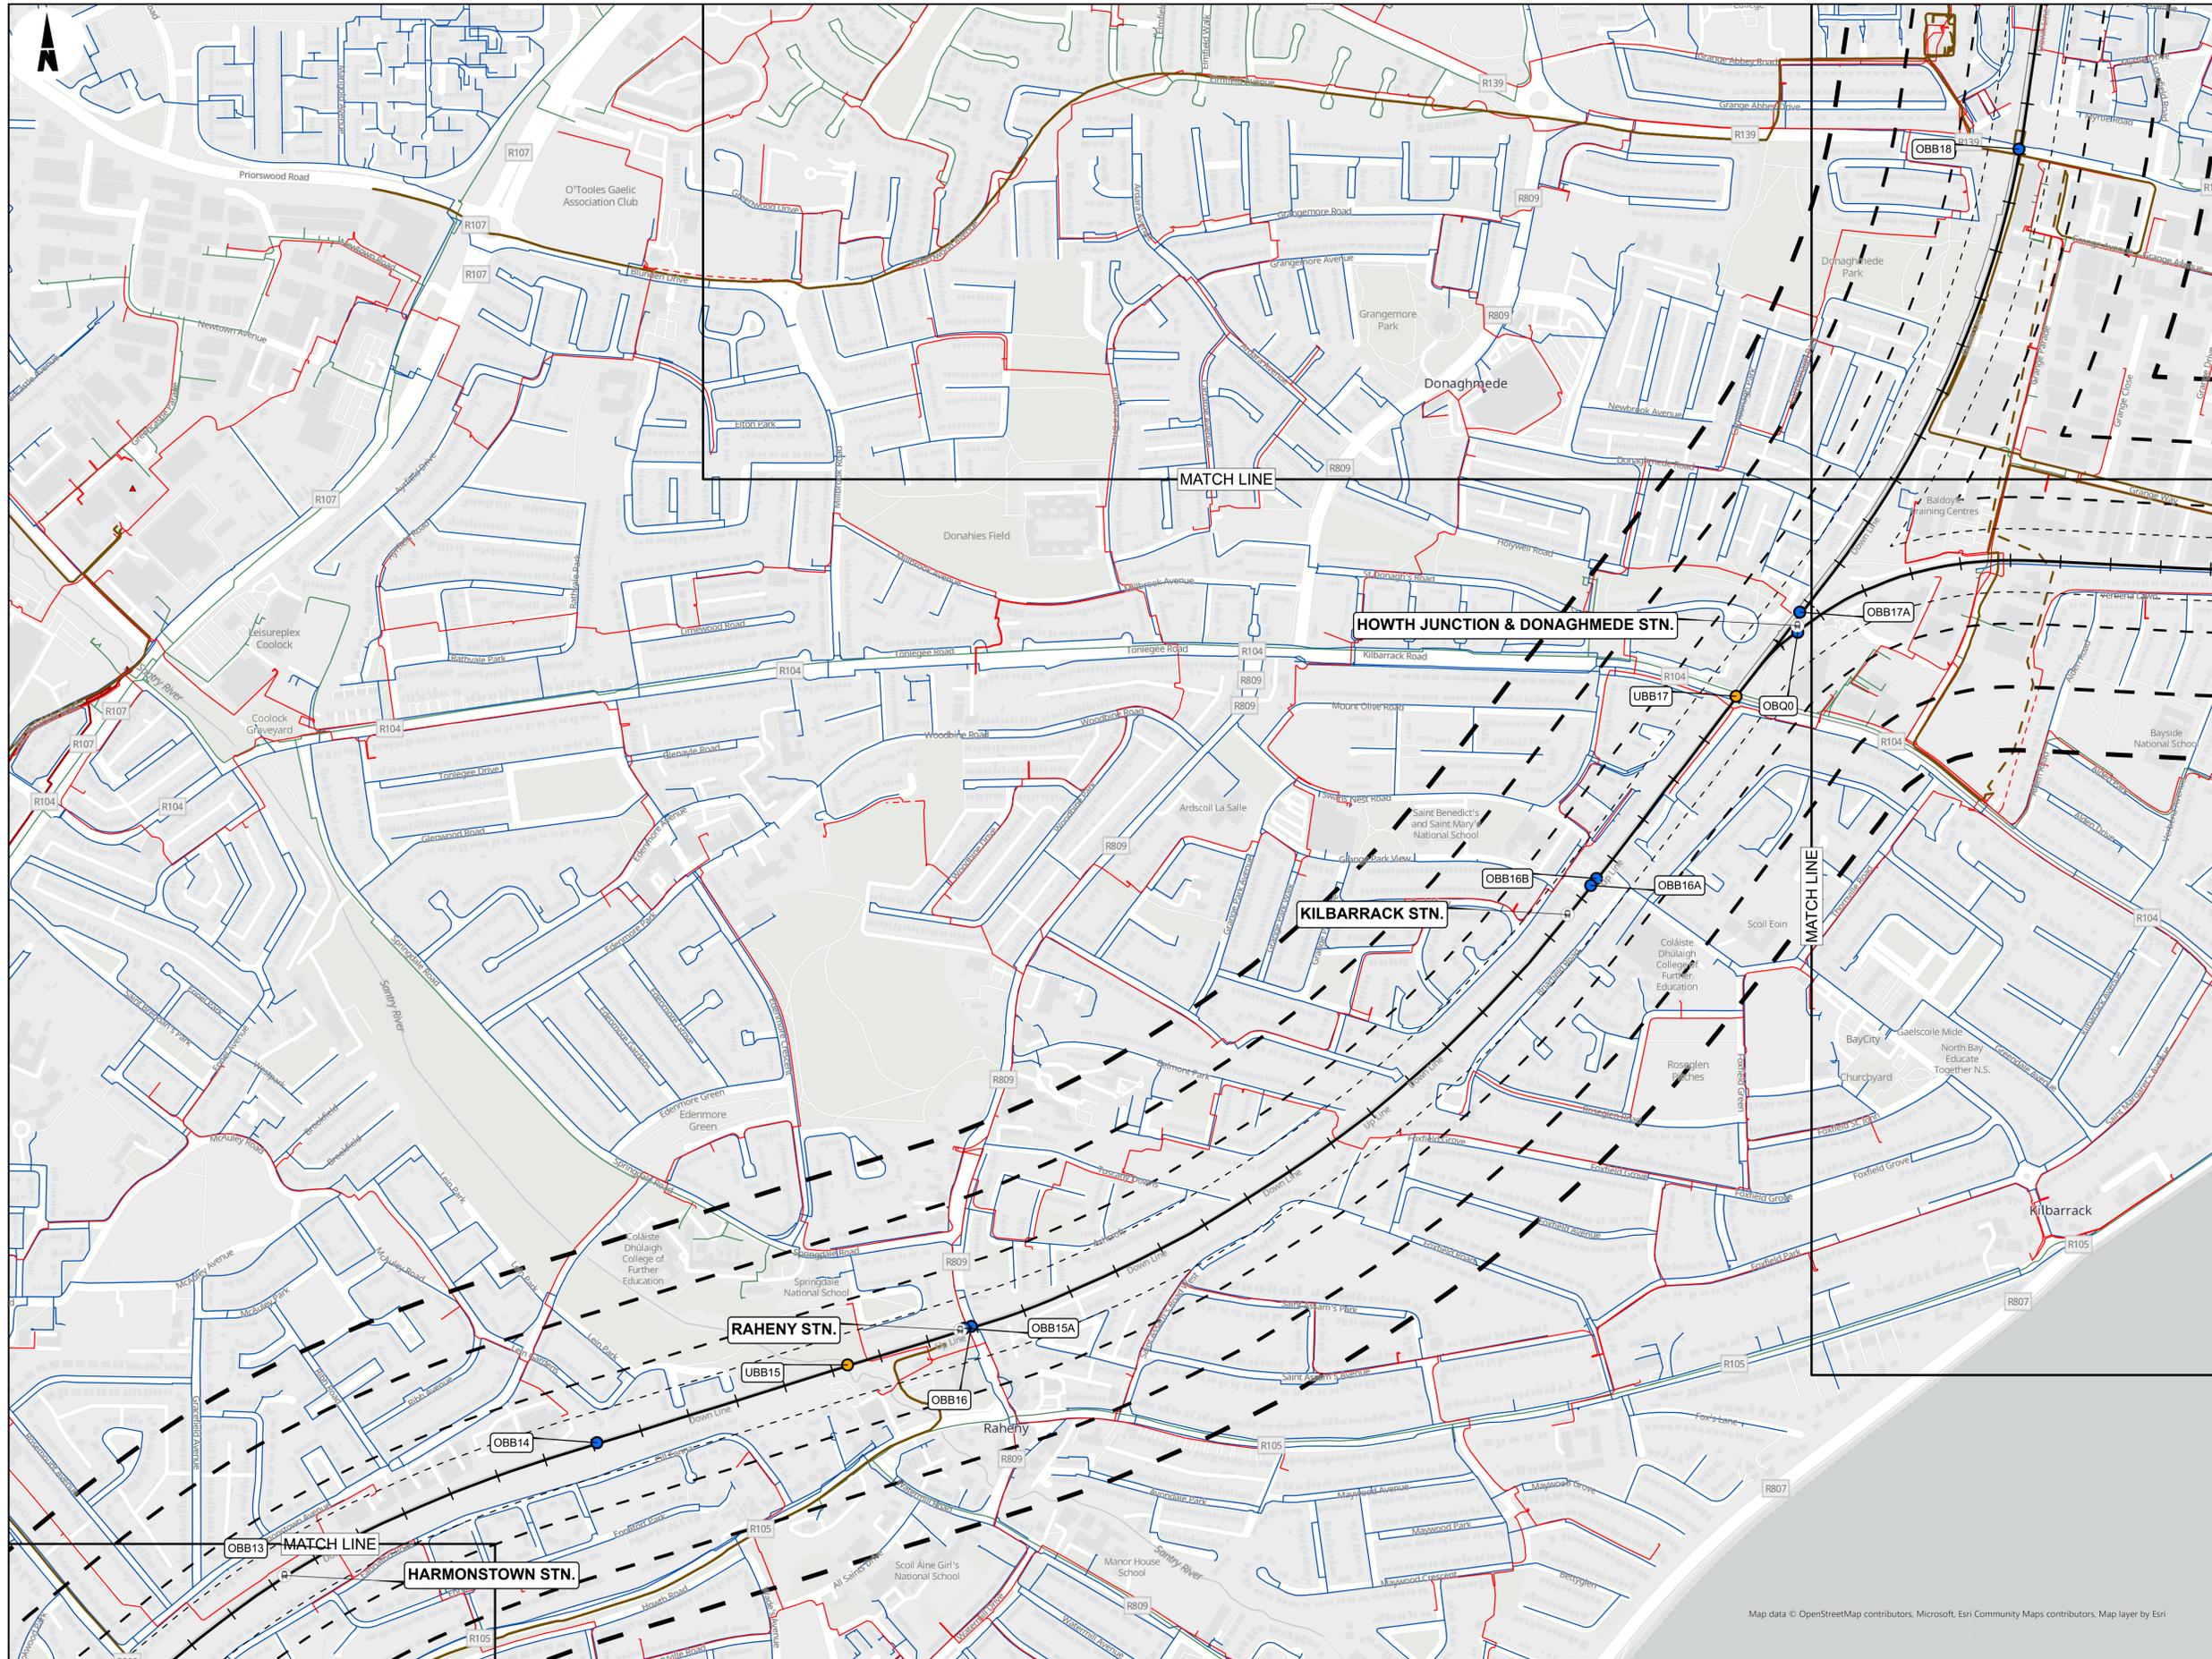

**LEGEND**

- RAILWAY STATIONS
- BRIDGES
  - OVERBRIDGE
  - UNDERBRIDGE
- RAILWAY LINE
- BUFFERS
  - 50M
  - 100M
  - 200M
  - 300M
- ADMINISTRATIVE BOUNDARY
- COUNTY BOUNDARY
- LICENCED FACILITIES
  - EPA LICENCED INDUSTRIAL EMISSIONS DIRECTIVE FACILITIES
  - EPA LICENCED WASTE FACILITIES
- ESB
  - HIGH VOLTAGE NETWORK
    - ESB HV OH
    - ESB HV UG
  - MEDIUM VOLTAGE NETWORK
    - ESB MV OH
    - ESB MV UG
- GAS NETWORKS IRELAND
  - HIGH PRESSURE NETWORK
  - MEDIUM PRESSURE NETWORK
  - LOW PRESSURE NETWORK

**ESB Data Disclaimer**  
 This map indicates the approximate location of ESB Networks Transmission (400kV, 220kV, 110kV, 38kV) and Distribution (20kV, 10kV, 230V/400V) underground cables and overhead lines in the general area of the proposed works. ESB Networks takes no responsibility for the accuracy or completeness of these maps. Low voltage (230V/400V) service cables (e.g. house services, factory/shop services, public lighting lamp services, etc.) are not included but their presence should be anticipated. The depths of underground cables must never be assumed. Additional more detailed information is available for high voltage Transmission underground cables (38kV, 110kV, 220kV, 400kV) for cables in the greater Dublin area call 01 6942957 and for all other areas call 1850 372 737. No work should be carried out in the vicinity of 38kV or higher voltage underground cables without prior consultation with ESB Networks. Before any mechanical excavation is undertaken, the actual location of all underground electricity cables must be established and verified on site, using: (a) Up-to-date map records; (b) Cable locator equipment operated in both power and radio modes; (c) Careful hand digging of trial holes using 'Safe Digging Practices'. Refer also to the 'HSA Code of Practice for Avoiding Danger from Underground Services'. ESB takes no responsibility and shall bear no liability in relation to any damage, injury/death or loss of supply as a result of damage or interference with its networks.

**GNI Data Disclaimer**  
 The information contained in this map concerning the location and technical designation of the gas distribution and transmission network (the 'Information') is provided 'as is' and no representation or warranty of any kind, express or implied, is made in relation to the Information and all such representations or warranties, express or implied, in relation to the Information are hereby excluded to the fullest extent permitted by law. No responsibility, liability or duty of care to you or to any other person in respect of the Information is accepted, and any reliance you or any other person places on the Information is therefore strictly at your own or at their own risk. In no event will liability be accepted for any loss or damage including, without limitation, indirect or consequential loss or damage, arising out of or in connection with the use of the Information. In the event that the Information is provided by you, in whole or in part, to a third party for whatever reason you shall ensure that the disclaimer is included with the Information and brought to the attention of the third party. The actual position of the gas distribution and transmission network must be verified on site before any mechanical excavating takes place. If any mechanical excavation is proposed, hard copy maps must be requested from Bort Gais Éireann. All work in the vicinity of the gas distribution and transmission network must be completed in accordance with the current edition of the Health & Safety Authority publication, 'Code of Practice for Avoiding Danger From Underground Services' which is available from the Health and Safety Authority (1850 28 80) or can be downloaded free of charge at www.hsa.ie.

Map data © OpenStreetMap contributors, Microsoft, Esri Community Maps contributors, Map layer by Esri

Copyright © Irish Rail (2021) This drawing is confidential and the copyright in it is owned by Irish Rail. This drawing must not be either loaned, copied or otherwise reproduced in whole or in part or used for any purpose without the prior permission of Irish Rail.

© OpenStreetMap contributors

© Ordnance Survey Ireland and Government of Ireland. All O.S. data used for plans are printed under "Copyright Ordnance Survey Ireland" Survey No. 0309720 (OSI Aerial Data or OSI Lidar Data) & Survey No. 2021055 (MMA, 150 (OSI Vector Data)). All elevations are in metres and relate to OSI Geoid Model (OSGM02) Mean Head as defined by existing Project Control. All Co-ordinates are in Irish Transverse Mercator Grid (ITM) as defined by OSI active GPS Station Tallaght College (TLTG).

**Notes**

- Information concerning the position of apparatus shown on this drawing is based on drawings supplied by the utility owners and/or the utility works contractor, whilst every care has been taken in the preparation of this drawing, positions should be taken as approximate and are intended for general guidance only and no representation is made by Irish Rail as to the accuracy, completeness, sufficiency or otherwise of this drawing and the position of the apparatus. The information contained herein does not purport to be comprehensive or final as the apparatus is subject to being altered and/or superseded. Recipients should not rely on this information. Any liabilities are hereby expressly disclaimed.
- The information contained herein has been provided by Irish Rail but does not purport to be comprehensive or final. Recipients should not rely on the information. Neither Irish Rail nor any of its directors, officers, employees, agents, stakeholders or advisers make any representation or warranty as to or accept any liability or responsibility, in relation to, the adequacy, accuracy, reasonableness or completeness of the information provided as part of this document or any matter on which the information is based (including but not limited to loss or damage arising as a result of reliance by recipients on the information or any part of it). Any liabilities are hereby expressly dismissed.

**DART+ Coastal North**

**NTA**  
 National Transport Authority

**Tionscadal Éireann Project Ireland 2040**

Rev	Date	Dn	Chkd	App'd	Description
P01	30/09/2021	DM	SH	COD	
P02	11/10/2021	DM	SH	COD	
P03	10/12/2021	DM	SH	COD	

Client: **larnród Éireann Irish Rail**

Engineering Designer: **ARUP**

Date: 20/09/2021 Scale: 1:5000 @ A1 1:10000 @ A3

Project Code: D-WP56 Originator Code: ARP

Drawn: DM Checked: SH Approved: COD



OMS Code: 279933-00

Project Title: **DART+ COASTAL NORTH**

Drawing Title: **CONSTRAINTS REPORT THIRD PARTY UTILITIES AND LICENCED FACILITIES CONSTRAINTS OPEN STREET MAP BASEMAP**

Drawing File Name: D-WP56-ARP-ZZ-LNR-EV-01018

Sheet Number	Status	Rev
18 of 19	902	P03

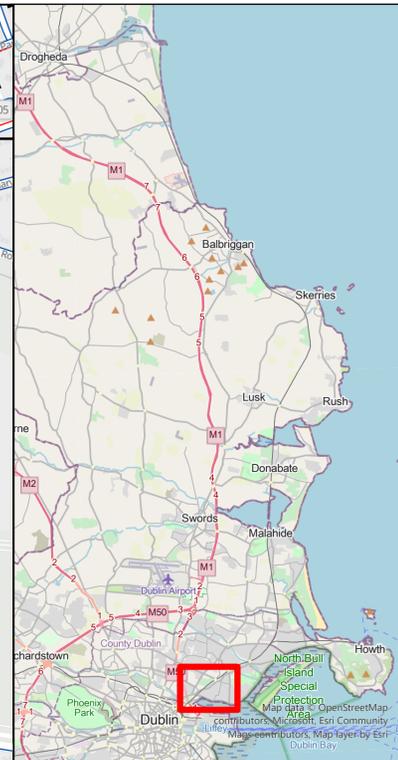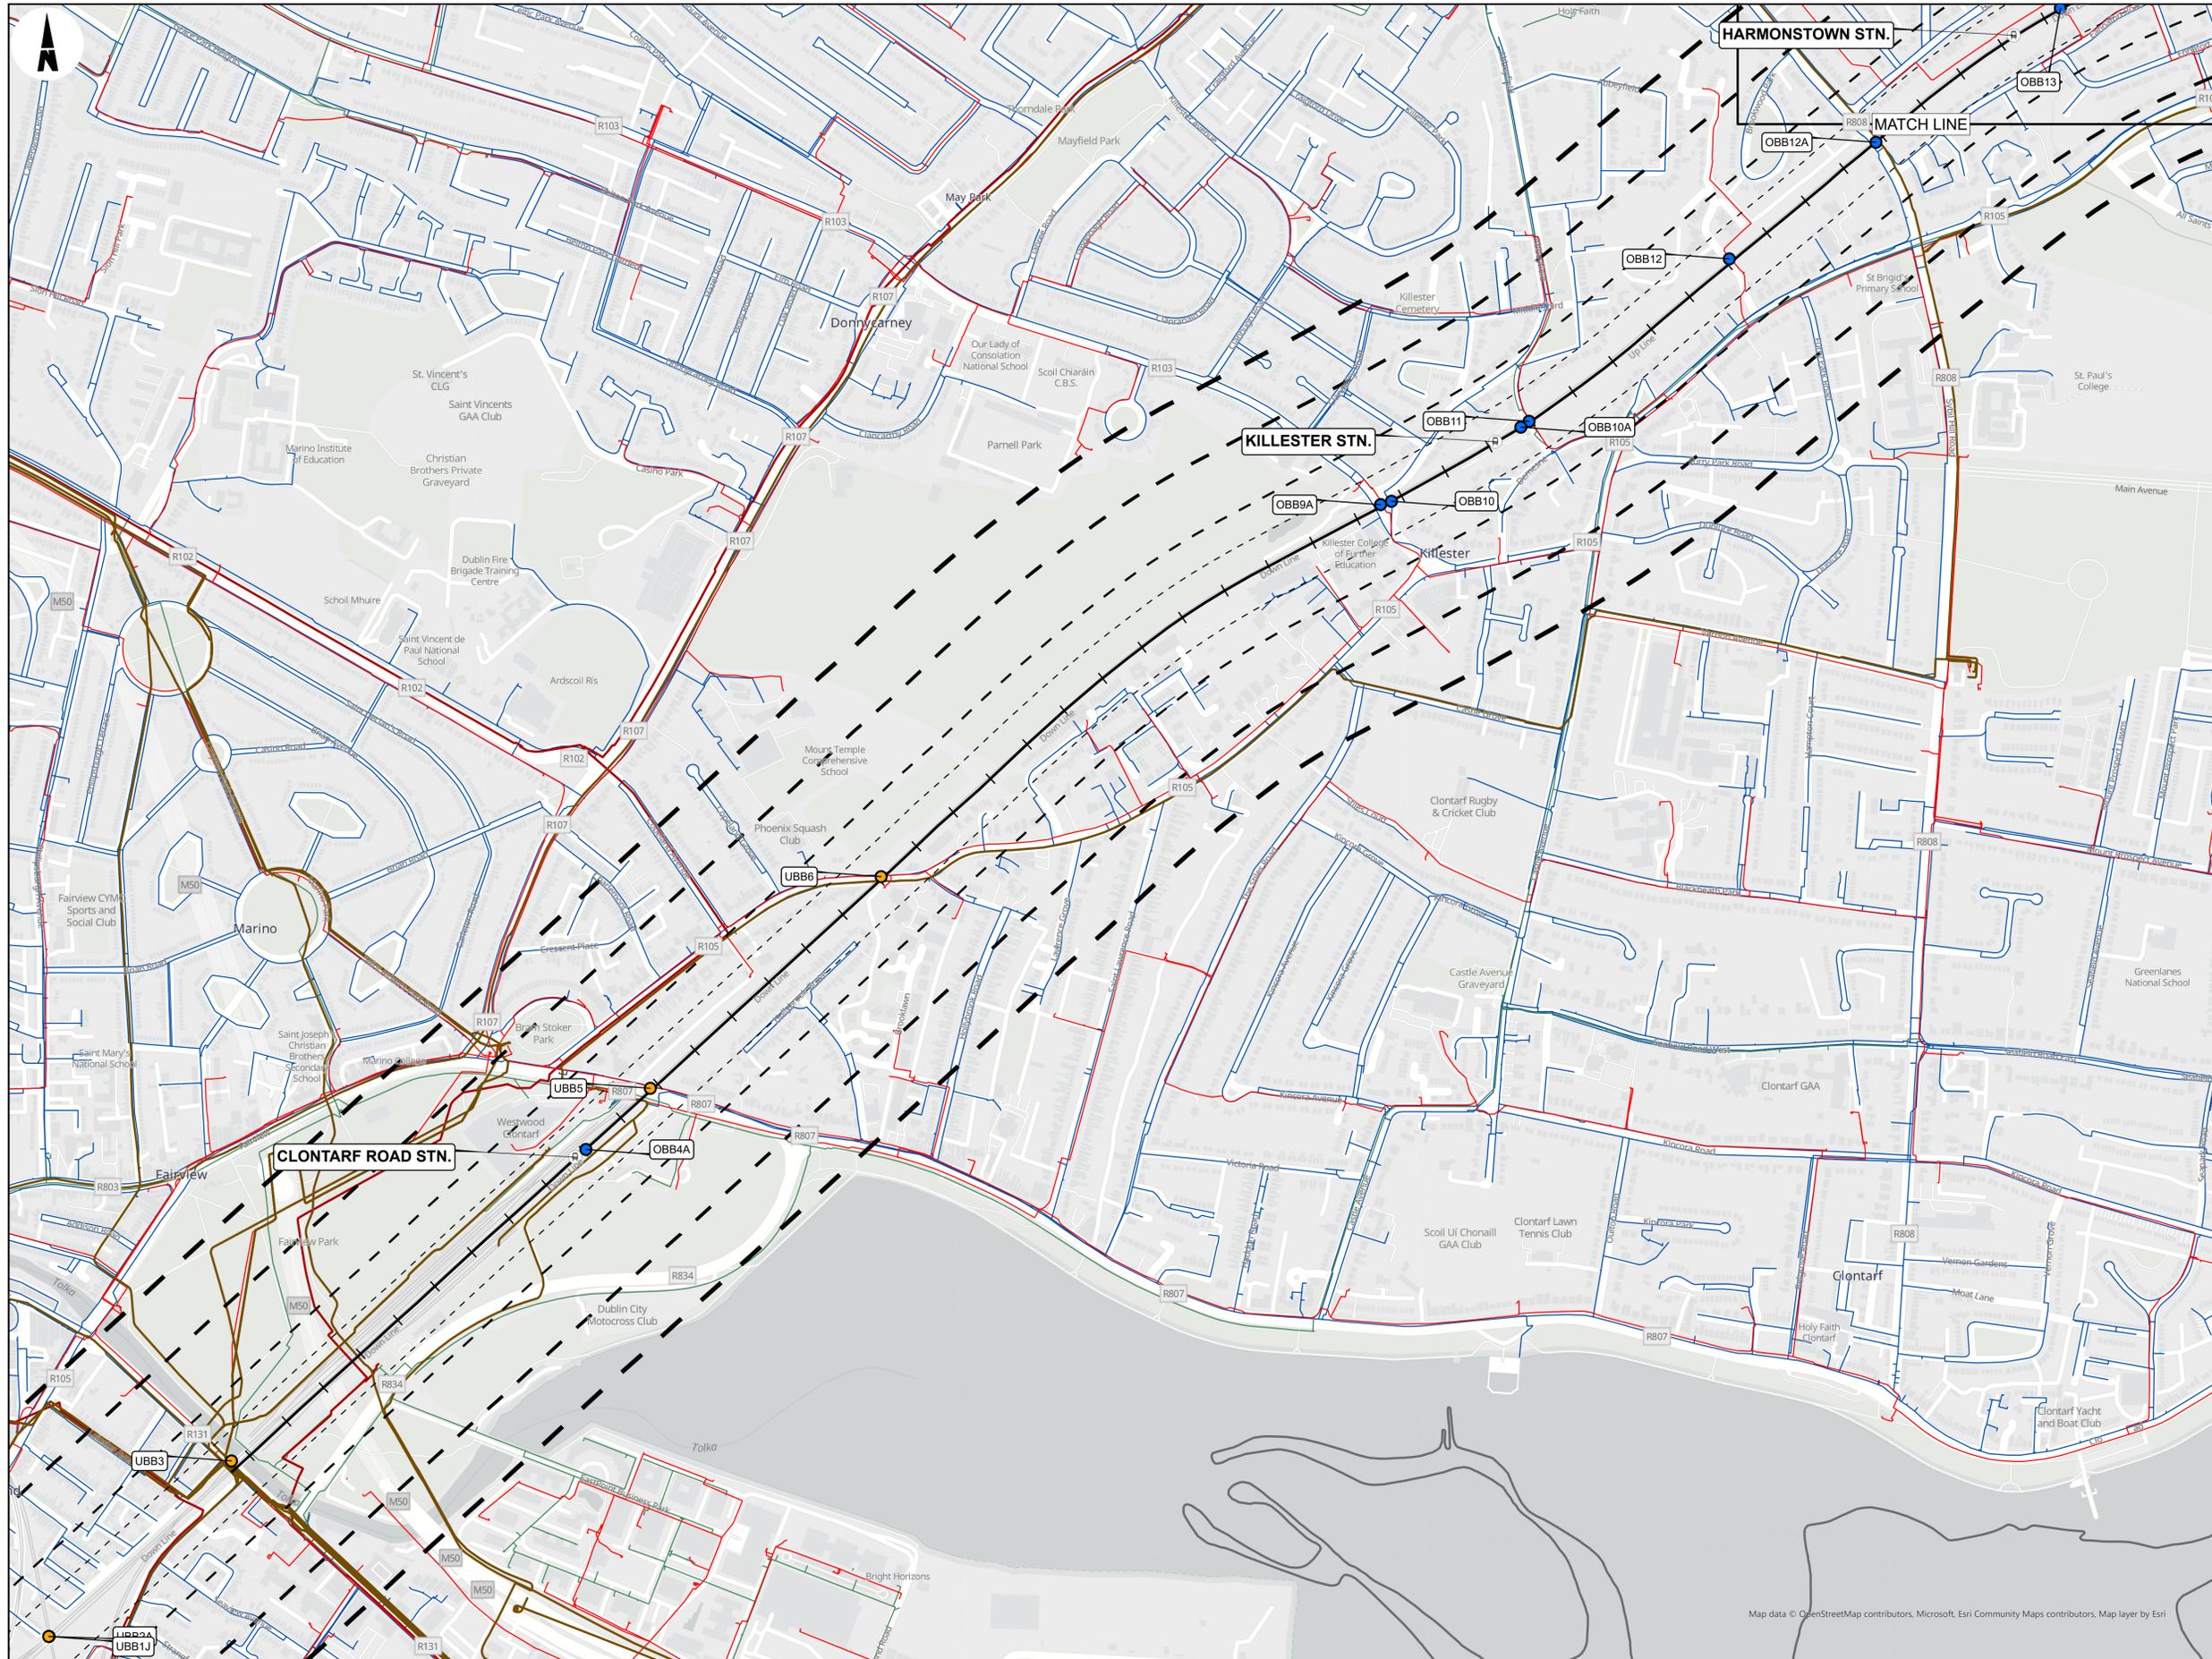

**LEGEND**

- RAILWAY STATIONS
- BRIDGES
  - OVERBRIDGE
  - UNDERBRIDGE
- RAILWAY LINE
- BUFFERS
  - 50M
  - 100M
  - 200M
  - 300M
- ADMINISTRATIVE BOUNDARY
- COUNTY BOUNDARY
- LICENCED FACILITIES
  - EPA LICENCED INDUSTRIAL EMISSIONS DIRECTIVE FACILITIES
  - EPA LICENCED WASTE FACILITIES
- ESB
  - HIGH VOLTAGE NETWORK
    - ESB HV UG
  - MEDIUM VOLTAGE NETWORK
    - ESB MV UG
- GAS NETWORKS IRELAND
  - HIGH PRESSURE NETWORK
  - MEDIUM PRESSURE NETWORK
  - LOW PRESSURE NETWORK

**ESB Data Disclaimer**  
 This map indicates the approximate location of ESB Networks Transmission (400kV, 220kV, 110kV, 38kV) and Distribution (20kV, 10kV, 230V/400V) underground cables and overhead lines in the general area of the proposed works. ESB Networks takes no responsibility for the accuracy or completeness of these maps. Low voltage (230V/400V) service cables (e.g. house services, factory/shop services, public lighting lamp services, etc.) are not included but their presence should be anticipated. The depths of underground cables must never be assumed. Additional more detailed information is available for high voltage Transmission underground cables (38kV, 110kV, 220kV, 400kV) - for cables in the greater Dublin area call 01 6942957 and for all other areas call 1850 372 737. No work should be carried out in the vicinity of 38kV or higher voltage underground cables without prior consultation with ESB Networks. Before any mechanical excavation is undertaken, the actual location of all underground electricity cables must be established and verified on site, using: (a) Up-to-date map records; (b) Cable locator equipment operated in both power and radio modes; (c) Careful hand digging of trial holes using 'Safe Digging Practice'. Refer also to the 'HSA Code of Practice for Avoiding Danger from Underground Services'. ESB takes no responsibility and shall bear no liability in relation to any damage, injury/death or loss of supply as a result of damage or interference with its networks.

**GNI Data Disclaimer**  
 The information contained in this map concerning the location and technical designation of the gas distribution and transmission network (the 'Information') is provided 'as is' and no representation or warranty of any kind, express or implied, is made in relation to the Information and all such representations or warranties, express or implied, in relation to the Information are hereby excluded to the fullest extent permitted by law. No responsibility, liability or duty of care to you or to any other person in respect of the Information is accepted, and any reliance you or any other person places on the Information is therefore strictly at your own or at their own risk. In no event will liability be accepted for any loss or damage including, without limitation, indirect or consequential loss or damage, arising out of or in connection with the use of the Information. In the event that the Information is provided by you, in whole or in part, to a third party for whatever reason you shall ensure that the disclaimer is included with the Information and brought to the attention of the third party. The actual position of the gas distribution and transmission network must be verified on site before any mechanical excavating takes place. If any mechanical excavation is proposed, hard copy maps must be requested from Bord Gais Eireann. All work in the vicinity of the gas distribution and transmission network must be completed in accordance with the current edition of the Health & Safety Authority publication, 'Code of Practice for Avoiding Danger From Underground Services' which is available from the Health and Safety Authority (1866 26 86 86) or can be downloaded free of charge at www.hsa.ie.

Map data © OpenStreetMap contributors, Microsoft, Esri Community Maps contributors, Map layer by Esri

Copyright © Irish Rail (2021). This drawing is confidential and the copyright in it is owned by Irish Rail. This drawing must not be either loaned, copied or otherwise reproduced in whole or in part or used for any purpose without the prior permission of Irish Rail.

© OpenStreetMap contributors

© Ordnance Survey Ireland and Government of Ireland. All O.S. data used for plans are printed under "Copyright Ordnance Survey Ireland" Survey No. 0039720 (OSI Aerial Data or OSI Lidar Data) & Survey No. 2021/05 (MMA, 180 (OSI Vector Data)). All elevations are in metres and relate to OSI Geoid Model (OSGM02) Mean Head as defined by existing Project Control. All Co-ordinates are in Irish Transverse Mercator Grid (ITM) as defined by OSI active GPS Station Tallaght College (TLG).

**Notes**

- Information concerning the position of apparatus shown on this drawing is based on drawings supplied by the utility owners and/or the utility works contractor, whilst every care has been taken in the preparation of this drawing, positions should be taken as approximate and are intended for general guidance only and no representation is made by Irish Rail as to the accuracy, completeness, sufficiency or otherwise of this drawing and the position of the apparatus. The information contained herein does not purport to be comprehensive or final as the apparatus is subject to being altered and/or superseded. Recipients should not rely on this information. Any liabilities are hereby expressly disclaimed.
- The information contained herein has been provided by Irish Rail but does not purport to be comprehensive or final. Recipients should not rely on the information. Neither Irish Rail nor any of its directors, officers, employees, agents, stakeholders or advisers make any representation or warranty as to or accept any liability or responsibility, in relation to, the adequacy, accuracy, reasonableness or completeness of the information provided as part of this document or any matter on which the information is based (including but not limited to loss or damage arising as a result of reliance by recipients on the information or any part of it). Any liabilities are hereby expressly dismissed.

**DART+ Coastal North**

**NTA**  
 Náisiúnta Aonúis  
 National Transport Authority

**Tionscadal Éireann**  
 Project Ireland 2040

Rev	Date	Dn	Chkd	App'd	Description
P01	30/09/2021	DM	SH	COD	
P02	11/10/2021	DM	SH	COD	
P03	10/12/2021	DM	SH	COD	

Client: **larnród Éireann Irish Rail**

Engineering Designer: **ARUP**

Date: 20/09/2021 Scale: 1:5000 @ A1 1:10000 @ A3

Drawn	DM	Checked	SH	Approved	COD
-------	----	---------	----	----------	-----

Project Code: D+WP56 Originator Code: ARP OMS Code: 279933-00

Project Title: **DART+ COASTAL NORTH**

Drawing Title: **THIRD PARTY UTILITIES AND LICENCED FACILITIES CONSTRAINTS OPEN STREET MAP BASEMAP**

Drawing File Name: D+WP56-ARP-ZZ-LNR-0V-010119

Sheet Number	19 of 19	Status	902	Rev	P03
--------------	----------	--------	-----	-----	-----