


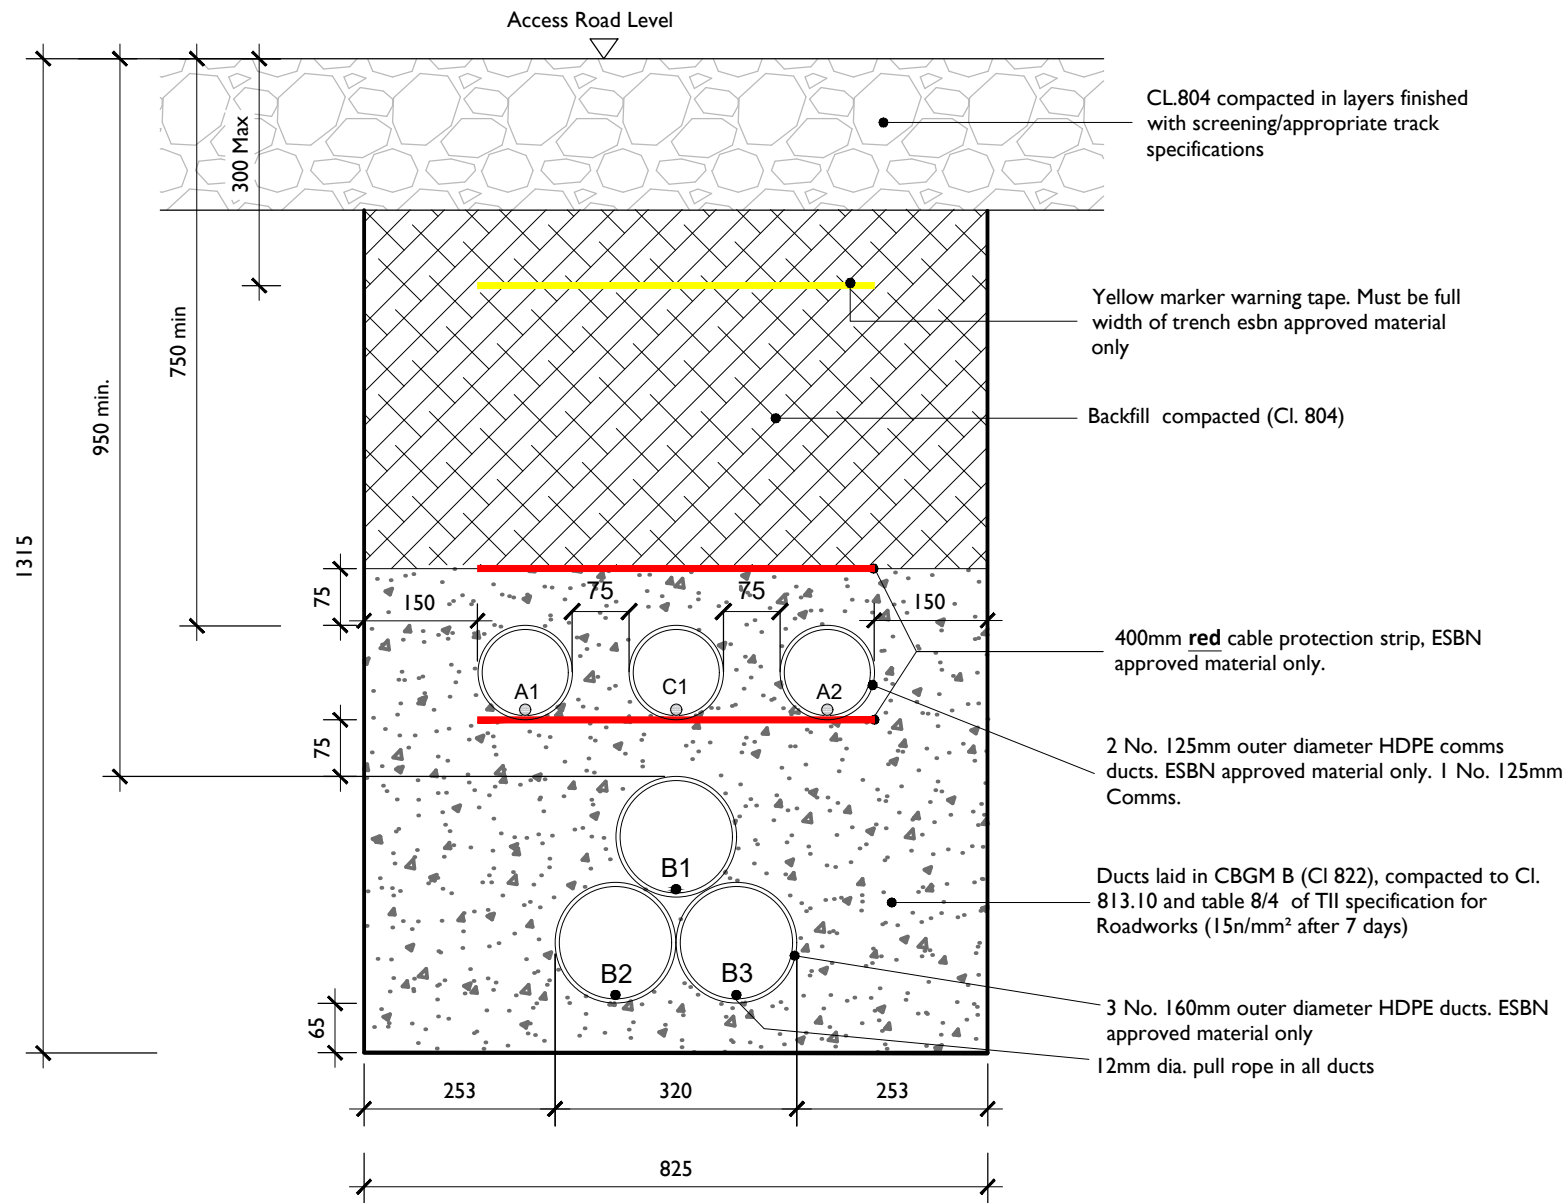

A = 125mm : Outer Diameter HDPE ESB Approved Duct, SDR=17.6
B = 160mm : Outer Diameter HDPE ESB Approved Duct, SDR= 21
C = 125mm : ECC Earth Continuity Conductor

Section Through Access Track

SCALE 1:10

ALL REINSTATEMENT WORKS ARE TO BE IN ACCORDANCE WITH LANDOWNERS REQUIREMENTS

- Note:
- This drawing is to be read in conjunction with relevant drawings, specifications and reports
 - Dimensions are in millimeters, unless noted otherwise
 - Drawings are not to be scaled use figured dimensions only



Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

CLIENT
PRT Solar Limited

PROJECT
Grangeford Solar PV Farm and Battery
Storage System 110kV Grid Connection

PROJECT NUMBER
05-967

SHEET NUMBER
05967-DR-III

SHEET TITLE
Ducting through Access Track

DRAWING STATUS
For Planning

ISSUE/REVISION		
P2	18.02.25	Issued For Planning
P1	20.09.24	Issued for Planning
I/R	DATE	DESCRIPTION