




- NOTES;
- 1. ALL DIMENSION IN MILLIMETERS UNLESS OTHERWISE STATED
 - 2. REINSTATEMENTS TO COMPLY WITH REQUIREMENTS OF THE RELEVANT LOCAL AUTHORITY/ASSET OWNER
 - 3. ALL MATERIALS AND WORKMANSHIP TO BE IN ACCORDANCE WITH NRA/T.I.I. SPECIFICATION FOR ROADWORKS, MAY 2005 & SUBSEQUENT REVISIONS
 - 4. REINFORCED CONCRETE TO BE MINIMUM GRADE C32 / 40. SULPHATE RESISTING CEMENT TO BE USED WHERE AGGRESSIVE SOIL CONDITIONS APPLY, REFER TO TABLE 6.1 OF THE BRITISH STANDARD 8110.
 - 5. CARRAIGEWAY COVERS AND FRAMES TO BE TO B.S EN 124.
 - 6. ALL COVERS SHALL HAVE "ESB" LOGO INCORPORATED IN THEM TO THE APPROVAL OF EIRGRID
 - 7. FURTHER DETAILS WILL BE PROVIDED BY EIRGRID.
 - 8. FINAL POSITION OF EARTH LINK CHAMBERS SHALL BE AGREED WITH EIRGRID

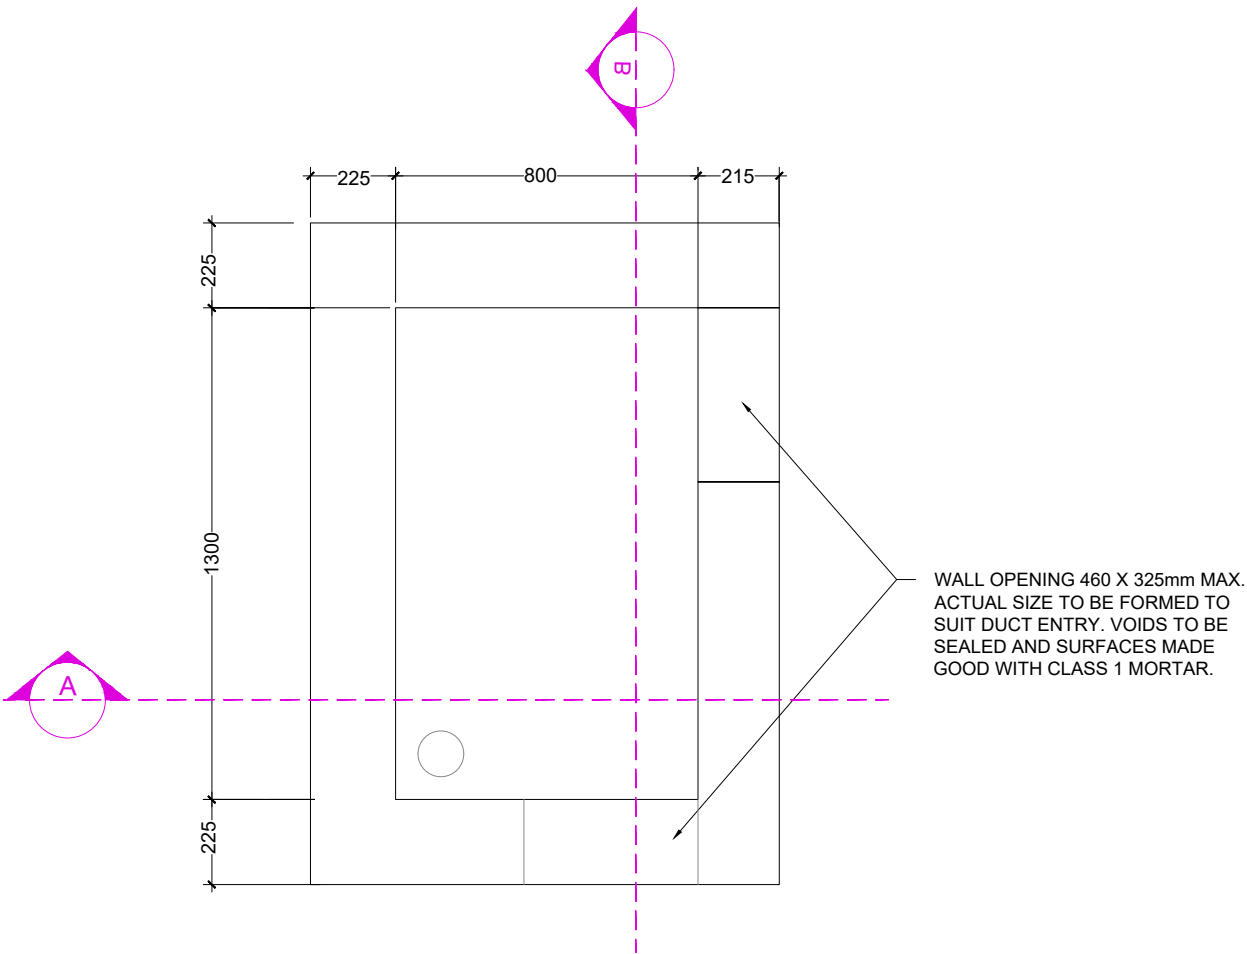

Plan of Earth Link Chamber
SCALE 1:20

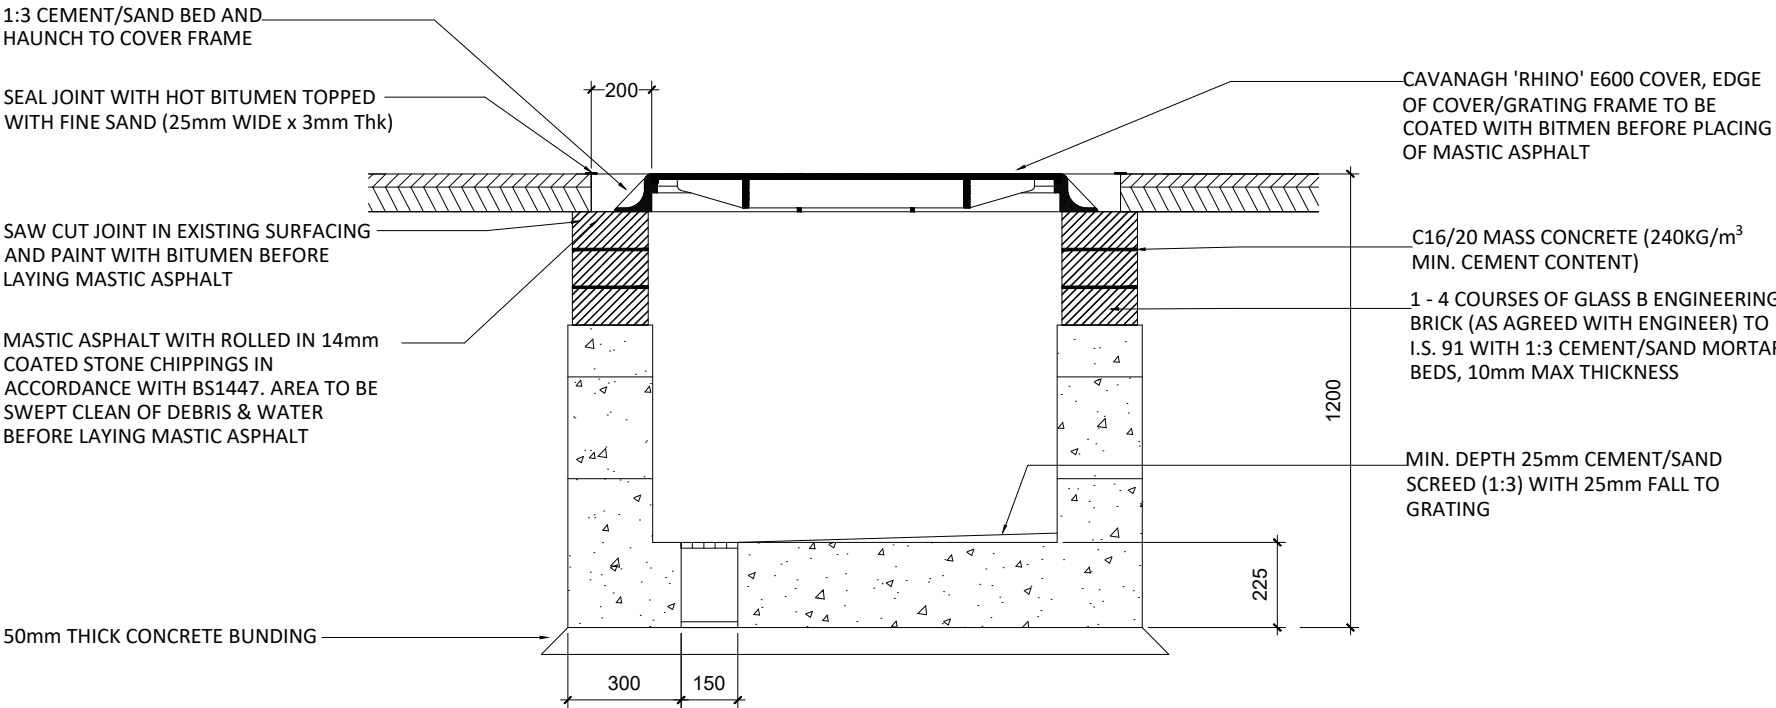

Earth Link Chamber - Section A
SCALE 1:20

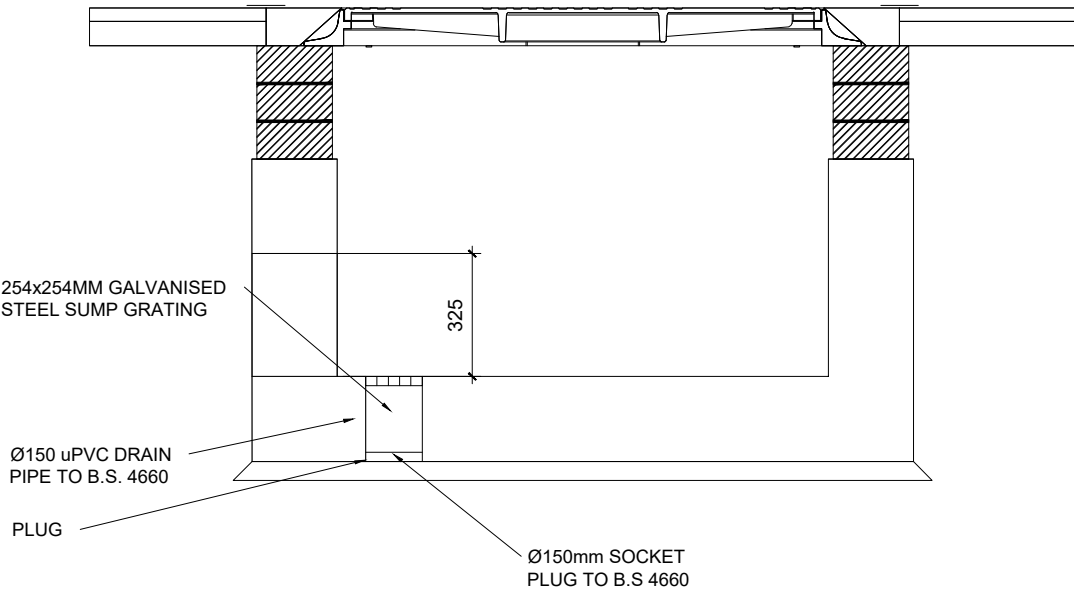

Earth Link Chamber - Section B
SCALE 1:20



Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

CLIENT
PRT Solar Limited

PROJECT
**Grangeford Solar PV Farm and Battery
Storage System 110kV Grid Connection**

PROJECT NUMBER
05-967

SHEET NUMBER
05967-DR-113

SHEET TITLE
**Earth Link
Chamber Details**

DRAWING STATUS
For Planning

ISSUE/REVISION		
P2	18.02.25	Issued For Planning
P1	20.09.24	Issued for Planning
I/R	DATE	DESCRIPTION