
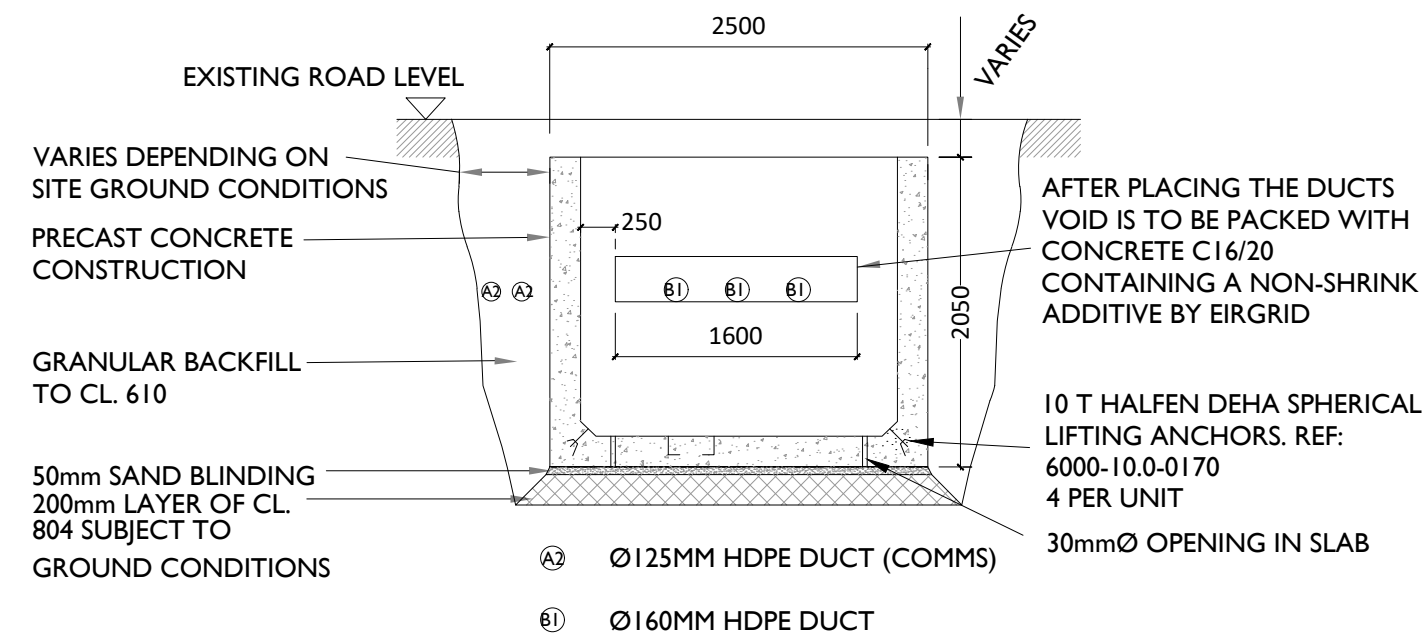
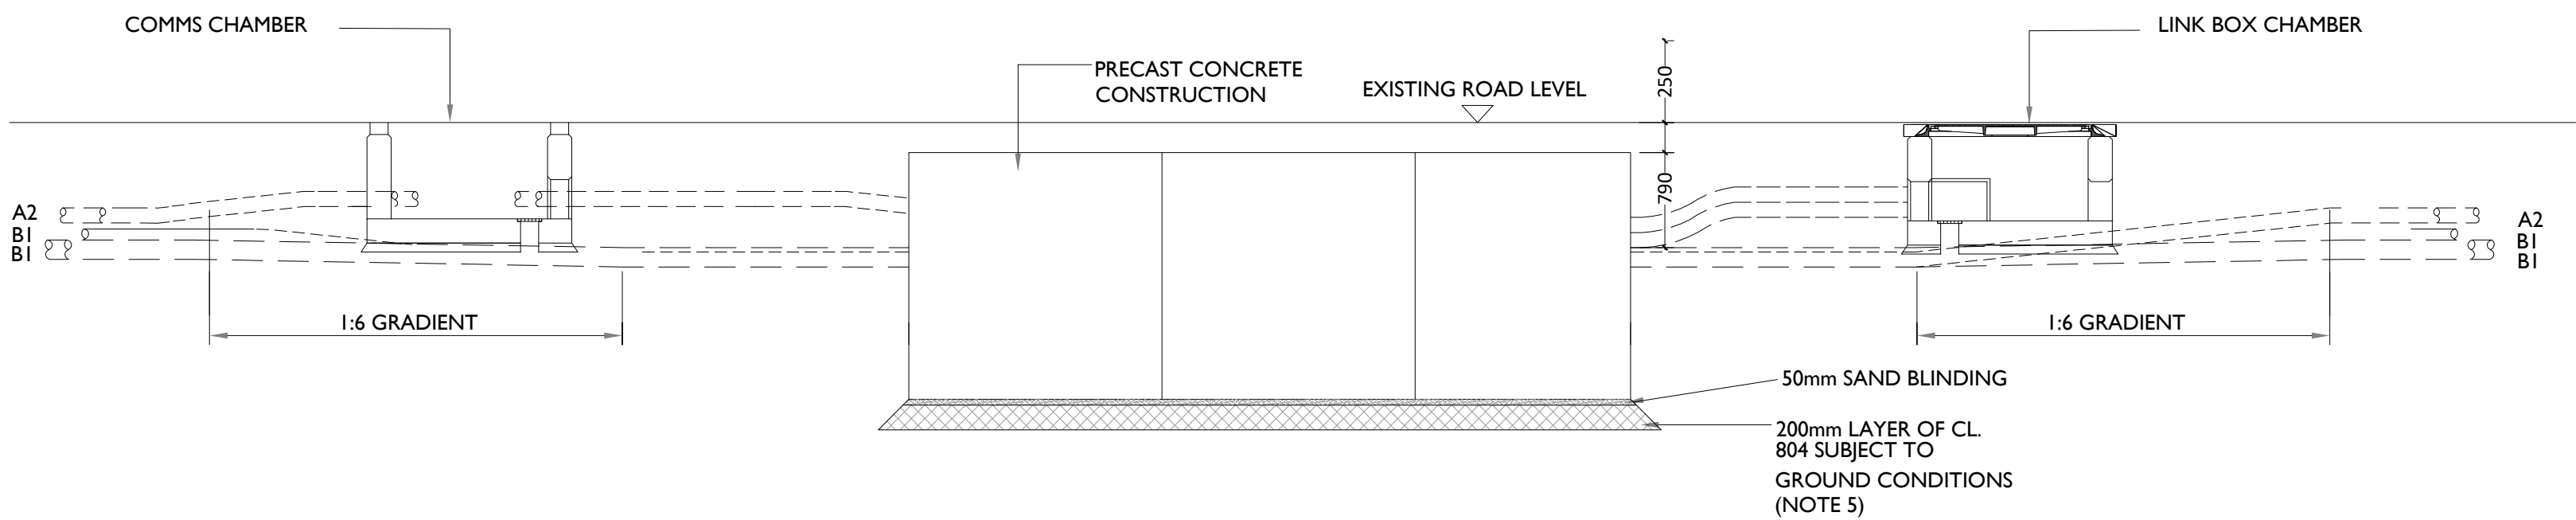
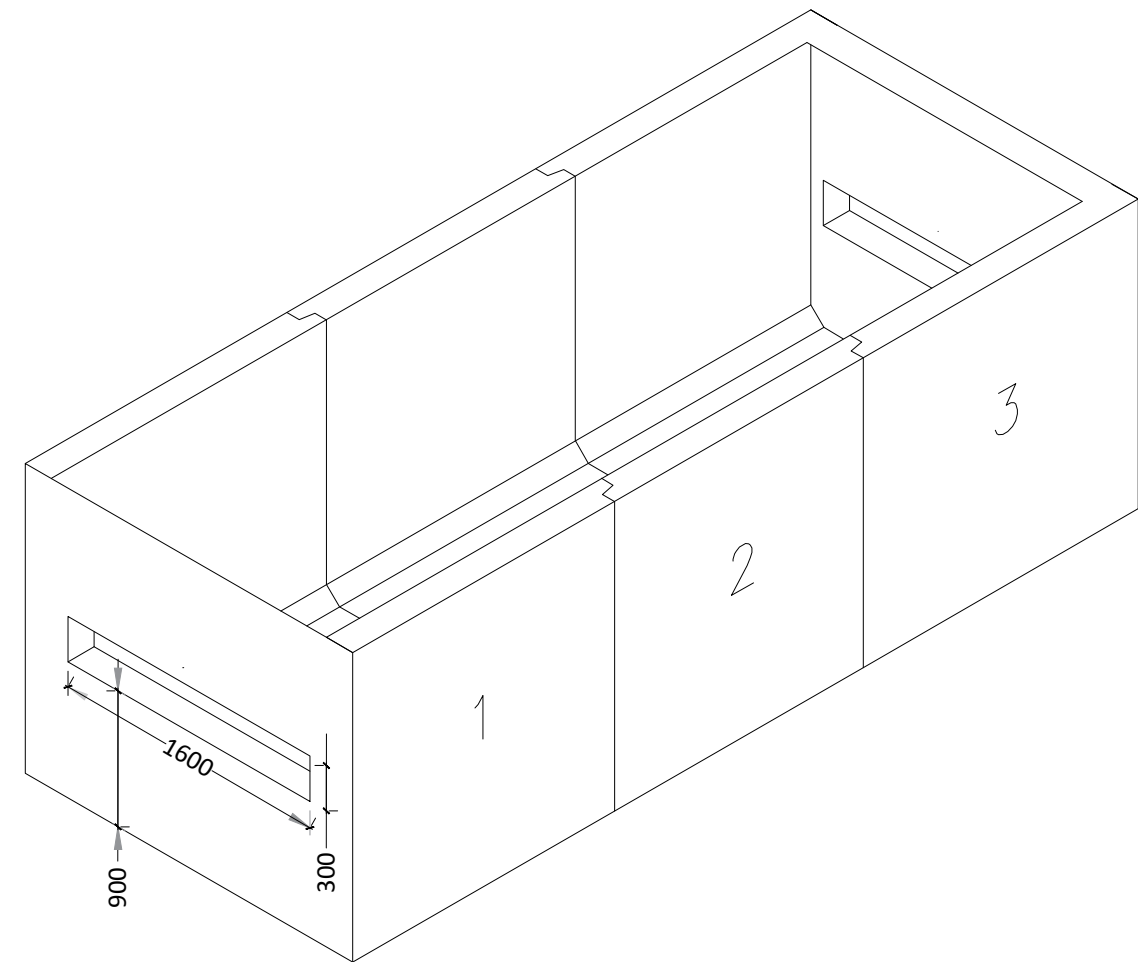


ISO A1 594mm x 841mm

Project Management Initials: Designer: J.C. Checked: C.K. Approved: D.B.

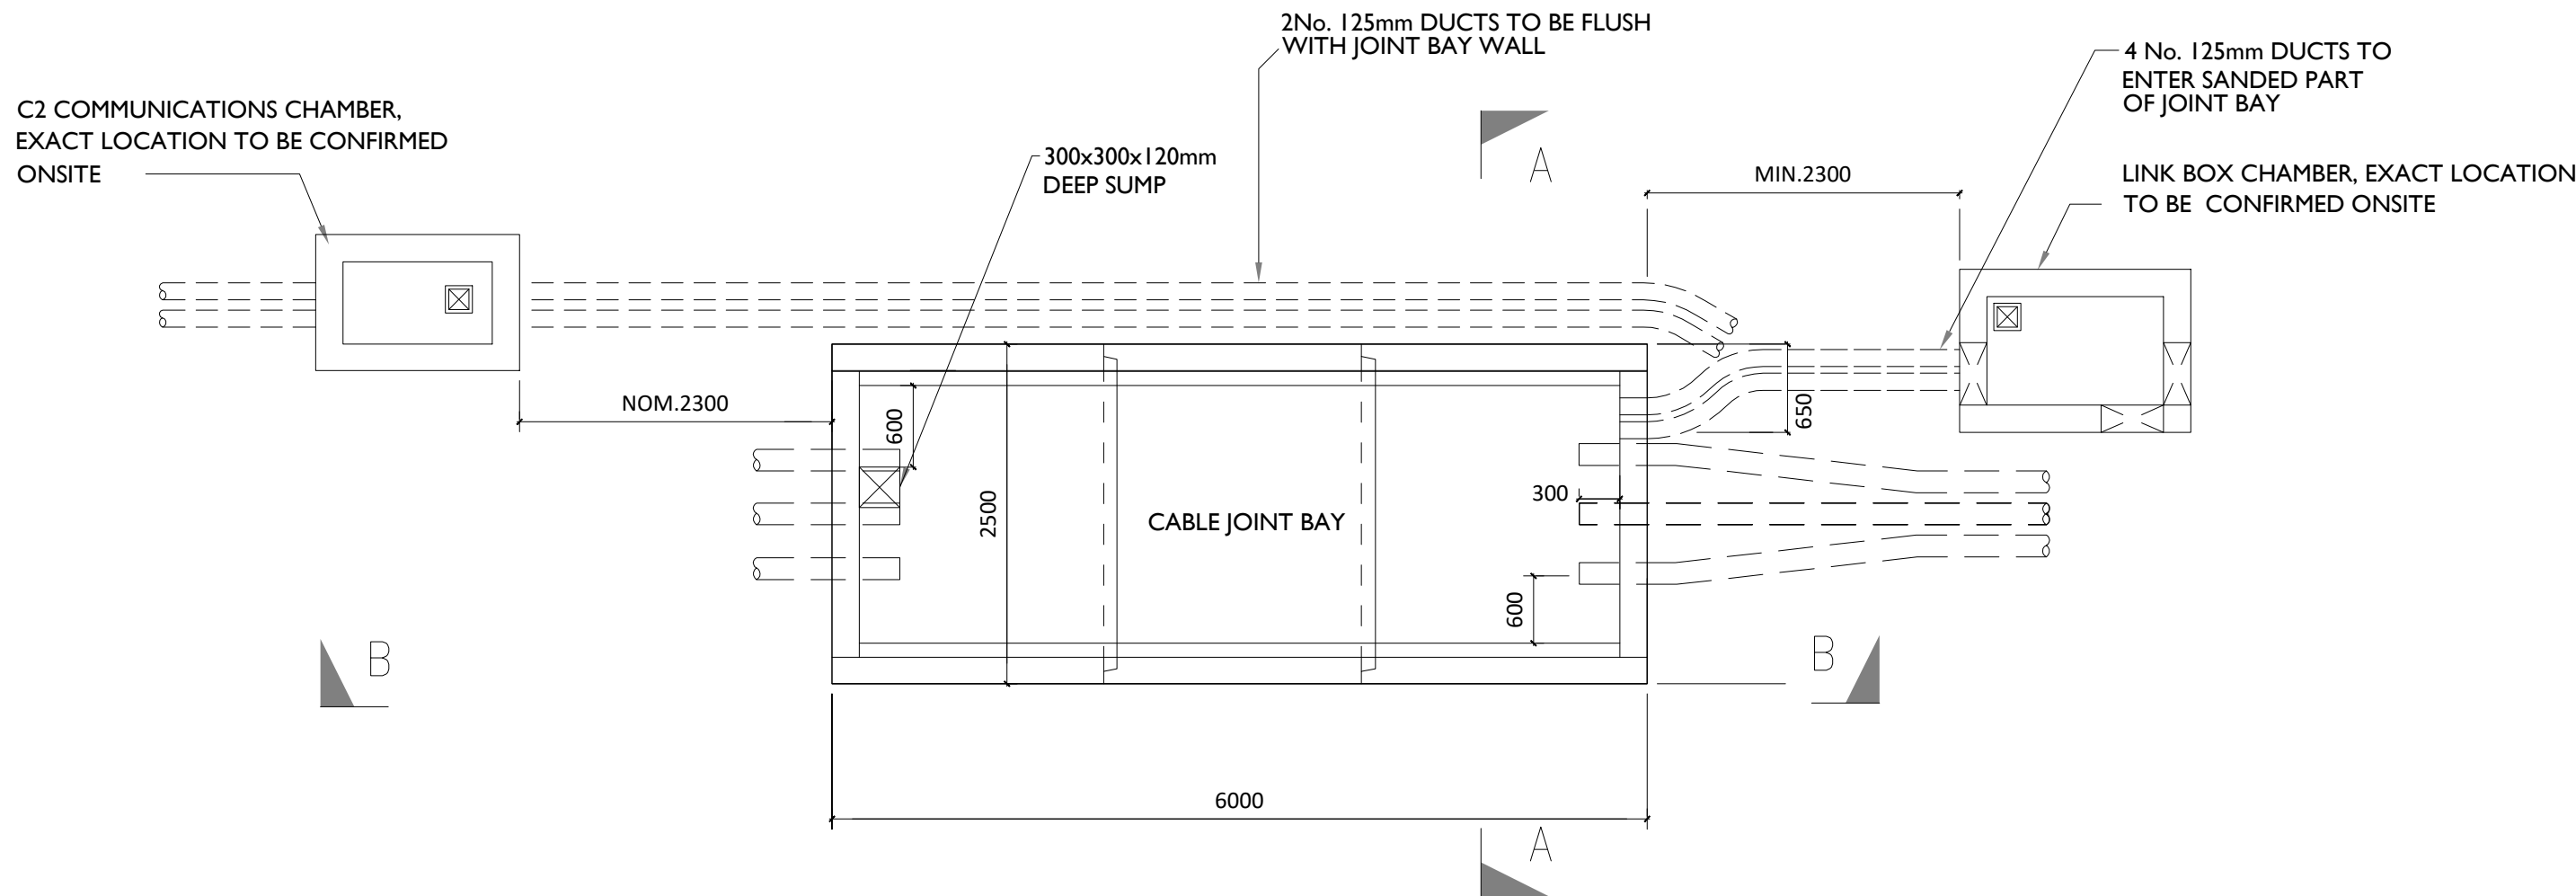

GENERAL NOTES:

- THIS DRAWING IS TO BE USED ONLY FOR THE PURPOSE OF ISSUE AND IS SUBJECT TO AMENDMENT.
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT INFORMATION
- DO NOT SCALE FROM THIS DRAWING. USE ONLY PRINTED DIMENSIONS.
- ALL DIMENSIONS ARE IN MILLIMETRES UNLESS DEFINED OTHERWISE.
- STANDARD FOUNDATIONS ARE BASED ON THE FORMATION AT THE BASE OF THE EXCAVATION SHOWN BEING SUITABLE FOR A MINIMUM BEARING PRESSURE OF 100kN/m². SUITABILITY OF STANDARD JOINT BAY FOUNDATIONS CAN ONLY BE CONFIRMED FOLLOWING GROUND INVESTIGATION. HAND VANE TESTS SHALL BE REQUIRED AS PER GI SPECIFICATION. WHERE SPECIFIED MINIMUM BEARING PRESSURE IS NOT ACHIEVABLE, AND WHERE PEAT IS ENCOUNTERED, THE CONTRACTOR SHALL REFER TO THE ENGINEER FOR GUIDANCE. THE LENGTH OF BONDING LEAD LENGTH SHALL IN NO CASE EXCEED 10M. NO JOINTS IN BONDING CABLE ARE PERMITTED.
- ALL EARTHING SHALL BE IN ACCORDANCE WITH ENA ER C55 AND EIRGRID/ESBN FUNCTIONAL SPECIFICATION
- THE DEPTH FROM GROUND/ROAD LEVEL TO THE TOP OF THE CONCRETE WALL SHALL BE
 - 500MM - IN CULTIVATED FIELDS & GRASS LAND
 - 300MM - IN PAVED ROADS AND GRASS VERGES
 - 350MM - IN PAVED CITY ROADS AND GRASS VERGES
- LINK BOX CHAMBERS TO BE POSITIONED AT THE EDGE OR OFF ROAD
- LINK BOX CHAMBERS AND C2 COMM CHAMBERS FINAL POSITIONING TO BE AGREED WITH EIRGRID PRIOR TO INSTALLATION



Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

Regional Office
Basepoint Business Centre
Stroudley Road, Basingstoke,
Hampshire,
RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

Grangeford Solar PV Farm
and Battery Storage System
110kV Grid Connection

CLIENT

PRT Solar Limited

CONSULTANTS



NOTES: -

See General Notes

LEGEND: -

ISSUE/REVISION

NO.	DATE	DESCRIPTION
P2	18.02.25	Issued For Planning
P1	20.09.24	Issued for Planning
I/R	DATE	DESCRIPTION

PROJECT NUMBER

05-967

SHEET TITLE

110kV Joint Bay General
Arrangement and Details

SHEET NUMBER

05967-DR-116