


ISO A1 594mm x 841mm

Project Management Initials: Designer: JC Checked: CK Approved: DB

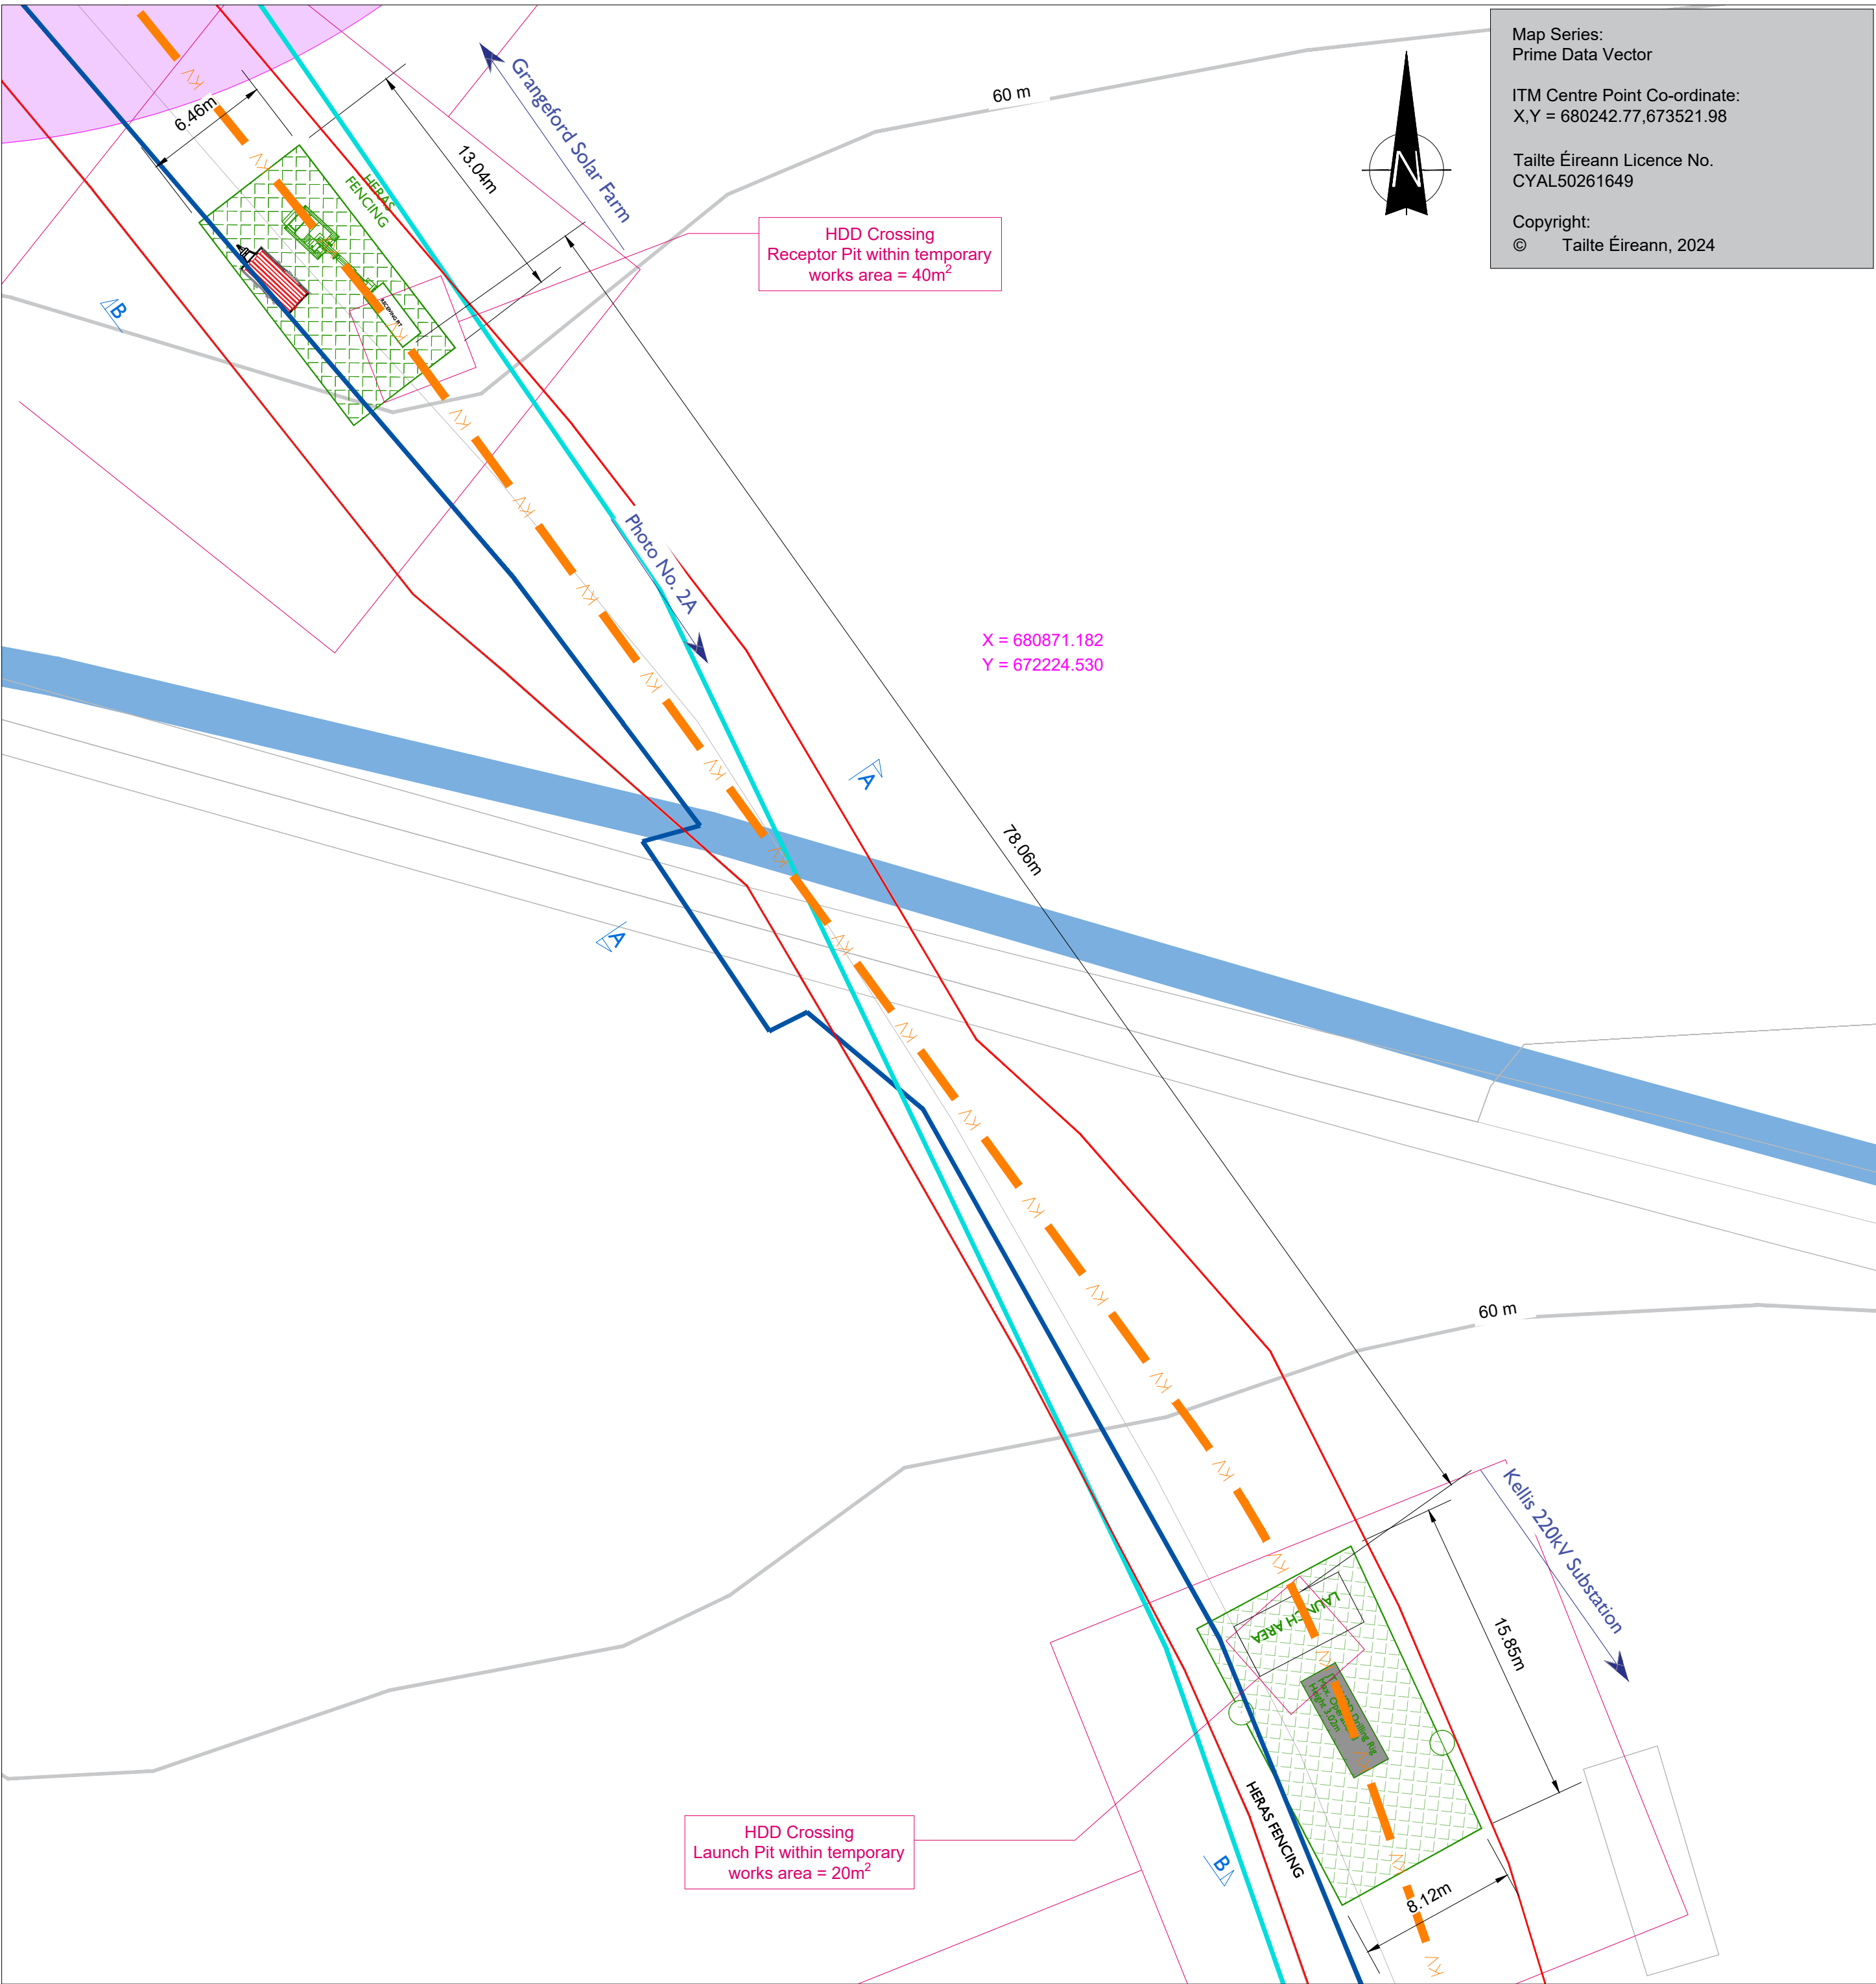

Plan View - Bridge 2
Scale : 1:250


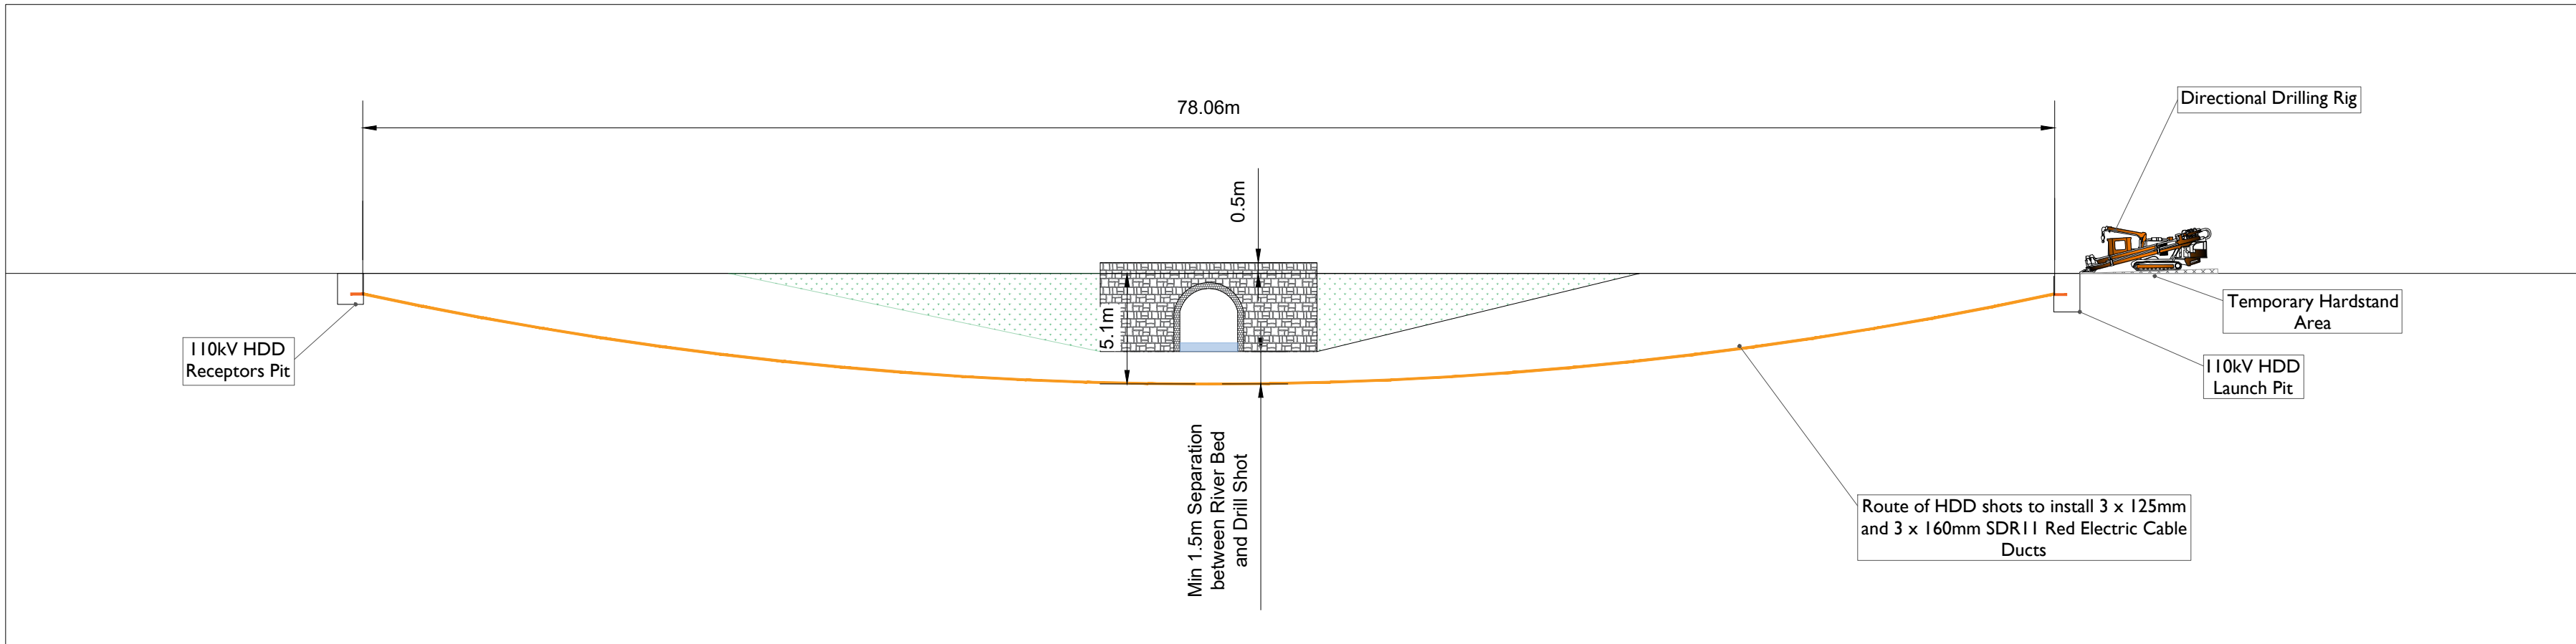


Photo 2A

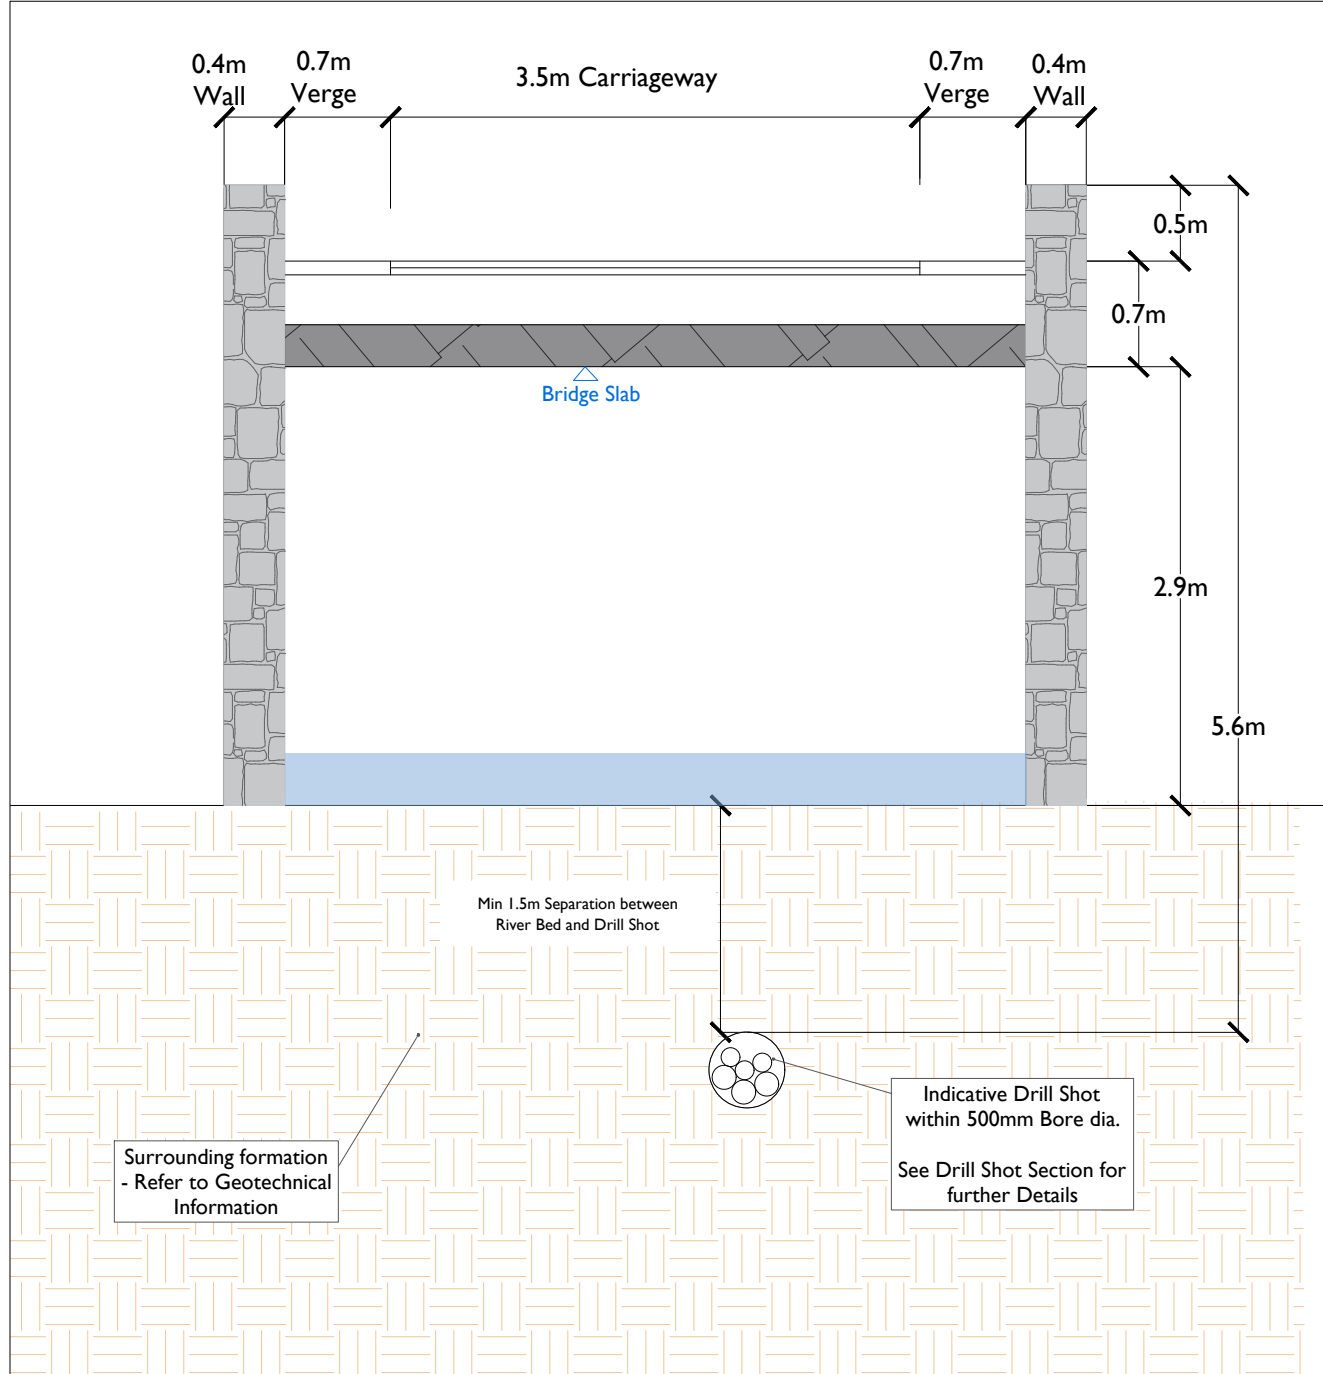

Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

Regional Office
Basepoint Business Centre
Stroudley Road, Basingstoke,
Hampshire,
RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

Grangeford Solar PV Farm
and Battery Storage System
110kV Grid Connection

CLIENT

PRT Solar Limited

CONSULTANTS



NOTES: -

- This drawing is to be used only for the purpose of the planning application and is subject to detailed design.
- Position of underground cable and location of joint bays, links boxes and comms chambers may vary depending on site conditions.
- Position of link boxes and comms chambers is to be agreed onsite with EirGrid/ESB.
- Other services may be encountered on the route.
- Position of HDD launch/reception shown points are indicative only and will be subject to site investigation works and detailed design.

LEGEND: -

Proposed UGC Grid Route (7.875km)	110kV
Red Line Planning Boundary	
Existing Rivers & Streams	
Irish Water Infrastructure shown thus	
Existing Eir Network OHL	
Recorded Monuments & associated Zone of Notification denoted thus	

ISSUE/REVISION

ISSUE/REVISION	DATE	DESCRIPTION
P2	18.02.25	Issued For Planning
P1	20.09.24	Issued for Planning
I/R	DATE	DESCRIPTION

PROJECT NUMBER

05-967

SHEET TITLE

Bridge 2
HDD Crossing

SHEET NUMBER

05-967-DR-131