




< 12 BAR TEST PRESSURE										
NOM. DIA. (mm)	DIMENSIONS									
	A	B	C	D	E	F	G	H	J	K
100	800	330	160	80	200	350	390	700	600	400
150	950	510	260	130	225	450	660	900	750	600

12 BAR TO 15 BAR TEST PRESSURE										
NOM. DIA. (mm)	DIMENSIONS									
	A	B	C	D	E	F	G	H	J	K
100	700	380	190	100	200	350	510	750	600	400
150	1135	620	320	160	225	450	760	950	750	600

15 BAR TO 18 BAR TEST PRESSURE										
NOM. DIA. (mm)	DIMENSIONS									
	A	B	C	D	E	F	G	H	J	K
100	750	400	205	100	220	400	530	800	650	400
150	1250	700	350	180	250	500	890	1000	850	650

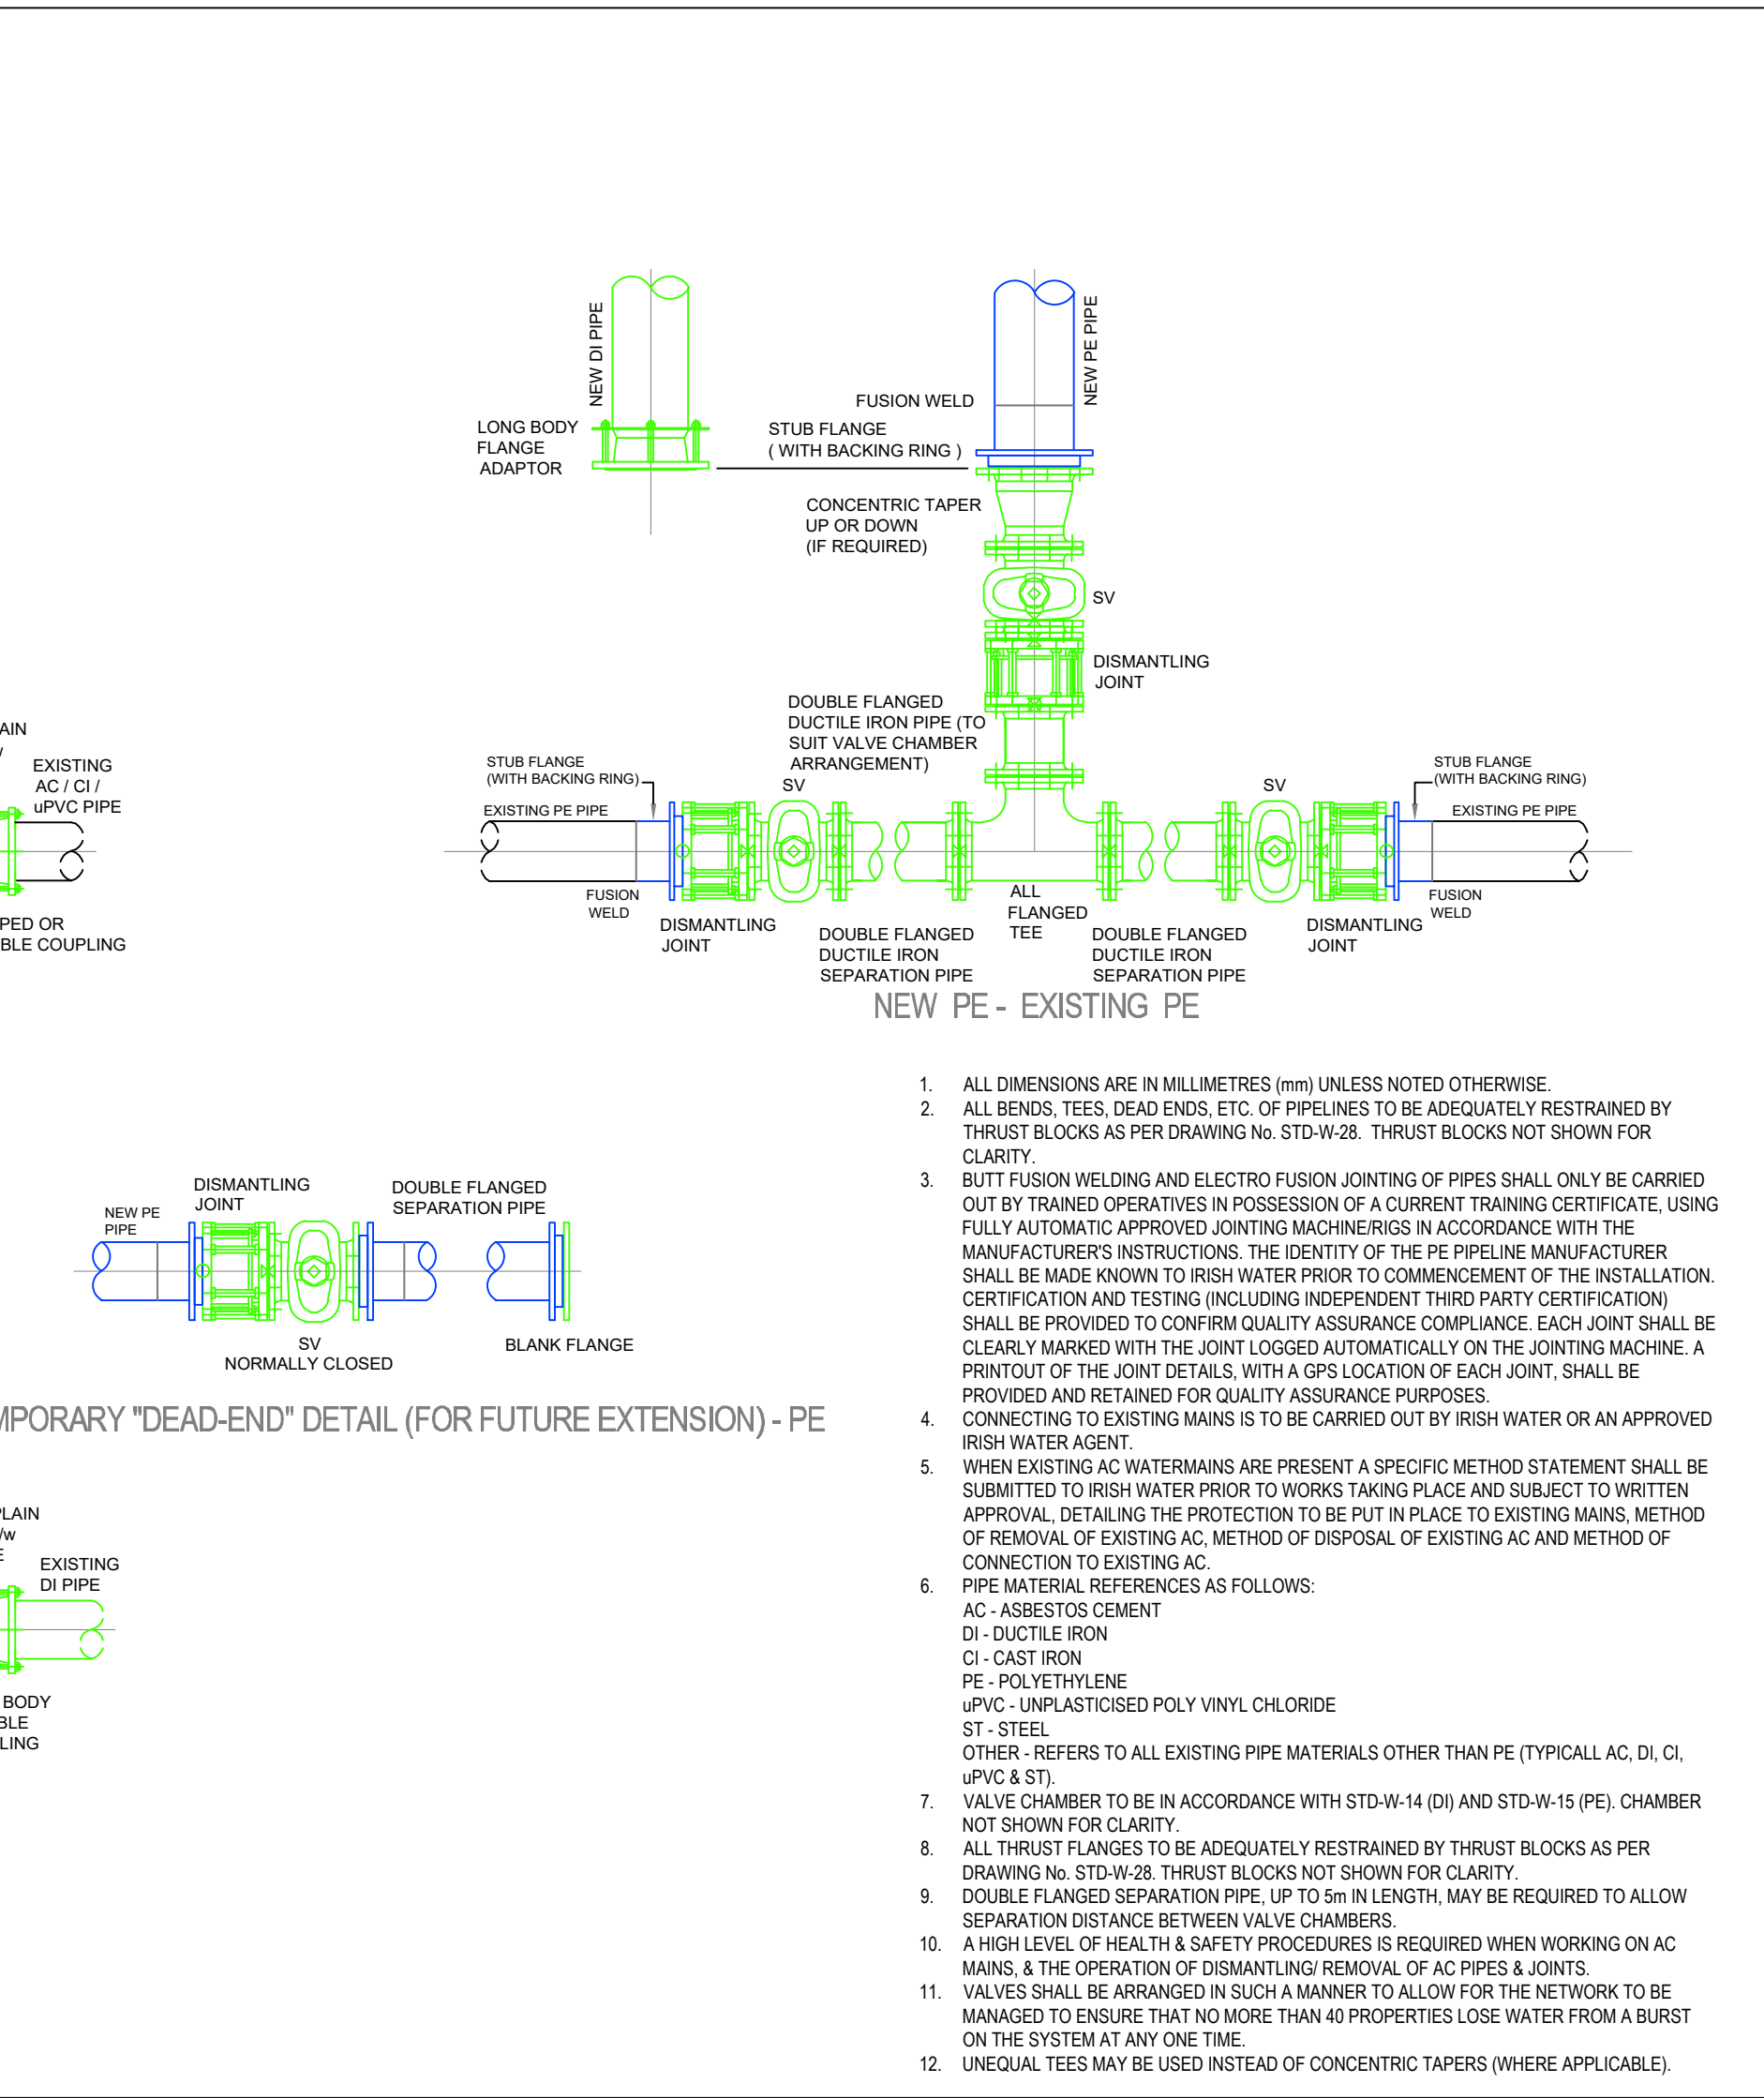

0	PLANNING ISSUE	05.09.2025	JD	ES
Rev.	Description	Date	Drawn	Chkd
Status:				
P3 - ISSUED FOR PLANNING				
 MALONE O'REGAN CONSULTING ENGINEERS		3-4 Canada Street Waterford Co. Waterford. X91 V52K Tel: +353 51 876 855 Email: waterford@morce.ie Web: www.maloneoregan.com		
Offices also in:				
DUBLIN : Tel: +353 1 260 2655		Email: dublin@morce.ie		
GALWAY : Tel: +353 91 531 069		Email: galway@morce.ie		
LONDON: Tel: +44 208 5281685		Email: london@morce.ie		
Client	 Port of Waterford	PORT OF WATERFORD COMPANY		
Job	PROPOSED OFFSHORE RENEWABLE ENERGY CAPABLE TERMINAL ON A 250m WHARF EXTENSION & ANCILLARY OPERATIONAL SUPPORT INFRASTRUCTURE			
Drawing SITE DEVELOPMENT DETAILS SHEET 1				
Job No	Revision	Approver	Scale	Sheet
W200088	0	ES	A1 AS SHOWN A3 AS SHOWN	A1
Drg No W20088-XX-XXX-DR-MOR-CE-01501				