


- Legend**
- Planning Boundary
 - Land Ownership Boundary
 - Existing Ground Contour - Major Contour
 - Existing Ground Contour - Minor Contour
 - Existing Ground Contour - Major Contour (with contour level)
 - Watercourse
 - Water Main
 - Gas Main
 - Existing Land Drain
 - Existing Road to be Upgraded
 - Proposed Road
 - Proposed Floated Road
 - Temporary Road Access for HDD Crossing
 - Passing Bays
 - Turning Areas
 - Turbine And Hardstanding Area
 - Turbine Swept Area
 - Substation Compound
 - Temporary Construction Compound Area
 - Culvert
 - 33kV Collector Cable
 - Accommodation Works
 - Sight Lines
 - Visibility Splay
 - Wayleave

- Legend - Factor of Safety Legend:**
- 0 < 1.0
 - ≥ 1.0 < 1.3
 - ≥ 1.3
 - No Peat Recorded At This Location
 - Increasing Stability

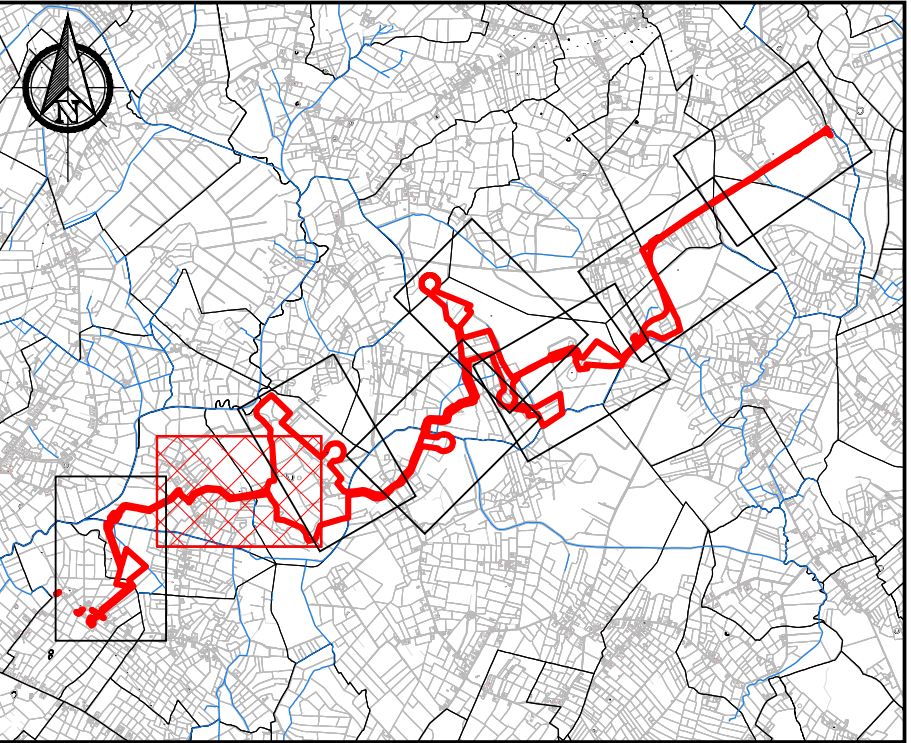

PLAN
Scale 1:2500

KEYPLAN
Scale 1:80000

0m 25m 50m 75m 100m 125m 150m 175m 200m 225m 250m
Scale 1:2500

If Applicable : Ordnance Survey Ireland Licence No. EN 0001220 © Ordnance Survey Ireland and Government of Ireland
2602,2603,2604,2605,2672,2673,2674,2675,2741,2742,2743,2744,2745,2809,2810,2811,2812,2813,2877,2878,2879,2880.

**FEHILY
TIMONEY** Cork | Dublin | Carlow
www.fehilytimoney.ie

No part of this document may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission of Fehily Timoney & Company as copyright holder except as agreed for use on the project for which the document was originally issued. Do not scale. Use figured dimensions only. If in doubt - Ask!

Rev.	Description	App By	Date
A	ISSUE FOR PLANNING	JH	13.08.25

PROJECT		CLIENT		
SHANCLON WIND FARM CO. GALWAY		RWE		
SHEET		Date	Project number	Scale (@ A1) As Shown
FACTOR OF SAFETY PLAN – SHORT TERM CRITICAL CONDITION (UNDRAINED) SHEET 2 OF 8		13.08.25	P20-306	
		Drawn by	Drawing Number	Rev
		POR	P20-306-0600-0302	A
		Checked by		
		RM		

O:\ACAD\2020\P20-306\P20-306-0600-0302