


- Legend**
- Planning Boundary
 - Land Ownership Boundary
 - Existing Ground Contour - Major Contour
 - Existing Ground Contour - Minor Contour
 - Existing Ground Contour - Major Contour (with contour level)
 - Watercourse
 - Water Main
 - Gas Main
 - Existing Land Drain
 - Existing Road to be Upgraded
 - Proposed Road
 - Proposed Floated Road
 - Temporary Road Access for HDD Crossing
 - Passing Bays
 - Turning Areas
 - Turbine And Hardstanding Area
 - Turbine Swept Area
 - Substation Compound
 - Temporary Construction Compound Area
 - Culvert
 - 33kV Collector Cable
 - Accommodation Works
 - Sight Lines
 - Visibility Splay
 - Wayleave

- Legend - Factor of Safety Legend:**
- 0 < 1.0
 - ≥ 1.0 < 1.3
 - ≥ 1.3
 - No Peat Recorded At This Location
- Increasing Stability ↓

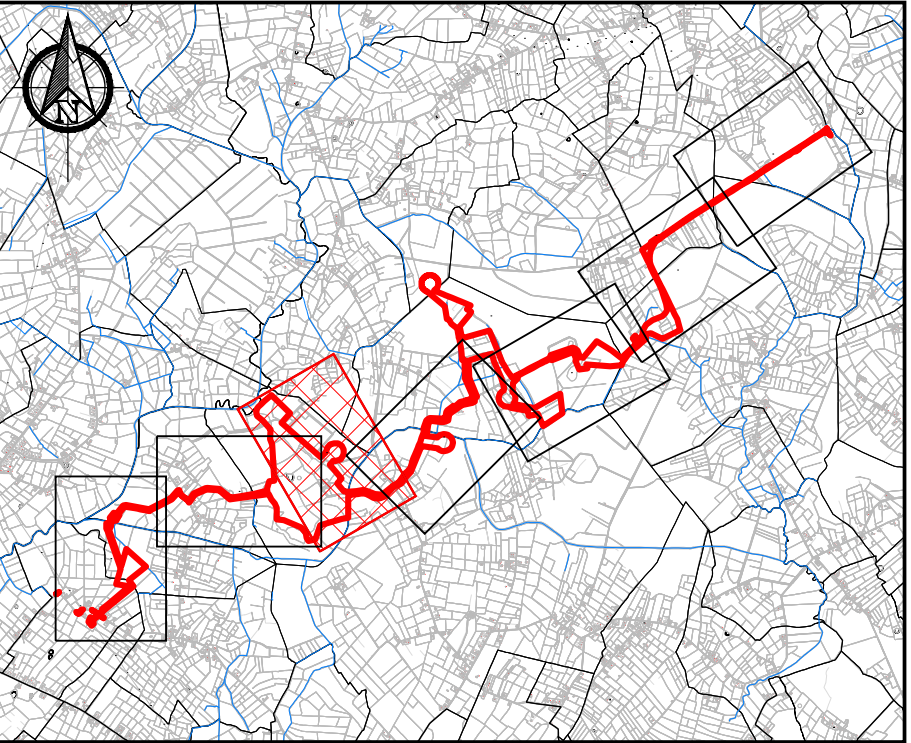


PLAN
Scale 1:2500

KEYPLAN
Scale 1:80000

0m 25m 50m 75m 100m 125m 150m 175m 200m 225m 250m
Scale 1:2500

If Applicable : Ordnance Survey Ireland Licence No. EN 0001220 © Ordnance Survey Ireland and Government of Ireland
2602,2603,2604,2605,2672,2673,2674,2675,2741,2742,2743,2744,2745,2809,2810,2811,2812,2813,2877,2878,2879,2880.

Rev.	Description	App By	Date
A	ISSUE FOR PLANNING	JH	13.08.25

PROJECT		CLIENT		
SHANCLOON WIND FARM CO. GALWAY				
SHEET		Date	Project number	Scale (@ A1) As Shown
FACTOR OF SAFETY PLAN – SHORT TERM CRITICAL CONDITION (UNDRAINED) SHEET 3 OF 8		13.08.25	P20-306	
		Drawn by	Drawing Number	Rev
		POR	P20-306-0600-0303	A
		Checked by	RM	