



TYPICAL PLAN OF JOINT BAY IN ROAD  
SCALE 1 : 50

**Note:**

- This drawing is subject to ESB design approval and should not be used for construction.
- This drawing is to be read in conjunction with relevant drawings, specifications and reports.
- Dimensions are in millimeters, unless noted otherwise.
- Drawings are not to be scaled use figured dimensions only.
- The compaction of backfill material around the cables shall be carried out by hand.
- The Contractor shall provide test certificates confirming that the thermal resistivity of the thermal sand is maximum 1.K.m/W.

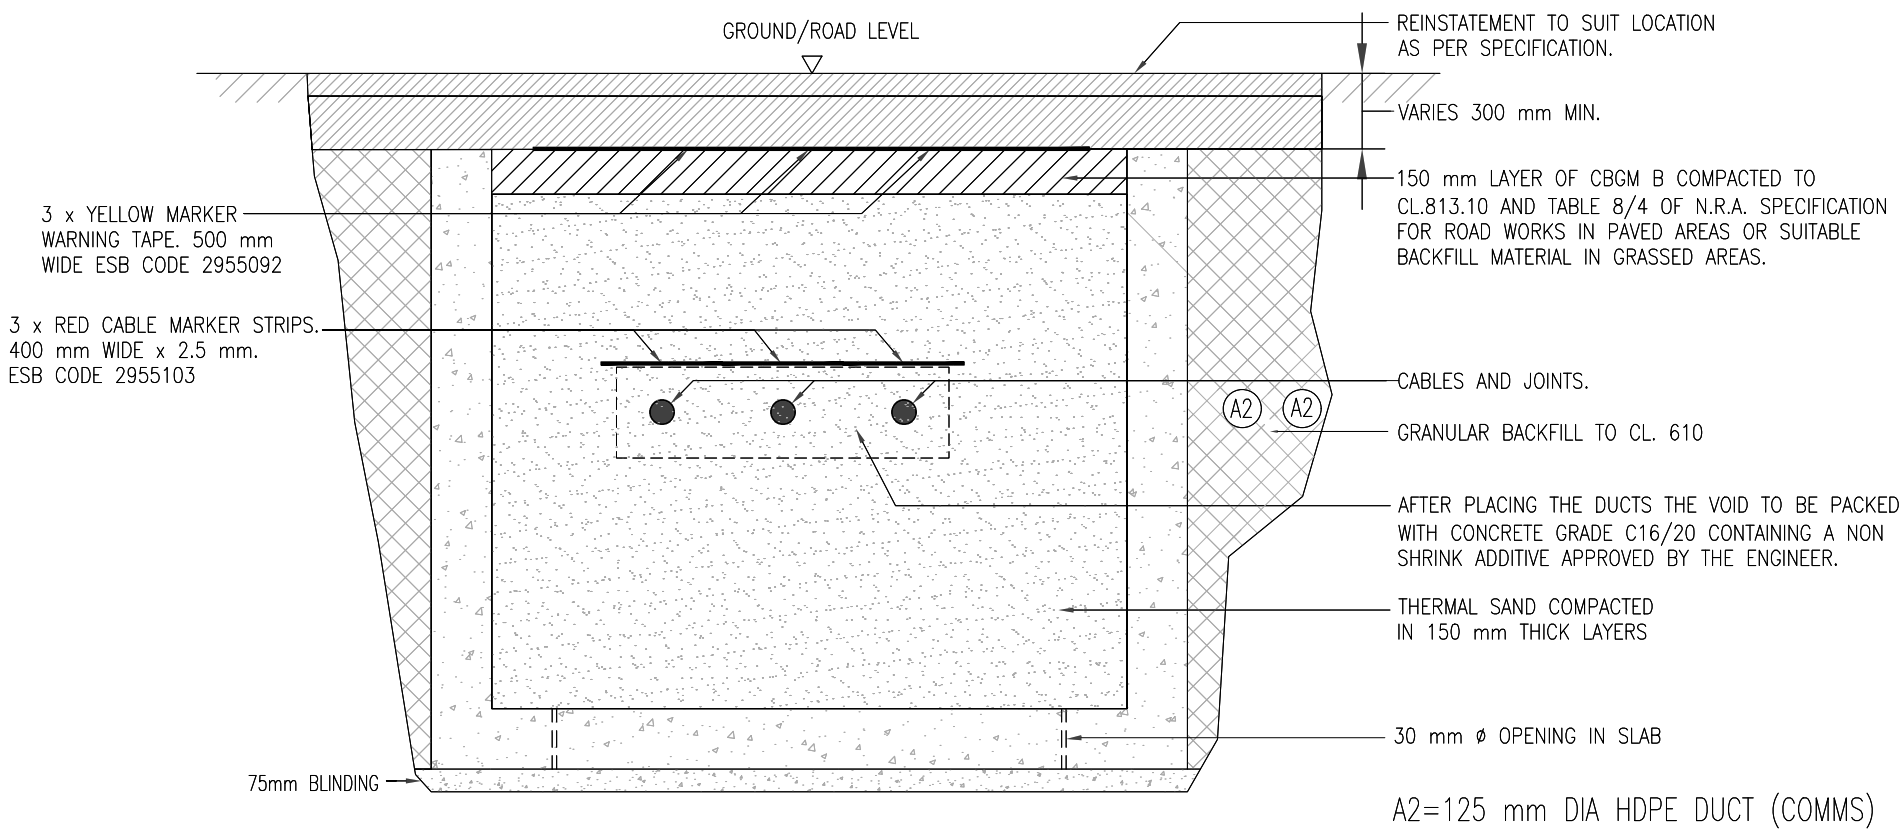

SECTION A-A PERMANENT REINSTATEMENT  
SCALE 1 : 25

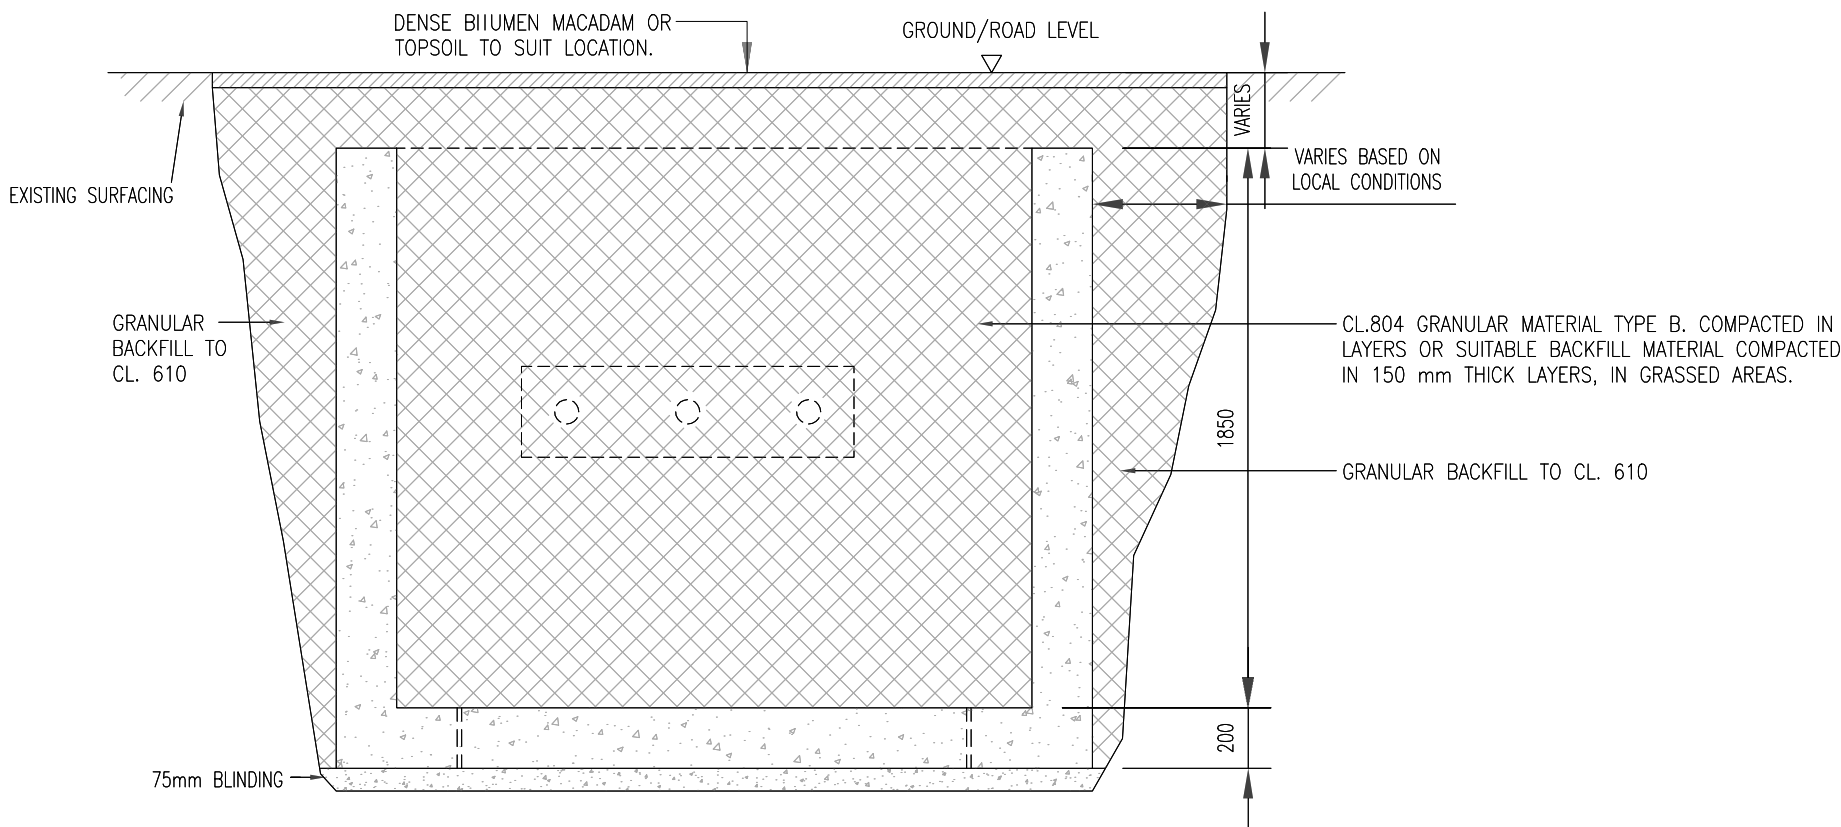

SECTION A-A TEMPORARY REINSTATEMENT  
SCALE 1 : 25

**ALL REINSTATEMENT WORKS ARE TO BE IN ACCORDANCE WITH  
LOCAL AREA ENGINEERS REQUIREMENTS AND GUIDELINES FOR  
MANAGING OPENINGS IN PUBLIC ROADS**

PROJECT

**Shancloon 110 kV  
Substation**

CLIENT

**RWE**

CONSULTANTS

NOTES: -

LEGEND: -

ISSUE/REVISION		
P00	18.10.24	Issued for Planning
N0	12.04.24	Issued for Information
I/R	DATE	DESCRIPTION

PROJECT NUMBER

05-1021

SHEET TITLE

110k Joint Bay

SHEET NUMBER

051021-DR-120