
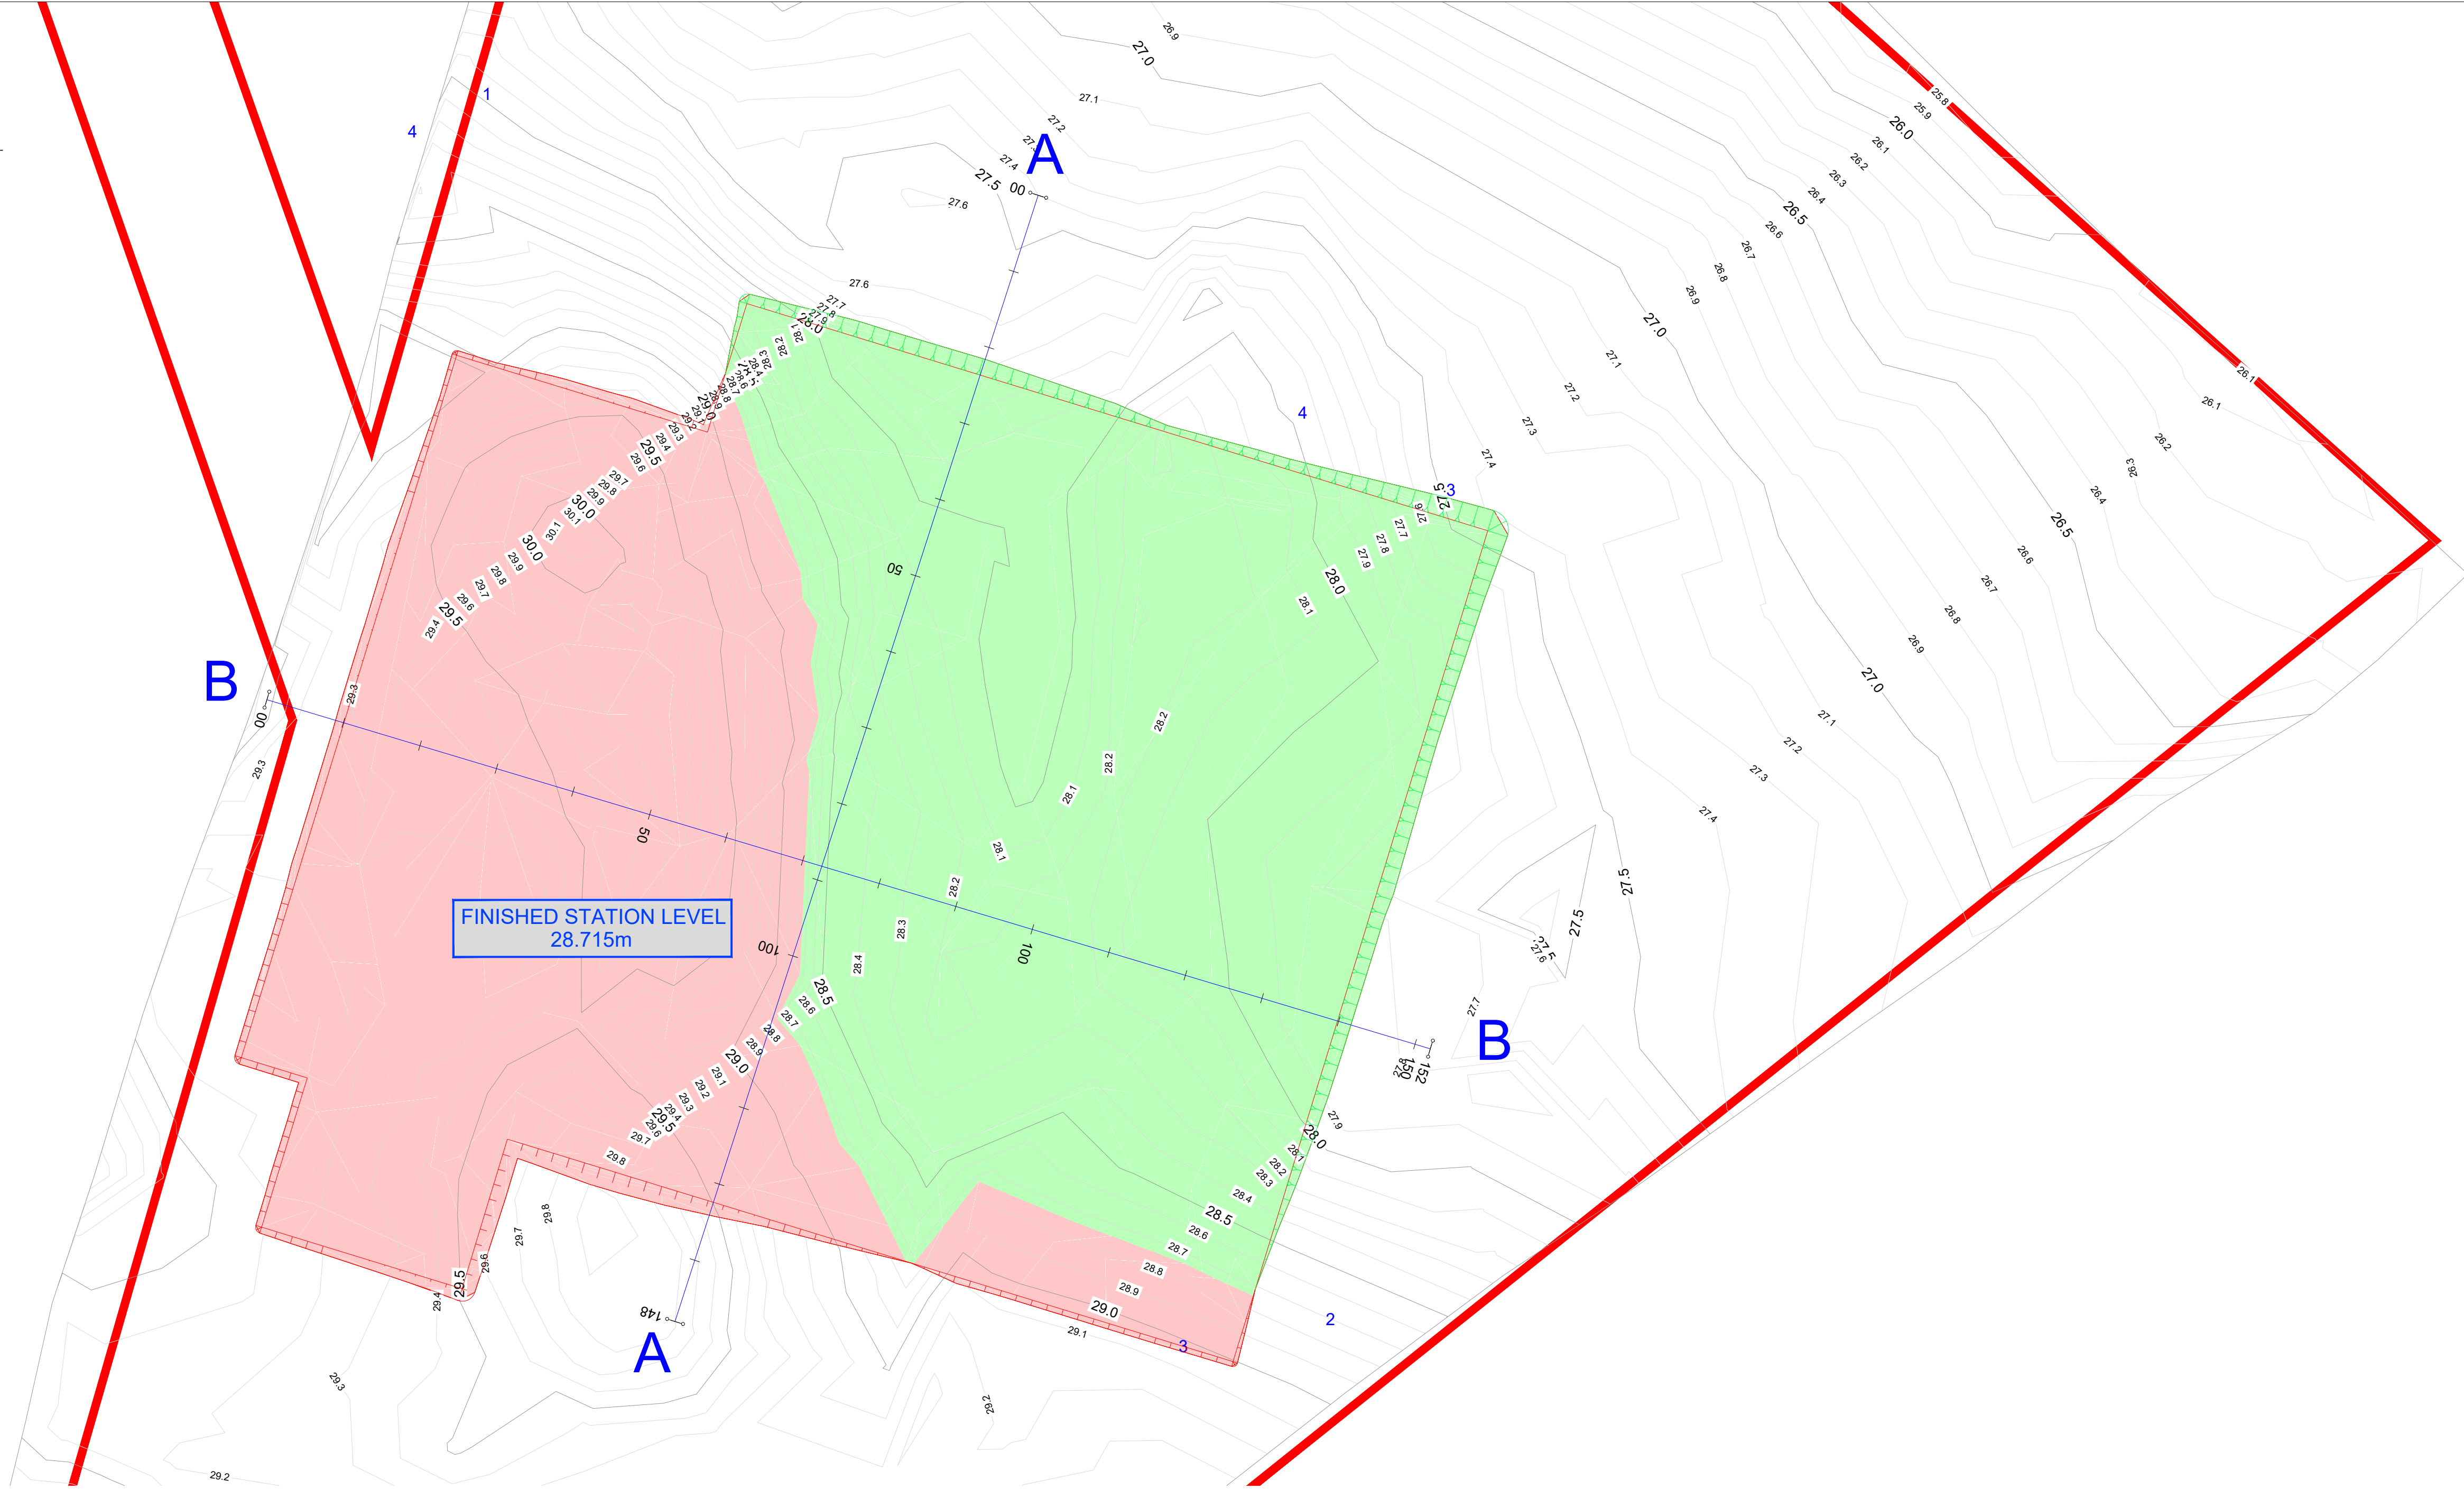



ISO A1 594mm x 841mm

Project Management Initials: Designer: CH Checked: ER Approved: AC




Cut & Fill Plan

SCALE 1:500

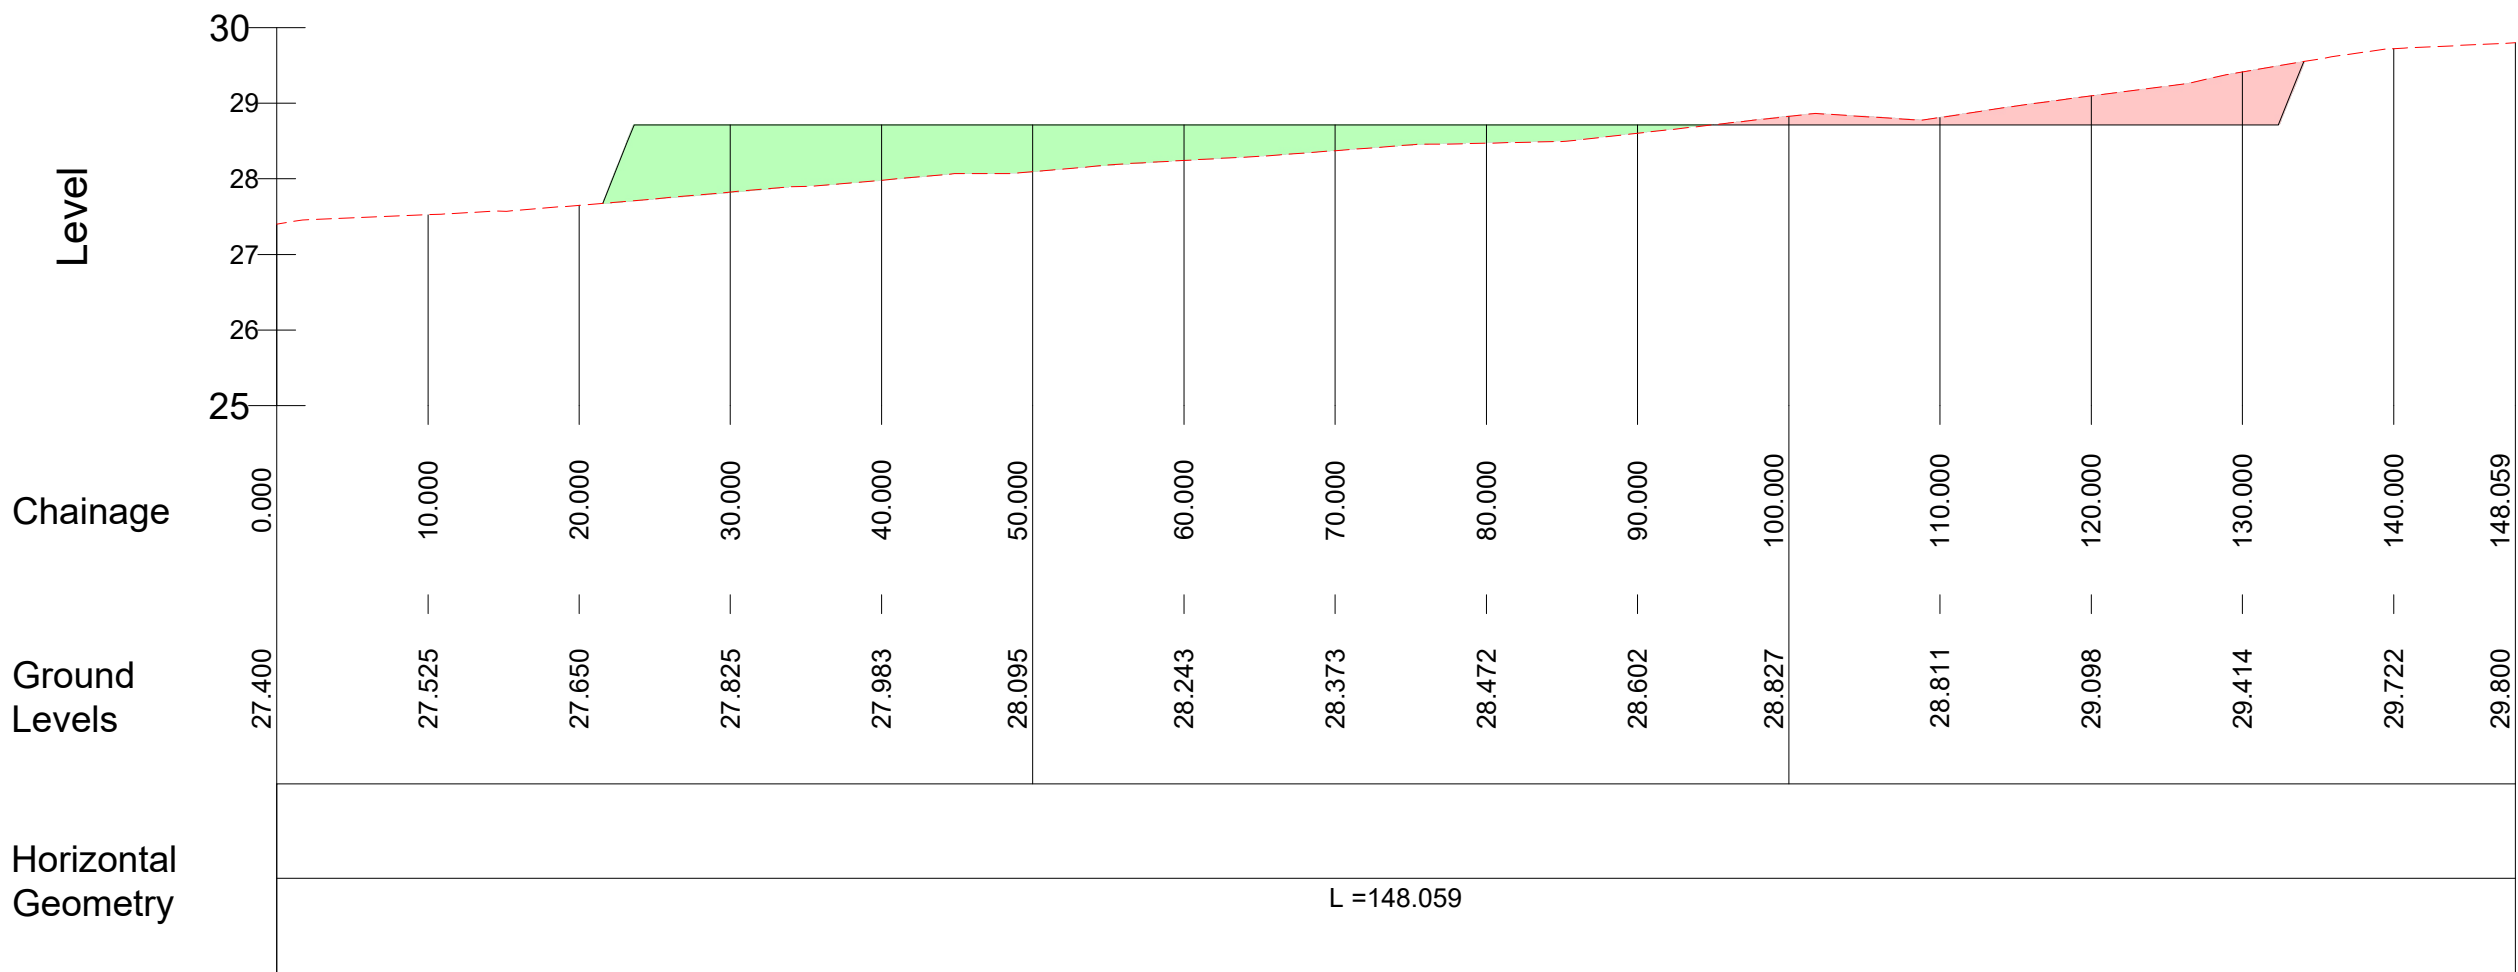


Section A - A

SCALE Hor.1:500, Vert. 1:100

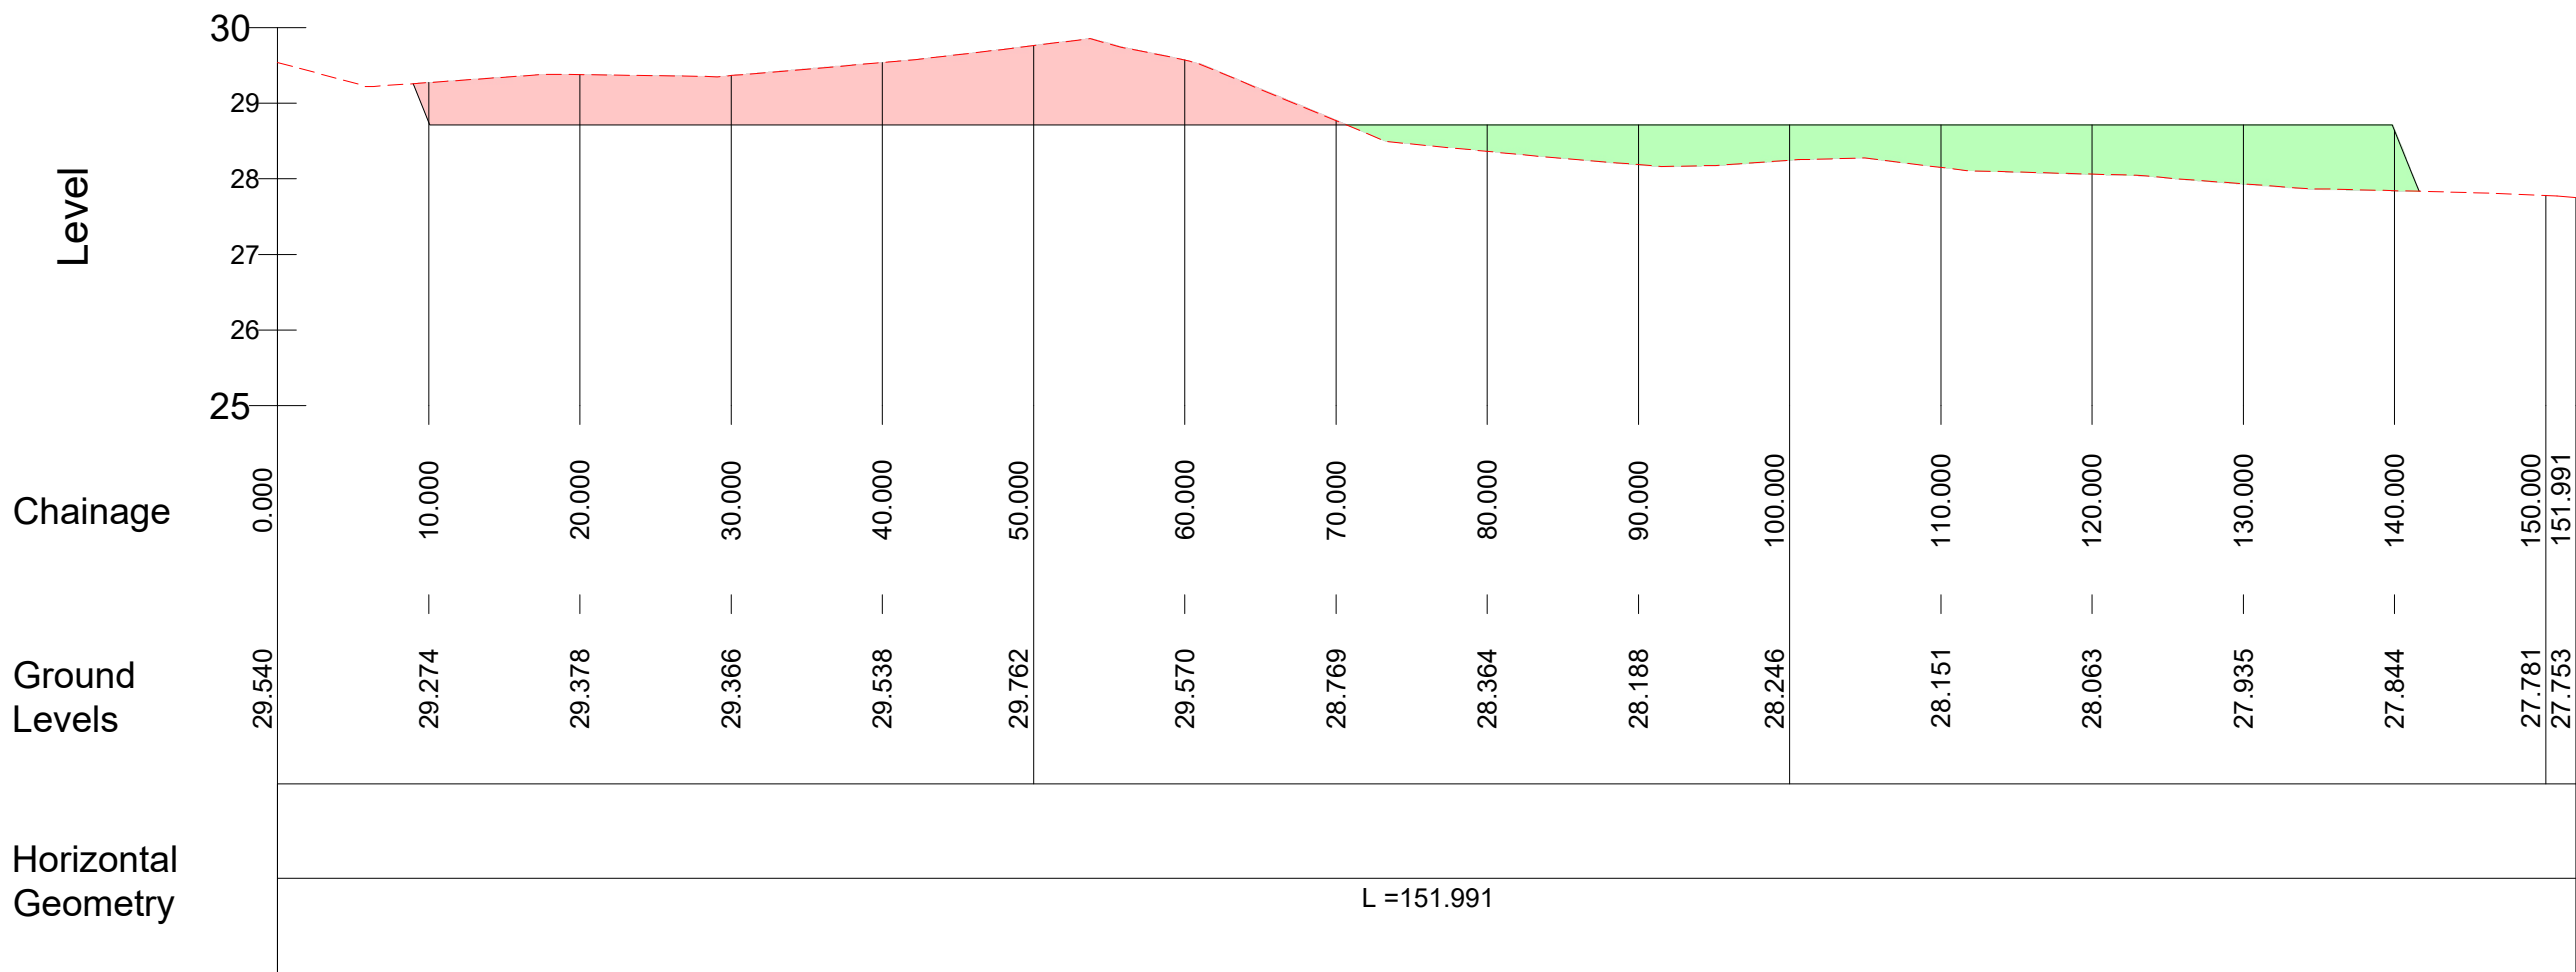

Section B - B

SCALE Hor.1:500, Vert. 1:100



Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

Regional Office
Basepoint Business Centre
Stroudley Road, Basingstoke,
Hampshire,
RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

Shanclon 110kV Substation,

CLIENT

RWE

CONSULTANTS

NOTES: -

- Cut & Fill Volumes are approximate for preliminary design only.
- Detailed Material Classification & Geotechnical Design to be completed at design phase.

Cut Volume = 4321.3 m³
Fill Volume = 4255.4 m³

LEGEND: -

Cut Volume = 4321.3 m³
Fill Volume = 4255.4 m³
Planning Boundary
Existing Ground Profile

ISSUE/REVISION

NO	DATE	DESCRIPTION
P01	11.08.25	Issued for Planning
P00	11.07.25	Issued for Planning
N0	25.06.24	Issued for Information
I/R	DATE	DESCRIPTION

PROJECT NUMBER

05-1021

SHEET TITLE

Cut & Fill Details

SHEET NUMBER

051021-DR-122