


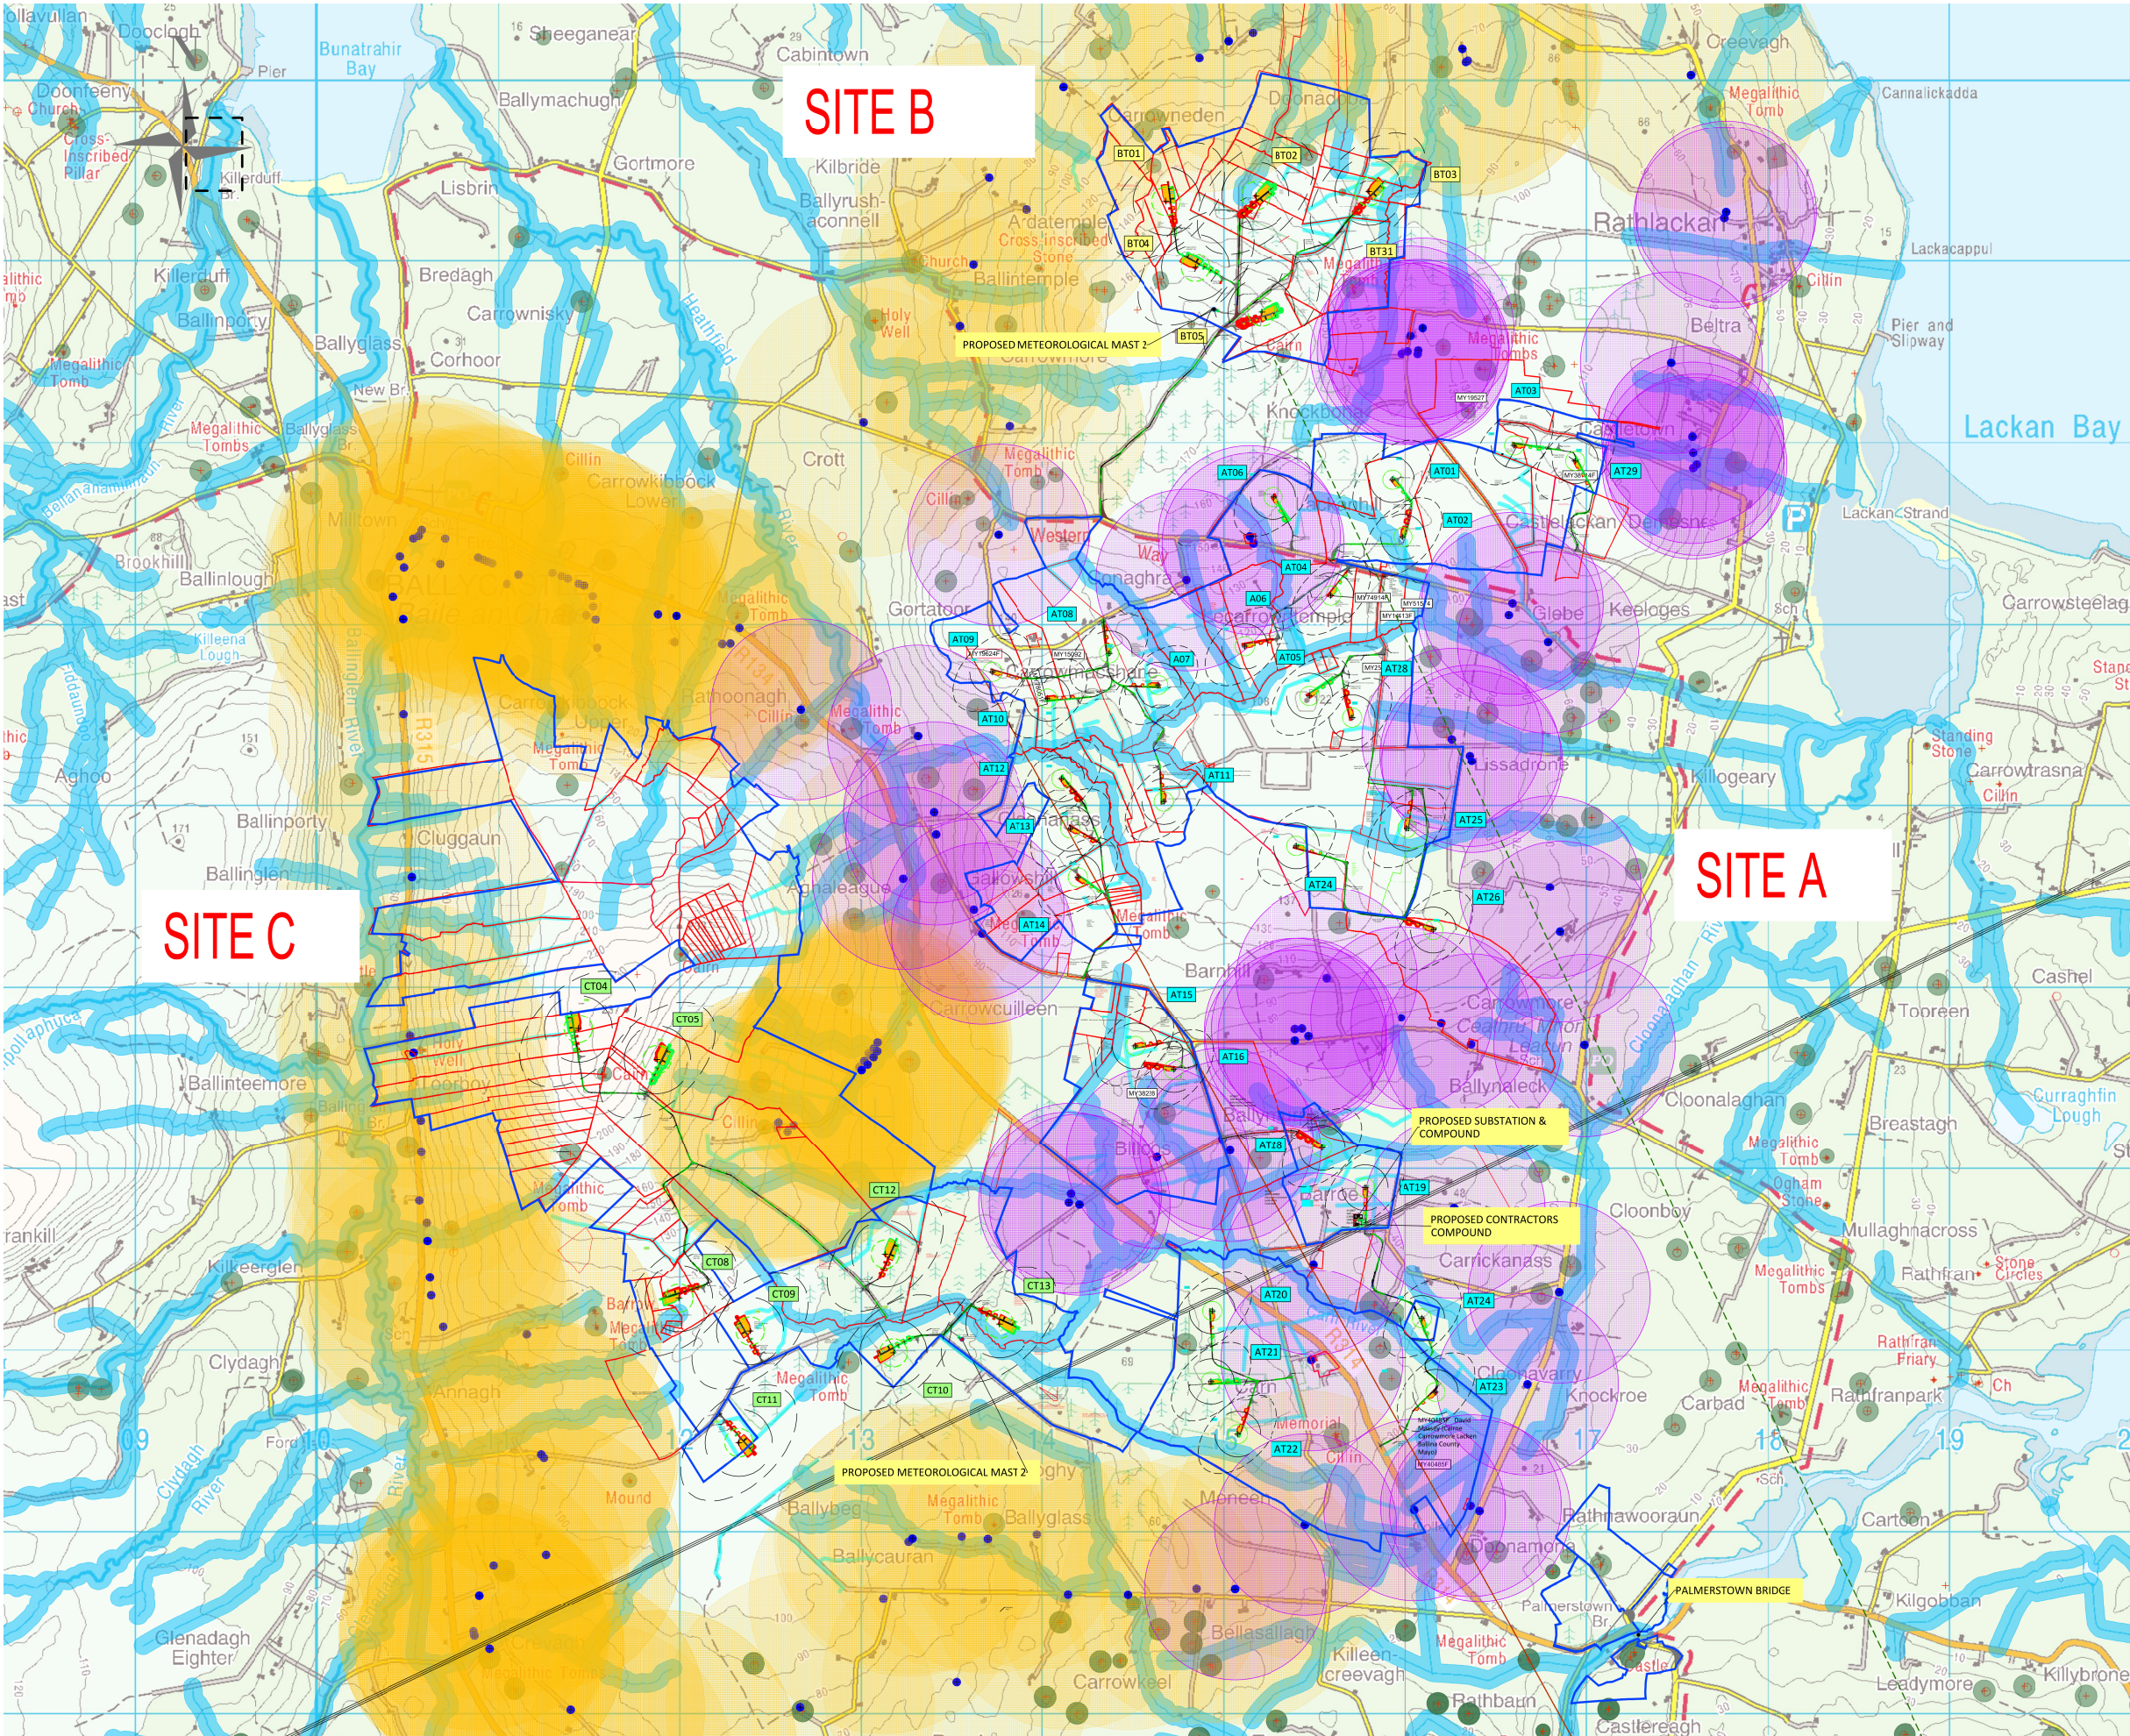

Legend

- NOTES:
- FIGURED DIMENSIONS ONLY TO BE TAKEN FROM THIS DRAWING.
 - ALL DRAWINGS TO BE CHECKED BY THE CONTRACTOR ON SITE.
 - ENGINEER TO BE INFORMED OF ANY DISCREPANCIES BEFORE ANY WORK COMMENCES.
 - THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS AND SPECIFICATIONS.

- Legend
- LANDOWNERS
 - LANDOWNERS (THIRD PARTY)
 - DEVELOPMENT AREA
 - PROPOSED WIND FARM ROADS
 - EXISTING ROADS -PUBLIC TO BE UPGRADED
 - TURBINE LOCATION
 - TURBINE HARDSTAND
 - WATERCOURSE CROSSING
 - SPOIL DEPOSITION AREA
 - FIELD DRAIN 10m BUFFER
 - WATERCOURSE EXCLUSION ZONE (50m)
 - 500m HOUSE CURTLAGE BUFFER
 - 740m HOUSE CURTLAGE BUFFER
 - ENET_Telecommunication
 - Vodafone_Telecommunication
 - Three_Telecommunications

Client
CONSTANT ENERGY LIMITED.

Project
TIRAWLEY WIND FARM,
CO. MAYO

Title
CONSTRAINTS MAP - INITIAL
LAYOUT



© COPYRIGHT OF
JENNINGS O'DONOVAN AND PARTNERS LIMITED
FINISKLIN Tel (+353) 719 161 416
SLIGO Email. info@jodireland.com
IRELAND www.jodireland.com

@JOD_Sligo Jennings O'Donovan & Partners Jennings O'Donovan

Date	18/09/2025	Revision	1	Job No.	6289
Scale	NOT TO SCALE	Stage	PLANNING	Figure	3.2
Drawing	DT	Checked	MG	Approved	MG