




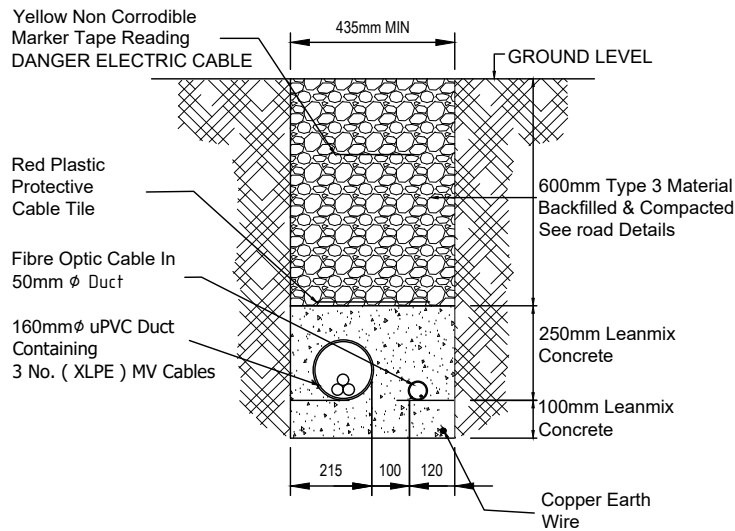


**CABLE TRENCH IN SITE ROADWAY SINGLE CIRCUIT
(INTERNAL WIND FARM)**
Scale 1:20

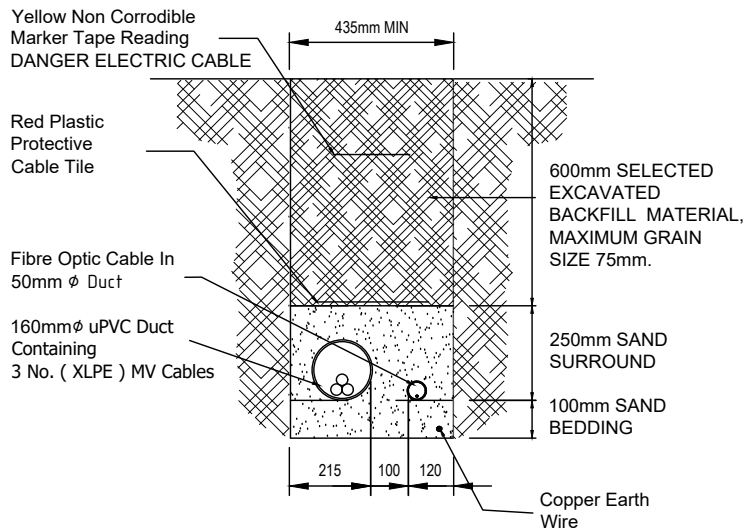


**CABLE TRENCH IN OPEN GROUND SINGLE CIRCUIT
(INTERNAL WIND FARM)**
Scale 1:20

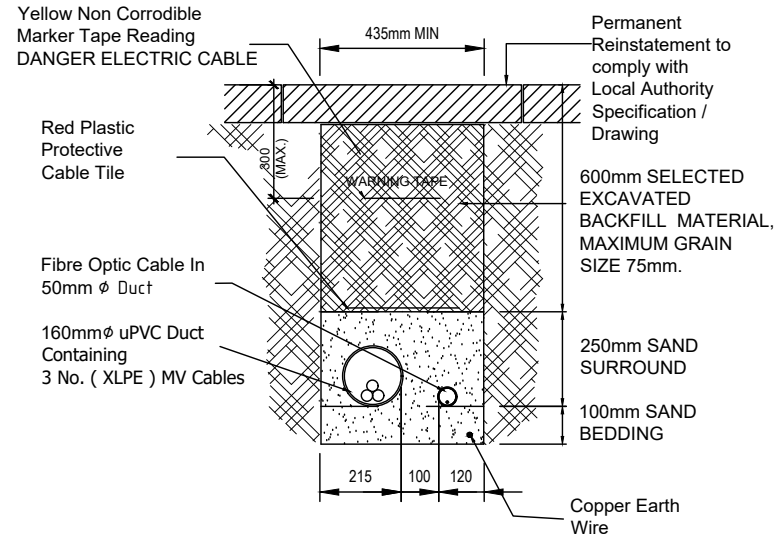


**CABLE TRENCH IN PUBLIC ROAD SINGLE CIRCUIT
(INTERNAL WIND FARM)**
Scale 1:20

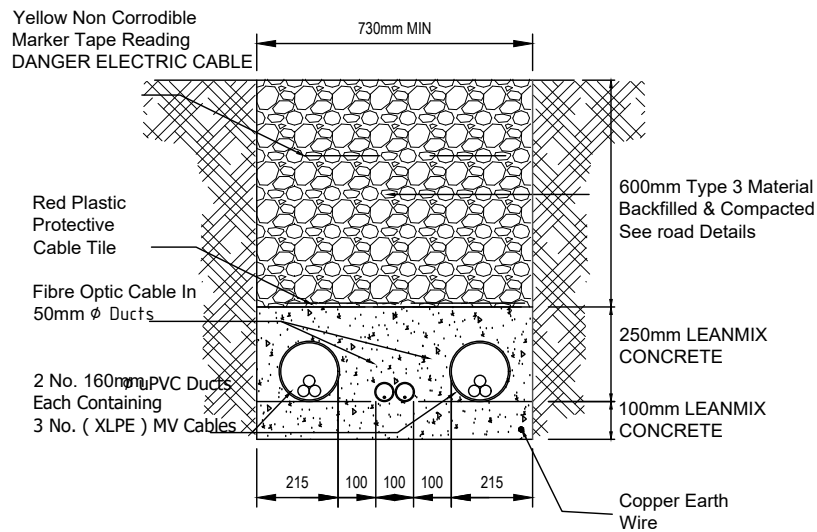

**CABLE TRENCH IN SITE ROADWAY TWIN CIRCUIT
(INTERNAL WIND FARM)**
Scale 1:20

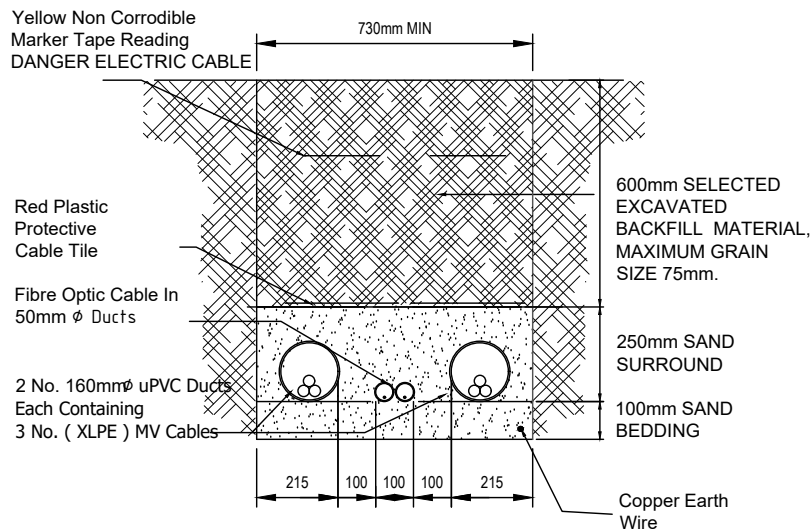

**CABLE TRENCH IN OPEN GROUND TWIN CIRCUIT
(INTERNAL WIND FARM)**
Scale 1:20

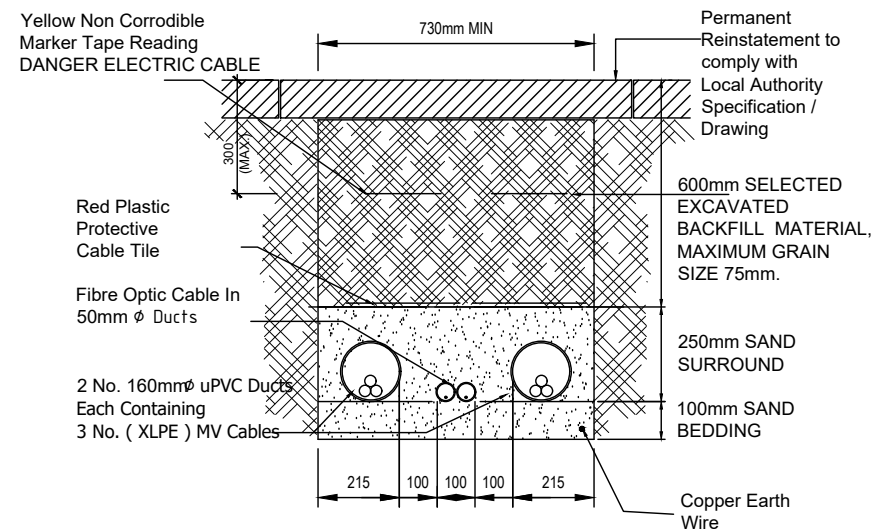

**CABLE TRENCH IN PUBLIC ROAD TWIN CIRCUIT
(INTERNAL WIND FARM)**
Scale 1:20

- NOTES:
- 1 FIGURED DIMENSIONS ONLY TO BE TAKEN FROM THIS DRAWING.
 - 2 ALL DRAWINGS TO BE CHECKED BY THE CONTRACTOR ON SITE.
 - 3 ENGINEER TO BE INFORMED OF ANY DISCREPANCIES BEFORE ANY WORK COMMENCES.
 - 4 THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS AND SPECIFICATIONS.

THIS DRAWING IS NOT TO BE USED AS A CONSTRUCTION DRAWING.

rev.	modifications	D	C	A

Client	CONSTANT ENERGY LTD			
Project	TIRAWLEY WIND FARM CO. MAYO			
Stage	PLANNING			
Title	INTERNAL POWER AND COMMUNICATION CABLE TRENCH DETAILS (WIND FARM)			
Scales	AS NOTED @ A3			
Surveyed JOD	Prepared JB	Checked MG / DT	Approved DK	Date 07/2025



© COPYRIGHT OF
JENNINGS O'DONOVAN AND PARTNERS LIMITED
FINISKLIN Tel (+353) 719 161 416
SLIGO Email. info@jodireland.com
IRELAND www.jodireland.com

@JOD_Sligo Jennings O'Donovan & Partners Jennings O'Donovan

Job No. 6289	Drawing no. PL-1001	Revision 0
-----------------	------------------------	---------------