



## NOTES:

- 1. ALL DIMENSIONS IN MILLIMETERS.
- REINSTATEMENT TO COMPLY WITH REQUIREMENTS OF THE RELEVANT LOCAL AUTHORITY/ASSET OWNER.
- ENTRANCE & EXIT DUCTS TO BE IN LINE.
- ALL MATERIALS AND WORKMANSHIP TO BE IN ACCORDANCE WITH THE NRA/T.I.I. SPECIFICATION FOR ROADWORKS, MAY 2005 & SUBSEQUENT REVISIONS.
- 5. REINFORCED CONCRETE TO BE MINIMUM GRADE C32/40, SULPHATE RESISTING CEMENT TO BE USED WHERE AGGRESSIVE SOIL CONDITIONS APPLY, REFER TO TABLE 6.1 OF B.S. 8110.
- CARRIAGEWAY COVERS AND FRAMES TO BE TO B.S. EN 124.
- ALL COVERS SHALL HAVE 'ESB' LOGO INCORPORATED IN THEM TO THE APPROVAL OF EIRGRID.
- STEP IRONS TO BE HOT DIPPED GALVANISED TO B.S. 729 AND POSITIONED AS SHOWN ON ANY CHAMBER DEEPER THAN 700mm ON THE END REMOTE FROM ANY SIDE ENTRY DUCT.
- 9. CONCRETE PRECAST CHAMBER AND COVER SHOULD BE TESTED THROUGH A 5 POINTS 40 TONNES VERTICAL STATIC LOADING TEST BY AN INDEPENDENT TEST COMPANY. IF REQUIRED, FURTHER DETAILS WILL BE PROVIDED BY EIRGRID.
- 10. FINAL POSITION OF C2 CHAMBERS SHALL BE AGREED WITH EIRGRID.

O:\ACAD\2022\P22-125\P22-125-0300-0016

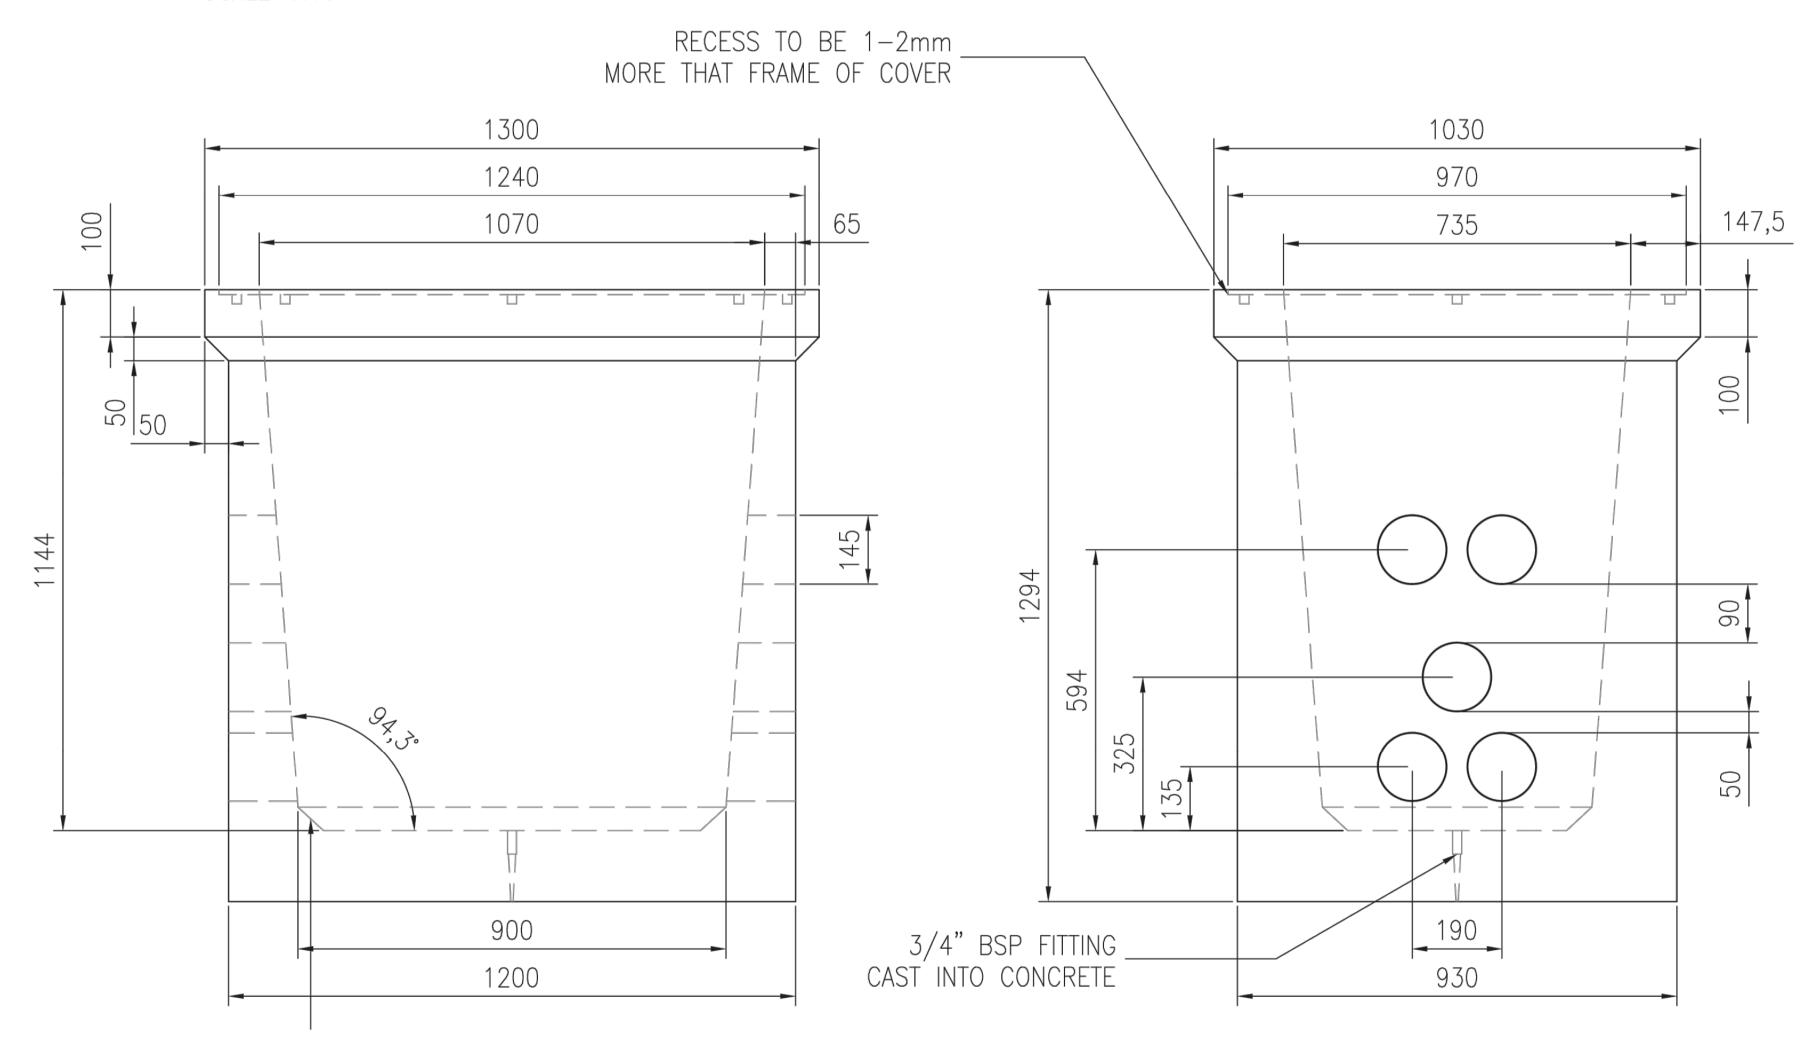

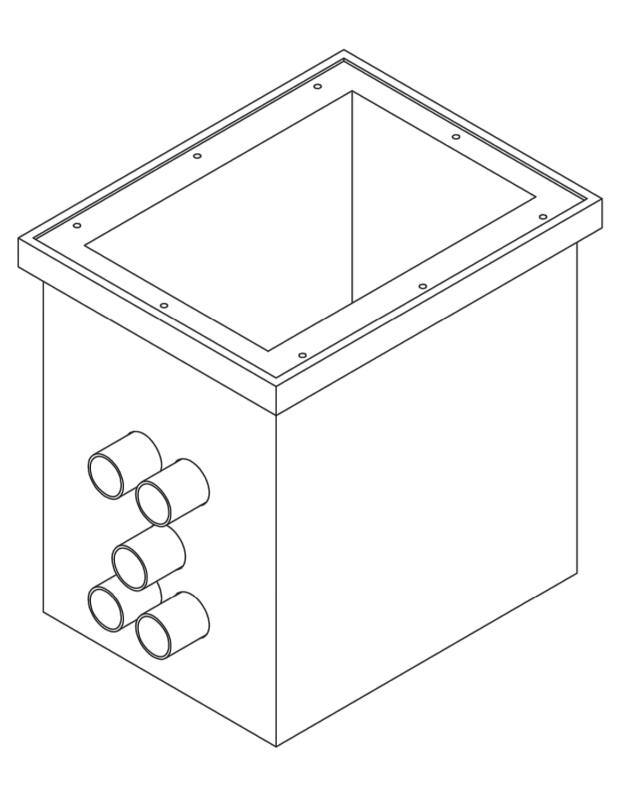

ISOMETRIC: C2 CHAMBER ARRANGEMENT NOT TO SCALE

If Applicable : Ordnance Survey Ireland Licence No. CYAL50221678 © Ordnance Survey Ireland and Government of Ireland OS SHEETS 4612, 4613, 4672, 4673



FEHILY Cork | Dublin | Carlow

Rev.	Description	Арр Ву	Date
P01	FOR PLANNING	JH	22.09.25
·			

	CLOONKETT WIND FARM				CLOO	NKETT Energy
	SHEET	Date	22.09.25	Project number P22-125	Scale (@ A1-) 1:25	
	INTERNAL JOINT BAY DETAILS		SK	Drawing Number		Rev
			ТВ	P22-125-0300-0016 (Sheet set subset 0300)		P01