



UNIT REF No.	NOMINAL FLOW	DIM 'L'	APPROX EMPTY WEIGHT (Kg)	FALL ACROSS UNIT
NS3	3 L/S	1760	110	50
NS6	6 L/S	1760	110	50
NS10	10 L/S	2610	130	50
NS15	15 L/S	3910	167	50

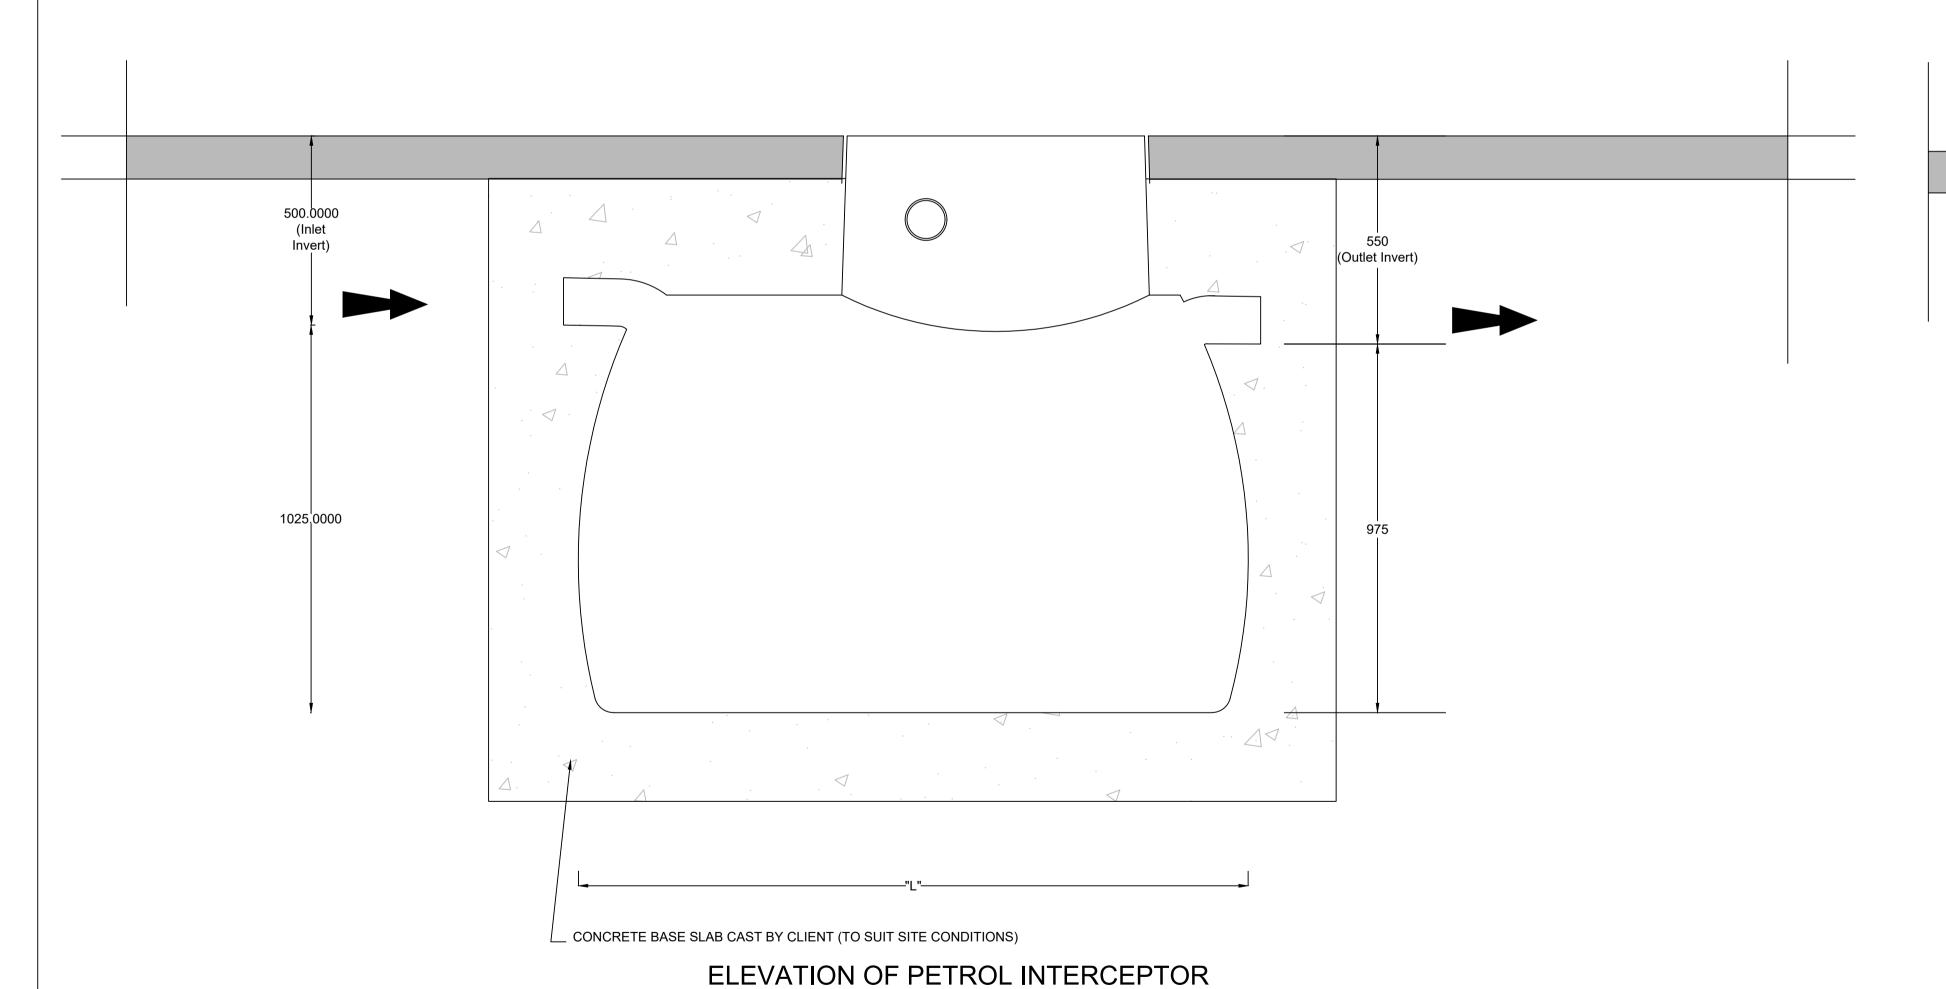

Scale 1:10

## NOTES

- 1. INLET/OUTLET PIPES ARE PLAIN PIPE Ø200mm PVCu. THE STANDARD EN858 STATES MINIMUM CONNECTION SIZES, UNITS ORDERED WITH DIFFERENT SIZED CONNECTIONS ARE NOT FULLY COMMPLIANT WITH THE STANDARD.
- 2. PLEASE NOTE A CLASS 1 SEPARATOR INCLUDES A COALESCER, CLASS 2 SEPARATORS DO NOT.
- 3. EXTENSION NECKS FOR DEEPER INVERTS CAN BE PROVIDED IN 0.5m INCREMENTS FOR ON SITE ASSEMBLY. THE FIRST 0.5m IS A PUSH-FIT SPIGOT. THE NEXT 0.5m IS FLANGED AND SUPPLIED WITH A MASTIC KIT AND NUTS AND BOLTS. MAX 2.0m INVERT RECOMMENDED.
- 4. ALL UNITS REQUIRE APPROPRIATE COVER & FRAME TO SUIT APPLIED LOADINGS.
- 5. THIS DRAWING SHOULD BE USED FOR DIMENSIONAL INFORMATION ONLY. IT IS ESSENTIAL THAT THIS DRAWING IS READ IN CONJUNCTION WITH INSTALLATION GUIDELINES SUPPLIED WITH UNIT. (COPIES ARE AVAILABLE FROM OUR SALES DEPARTMENT).
- 6. REDUCERS ARE AVAILABLE AT EXTRA COST TO SUIT ALTERNATE PIPEWORK REQUIREMENTS.

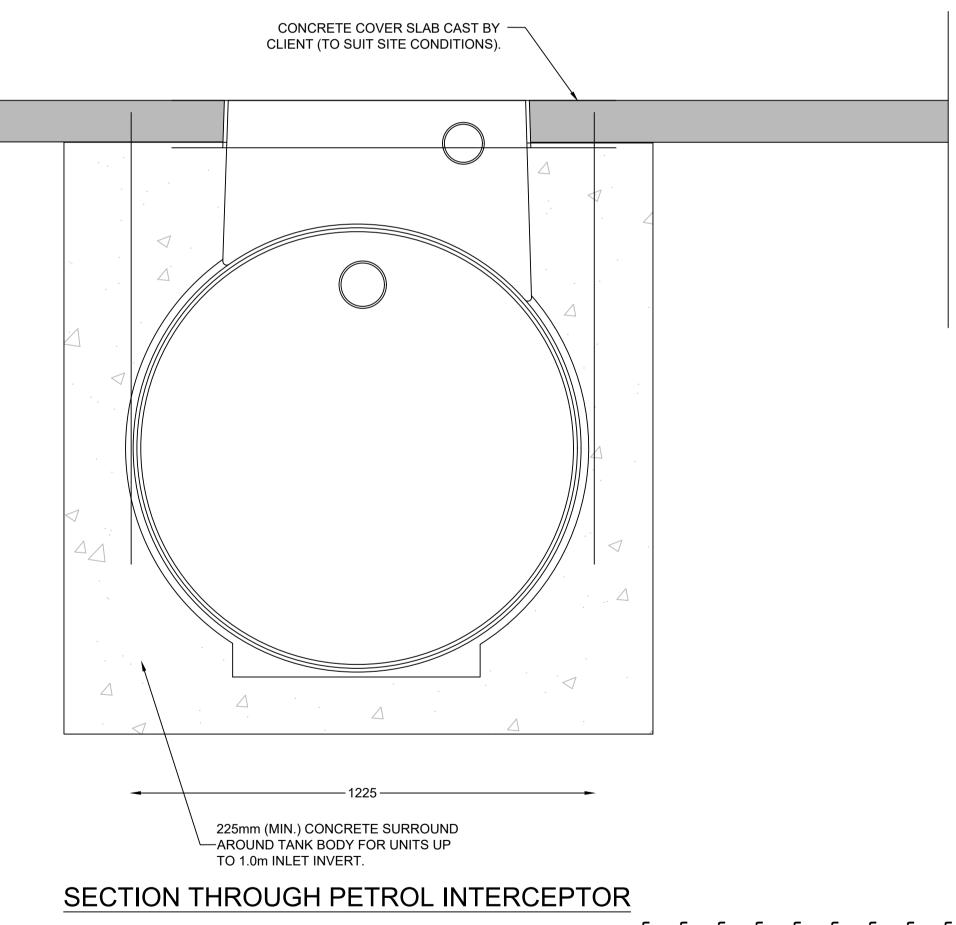

Scale 1:10

FELILIV

issued. Do not scale. Use figured dimensions only. If in doubt - Ask!

If Applicable : Ordnance Survey Ireland Licence No. CYAL50221678 © Ordnance Survey Ireland and Government of Ireland

FEHILY Cork | Dublin | Carlow www.fehilytimoney.ie

No part of this document may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission of Fehily Timoney & Company as copyright holder except as agreed for use on the project for which the document was originally

Rev.	Description	Арр Ву	Date
P01	FOR PLANNING	JH	22.09.25

PROJECT	CLOONKETT WIND FARM	CLOONKETT GREEN ENERGY		CLOC	NKETT n Energy	
SHEET	IEET	Date	22.09.25	Project number P22-125	Scale (@ A1-) 1:10	
FUEL RETENTION PETROL INTERCEPTOR		Drawn by	SK	Drawing Number		Rev
		Checked by	ТВ	P22-125-0501-0004		P01
		O:\ACAD\2022\P2	2-125\P22-125-0501	-0004		