


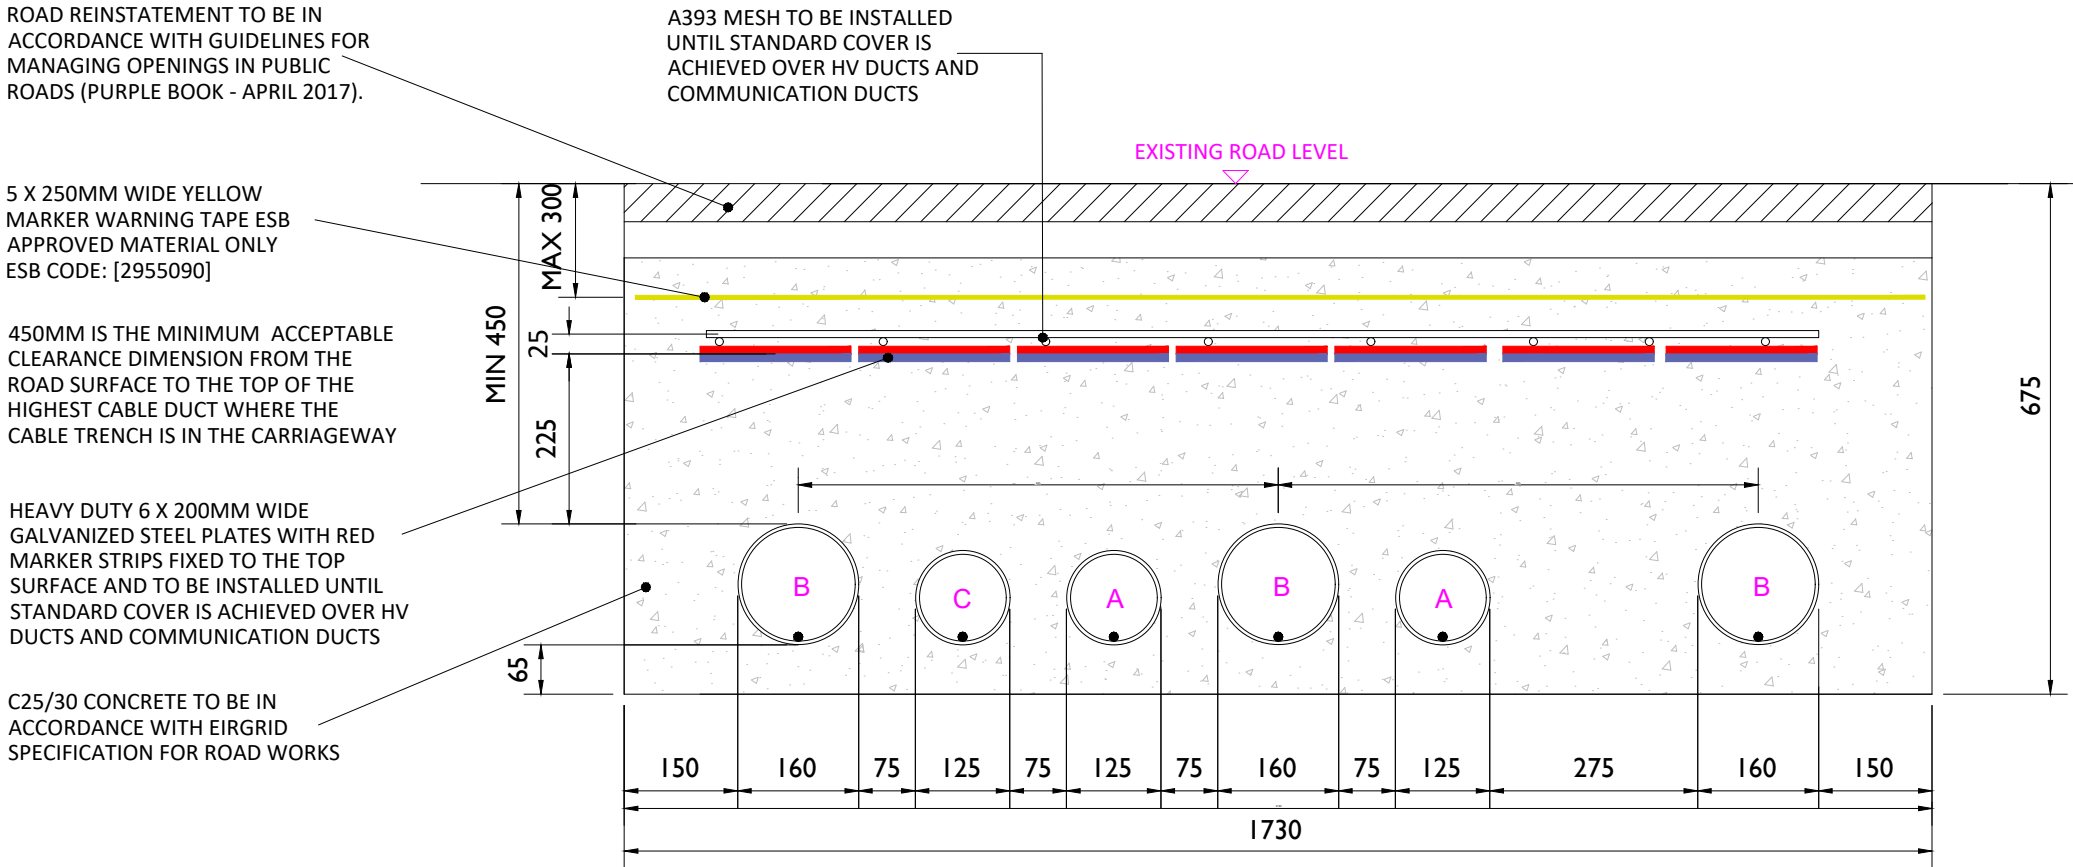

A = 125mm: OUTER DIAMETER HDPE ESB APPROVED DUCT, SDR = 17.6 (COMMS)
B = 160mm: OUTER DIAMETER HDPE ESB APPROVED DUCT, SDR = 21 (POWER)
C = 125mm: OUTER DIAMETER HDPE ESB APPROVED DUCT, SDR = 17.6 (ECC)

Section Through Ducting in Flat Formation

SCALE 1:10

- Note:
- This drawing is to be read in conjunction with relevant drawings, specifications and reports
 - Dimensions are in millimeters, unless noted otherwise
 - Drawings are not to be scaled use figured dimensions only

ALL REINSTATEMENT WORKS ARE TO BE IN ACCORDANCE WITH LOCAL AREA ENGINEERS LANDOWNERS REQUIREMENTS AND GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS



Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710



CLIENT
PROJECT
Scart Mountain Wind Farm
110 kV Grid Connection
PROJECT NUMBER
05-854
SHEET NUMBER
05854-DR-209

SHEET TITLE
Section Through Ducting
in Flat Formation
DRAWING STATUS
For Planning

ISSUE/REVISION		
P2	10.06.2024	Issued for Planning
P1	09.11.2023	Issued for Planning
I/R	DATE	DESCRIPTION