


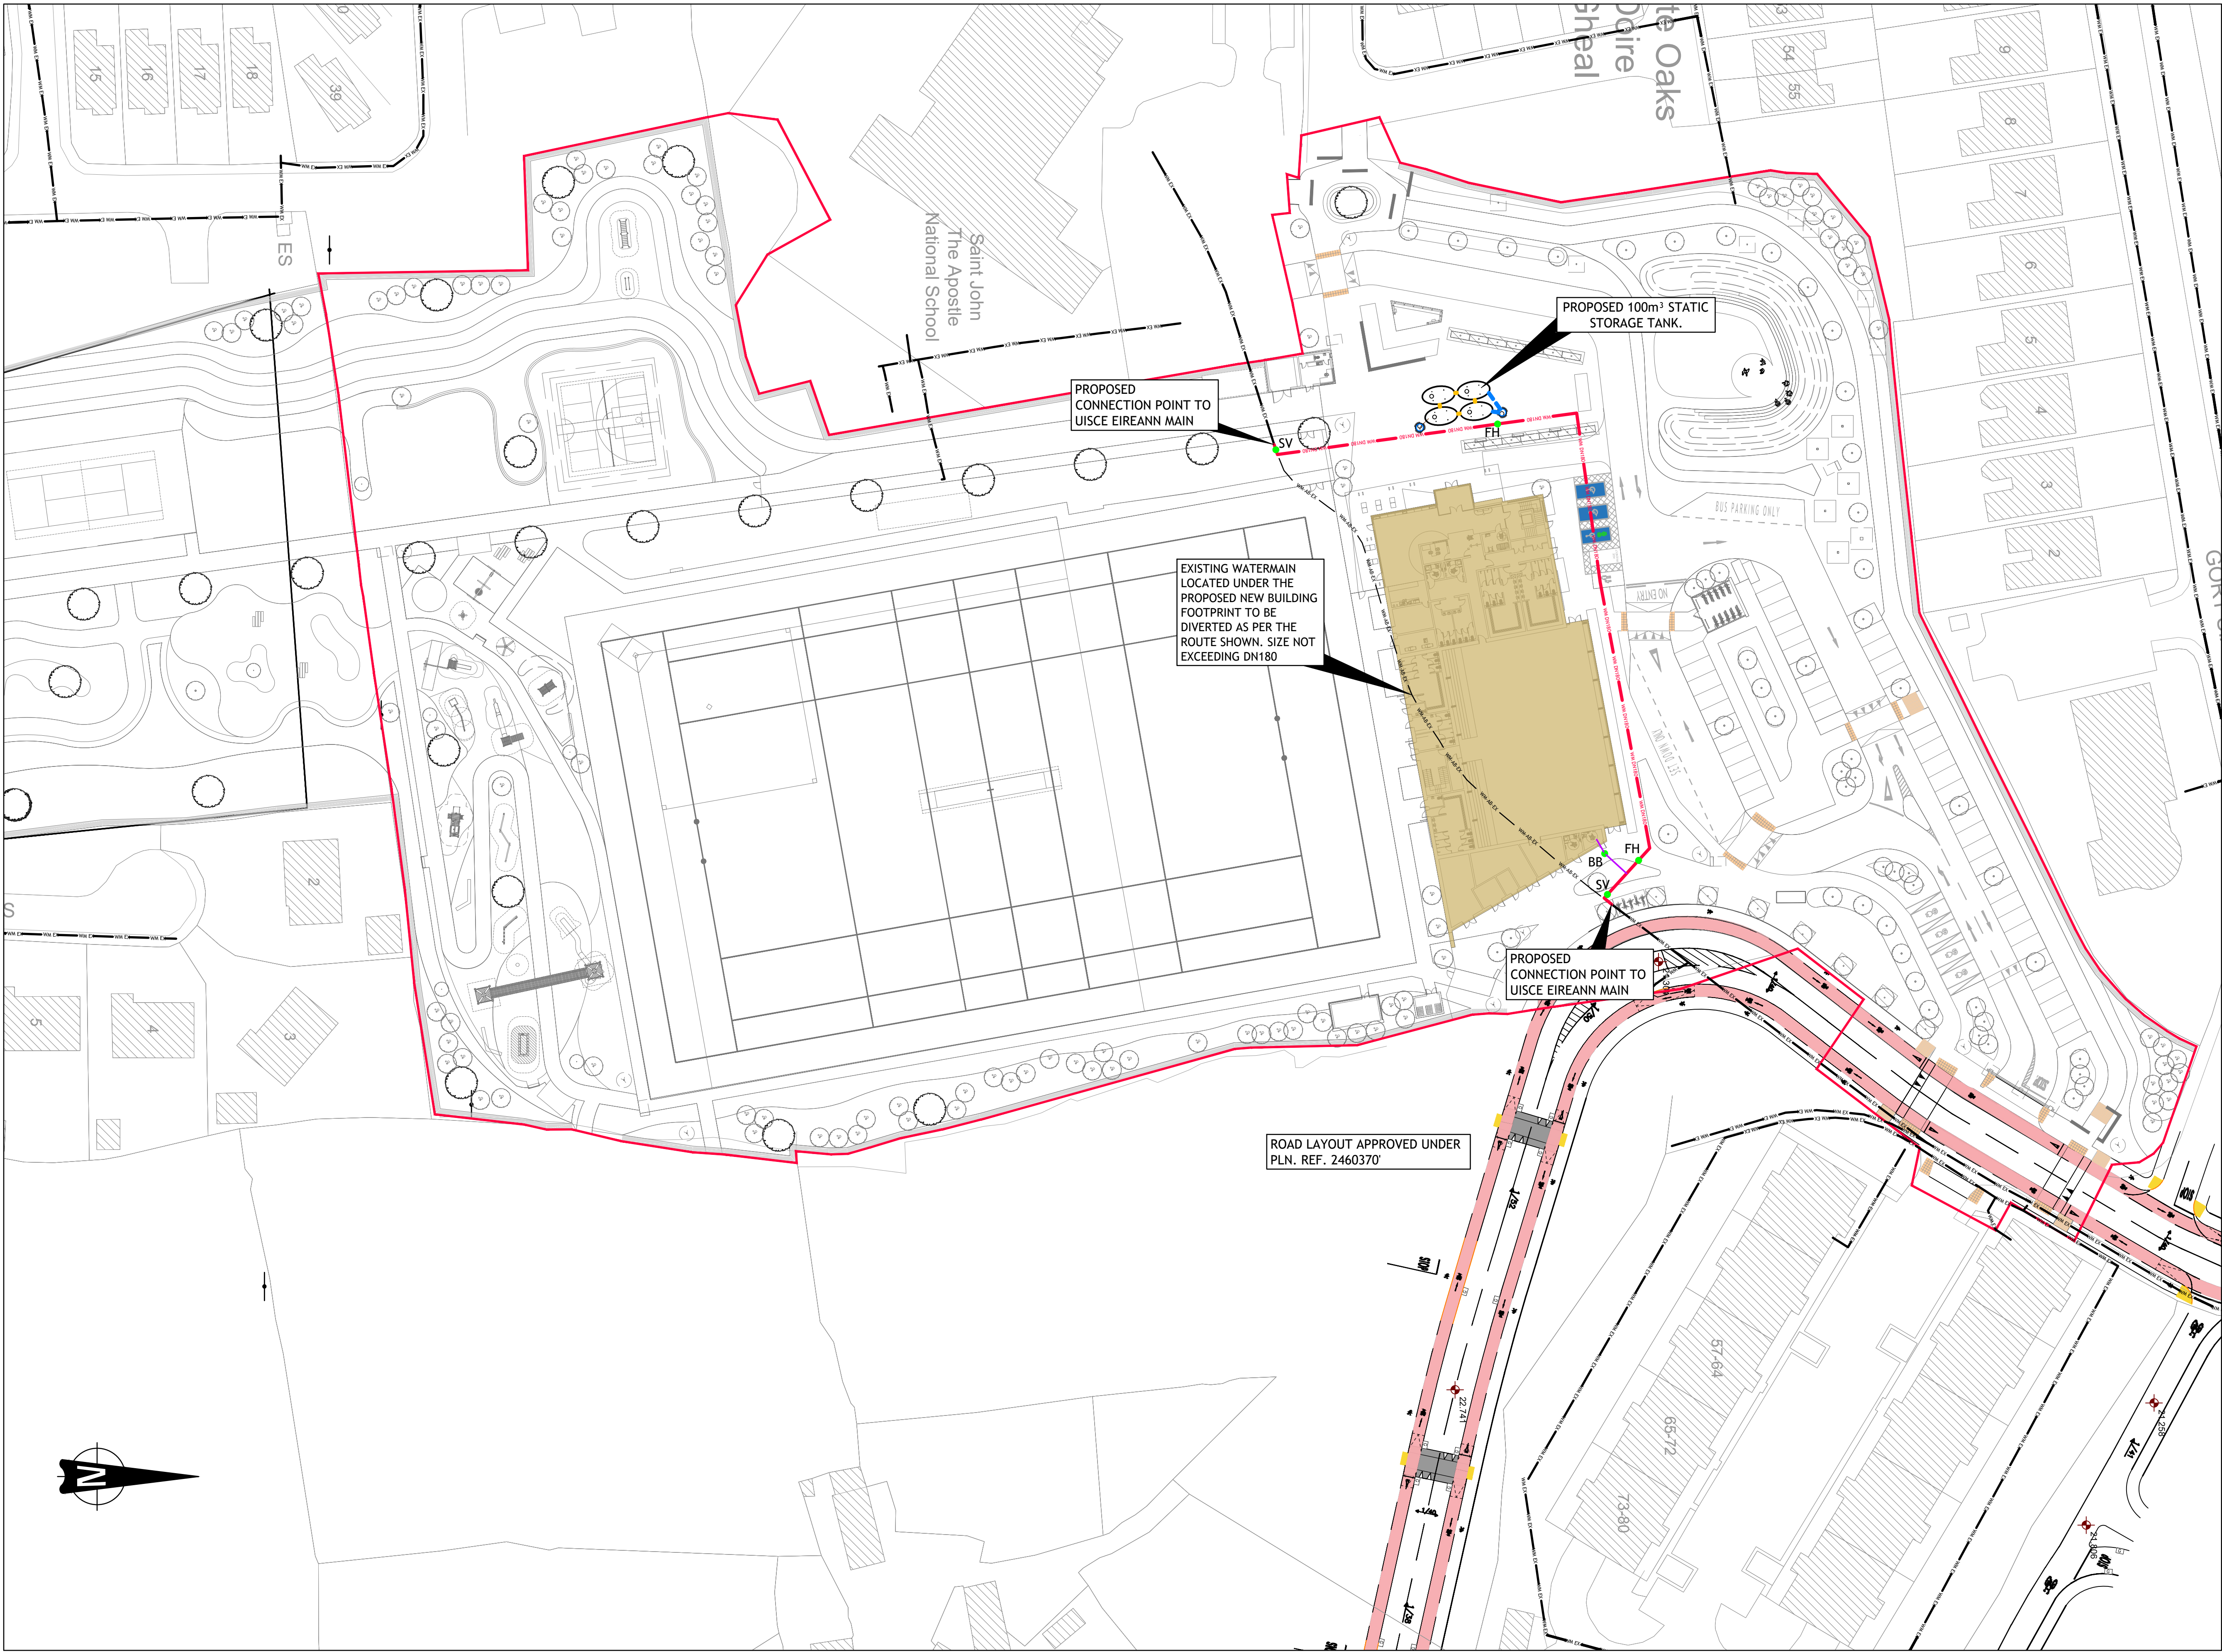

LEGEND

SITE BOUNDARY

PROPOSED BUILDING

EXISTING BUILDING

EXISTING WATERMAIN

PROPOSED WATERMAIN (180 OD PE100 SDR11 PIPE)
MATERIALS MUST BE IN ACCORDANCE WITH UISCE EIREANN STANDARDS

PROPOSED WATERMAIN CONNECTION - SIZE TO BE CONFIRMED BY M&E CONSULTANT

EXISTING WATERMAIN TO BE ABANDONED, DEMOLISHED & REMOVED

PROPOSED FIRE HYDRANT

PROPOSED SLUICE VALVE

PROPOSED WATER SERVICE CONNECTION AND BOUNDARY BOX TO IRISH WATER DETAIL STD-W-26G.

FH

SV

BB

EXTRACT OS SHEETS 3407-B, 3407-13, 3407-14
© ORDNANCE SURVEY IRELAND. ALL RIGHTS RESERVED.
LICENCE NUMBER 2024/24CCMA/GALWAY CITY COUNCIL

Tailte Éireann Licence No. CYAL50443614
© Tailte Éireann - Surveying.

© PUNCH Consulting Engineers

This drawing and any design hereon is the copyright of the Consultants and must not be reproduced without their written consent.
All drawings remain the property of the Consultants.
Figured dimension only to be taken from this drawing.
Consultants to be informed immediately of any discrepancies before work proceeds.



Rev	Amendment	By	Date	Rev	Amendment	By	Date
P01	FOR REVIEW & COMMENT	PJM	2025-09-23				
C01	ISSUED FOR PLANNING	PJM	2025-10-17				
C02	ISSUED FOR PLANNING	PJM	2025-10-31				

Rev	Amendment	By	Date

Client:
GALWAY CITY COUNCIL

PUNCH
consulting engineers
Dublin | Limerick | Cork | Galway | Glasgow
Carleycon House, Main Street, Orammore,
Co. Galway, H91 T026
t +353 91 703 500 | w punchconsulting.com

Project:	KINGSTON PARK AND MILLERS LANE - PUBLIC PARK AND URBAN REALM PROJECT
Title:	KINGSTON PARK - PROPOSED WATERMAIN LAYOUT
Drawn:	PJ Mulcahy
Date drawn:	2025-09-23
Technician Check:	PJ Mulcahy
Engineer Check:	Metias McCabe
Approved:	Matthew Greene
Project No:	233114
Model Ref:	233114-PUNCH-KP-XX-M2-C-0301
Drawing Status:	A0 (Planning)
Scale @ A1:	1:500
Document No:	233114-PUNCH-KP-XX-DR-C-0301
Revision No:	C02