

Environmental Impact Assessment Report (EIAR)

Volume 6 of 6: Appendices

(Appendix 4.2) Standard Specification for ESB 38kV Networks

Document no: 32105801/EIARA4.2

Version: Final



December 2025

PAGE LEFT INTENTIONALLY BLANK




Standard Specification for ESB 38kV Networks Ducting/Cabling (Minimum Standards)

Note 1 : ESB Networks reserves the right not to accept ducting which does not conform to these standards and dimensions
 Note 2 : Refer to ESB Networks for Specific job Specification. These instructions do not apply to LV/MV/110kV/220kV cable
 Note 3 : All materials (ducts, marker tapes/strips, duct surrounds, mandrels and brushes) must be ESB approved materials

ESB Networks
 Rev 0: Date 08-09
 Approved:

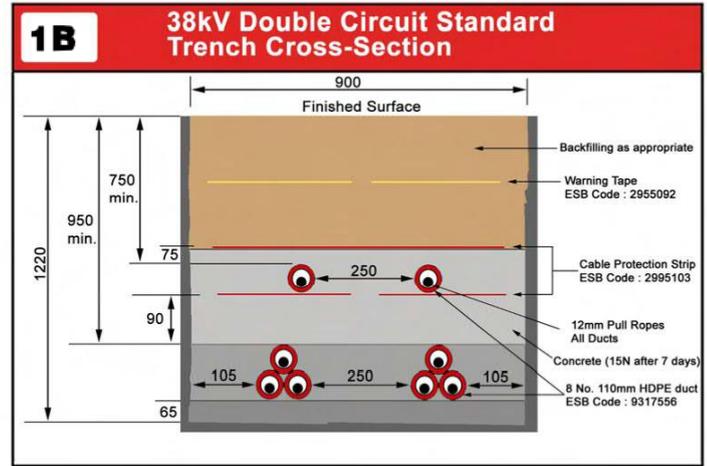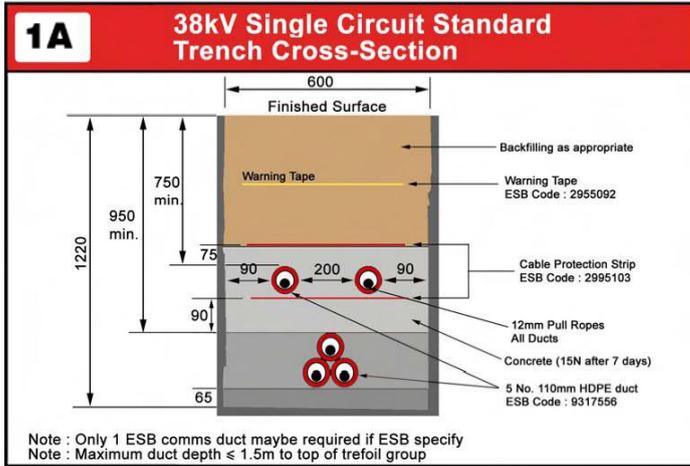


1C Trench Installation Sequence






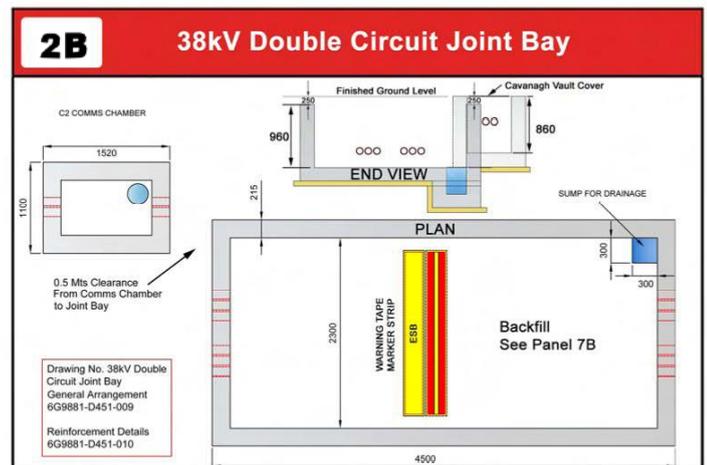
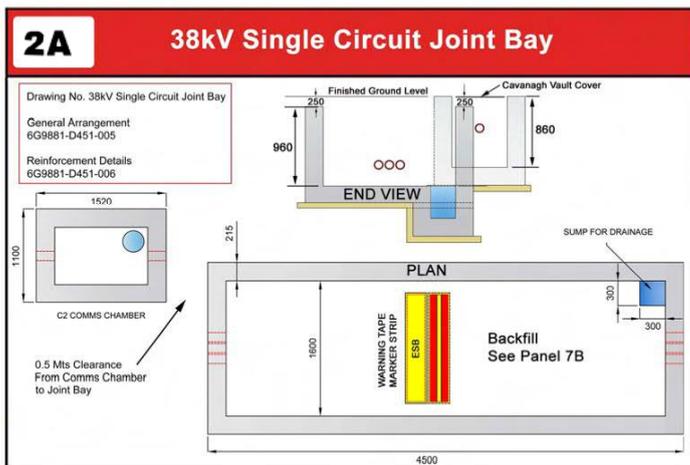
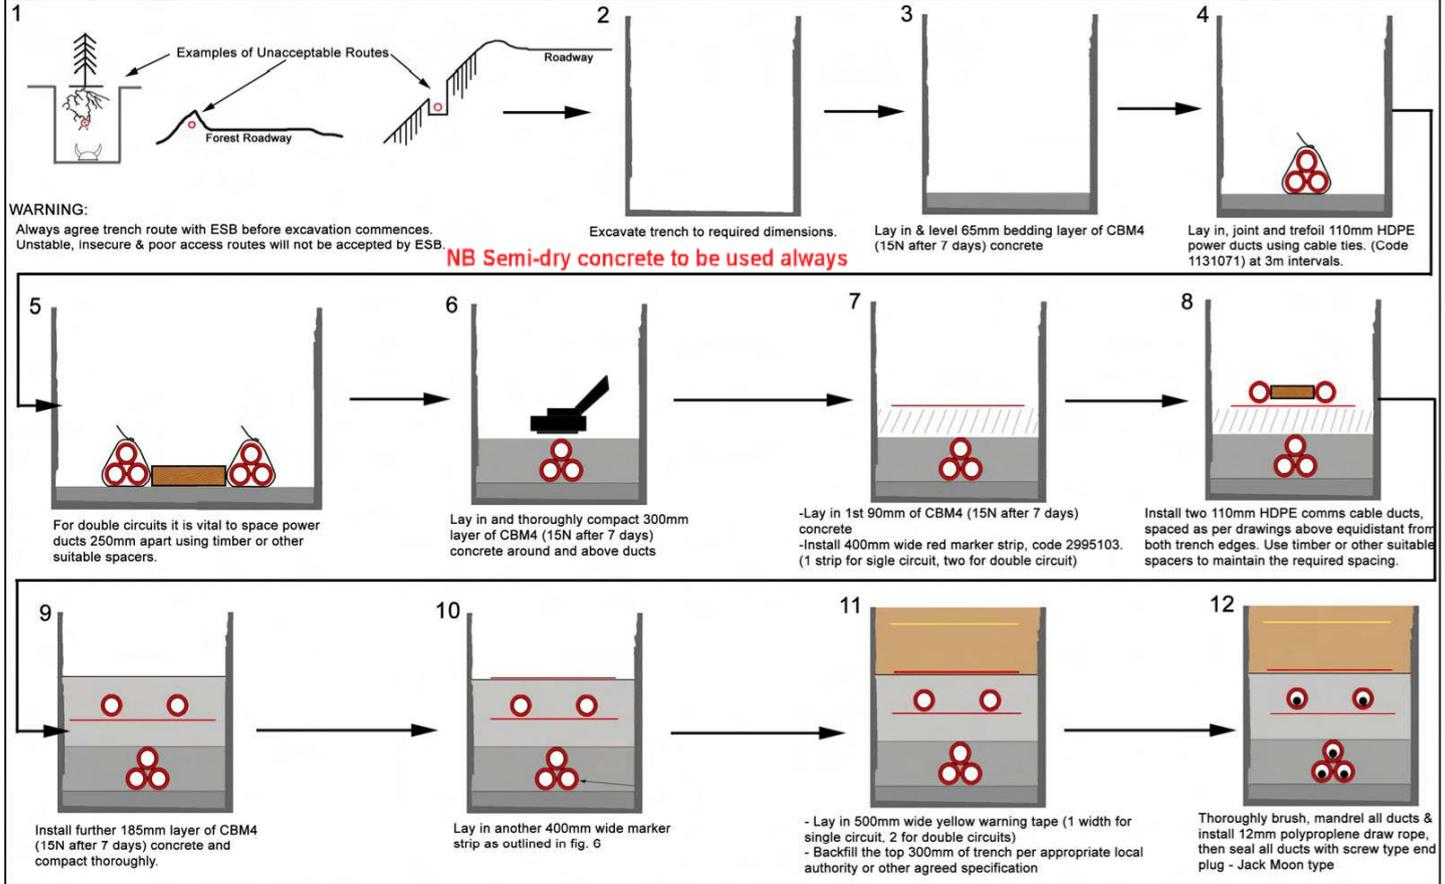


Networks Ducting/Cabling (Minimum Standards)

Note 1 : ESB Networks reserves the right not to accept ducting which does not conform to these standards and dimensions
 Note 2 : Refer to ESB Networks for Specific job Specification. These instructions do not apply to LV/MV/110kV/220kV cable
 Note 3 : All materials (ducts, marker tapes/strips, duct surrounds, mandrels and brushes) must be ESB approved materials

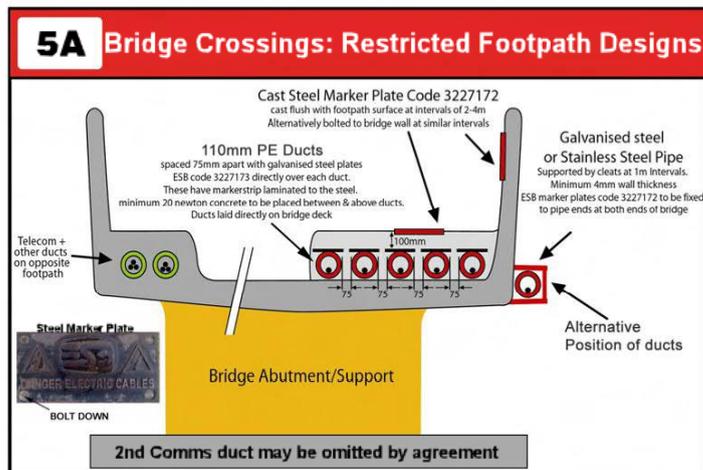

- ### 5B Bridge Crossings: Restricted Footpath Designs
1. The design must be agreed with the bridge authority. Position in footpath is preferred.
 2. Minimum cover over ducts on footpath 100mm.
 3. Where duct cover is > 300mm, marker strip & surface marker plates can be used.
 4. Red ducting is not suitable for cable run external to bridges.
 5. Where possible galvanised steel/stainless steel piping should be used, all joints must be free of weld burrs on inside. Alternatively heavy duty 10mm wall thickness black HDPE material with cast steel marker plates attached must be used to permanently warn of presence of electric cable.

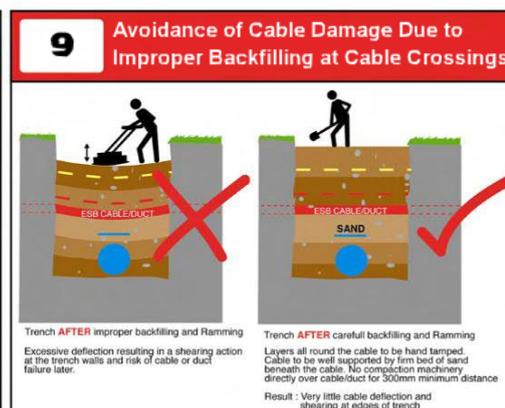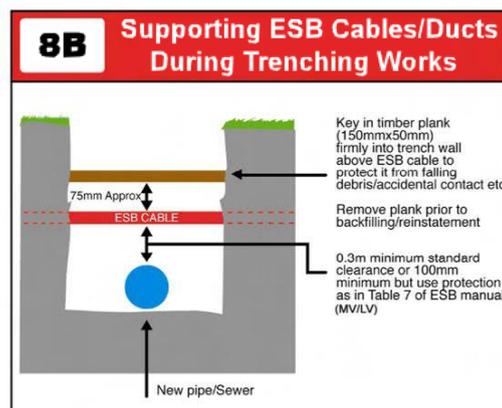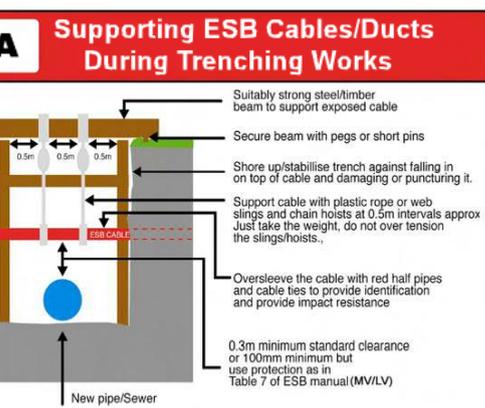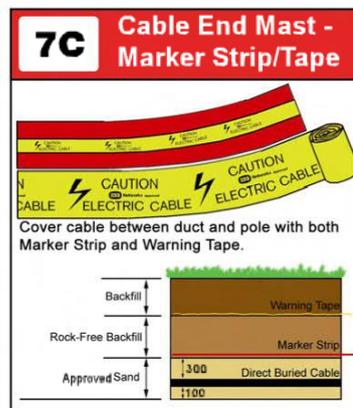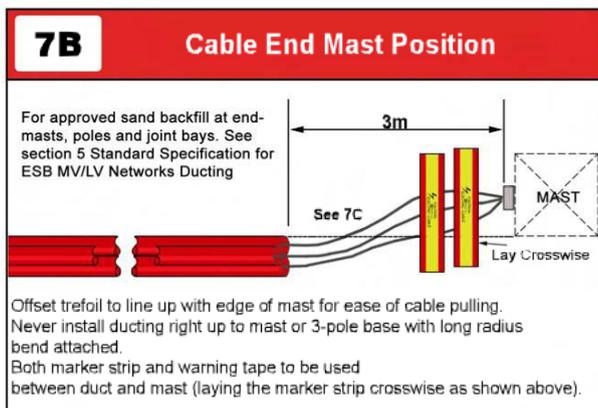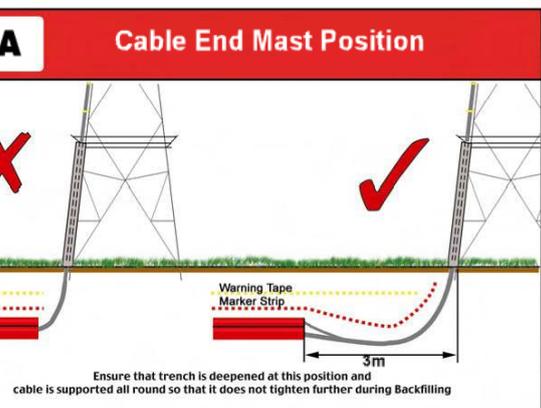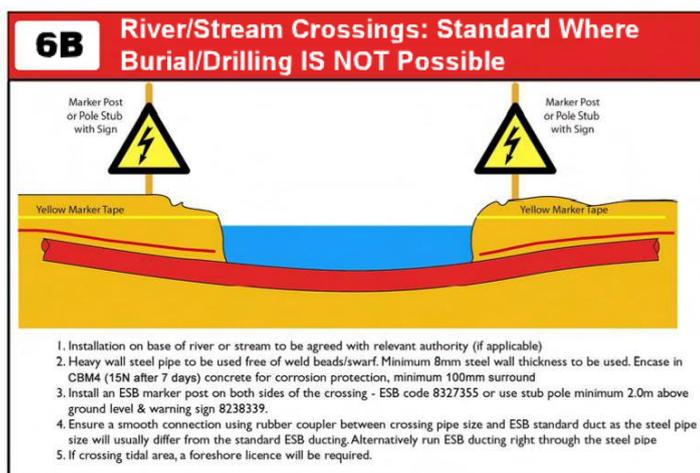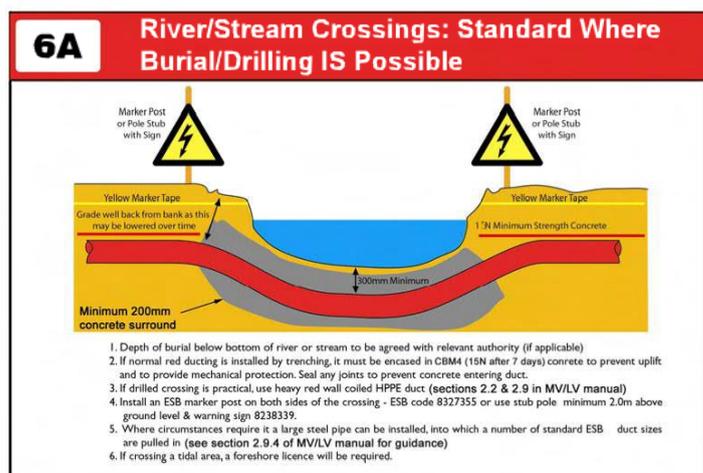

Standard Specification for ESB 38kV Networks Ducting/Cabling (Minimum Standards)

Note 1 : ESB Networks reserves the right not to accept ducting which does not conform to these standards and dimensions
 Note 2 : Refer to ESB Networks for Specific job Specification. These instructions do not apply to LV/MV/110kV/220kV cable
 Note 3 : All materials (ducts, marker tapes/strips, duct surrounds, mandrels and brushes) must be ESB approved materials



3A End Mast Termination

For existing 9m masts increase steel work height by 1.3m at mast top

12m Mast (For all new works)

Anti-Climbing Guard

EARTH GRID

Cable Assembly Drawing Number : D205778

3B Triple Pole Structure

Cable Steel Work Code: 1286697

Made up anti-climbing guard

7m Min Dimension to Bare Metal Use 12m Pole

3C Station Termination

To Cubicle

If Cable run <50m install lightning arrestors.

Assess need for mesh screen guard (Code: 3175003)

Drg. No A3205856

Clearances : Phase to:
 - Phase 500mm outdoor
 - Earth 500mm outdoor

3D Earth Grids

10m PLAN

10m

3m approx.

1.5m

1.5m

12 Rod Earth Grid For 3-Pole Structure

12 Rod Earth Grid For Mast Structure

Warning Tape

500

300

Earth Grid resistances <10 Ohms. If ground is known to be high resistance, plan ahead and put additional earthwire into cable trench.

Drg. No. A4D 205343
 PE424-D901-911-001-000

4A Obligation of Duct Installer to minimise the number and severity of duct bends

The duct installer must minimise the number and severity of preformed bends in ground with obstructions and other utility service crossings by opening ground 15m ahead of backfilled duct, wherever practical to do so. This safety obligation, which may require use of steel plating, allows the duct installer to pick the least bendy duct route through utility crossings and obstructions. Otherwise, numerous sharp unrecorded duct route deviations will be present making cable installation considerably more difficult and less safe for the cable installer.

Backfilled Duct

Obstructions

Digger

Dig 15m Ahead of duct to uncover obstructions

4B Standard for Brushing, Mandrelling, Roping and End-Capping of 38kV ducts

All Ducts must be:

- Thoroughly brushed and mandrelled to prove ducts against debris /excessive deflection
- Roped using 12mm polypropylene rope with certified safe breaking load of 1.5 tons -- all rope joints to be properly spliced and PVC taped over. Approved Supplier Silver Strand Bunclana Donegal, ph (074) 9382503 - 500m drum lengths available to minimise splicing/coil handling
- Sealed using endcaps against grit and water getting into them

NB: Replace mandrels once mandrel wear indicators or grooves are worn down
 Replace brushes once brush diameter falls 5mm below dimensions in table below

- Approved endcaps, both disposable and reusable types, are available from suppliers of approved ESB ducting
- Approved ESB Mandrel and brush suppliers :

Brandon Agencies, Rathnew, Co Wicklow: Phone 0404 20500 (Brushes & Mandrels)
 IS Varian, Greenhills Industrial Estate, Walkinstown, Dublin 12 Phone: 01-4501150 (Brushes Only)
 Clydesdale UK Phone 086 172 6665 (Brushes & Mandrels)
 Tynagh Network Systems, Loughrea, Co Galway, Phone: 091 842206 (Brushes & Mandrels)

110mm HDPE Duct Size		
250mm	250mm	
85mm	100mm	
Mandrel	Brush	Sponge
Code: 9317546	Code: 8783255	Code: 8783252

4C Approved ESB Ducting for 38kV Cables

- Use only solid wall high impact resistance ESB approved HDPE red ducting to IS 370 colour standard and ESB specification 16113 (6.3mm minimum wall thickness) Discoloured or unidentified ducting not acceptable. All duct material must be approved by ESB Networks.
- Lightweight flexible corrugated twinwall ducting is not acceptable to ESB irrespective of manufacturer
- Current approved HDPE Duct and duct bend manufacturers are: Lynplast (bend fittings only), Uponor-Radius Systems, Wavin, Quality Plastics

4D Specification for Duct Jointing for 38kV Cables

Mallet or Hammer

Timber block to protect end of duct from damage

Long Coupler

Fully jointed Duct Marks

All ducts to be securely jointed by tapping against timber board on each duct until the black depth insertion mark is reached
 Always smear duct lubricant on coupler rubber ring

4E Repair of Existing Ducts

Use only approved slip couplers from approved manufacturers in section 4C

Damaged Duct Section

Slip Coupler

Slip Coupler

Repair length

- Cut out damaged section of duct and ensure all cut surfaces are square and free from sharp edges
- Slide, position and centre the repair couplers on the centering marks

4F Sealing of Ducts

All ducts to be permanently sealed at both ends of duct run
 Ducts to be temporarily sealed during installation using endcaps provided with each bale

Endcap Plain End

ESB Code 110mm: 9317569

10A 38kV Railway Crossing Details

ESB Signpost

3m

ESB Signpost

Drilling pits outside CIE property line

Formal licence for crossing and approval required from CIE. Accurately record crossing location & erect marker posts.

10B Directional Drill/Thrust Bore Duct Bore Details

DESIGN 1

Minimum internal bore size = 325mm for 5 ducts

=290mm for 4 ducts where approved by ESB

Spacer

5 no. 110mm diameter HDPE ducts

Alternatively use 2 x 37mm HDPE ducts for comms cables with C2 chamber on each side of the crossing to permit pulling along entire route. (See 10C)

Completed interstitial space to be bentonited thoroughly to maintain cable rating. Accurately record crossing location & erect marker posts.

10C Directional Drill/Thrust Bore Duct Bore Details

ALTERNATIVE DESIGN

ESB Signpost

3m

ESB Signpost

Cable joint pit

Cable joint pit

37

37

Install 1 no. 200mm SDR 17.6 duct with 3 no. short length cables pulled into this pipe along with 2 x 37mm comms ducts. Full cable joint bays are required on either side of crossing along with C2 chambers for this design. This method is used where it is not practical to install large diameter pipe -eg. risk of ground upheaval or presence of obstructions. Completed interstitial space to be thoroughly bentonited to maintain cable rating. Accurately record crossing location & erect marker posts.

10D Double Circuit Bore Crossing

Standard Design

3m min

-Both Bentonited

Separate drilling for each circuit crossing

Alternative

HDPE or steel thrust bore pipe Diameter ID= 400mm

Bentonite

6 no. 110mm Power ducts + 2 no. 110mm comms ducts

2 no. sets of 110mm HDPE ducts - 8 ducts in total. All crossings to be accurately recorded and signposts erected given impracticality of marker tape. If both circuits = 40MVA then use 630 Cu cable

12 Minimum Standard Clearances to Other Services

Normal Services

300

600

Large Pipelines High Pressure Pipes

Clearances less than the above at pinch points and crossings requires placement of additional mechanical protection (concrete slab/brick) and agreement of ESB

ESB ducts must never be laid over other services on parallel runs, except with the written prior agreement of the other utilities and ESB

Other services must never be laid directly over ESB ducts on parallel runs

13 Combined MV & 38kV Cable Runs

38kV Trench

1.1m to 1.25m Depending on Location

Yellow Marker Tape

Pilot Cables

Concrete Surround

MV/LV Cables

Yellow Marker Tape

Red Marker Strip

150mm

150mm

Additional MV/LV Ducts as Required

300mm Strict Minimum Separation

Where it is impractical to avoid such trench runs, the separation of 300mm should be strictly controlled and monitored to minimise derating (See MV/LV manual page 180)

14 Sealing and Protection of 38kV Cables Once They Exit Ducts

Duct

Sandbags or other durable support for cable as it exits ducts to prevent damage to cable sheath

Ducts to be thoroughly using ESB approved water sealant and 4hr fire rating approved for firestop. NB - All joint bay duct entries to be thoroughly sealed to prevent sand washout and subsidence.

15 Duct Crossovers Are Not Allowed

1, 2, 3

2, 3, 1

Be especially careful when going from flat to trefoil formation in vicinity of services

Eliminate this possibility by marking ducts 1, 2, 3 etc before & after flattening to avoid an obstruction.

NB. If using double circuit, tape mark power ducts 1 to 6

16 Crossing Dumps/Contaminated Ground

Thoroughly seal all joints with adhesive water-tight duct jointing compound and pressure test for airtightness. Gasketed couplers alone are inadequate. Fusion welded couplers are also acceptable but require red over-taping.

NB. Avoid whenever possible due to: Subsidence, methane gas & severe thermal derating risks. Seek advice from ug networks section to ensure rating of cable is adequate (derating of 50% can occur) NB. Waste oils and chemicals can also seriously damage cables

Seal all duct joints with duct adhesive compound or use continuous duct lengths & seal all duct ends in joint bays. Alternatively weld pipes.

Concrete is continued up to 300mm of final surface to offset derating (CBM4 - 15N after 7 days)

Standard Specification for ESB MV/LV Networks Ducting (Minimum Standards)

Note 1: ESB Networks reserves the right not to accept ducting which does not conform to these standards and dimensions
 Note 2: Refer to ESB Networks for Specific job Specification. These instructions do not apply to 38kV/110kV/220kV cable
 Note 3: All materials (ducts, marker tapes/strips, duct surrounds, mandrels and brushes) must be ESB approved materials

ESB Networks
 Drg. No. NW-014
 Rev 0: Date 09-08
 Approved:

1 MINIMUM depths below finished ground level

DEPTH

- 450mm in established footways
- 600mm in new housing estate carriageways & footways and all grassed areas
- 750mm All Non-Housing Estate carriageways, forestry, farmland & bogland

Depth is measured to top of duct
 Max depth is 1m except at:

- service crossings where 1.5m is allowed
- short rail and road crossings where up to 2.5m is allowed

2A Minimum Standard Clearances to Other Services

300mm Clearance to Normal Services
 600mm Clearance to: Large Pipelines High Pressure Pipes

- To achieve these clearances see sections 3D and 3E below
- Clearances less than the above at pinch points and crossings requires placement of additional mechanical protection (concrete slab/brick) and agreement of ESB
- ESB ducts must never be laid over other services on parallel runs, except with the written prior agreement of the other utilities and ESB
- Other Services must never be laid directly over ESB ducts on parallel runs

2B Trench Installation Sequence

1 Examples of Unacceptable Routes: Roadway, Forest Roadway

2 Excavate trench to required dimensions. Ensure loose material and protruding stones are removed

3 Lay in & compact a bedding layer of approved material to a min thickness of 50mm or as otherwise specified

4 Lay ducts and horizontal spacer on 50mm bedding layer maintaining specified clearances

5 For multiple circuits ensure ducts are spaced as per Section 3 below with a min of 150mm duct spacing

6 Lay in and compact a layer of approved backfill to a depth of 200/275mm above bedding layer

7 Install ESB approved red marker strip on top of approved compacted backfill

8 Lay in and compact a layer of approved backfill maintaining a max depth of 300mm to the surface

9 Install ESB approved yellow marker tape. The max depth for the marker tape is 300mm from finished ground level

10 Reinstate final layer of backfill as per agreed L&L and Owner Specification

3A Minimum Duct Spacings for ESB Ducts

75mm minimum duct spacing for up to two ducts in any layer

Duct crossovers not allowed at any point along route.

3B Minimum Duct Spacings for ESB Ducts

150mm duct spacing required for more than 2 ducts in any layer

Duct crossovers not allowed at any point along route.

3C Minimum Duct Spacings for ESB Ducts

Minimum duct to trench wall clearances and minimum bedding depths

Minimum duct to trench edge clearance is 100mm and minimum bedding depth is 50mm

NB: 50mm minimum depth of compacted approved backfill above duct top

3D Minimum Duct Spacings for ESB Ducts

Achievement of Horizontal Duct Spacing

Use 75mm or 150mm temporary timber/brick or plastic spacers as appropriate to establish horizontal duct spacing during construction

NB Use 300mm or 600mm horizontal spacers to achieve horizontal spacing from other utilities as appropriate

Always keep a stock of 300mm, 150mm & 75mm spacers for ESB Trenching

3E Minimum Duct Spacings for ESB Ducts

Achievement of Vertical Duct Spacing

STEP 1 Lay in Ducts and horizontal spacer Lay in 50mm bedding Layer

Step 2 Lay in and compact approved backfill to 200/275mm depth depending on spacing in 3A/3B above

Step 3 Check depth of approved backfill above 1st duct layer and lay in 2nd layer of ducts and spacers on top of sand layer

NB. Vertical Duct Spacers are not allowed anywhere as they create point loading of ducts. Refer to 3A/3B for spacings in specific situations

4A Installation of: Special ESB marked Yellow Marker Tape and Special ESB marked Red Marker Strip in Carriageways

ESB yellow marker tape and red marker strip is to be used on all carriageways and on grassed areas for both LV & MV cables

300mm Maximum for ESB yellow marker tape

75mm minimum above duct for ESB red marker strip.

ESB yellow marker tape and red marker strip widths must always be wider than ducts beneath

ESB yellow marker tape and ESB red marker strip must never be laid directly on top of ducts

Never lay other utility marker tape or strip over ESB ducts

Never lay ESB marker tape or strip over other utility pipes

4B Installation of Special ESB marked Yellow Marker Tape in all Footways

ESB approved yellow marker tape to be used on all Footways

300mm Maximum for ESB yellow marker tape

ESB yellow marker tape width must always be wider than width of ducts beneath

ESB Yellow marker tape must never be laid directly on top of ducts

Never lay other utility marker tape or strip over ESB ducts

Never lay ESB marker tape or strip over other utility pipes

CAUTION
ELECTRIC CABLE

5 Specification for duct surround material

The thermal resistivity of the duct surround material must be maximum 1.0km/watt @0% moisture content. Only ESB approved unwashed sand graded to BS882 standard or equivalent ESB approved material is acceptable.

Duct surround material must be well compacted around ducts without damaging the ducts

NB: Pea gravel and foam concrete are unacceptable ESB duct surround materials

6A Specification for Installation of Ducts at sharp route bends

ESB Approved Long Radius Bend (minimum Duct Bend Radius 1.2 Metres) Bends less than 1.2m radius are unacceptable

400mm 10N Minimum strength concrete on inside of bend to withstand cable pulling forces

Cross Section at bend Showing concrete support all around the duct and increased trench width

Wider trench to accommodate 400mm of concrete on inside of bend

Normal Trench Width

6B Specification for Installation of Ducts at Gentle sweep bend positions

6m length straight pipe

Always use a series of 11, 22 or 45° bends to provide a smooth joint interface where the trench route curves around in a large sweep. Never bend ducts around a large sweep trench

Concrete support as for item 6A

7 Obligation of Duct Installer to minimise the number and severity of duct bends

The duct installer must minimise the number and severity of preformed bends in ground with obstructions and other utility service crossings by opening ground 12m ahead of backfilled duct, wherever practical to do so. This safety obligation, which may require use of steel plating, allows the duct installer to pick the least bendy duct route through utility crossings and obstructions. Otherwise, numerous sharp unrecorded duct route deviations will be present making cable installation considerably more difficult and less safe for the cable installer.

Backfilled Duct

Obstructions

Digger

Dig 12m Ahead of duct to uncover obstructions

8 Standard for Brushing, Mandrelling Roping and End-capping of MV/LV Ducts

All Ducts must be:

- Thoroughly brushed and mandrelled to prove ducts against debris/excessive deflection
- Roped using 12mm polypropylene rope with certified safe breaking load of 1.5 tons – all rope joints to be properly spliced and PVC taped over. Approved Supplier Silver Strand Bundana Donegal, ph (074) 9382503 - 500m drum lengths available to minimise splicing/handling
- Sealed using endcaps against grit and water getting into them
- NB: Replace mandrels once mandrel wear indicators or grooves are worn down
- Replace brushes once brush diameter falls 5mm below dimensions in table below
- Approved endcaps, both disposable and reusable types, are available from suppliers of approved ESB ducting
- Approved ESB Mandrel and brush suppliers:

Brandon Agencies, Rathnew, Co Wicklow. Phone 0464 20500 (Brushes & Mandrels)
 IS Varian, Greenhills Industrial Estate, Walkinstown, Dublin 12. Phone: 01-4501150 (Brushes Only)
 Clydesdale UK Phone 085 172 6665 (Brushes & Mandrels)
 Tynagh Network Systems, Loughrea, Co Galway. Phone: 091 842206 (Brushes & Mandrels)

125mm uPVC Duct Size	160mm uPVC Duct Size
Mandrel Code: 9317547	Mandrel Code: 9317548
Brush Code: 8783254	Brush Code: 8783251

9 Guidance on Correct Direction to Lay Spigot and Socket Ducting

Case 1 Duct run with all bends at one end

Correct direction as cable drum will be located at bendy end

Case 2 (a) Bendy no matter which side route is looked at
No best direction to lay ducts

Case 2 (b) More bends at one end than the other
Correct direction

Case 3 Trenching routes longer than 500m

Treat any route as a series of lengths between joint bays at say 500m intervals and lay ducting as for Case 1 & 2 above

If on large sloping route lay as shown

10 Approved ESB Ducting for MV/LV Cables

- Use only solid wall high impact resistance ESB approved PVC red ducting to IS 370 colour standard and ESB specification 16113 (3.8mm minimum wall thickness) Discoloured or unidentified ducting not acceptable. All duct material must be approved by ESB Networks.
- Lightweight flexible corrugated twinwall ducting is not acceptable to ESB irrespective of manufacturer
- Current approved Duct and duct bend manufacturers are: Lynplast (bend fittings only) Radius Systems, Wavin, Quality Plastics, MFP Plastics, Cork Plastics, Emtelle

11 Specification for Duct Jointing for MV/LV Cables

All ducts to be securely jointed by tapping against timber board on each duct until the black depth insertion mark is reached

12 Repair of Existing Ducts

Use only approved slip couplers from approved manufacturers in section 9

- Cut out damaged section of duct and ensure all cut surfaces are square and free from sharp edges
- Slide, position and centre the repair couplers on the centering marks

13 Sealing of Ducts

All ducts to be permanently sealed at both ends of duct run
Ducts to be temporarily sealed during installation using endcaps provided with each bale

ESB Code 125mm: 9317583 ESB Code 160mm: 9317566

14A Cross-Sectional Drawing of Backfilling in Front of MV Sub

SAFETY WARNING!!
Earths are an essential safety system. Connection will not be made available until they are installed.

See pg. 213 of MV/LV Manual

14B Plan View of Ducting in Front of Substation

300mm Minimum
75mm - 1-3 ducts
150mm - 3+ ducts
2.5m Minimum Pit Opening Length
1.0m Minimum

See pg. 212 of MV/LV Manual

17A Supporting ESB Cables/Ducts During Trenching Works

Suitably strong steel/timber beam to support exposed cable
Secure beam with pegs or short pins
Shore up/stabilise trench against falling in on top of cable and damaging or puncturing it.
Support cable with plastic rope or web slings and chain hoists at 0.5m intervals approx. Just take the weight, do not over tension the slings/hoists.
Oversleeve the cable with red half pipes and cable ties to provide identification and provide impact resistance
0.3m minimum standard clearance or 100mm minimum but use protection as in relevant section of ESB manual

New pipe/Sewer

See pg. 42 of MV/LV Manual

17B Supporting ESB Cables/Ducts During Trenching Works

Key in timber plank (150mmx50mm) firmly into trench wall above ESB cable to protect it from falling debris/accidental contact etc
Remove plank prior to backfilling/reinstatement
0.3m minimum standard clearance or 100mm minimum but use protection as in Table 7 of ESB manual

New pipe/Sewer

See pg. 42 of MV/LV Manual

18 Avoidance of Cable Damage Due to Improper Backfilling at Cable Crossings


Excursive deflection resulting in a shearing action at the trench walls and risk of cable or duct failure later.

Layers all round the cable to be hand tamped. Cable to be well supported by firm bed of sand beneath the cable. No compaction machinery directly over cable/duct for 300mm minimum distance

Result: Very little cable deflection and shearing at edges of trench

See pg. 44 of LV/MV Manual

19 MV/LV Trench Dimensions & Duct Clearances for 125mm Ducting Layouts

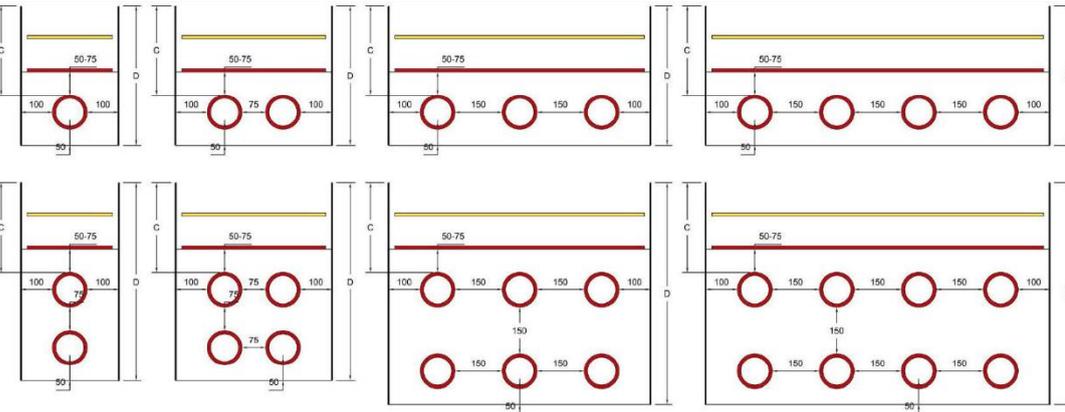

Minimum Trench Widths for 1 & 2 Rows of Ducts

No. Of Ducts in Row	1	2	3	4	5	6
Minimum Trench Width	325	525	875	1150	1425	1700


Minimum Trench & Duct Depths for 1 Horizontal Row of Ducts

Location of Trench	New Housing Scheme Footpath, road & Grass Areas in Vximity	Existing Footpaths	Existing or New Roads Other Than New Housing Scheme	Farmland, Forestry tracks & Bogland
Minimum Trench Depth (D)	775	625	925	925
Minimum Depth to top of Duct (C)	600	450	750	750

Minimum Trench & Duct Depths for 2 Horizontal Row of Ducts

Location of Trench	New Housing Scheme Footpath, road & Grass Areas in Vximity	Existing Footpaths	Existing or New Roads Other Than New Housing Scheme	Farmland, Forestry tracks & Bogland
Minimum Trench Depth (D)	975	825	1125	1125
Minimum Depth to top of Duct (C)	1050	900	1200	1200
Minimum Depth to top of Duct (C)	600	450	750	750

20A Bridge Crossings: Restricted Footpath Designs

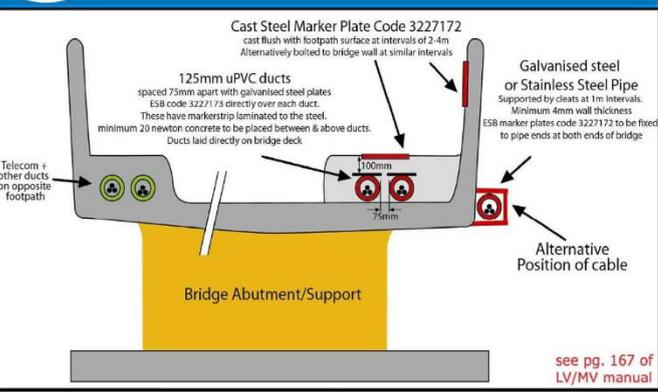


see pg. 167 of LV/MV manual

20B Bridge Crossings: Restricted Footpath Designs

1. The design must be agreed with the bridge authority. Position in footpath is preferred.
2. Minimum cover over ducts on footpath 100mm.
3. Where duct cover is > 300mm, marker strip & surface marker plates can be used.
4. Red uPVC ducting is not suitable for cable run external to bridges.
5. Where possible galvanised steel/stainless steel piping should be used, all joints must be free of weld burrs on inside. Alternatively heavy duty 10mm wall thickness black HDPE material with cast steel marker plates attached must be used to permanently warn of presence of electric cable.

see pg. 167 of LV/MV manual

21A River/Stream Crossings: Standard Where Burial/Drilling is possible

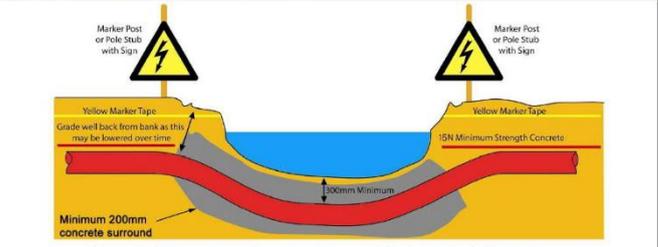

1. Depth of burial below bottom of river or stream to be agreed with relevant authority (if applicable)
2. If normal red ducting is installed by trenching, it must be encased in CBM4 (15N after 7 days) concrete to prevent uplift and to provide mechanical protection. Seal any joints to prevent concrete entering duct.
3. If drilled crossing is practical, use heavy red wall coated HDPE duct (sections 2.2 & 2.9 in MV/LV manual)
4. Install an ESB marker post on both sides of the crossing - ESB code 8327355 or use stub pole minimum 2.0m above ground level & warning sign 8238339.
5. Where circumstances require it a large steel pipe can be installed, into which a number of standard ESB duct sizes are pulled in (see section 2.9.4 of MV/LV manual for guidance)
6. If crossing a tidal area, a foreshore licence will be required.

See pg. 168 of LV/MV manual


21B River/Stream Crossings: Standard Where Burial/Drilling is not possible



1. Installation on base of river or stream to be agreed with relevant authority (if applicable)
2. Heavy wall steel pipe to be used free of weld beads/swarf. Minimum 8mm steel wall thickness to be used. Encase in CBM4 (15N after 7 days) concrete for corrosion protection, minimum 100mm surround
3. Install an ESB marker post on both sides of the crossing - ESB code 8327355 or use stub pole minimum 2.0m above ground level & warning sign 8238339.
4. Ensure a smooth connection using rubber coupler between crossing pipe size and ESB standard duct as the steel pipe size will usually differ from the standard ESB ducting. Alternatively run ESB ducting right through the steel pipe.
5. If crossing tidal area, a foreshore licence will be required.

See pg. 168 of LV/MV manual

22A Minimum Standard Over Basements/Carparks

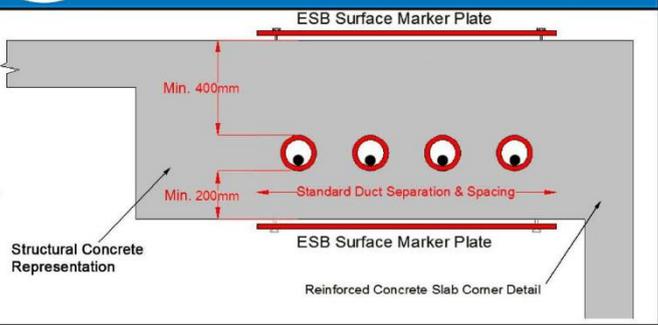

22B Minimum Standard Over Basements/Carparks

Minimum depth of duct is 400mm.


Minimum thickness from bottom of duct to underside of slab is 200mm.

ESB surface marker plates are to be placed at approximate intervals of 3 metres on the top and bottom surfaces of the slab.

Marker plates are to be cast level with the surface and screwed down to avoid lift off (ESB code: 3227172)

For ESB Ducts concrete surround - same strength for entire slab

23 MV/LV Trench Dimensions & Duct Clearances for 160mm Ducting

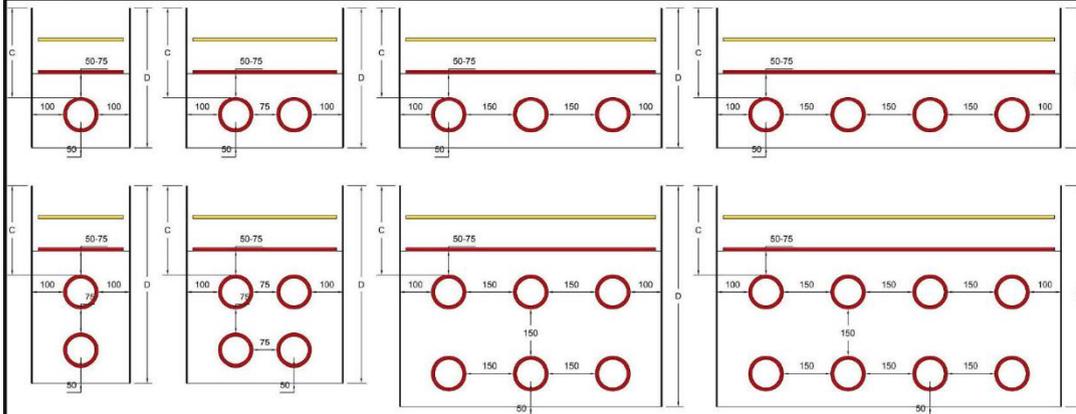

Minimum Trench Widths for 1 & 2 Rows of Ducts

No. Of Ducts in Row	1	2	3	4	5	6
Minimum Trench Width	360	595	980	1290	1600	1910


Minimum Trench & Duct Depths for 1 Horizontal Row of Ducts

Location of Trench	New Housing Scheme Footpath, road & Grass Areas in Vicinity	Existing Footpaths	Existing or New Roads Other Than New Housing Scheme	Farmland, Forestry tracks & Bogland
Minimum Trench Depth (D)	810	660	960	960
Minimum Depth to top of Duct (C)	600	450	750	750


Minimum Trench & Duct Depths for 2 Horizontal Row of Ducts

Location of Trench	New Housing Scheme Footpath, road & Grass Areas in Vicinity	Existing Footpaths	Existing or New Roads Other Than New Housing Scheme	Farmland, Forestry tracks & Bogland
Minimum Trench Depth (D)	1045	895	1195	1195
Minimum Depth to top of Duct (C)	1120	970	1270	1270
Minimum Depth to top of Duct (C)	600	450	750	750


24A MV Cable End Pole Position - Elevation

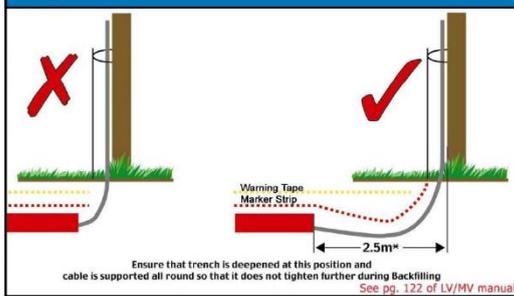

24B MV Cable End Pole Position - Plan View

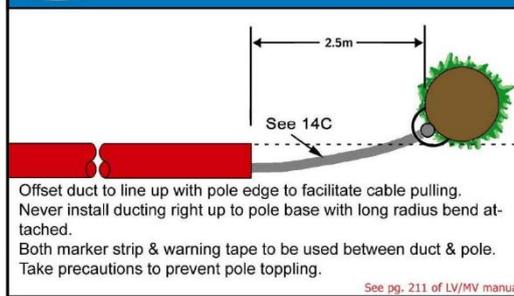


24C MV Cable End Pole - Marker Strip/Tape

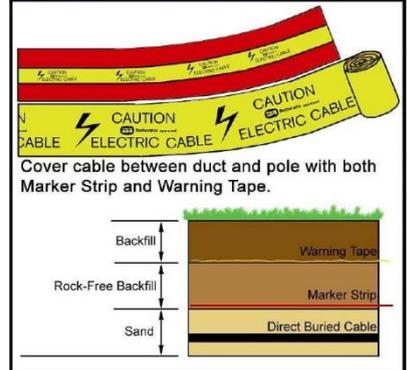


24D LV Cable End Pole Position - Elevation

Ducting For LV Mains and LV Service Cable

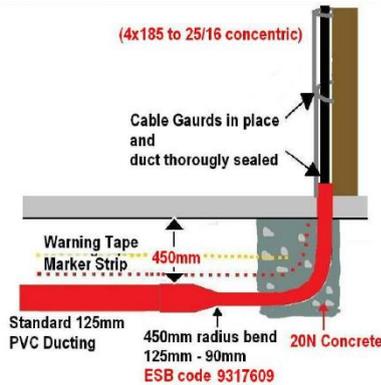


24E LV Cable End Pole Position - Plan View

Ducting for LV Mains and LV Service Cable

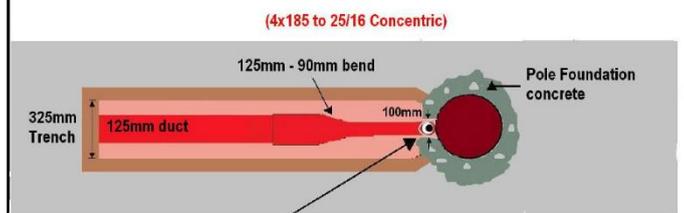

1. Cut channel into pole concrete foundation to allow for the vertical section of the duct bend to lie against the pole
2. Place duct bend into position
3. Backfill and support bend with 20N concrete mix as per elevation view

25 A LV Ducting for Non Domestic Connections Duct laid to Mains Cable

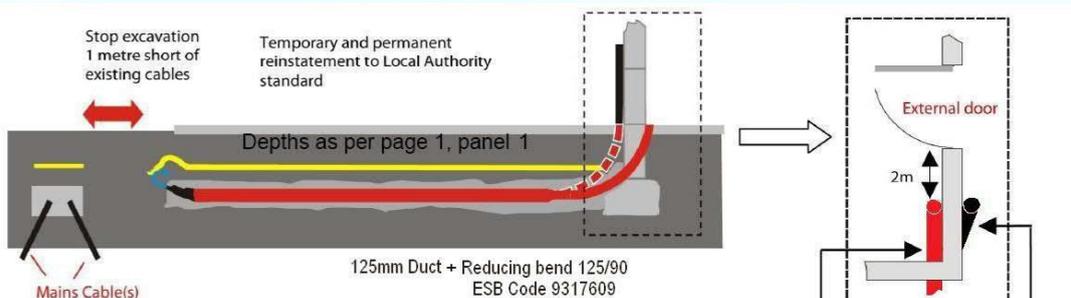

General Note for all Cases:

- 1: Excavation within 1 metre of existing cables must only be carried out by hand and with agreement of the local ESB Networks office. This is to prevent damage to existing cables and consequent safety risk for workers.
 - 2: Liaise with ESB Networks to confirm location of all cables.
- All Excavation work to be in accordance with HSA Code of Practice

Internal location option


External location option (not >2m from external door, see "National Code of practice for Customer Interface")

25B

LV Ducting for Non Domestic Connections Duct laid to Mini Pillar Location

The new duct must only be put into the vault with an ESB Networks person present

If no vault in front of minipillar, the limit of excavation must be agreed with ESB Networks personnel locally. Temporary and permanent reinstatement to Local Authority Standard.

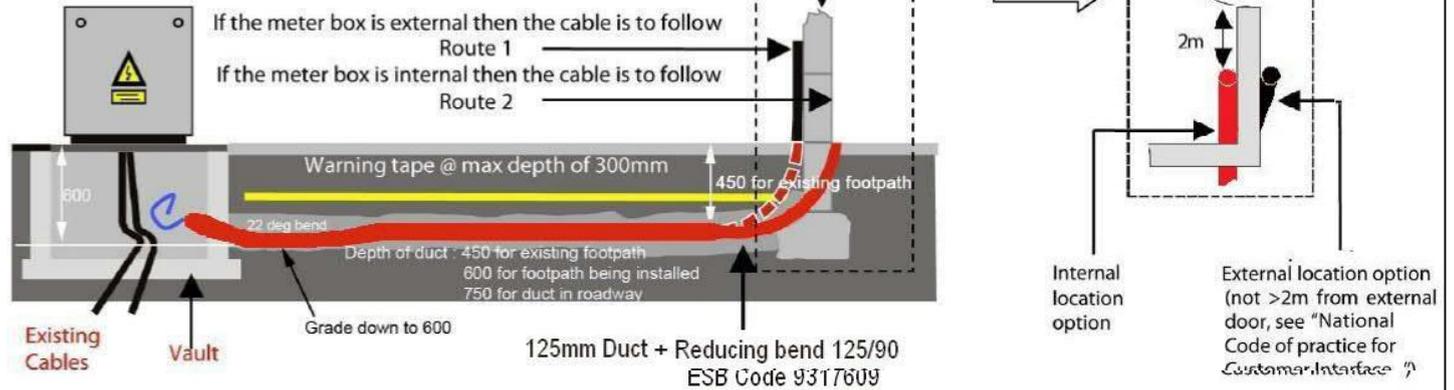

26

Specification for Standard Non-Scheme Domestic Underground Service to an Outdoor Meter Cabinet (low-voltage service not exceeding 50m) from an Overhead Network



The Customer must ensure that:

- The service pole and the complete run of the duct are both within the site boundary. ESB's Engineering Officer will confirm the service pole position and the ducting route on-site.
- An outdoor meter cabinet, to ESI Standard 12-3 (1986), is installed in a suitable location, see overleaf.
- An ESB approved "hockey stick" is installed at the meter cabinet position.
- Red ESB approved 50mm service ducting is installed at a minimum depth of 600mm between the hockey stick position and the service pole. Yellow ESB cable warning tape must be installed at a maximum depth of 300mm below ground level along the full length of the duct.
- Corrugated Ducting of any colour is not permitted.
- The duct shall be as straight as possible and free of sharp bends.
- A continuous and strong 10mm polypropylene draw rope is installed in the duct. It must be free of knots and secured at both ends of the duct.

Notes:

- It is essential that the ESB cable does not come into contact with the cavity insulation. Allow a projection of 25mm of the hockey stick into the base of the cabinet.
- There must be a minimum clearance of 100mm between the service duct and other services on the house-holder's property.
- ESB will provide black UV light-resistant ducting from below the finished ground level to the top of the service pole.
- For poles more than 50m away from the cabinet, 125mm red ESB approved ducting shall be used with an ESB approved service vault at the junction of the duct and the hockey stick.

Connection will only be made after all above requirements are met.

