

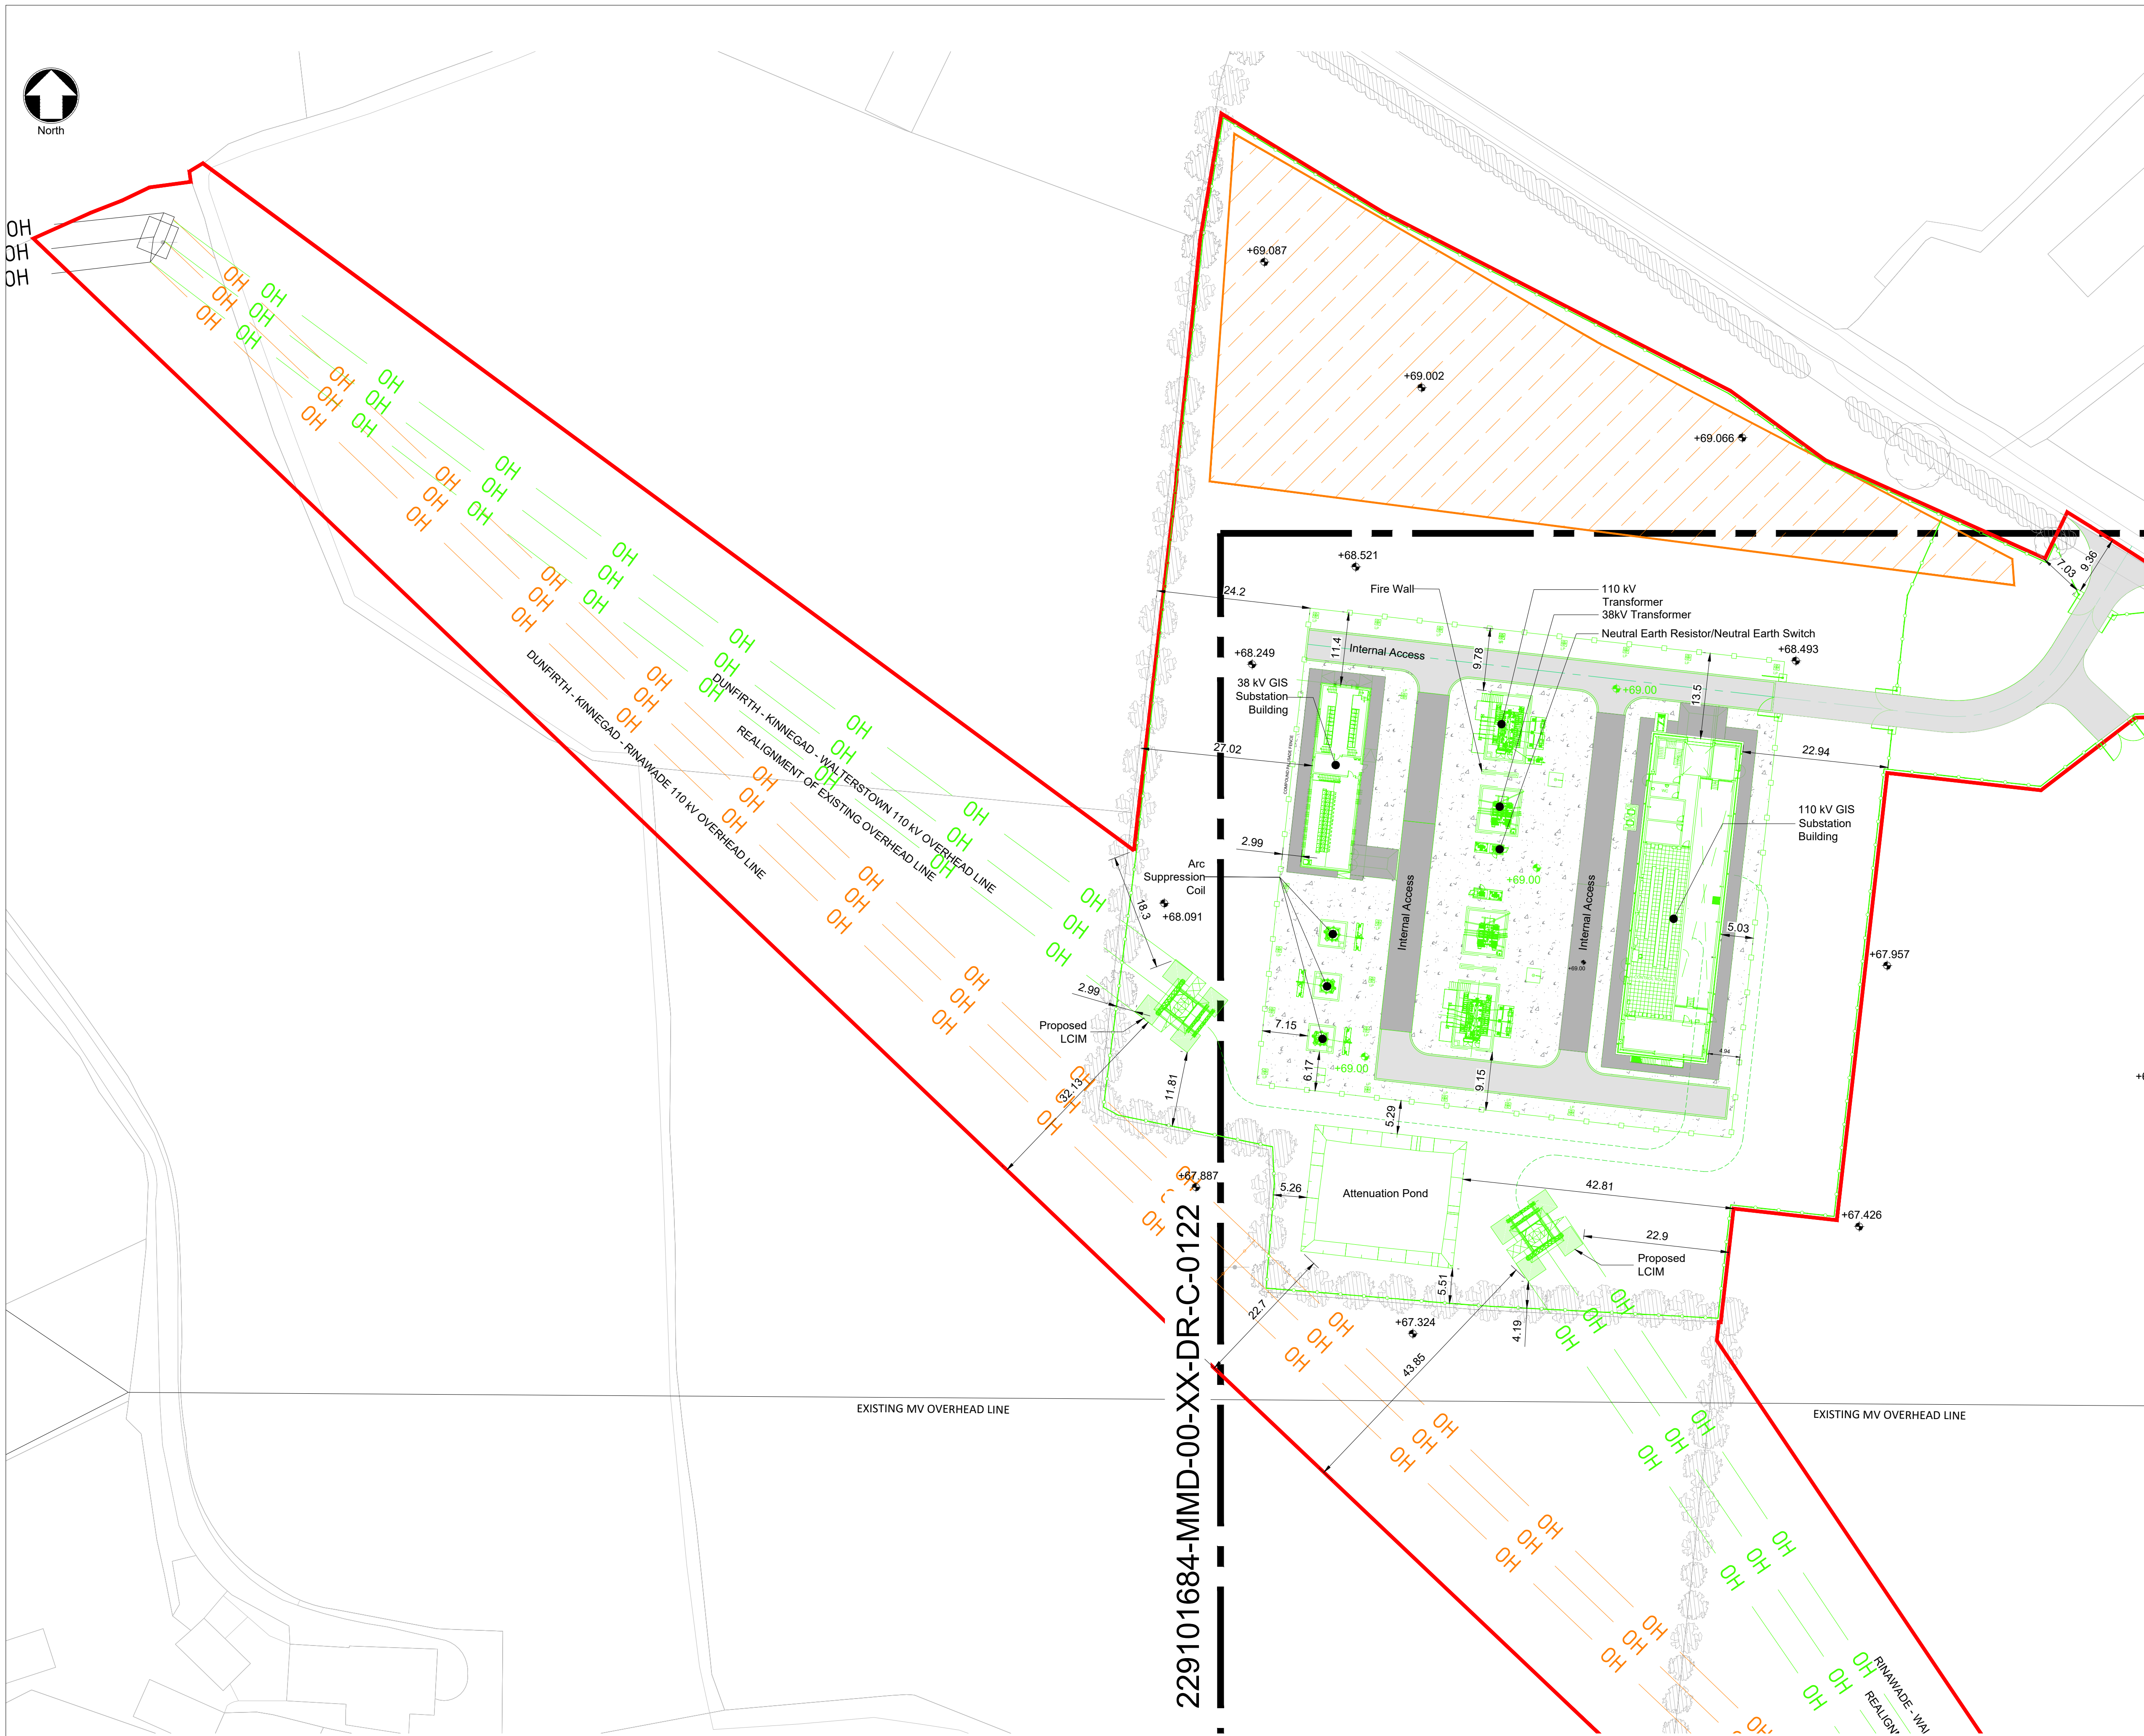




1. For planning purposes only. Not for construction.
2. All dimensions are in metres unless otherwise noted.

	Application Site Boundary
	Proposed Equipment / Infrastructure
	Palisade Fence
	Post & Rail Fence
	110 kV Underground Cables
	Proposed OHL
	Existing OHL
	OHL to be dismantled
	4m High Lighting Pole
	15m High Lightning Mast
	Temporary Construction Compound
	Asphalt Finish
	Concrete Finish
	Hardstanding
	Existing Trees/Hedgerows
	Existing Site Level
	Proposed Site Level

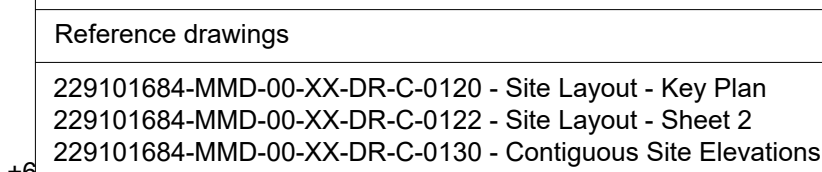

M
M
MOTT
MACDONALD

South Block
Rockfield
Dundrum
Dublin 16
Ireland
T +353 (0)1 291 6700
F
W www.mottmac.com



Title	Walterstown 110kV Substation
	Site Layout
	Sheet 1

Drawing Number	229101684-MMD-00-XX-DR-C-0121
----------------	-------------------------------

© Mott MacDonald Ireland

This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.

We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

OS Mapping Reference: OS3128-C	CYAL50465184 © Tailte Éireann - Surveying
-----------------------------------	---