


- Legend:**
- Agreed shared access road (SID Ref. 320532)
  - Planning Application Site Boundary
  - 110 kV Overhead Lines
  - Existing Screening / Hedgerow Area
  - Proposed Screening / Hedgerow Area
  - Overhead Line Cable Buffer Zone At 20 m Each Side
  - Overhead Line Tower
  - Existing Wooden Poleset
  - Proposed 6 m Wide Access Track

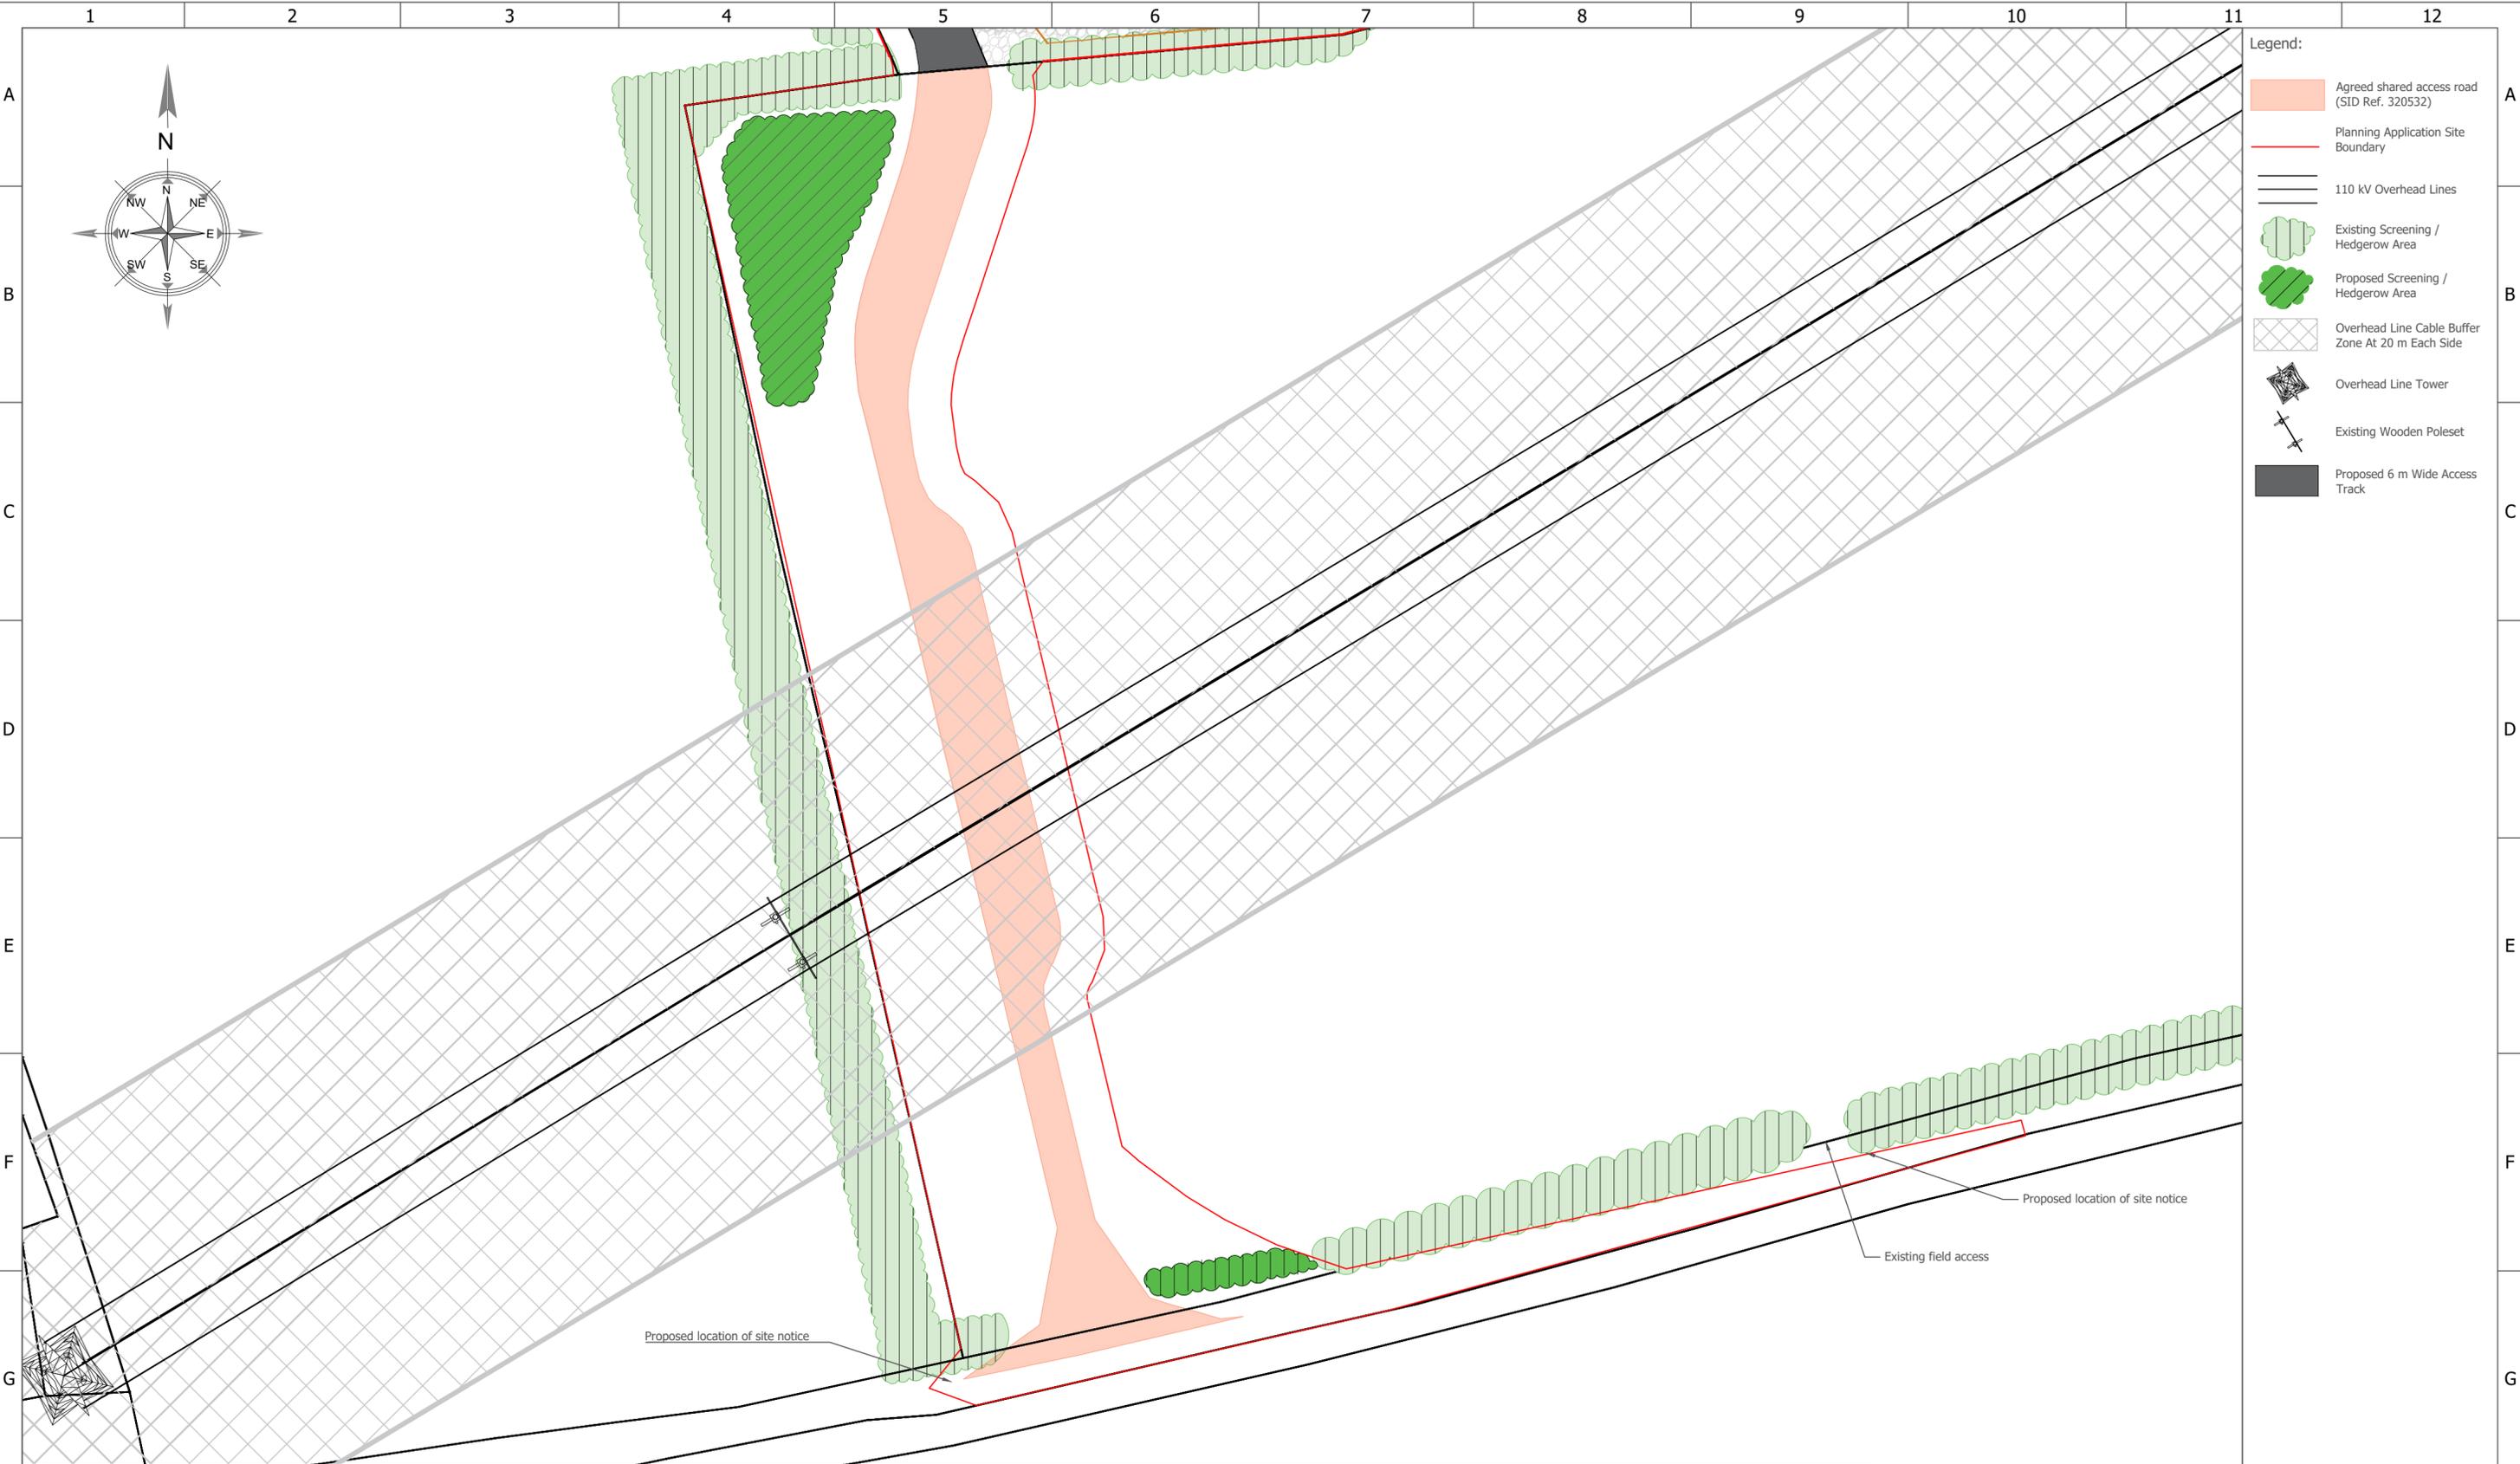

Noriker Power Ltd.  
Fourth Floor, The Quadrangle,  
Imperial Square, Cheltenham  
GL50 1PZ

Originator:	Version	Change Description	Author	Approver	Date
Noriker Power Ltd.	3.50	Finalised for planning	AP	JW	15/01/2026
<b>Project Title:</b>					
KNOCKRAHA BESS, CO. CORK					
<b>Drawing Title:</b>					
Site Layout - MAP "A"					

Transmission Type: External	
Intended Paper Size: A2	
Scale: 1:500	Sheet: 1 of 1

**NOTES:**  
 1. ALL DIMENSIONS ARE IN METRES AND LEVELS IN METRES UNLESS NOTED OTHERWISE.  
 2. USE FIGURED DIMENSIONS ONLY. DO NOT SCALE.  
 3. DRAWINGS TO BE READ IN CONJUNCTION WITH ALL RELEVANT ENGINEER'S, CLIENT'S AND SERVICE ENGINEER'S DRAWINGS AND SPECIFICATIONS.  
 4. ALL WORKS TO BE CARRIED OUT IN ACCORDANCE WITH CURRENT BUILDING REGULATIONS.

