



A1


DO NOT SCALE

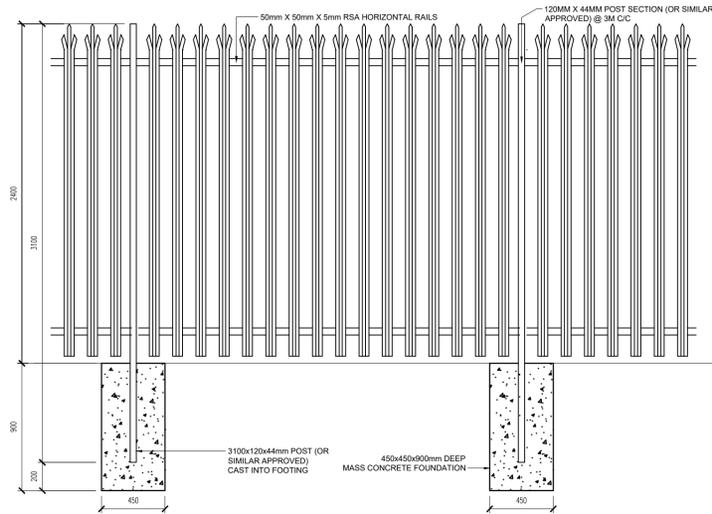

TYPICAL PALISADE FENCE PANEL ELEVATION
Scale at A1 1:25

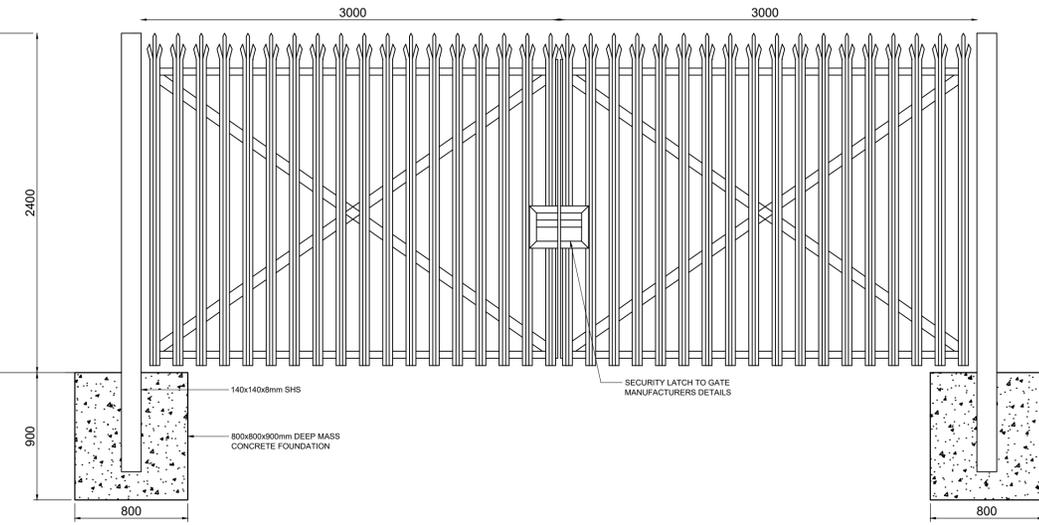


TYPICAL PALISADE PEDESTRIAN GATE ELEVATION
Scale at A1 1:25

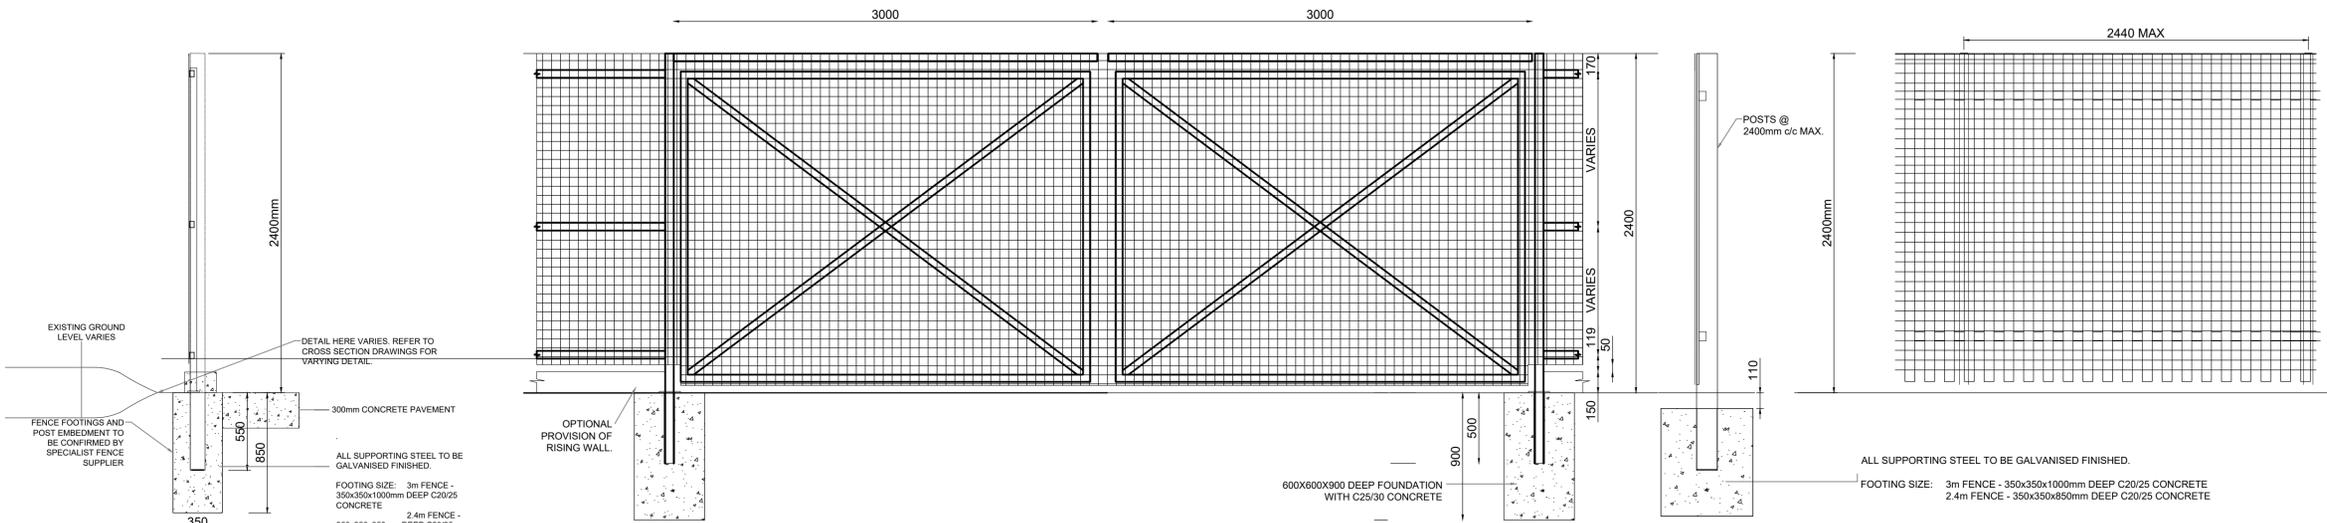


TYPICAL PALADIN FENCE PANEL ELEVATION
Scale at A1 1:25

TYPICAL MESH PALADIN GATE DETAIL
Scale at A1 1:25


TYPICAL PALADIN MESH FENCE DETAIL
Scale at A1 1:25

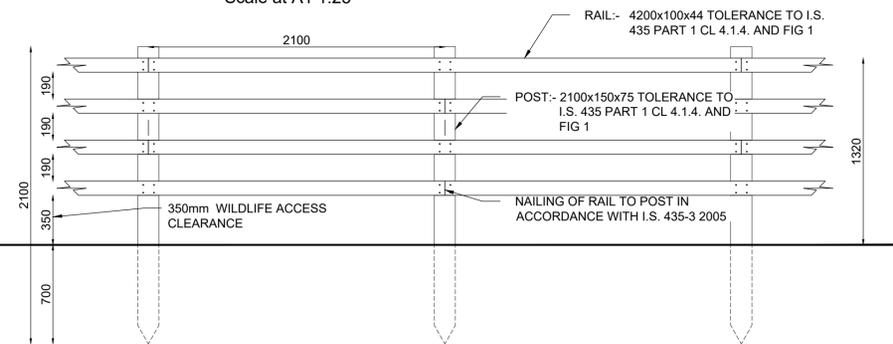

TYPICAL POST & RAIL FENCE ELEVATION (From Road)
Scale at A1 1:25

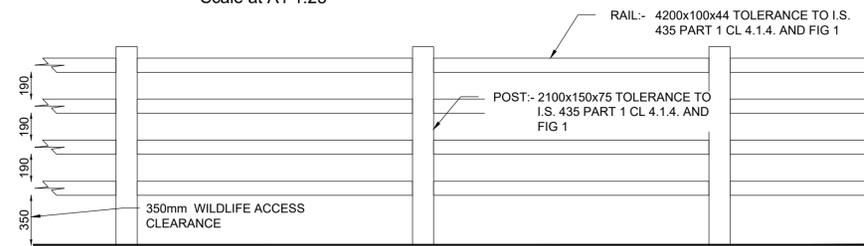

TYPICAL POST & RAIL FENCE ELEVATION (From Field)
Scale at A1 1:25

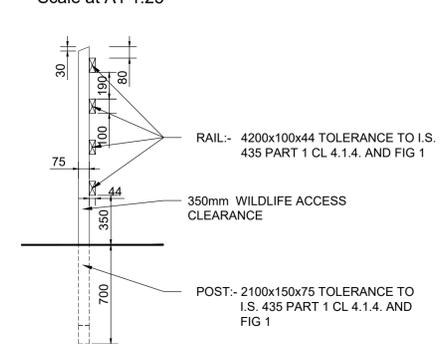

TYPICAL POST & RAIL FENCE SECTION
Scale at A1 1:25

TYPICAL POST & RAIL FENCE PART PLAN
Scale at A1 1:25

- GENERAL NOTES**
1. ALL DIMENSIONS ARE IN METERS UNLESS NOTED OTHERWISE
 2. ONLY WRITTEN DIMENSIONS SHALL BE USED. NO DIMENSIONS SHALL BE SCALED FROM THE DRAWINGS
 3. ALL LEVELS ARE IN METERS AND ARE TO MALIN HEAD DATUM
 4. ALL COORDINATES ARE IN METERS AND ARE TO IRISH TRANSVERSE MERCATOR
 5. DRAWINGS ARE TO BE READ IN CONJUNCTION WITH THE SPECIFICATION
 6. THIS DRAWING IS TO BE USED ONLY FOR THE PURPOSES OF THE PLANNING APPLICATION AND IS SUBJECT TO DETAILED DESIGN.

- POST & RAIL FENCE NOTES:-**
1. FENCES SHALL BE CONSTRUCTED AND ERECTED IN ACCORDANCE WITH I.S. 435: 2005. EXCEPT WHERE OTHERWISE SHOWN
 2. ANY LENGTH OFF FENCING (INCLUDING BOUNDARIES AND SPURS) SHALL START WITH A POST AND END WITH A POST. AN ADDITIONAL POST SHALL BE PROVIDED AT FENCE JUNCTIONS AND AT FENCE CORNERS. POST HOLES FALLING IN ROCK SHALL BE EXCAVATED TO THE DEPTH SHOWN ON THIS DRAWING OR, SUBJECT TO AGREEMENT WITH THE EMPLOYER'S REPRESENTATIVE, TO A DEPTH OF 500mm AND SHALL BE BACKFILLED WITH MIX ST2 CONCRETE. WHERE A REDUCED DEPTH OF HOLE IS AGREED, THE TOP OF THE POST SHALL BE SUITABLY CUT AND TREATED IN ACCORDANCE WITH THE RECOMMENDATIONS OF I.S. 435: 2005.
 3. FENCE POST AND RAIL SHALL BE TREATED WITH PRESERVATIVE IN ACCORDANCE WITH THE REQUIREMENTS OF CC-SPW-00300 AND APPENDIX B OF I.S. 435-1: 2005.
 4. CONCRETE FOUNDATIONS TO POSTS SHALL BE PROVIDED WHERE STATED IN APPENDIX 3/1.
 5. WHERE SIDELONG GROUND SLOPES DOWN TOWARDS THE FENCE AT A SLOPE GREATER THAN 1:4, THEN THE PERMANENT FENCING POST HEIGHT SHALL BE INCREASED BY A MINIMUM OF 250mm AND AN ADDITIONAL RAIL ADDED.
 6. FIXING IN ACCORDANCE WITH I.S. 435-3, 2005. NOTES 13 AND 14 AND SECTION 4.4 OF I.S. 435-3, 2005

© ORDNANCE SURVEY IRELAND LICENSE No. AR 0082524. ORDNANCE SURVEY IRELAND & GOVERNMENT OF IRELAND REFER TO OSI SHEETS 3220-B, 3220-D, 3221-A, 3221-B, 3221-C & 3221-D

File: PEK3-ATK-ZZ-01-DR-CE-903106.dwg
Date: Jan 29, 2024 - 4:39pm
Plotted by: SHER8400

Rev	Description	By	Date	Chk'd	Auth
0	ISSUED FOR PLANNING	PS	01.12.25	ND	AJB

AtkinsRéalis
DUBLIN | CORK | GALWAY | DUNDALK
ATKINS HOUSE, 150 AIRSIDE BUSINESS PARK, SWORDS, DUBLIN, K67 K5W4.
Tel : +353 1 810 8000 Email : info.ie@atkinsrealis.com

Bord Gáis Energy
Project: **CASHLA PEAKER PLANT**
Rathmorrisry and Pollnagroagh (Townlands), Atherny, Co. Galway.

Purpose		PLANNING			
Title		TYPICAL DETAILS - SHEET 06 FENCING DETAILS			
Original Scale	Design/Drawn	Checked	Authorized		
1:25 at A1	PS	ND	AJB		
Status	Drawing Number	Date	Date	Date	Rev
A2	PEK3-ATK-ZZ-01-DR-CE-903106	01.12.25	01.12.25	01.12.25	0