


## **Appendix 14. Material Assets**

### **14.1. Existing Utility Drawings / Maps**



- Backdrop
- Other; Unknown
- Sewer Discharge Points**
- Overflow
- Other; Unknown
- Sewer Inlets**
- ⊕ Gully
- Other; Unknown
- Sewer Fittings**
- Vent/Col
- Other; Unknown
- Sewer Mains (Irish Water)**
- Gravity - Combined
- Gravity - Foul
- Gravity - Overflow
- Gravity - Unknown
- Pumping - Foul
- Sewer Mains (Private)**
- Gravity - Foul
- Pumping - Foul
- Sewer Lateral Lines**
- Sewer Lateral Lines
- Pump Station**
- ▲ Pump Station
- Waste Water Treatment Plant**
- 🏠 Waste Water Treatment Plant

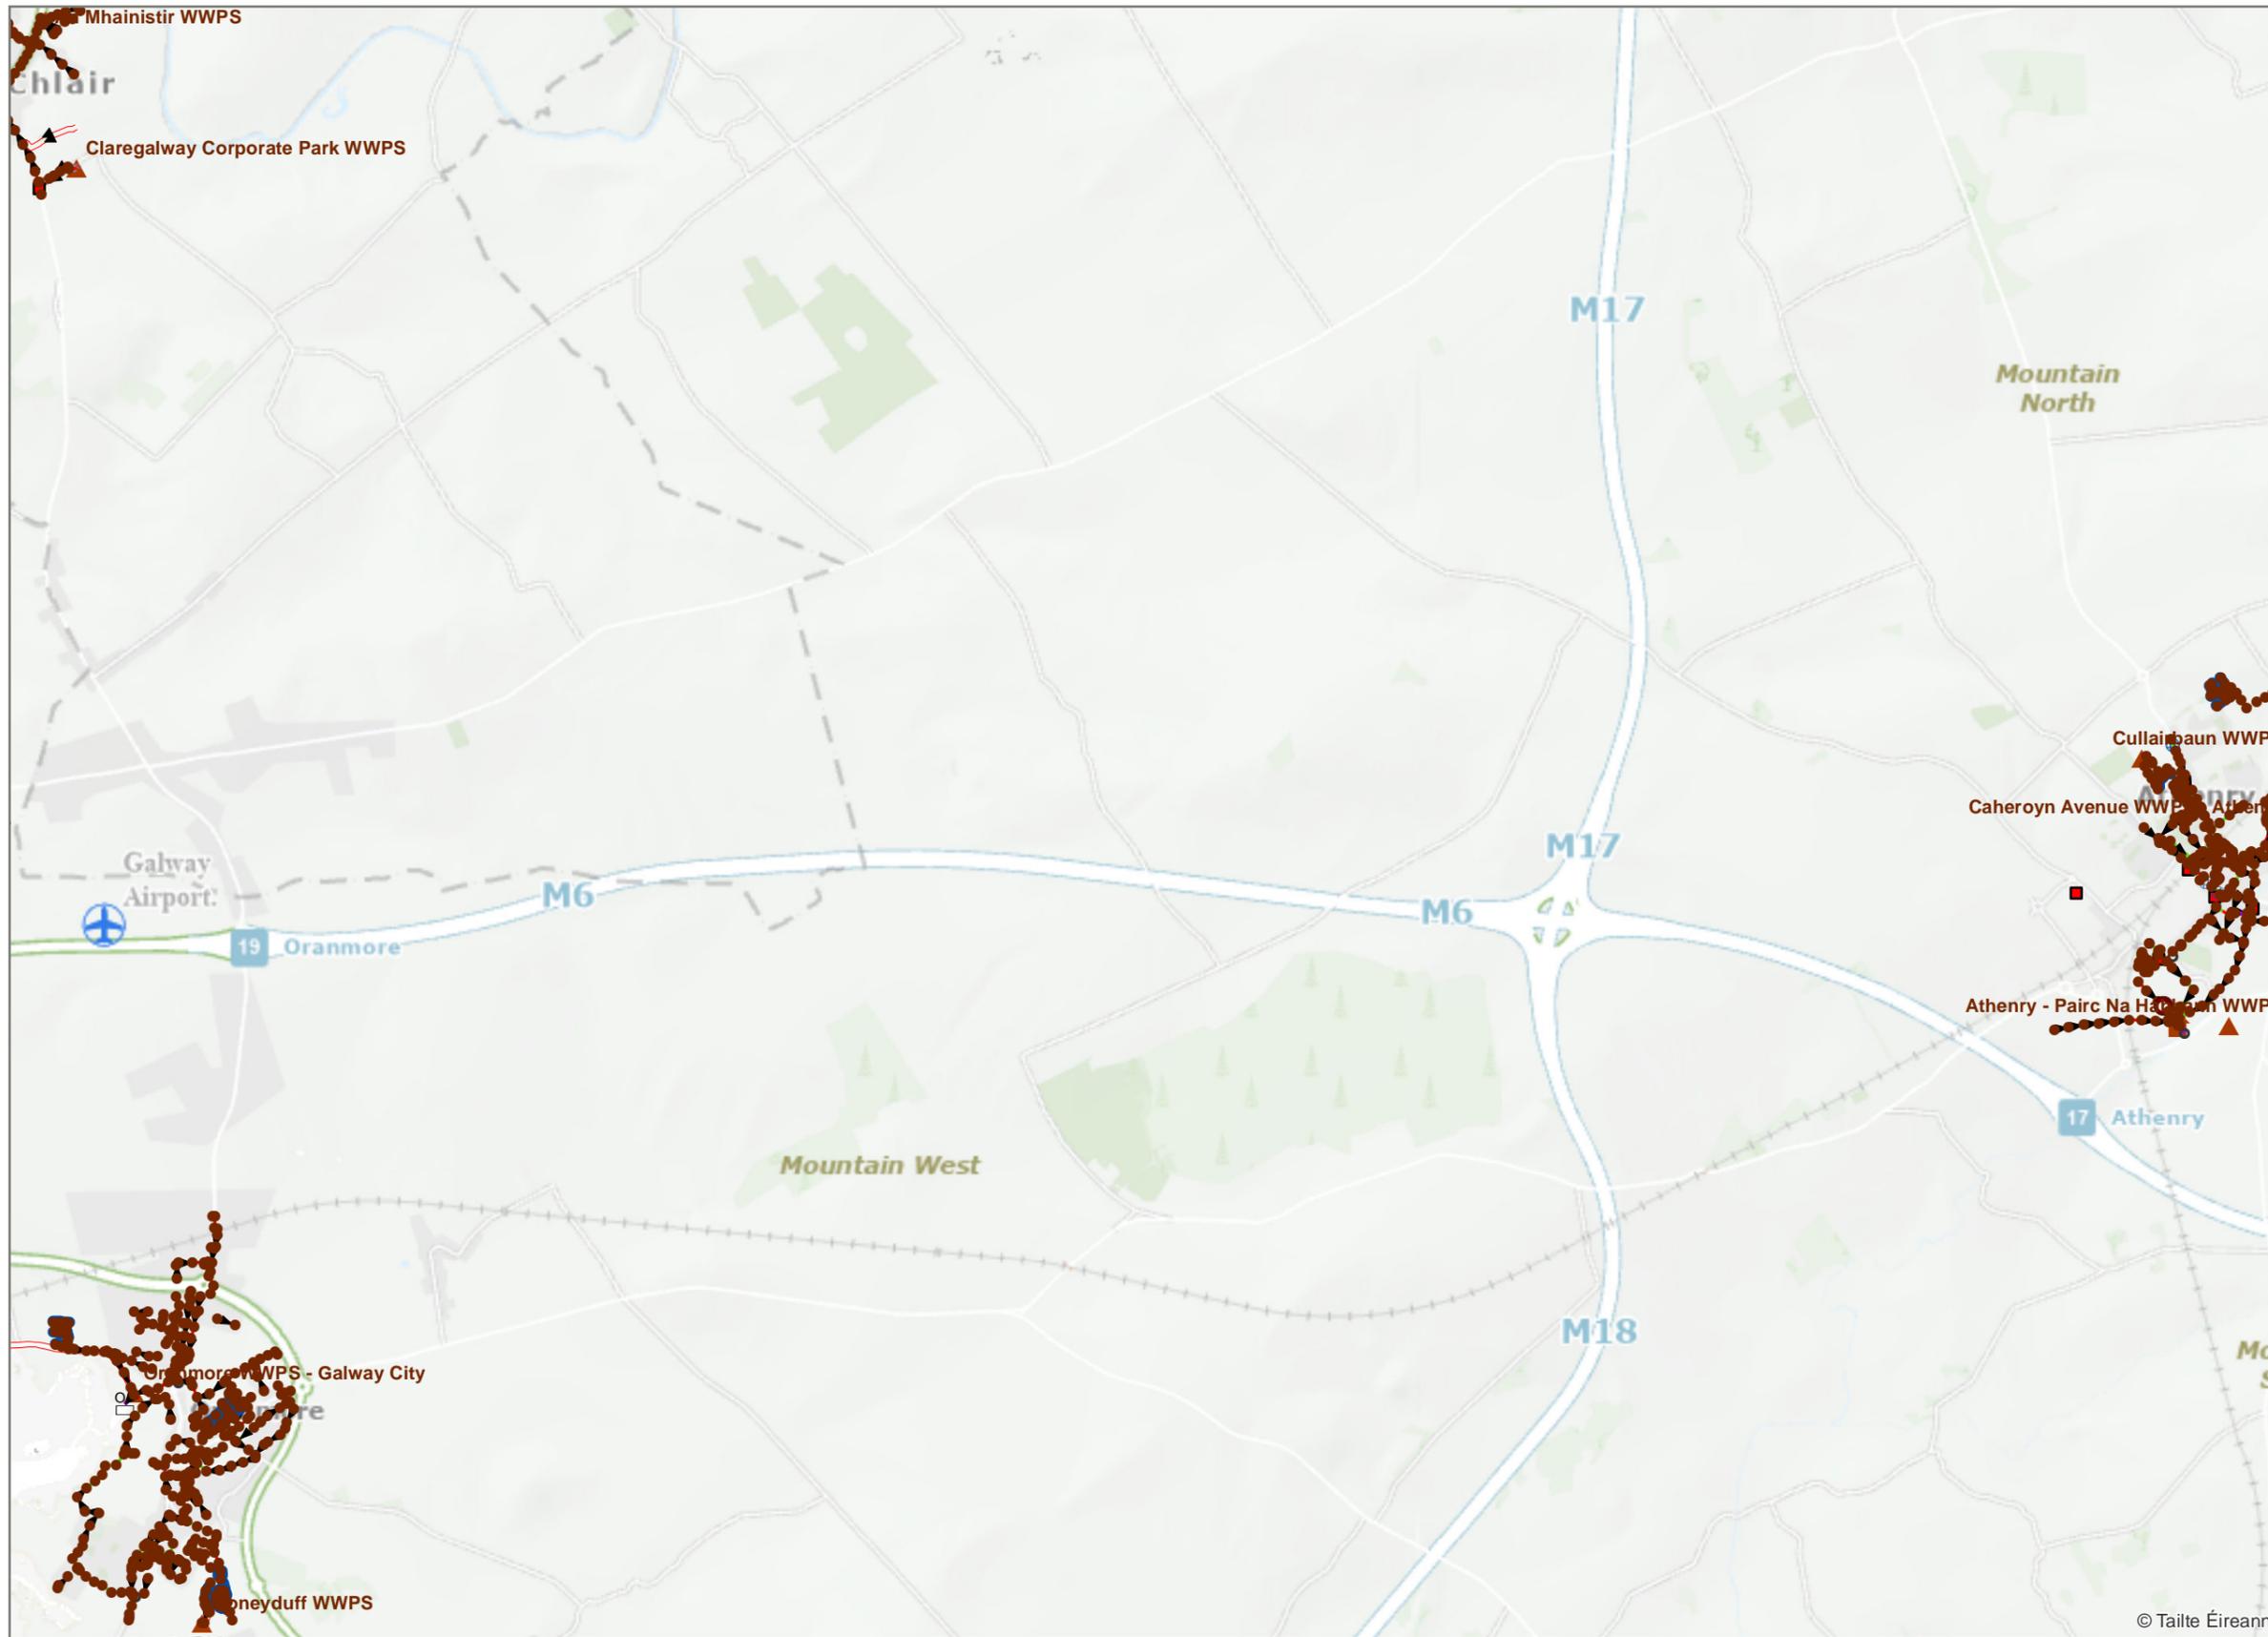

Coordinate System: TM65 Irish Grid  
Projection: Transverse Mercator

Scale @ A3: 1:40,000

Drawing No.: IW-AGG-2023-000

Drawn By: RG

Checked By: <Add Name>

Approved By: <Add Name>

Drawn Date: 01/05/2025

Checked Date: <dd/mm/yyyy>

Approved Date: <dd/mm/yyyy>



1. No part of this drawing may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission of Uisce Éireann as copyright holder except as agreed for use on the project for which the document was originally issued.


2. Whilst every care has been taken in its compilation, Uisce Éireann gives this information as to the position of its underground network as a general guide only on the strict understanding that it is based on the best available information provided by each Local Authority in Ireland to Uisce Éireann. Uisce Éireann can assume no responsibility for and give no guarantees, undertakings or warranties concerning the accuracy, completeness or up to date nature of the information provided and does not accept any liability whatsoever arising from any errors or omissions. This information should not be relied upon in the event of excavations or any other works being carried out in the vicinity of the Uisce Éireann underground network. The onus is on the parties carrying out excavations or any other works to ensure the exact location of the Uisce Éireann underground network is identified prior to excavations or any other works being carried out. Service connection pipes are not generally shown but their presence should be anticipated.

© Copyright Uisce Éireann.

Reproduced from the Ordnance Survey Of Ireland by Permission of the Government. License No. 3-3-34

## Sewer Network Athenry-Oranmore, Co. Galway

© Tailte Éireann

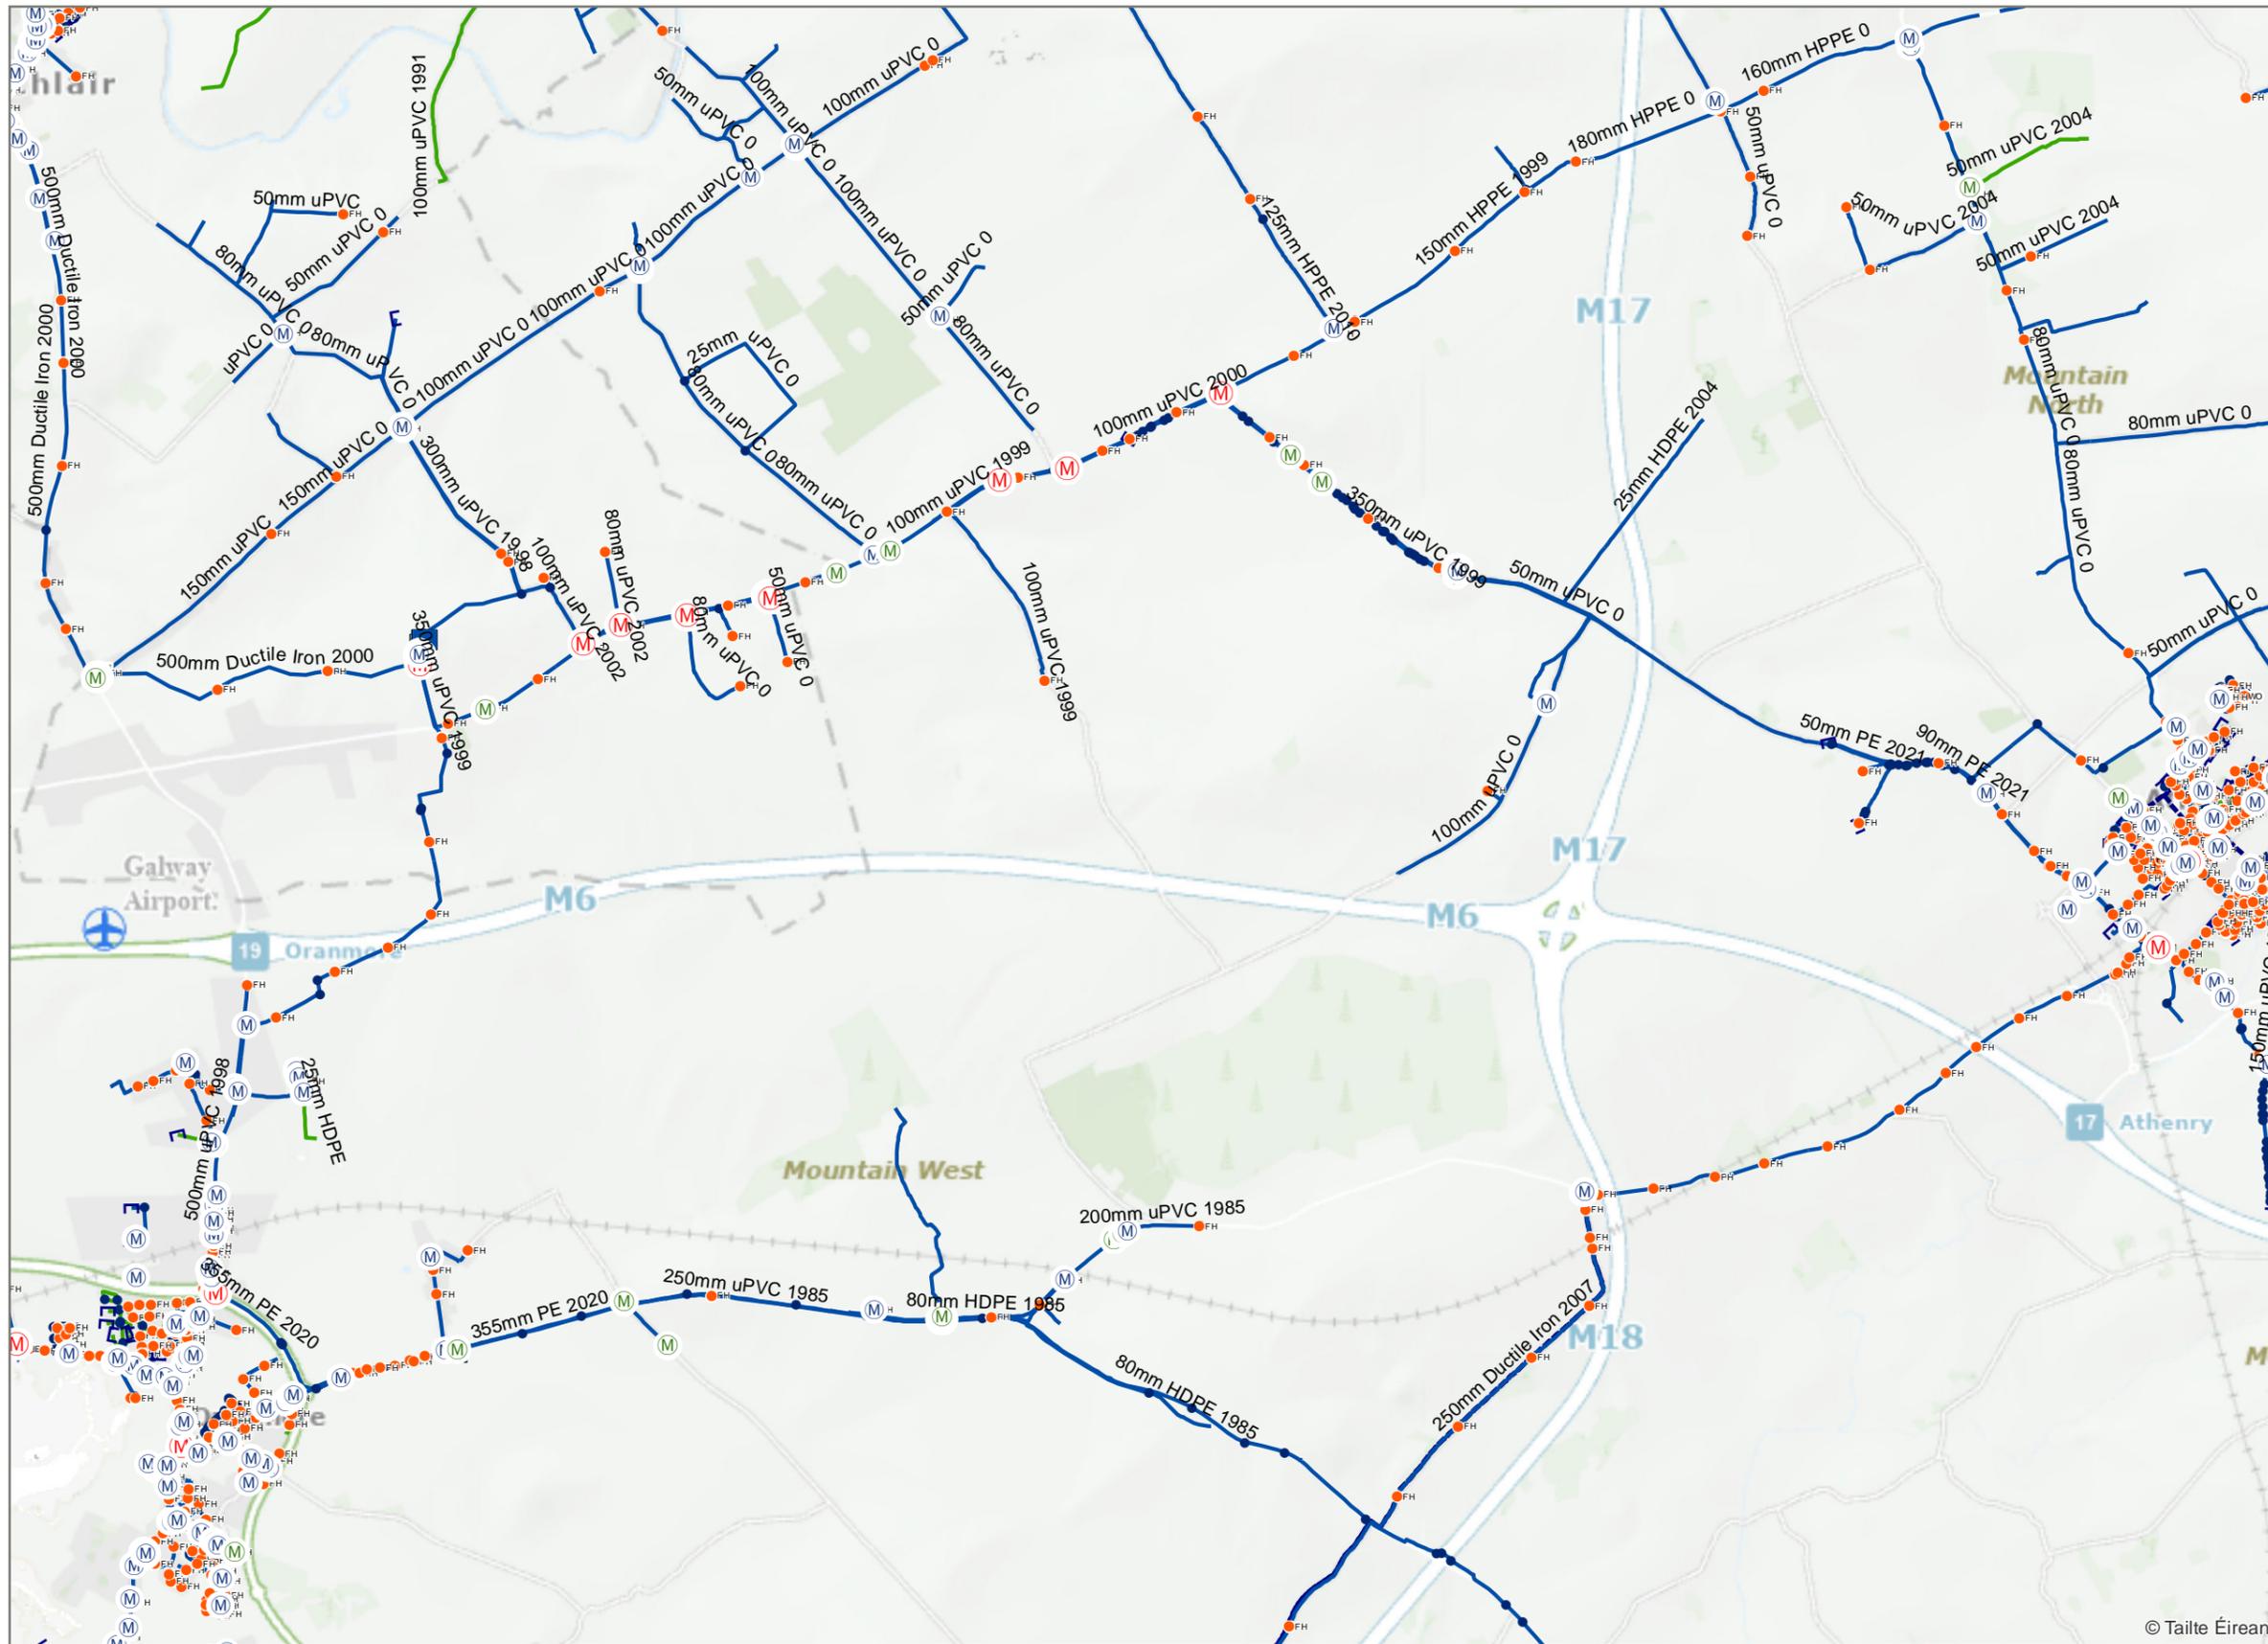

- (M) Group Scheme
- Boundary Meter**
- (M) District (Boundary Meter)
- Water Hydrants**
- FH Fire Hydrant
- W Washout
- Reservoir**
- Potable
- Pump Stations**
- ▲ Pump Stations
- Water Network Structures**
- Water Network Structures
- Abstraction Point**
- ◇ Abstraction Point
- Kisok**
- Kisok
- Water Fittings**
- Cap
- Other Fitting
- Water Mains(Irish Water Owned)**
- Potable Water
- Water Mains(Non Irish Water Owned)**
- Potable Water
- Water Abandoned Lines**
- Water Abandoned Lines



Coordinate System: TM65 Irish Grid  
Projection: Transverse Mercator

Scale @ A3: 1:40,000

Drawing No.: IW-AGG-2023-000

Drawn By: RG

Checked By: <Add Name>

Approved By: <Add Name>

Drawn Date: 01/05/2025

Checked Date: <dd/mm/yyyy>

Approved Date: <dd/mm/yyyy>



1. No part of this drawing may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission of Uisce Éireann as copyright holder except as agreed for use on the project for which the document was originally issued.


2. Whilst every care has been taken in its compilation, Uisce Éireann gives this information as to the position of its underground network as a general guide only on the strict understanding that it is based on the best available information provided by each Local Authority in Ireland to Uisce Éireann. Uisce Éireann can assume no responsibility for and give no guarantees, undertakings or warranties concerning the accuracy, completeness or up to date nature of the information provided and does not accept any liability whatsoever arising from any errors or omissions. This information should not be relied upon in the event of excavations or any other works being carried out in the vicinity of the Uisce Éireann underground network. The onus is on the parties carrying out excavations or any other works to ensure the exact location of the Uisce Éireann underground network is identified prior to excavations or any other works being carried out. Service connection pipes are not generally shown but their presence should be anticipated.

© Copyright Uisce Éireann.

Reproduced from the Ordnance Survey Of Ireland by Permission of the Government. License No. 3-3-34

## Water Distribution Athenry-Oranmore, Co. Galway

© Tailte Éireann

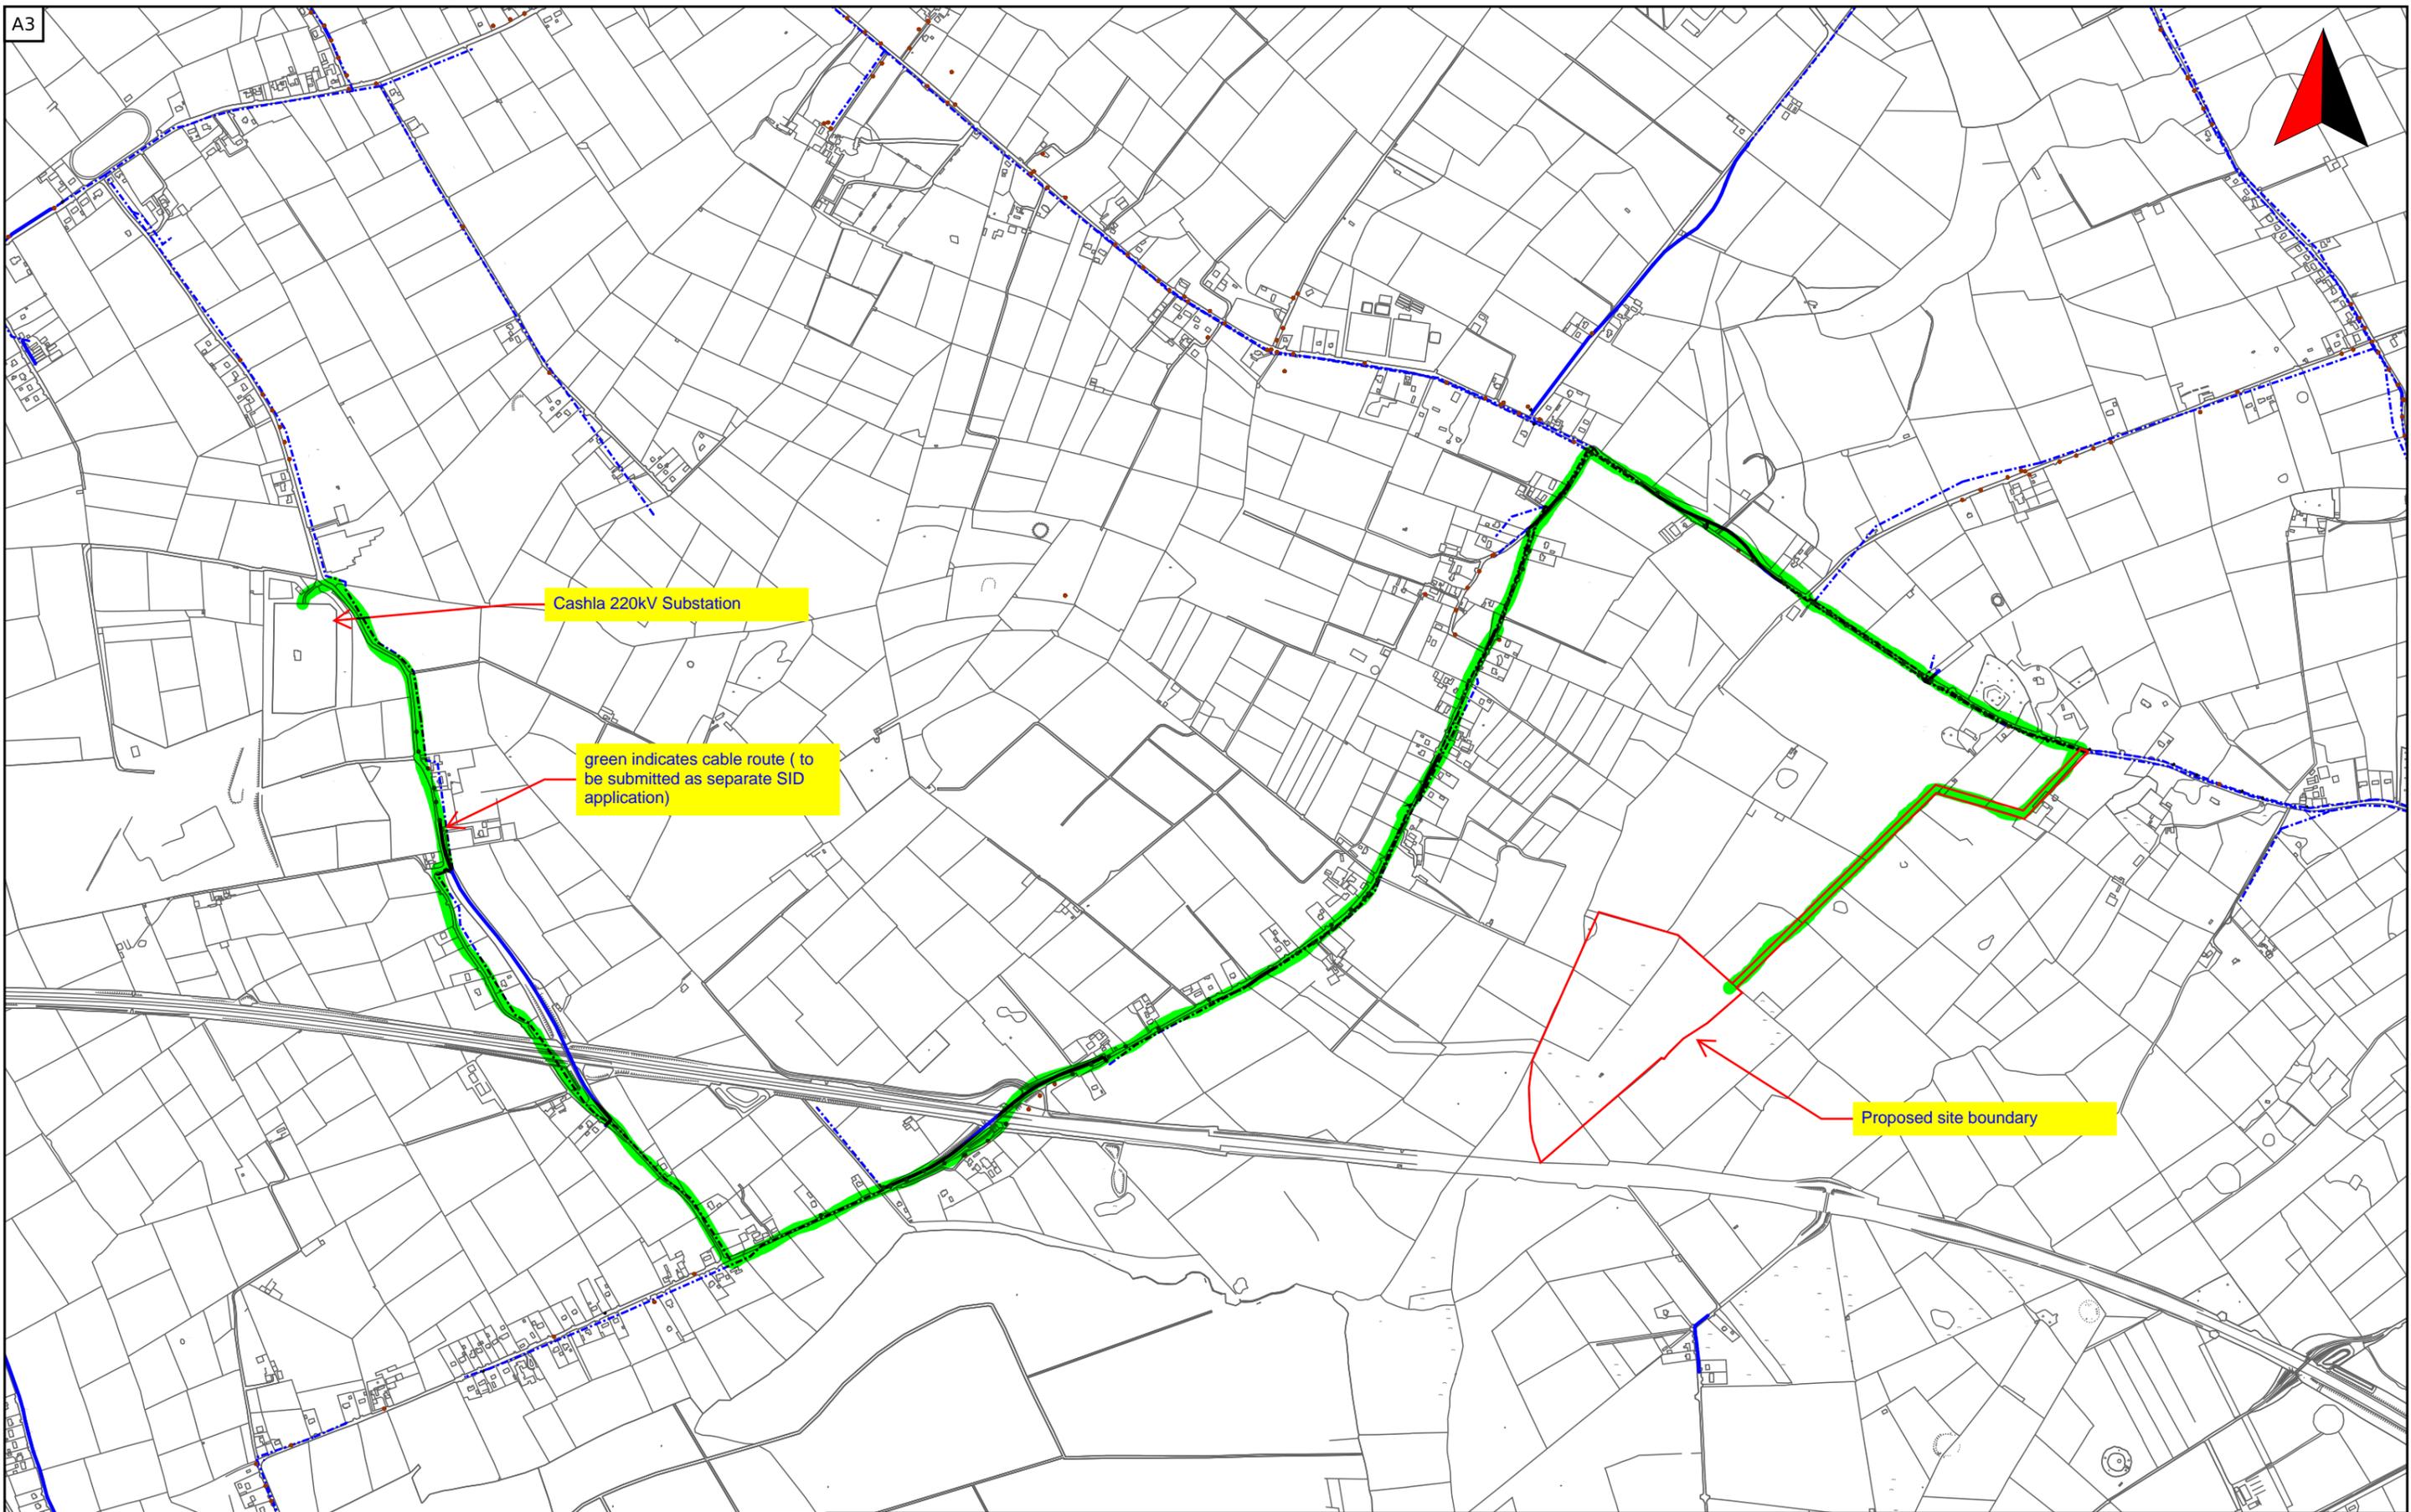

Cashla 220kV Substation

green indicates cable route ( to be submitted as separate SID application)

Proposed site boundary

<b>open eir Civil Engineering Infrastructure Service</b>		Scale: 1:15000	Irish National Grid Centre XY: 545413 m, 728546 m
		Date 02/12/2025	Smallworld Powered by GE
<p>THE INFORMATION IN THIS DRAWING IS CONFIDENTIAL AND SHOULD NOT BE DISCLOSED TO ANY THIRD PARTY WITHOUT THE EXPRESS WRITTEN CONSENT OF open eir. THE DRAWING MAY NOT BE PHOTOCOPIED OR REPRODUCED IN ANY WAY.</p>		<p>THE INFORMATION GIVEN IS COMPILED FROM PASSIVE ACCESS RECORDS AND IS BELIEVED TO BE CORRECT. THERE MAY, HOWEVER, BE DEPARTURES FROM THE COURSE(S) AND DEPTH(S) SHOWN OR INDICATED. THERE MAY ALSO BE ITEMS OF open eir INFRASTRUCTURE OF WHICH NO RECORDS IS HELD. THE INFORMATION IS GIVEN WITHOUT PREJUDICE TO THE LEGAL RIGHTS OF open eir TO COMPENSATION SHOULD open eir INFRASTRUCTURE BE DAMAGED.</p>	
 <small>Ordnance Survey Ireland Licence No EN 0007904 Copyright Ordnance Survey Ireland and Government of Ireland</small>			





