


ISO A1 594mm x 841mm

Project Management Initials: Designer: JC Checked: DB Approved: RG

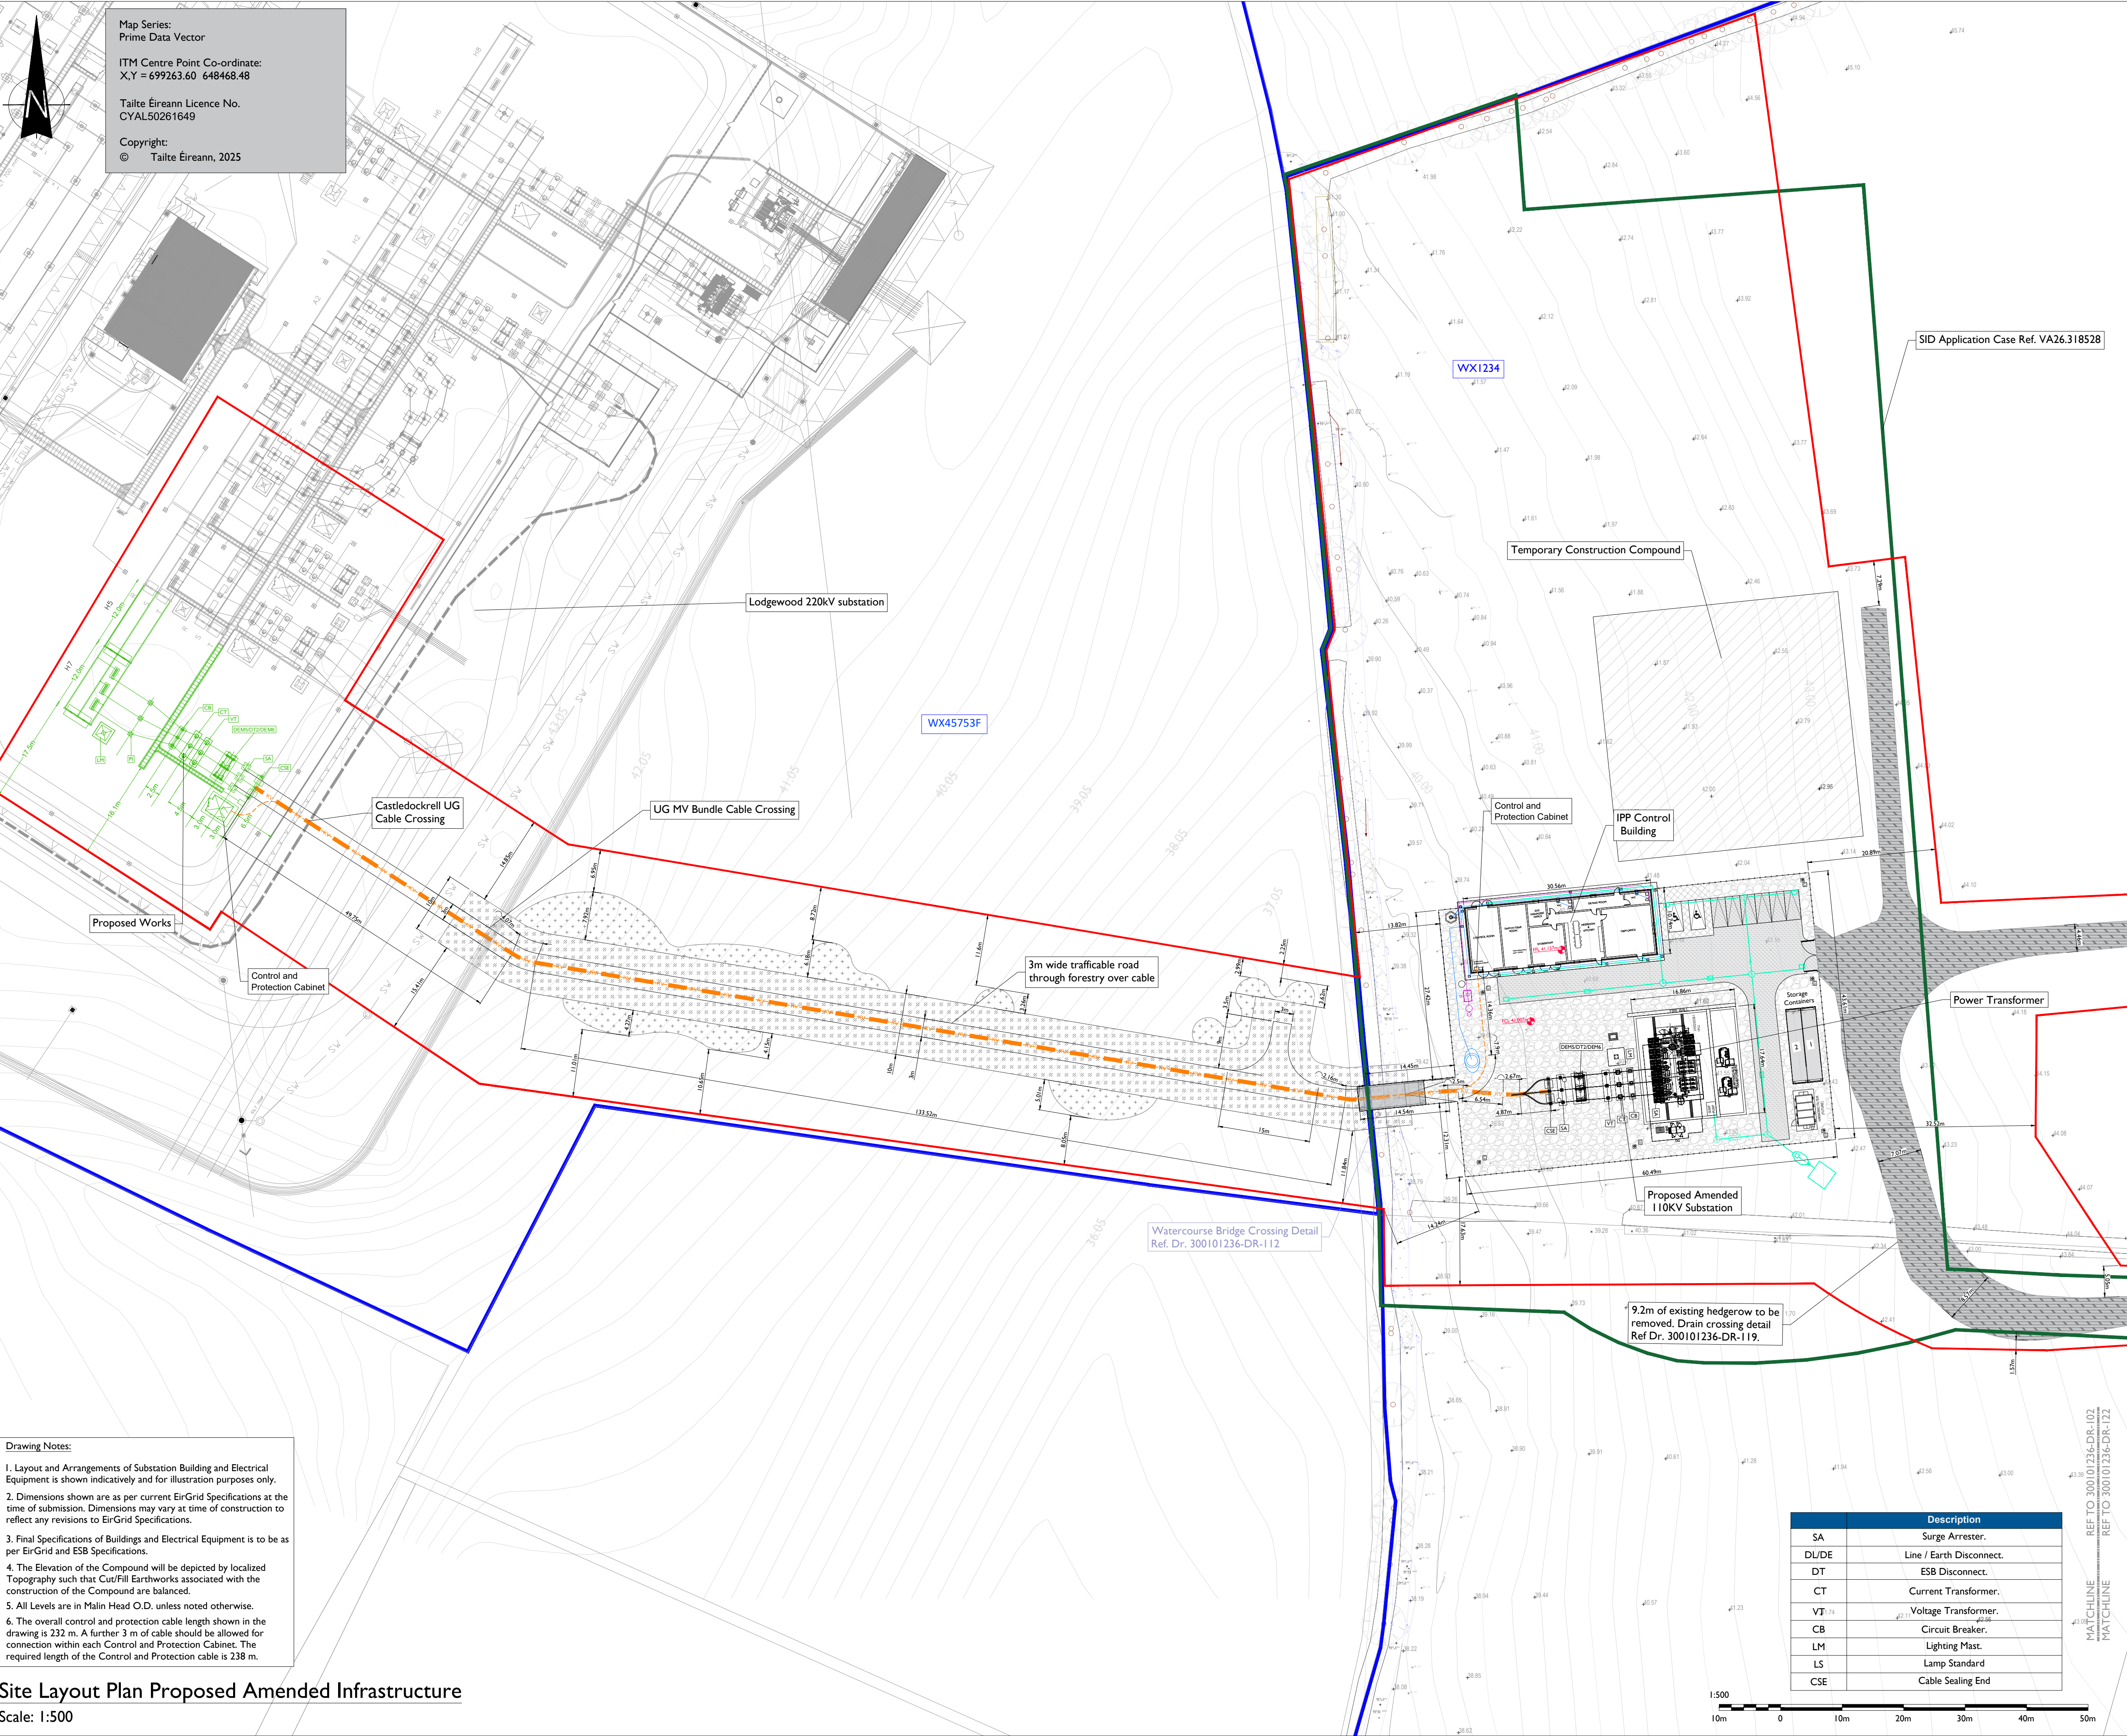

Head Office
Beenleigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

Regional Office
Basepoint Business Centre
Scroudlley Road, Basingstoke,
Hampshire,
RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

Tincurry 110kV Substation and Grid Connection

CLIENT

Lodgewood Solar Farm Limited

CONSULTANTS

TOBIN CONSULTING ENGINEERS

NOTES: -

See Drawing Notes in Viewport

LEGEND: -

- Proposed 110kV Grid UGC Route (0.221km)
- Proposed Control and Protection Cable Route (0.232km)
- Planning Boundary shown thus
- Proposed Reinforcement Works
- Landowner Property boundaries
- Contour Topographical survey shown thus
- Spot Height shown thus
- Bore Well Pumped Water System shown thus
- Storm Water, Oil Separator and Soakaway
- Manhole/Gully shown thus
- Foul Waste Holding Tank and System
- SID Application Case Ref. VA26.318528
- Required Tree Removal as Detailed in Chapter 3 of the Planning and Environmental Considerations Report
- Required Tree and Vegetation Removal as Detailed in Chapter 3 of the Planning and Environmental Considerations Report
- Access track

ISSUE/REVISION

Issue/Revision	Date	Description
P3	19.12.25	Issued for Planning
P2	21.11.25	Issued for Planning
P1	05.09.25	Issued for Planning
N3	16.05.25	Issued for Information
N2	10.04.25	Issued for Information
N1	20.03.25	Issued for Information
I/R	DATE	DESCRIPTION

PROJECT NUMBER

300-101236

SHEET TITLE

Site Layout Details
Proposed Amended Infrastructure

SHEET NUMBER

300101236-DR-102