
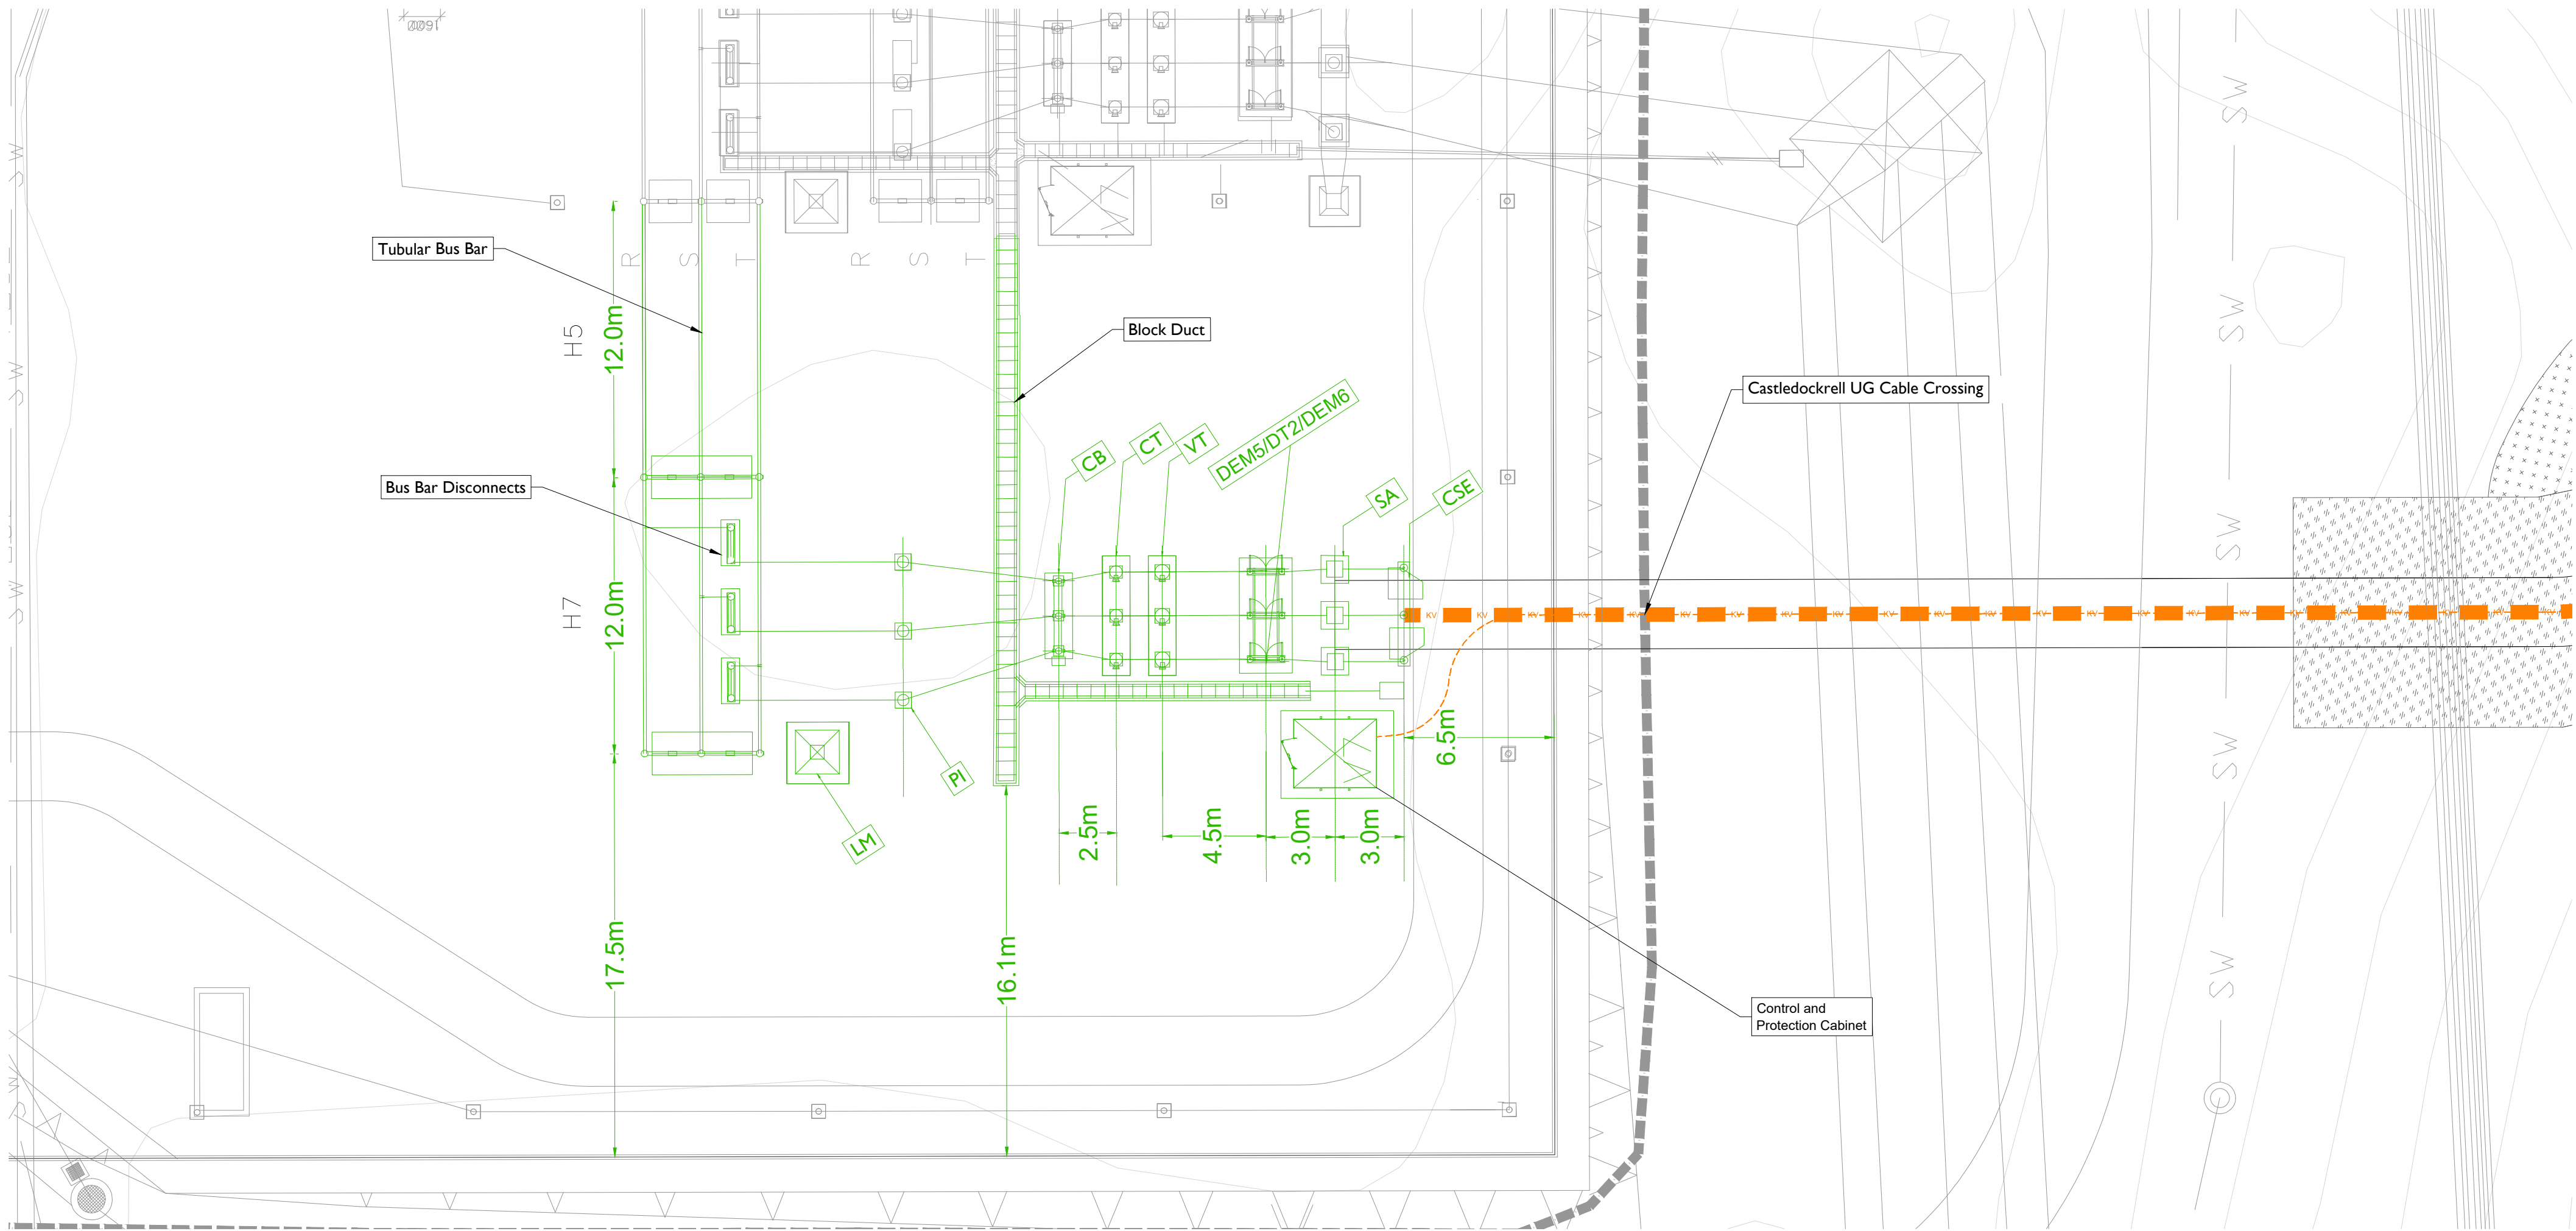


ISO A1 594mm x 841mm

Project Management Initials: Designer: JC Checked: DB Approved: RG



Map Series:
Prime Data Vector

ITM Centre Point Co-ordinate:
X,Y = 699263.60 648468.48

Tailte Éireann Licence No.
CYAL50261649

Copyright:
© Tailte Éireann, 2025



Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

Regional Office
Basepoint Business Centre
Scroudfley Road, Basingstoke,
Hampshire,
RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

Tincurry 110kV Substation and Grid Connection

CLIENT

Lodgewood Solar Farm Limited

CONSULTANTS

TOBIN
CONSULTING ENGINEERS

NOTES: -

- This drawing is to be used only for the purpose of the planning application and is subject to detailed design.
- Position of underground cable may vary depending on site conditions.
- Other services may be encountered on the route.

LEGEND: -

Proposed 110kV Grid UGC Route (0.221km) ---

Proposed Control and Protection Cable Route (0.232km) ---

Proposed Reinforcement Works ---

Required Tree Removal as Detailed in Chapter 3 of the Planning and Environmental Considerations Report ---

Required Tree and Vegetation Removal as Detailed in Chapter 3 of the Planning and Environmental Considerations Report ---

	Description
SA	Surge Arrester.
DT/DEM	Line / Earth Disconnect.
PI	Post Insulator.
CT	Current Transformer.
VT	Voltage Transformer.
CB	Circuit Breaker.
CSE	Cable Sealing End

ISSUE/REVISION

P3	19.12.25	Issued for Planning
P2	21.11.25	Issued for Planning
P1	05.09.25	Issued for Planning
N3	18.06.25	Issued for Information
N2	10.04.25	Issued for Information
N1	20.03.25	Issued for Information
I/R	DATE	DESCRIPTION

PROJECT NUMBER

300-101236

SHEET TITLE


Lodgewood Substation - Proposed Works Plan & Elevation

SHEET NUMBER

300101236-DR-104

Substation Layout Plan-Proposed Works

Scale: 1:200

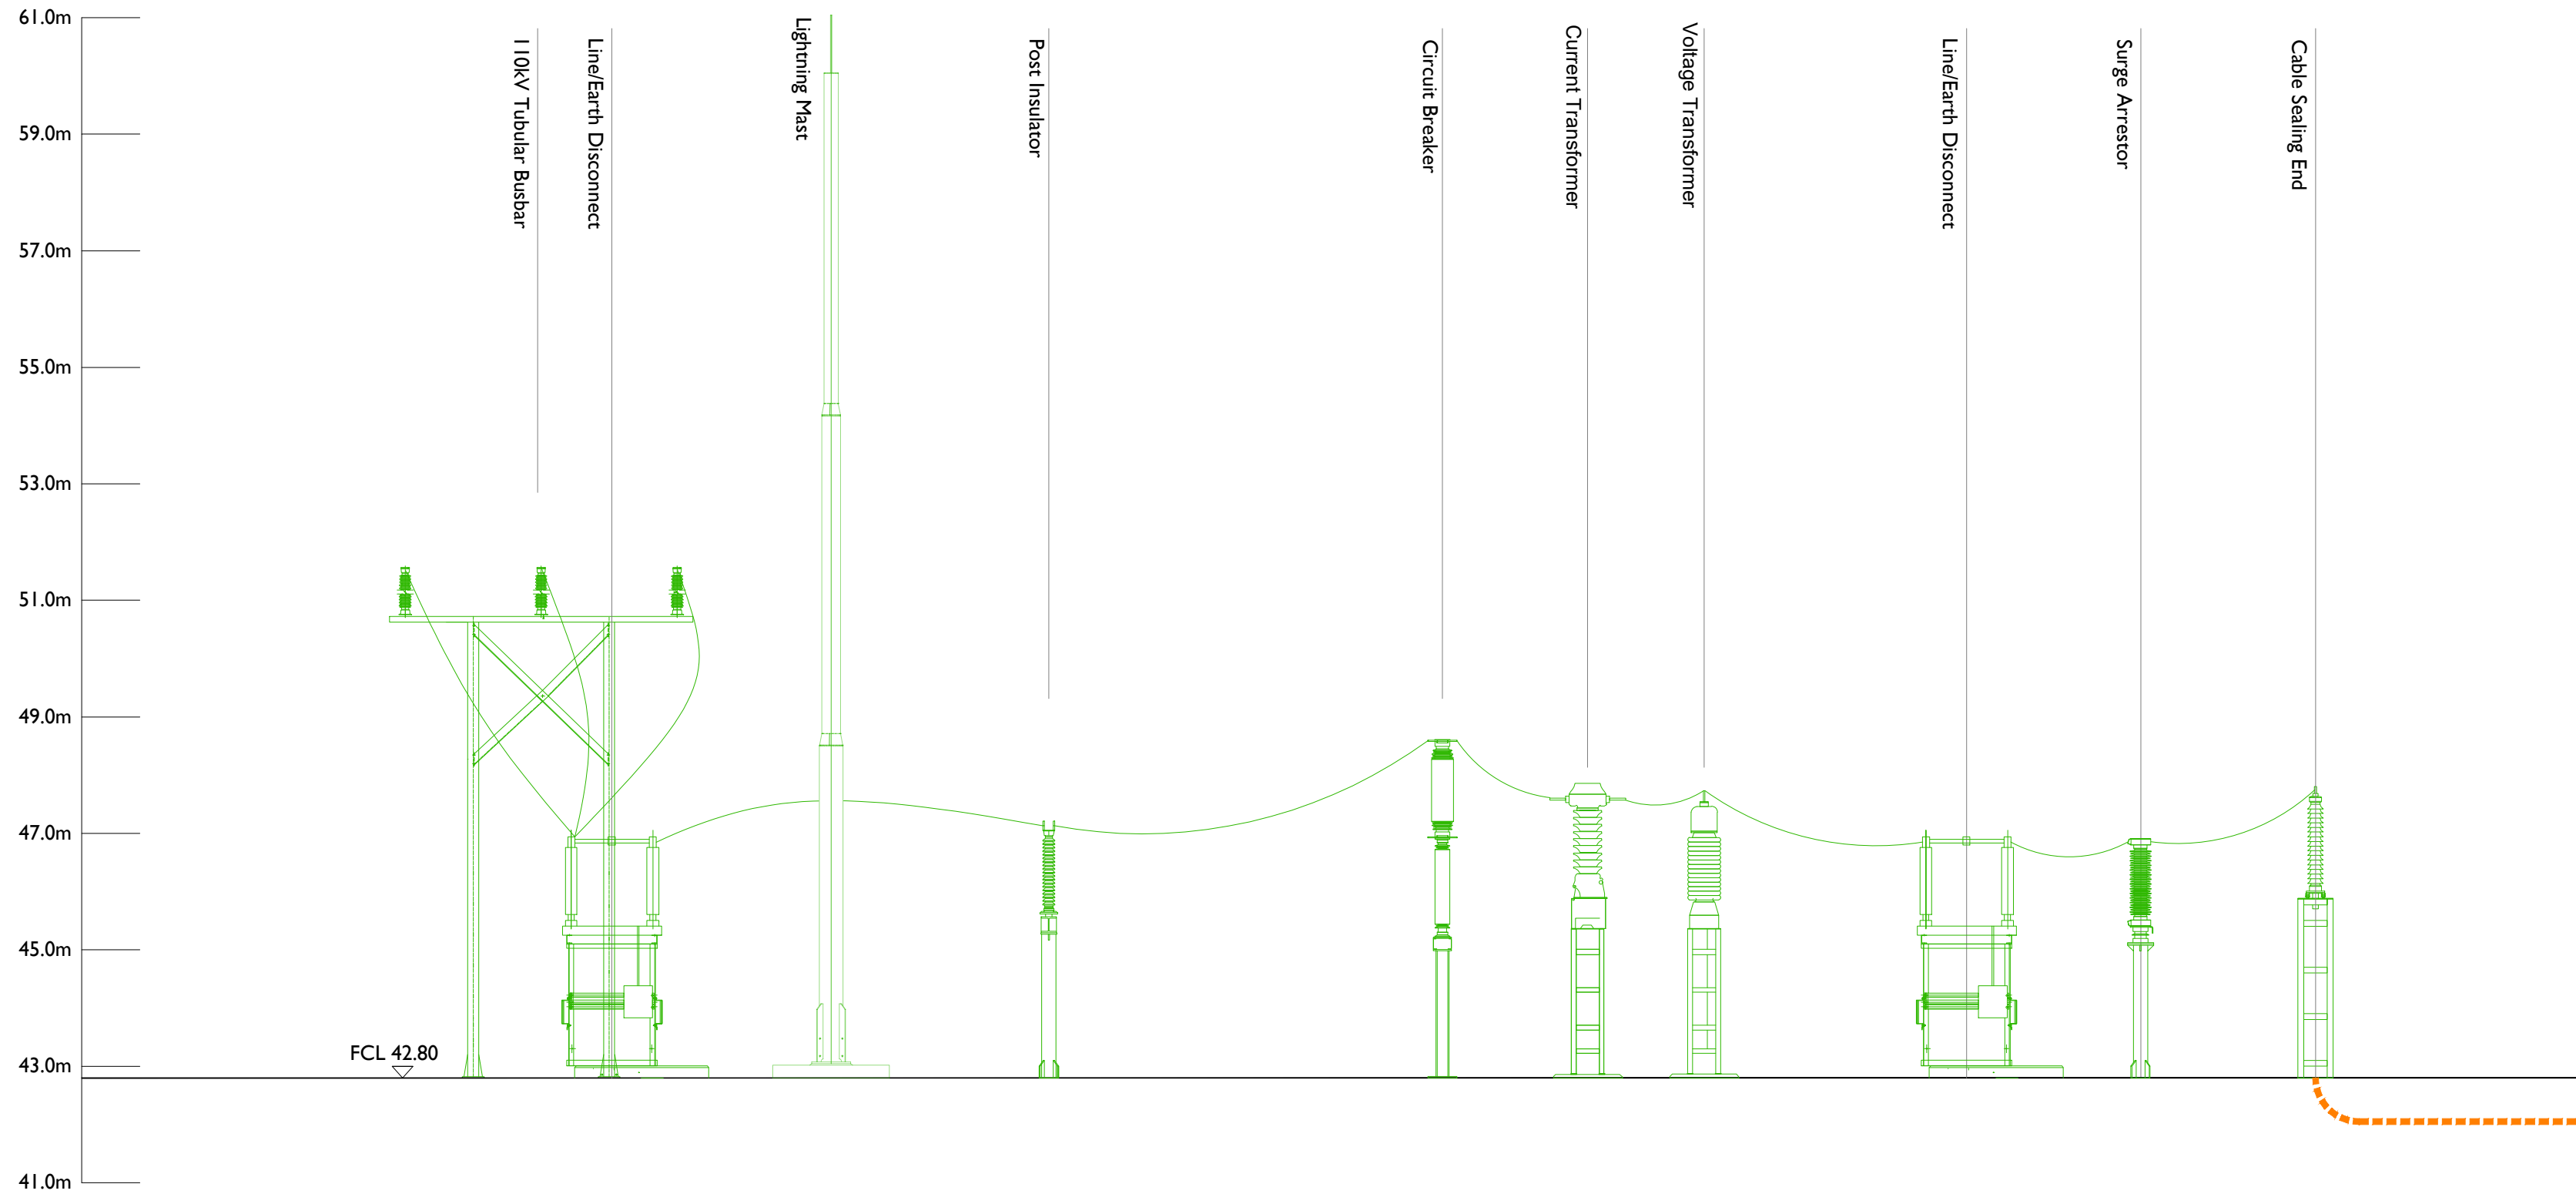

South Elevation

Scale: 1:100