



ISO A2 420mm x 594mm

Project Management Initials: Designer: JC Checked: DB Approved: RG

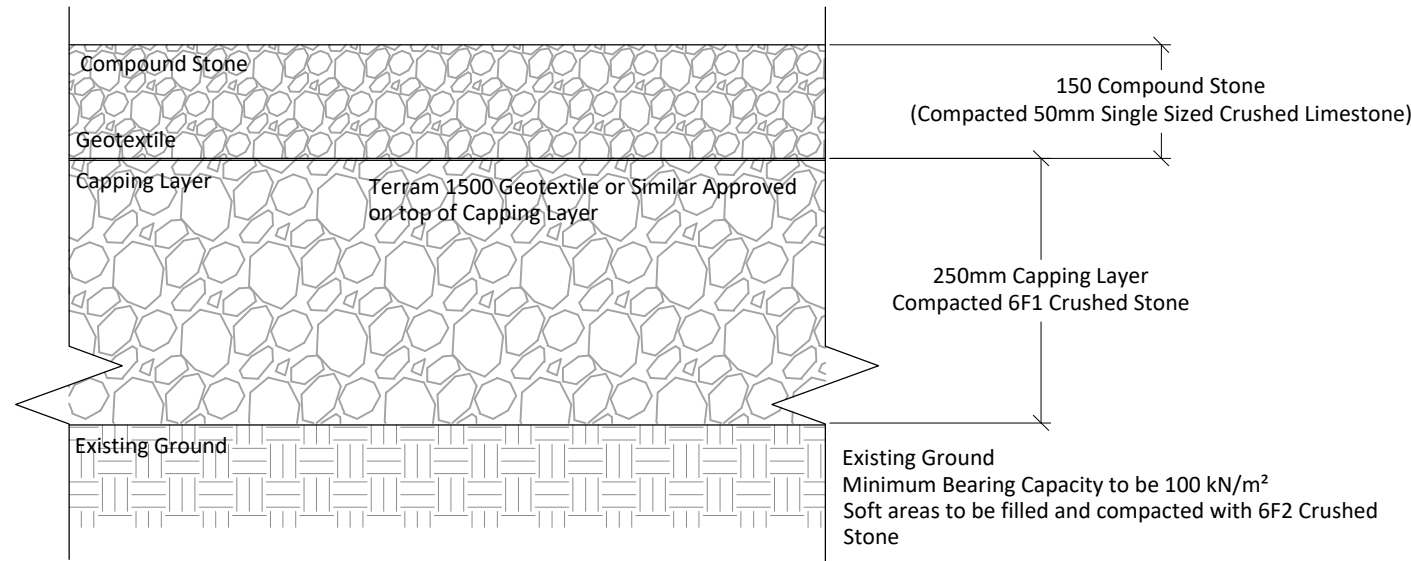


All earthwork fills shall be carried out in accordance with Section 3.12 of PE607-F0000-S00-004 and test results to be provided to ESB for approval"

**Typical Compound Detail**  
SCALE 1:10

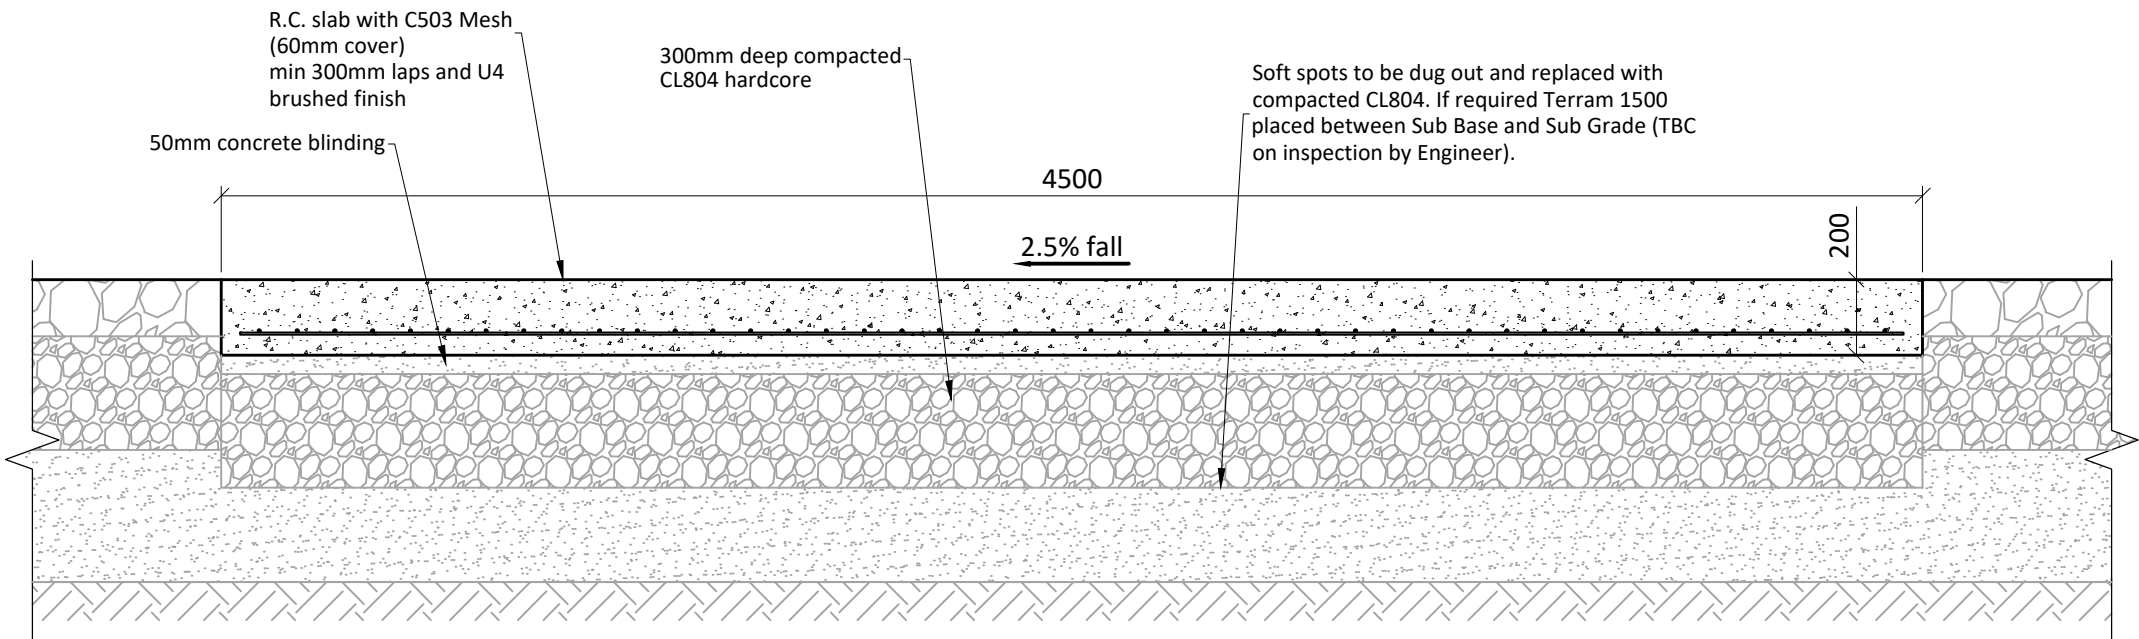


**Typical Section - Concrete Access Road**  
SCALE 1:20

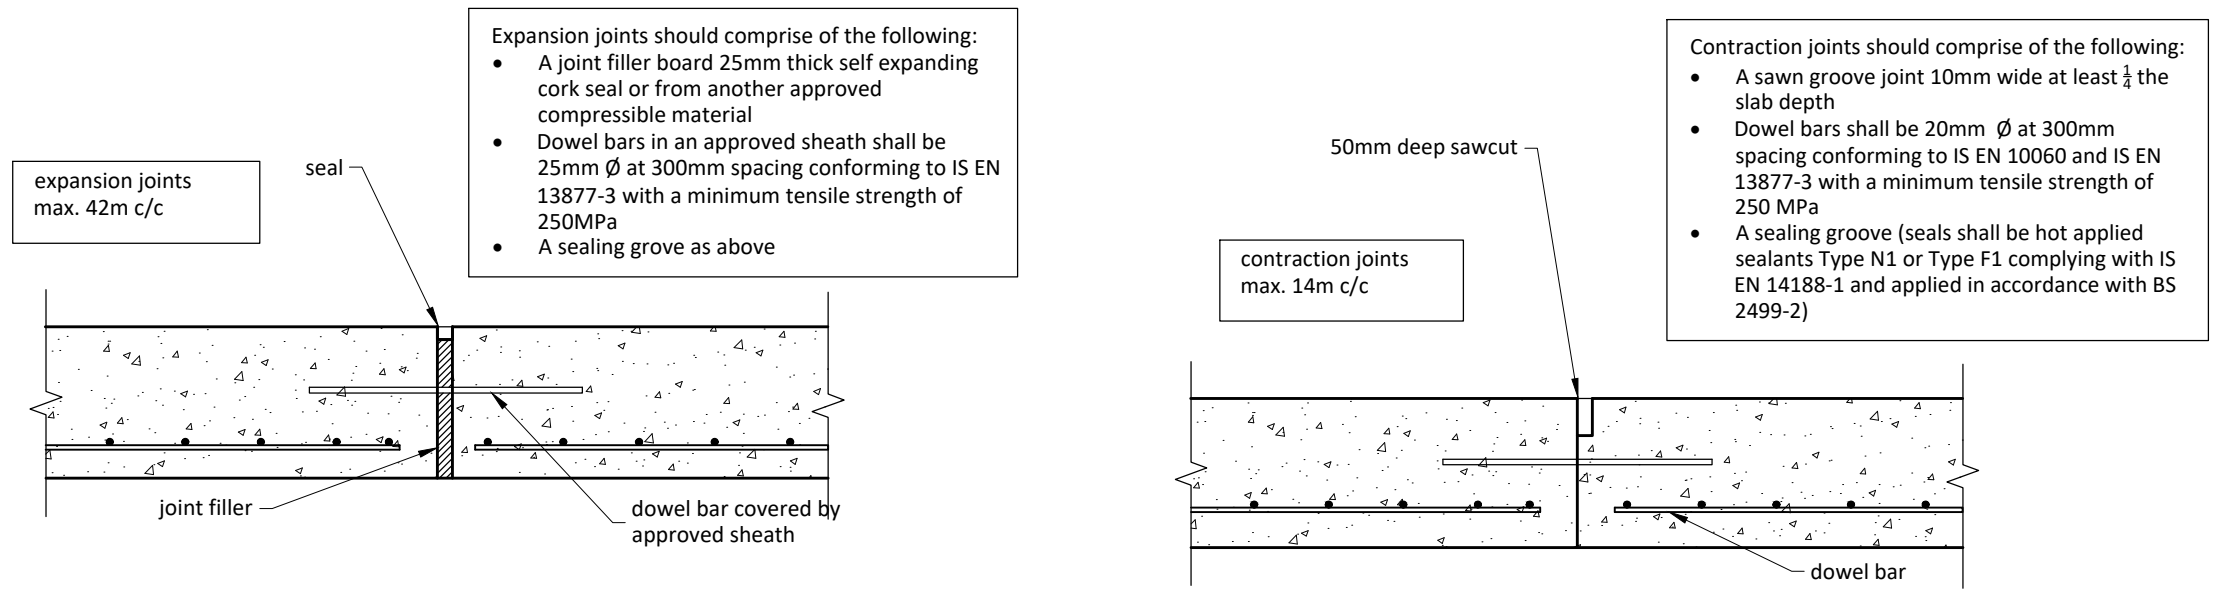


**Concrete Access Road Expansion Joint**  
SCALE 1:10


**Concrete Access Road Contraction Joint**  
SCALE 1:10

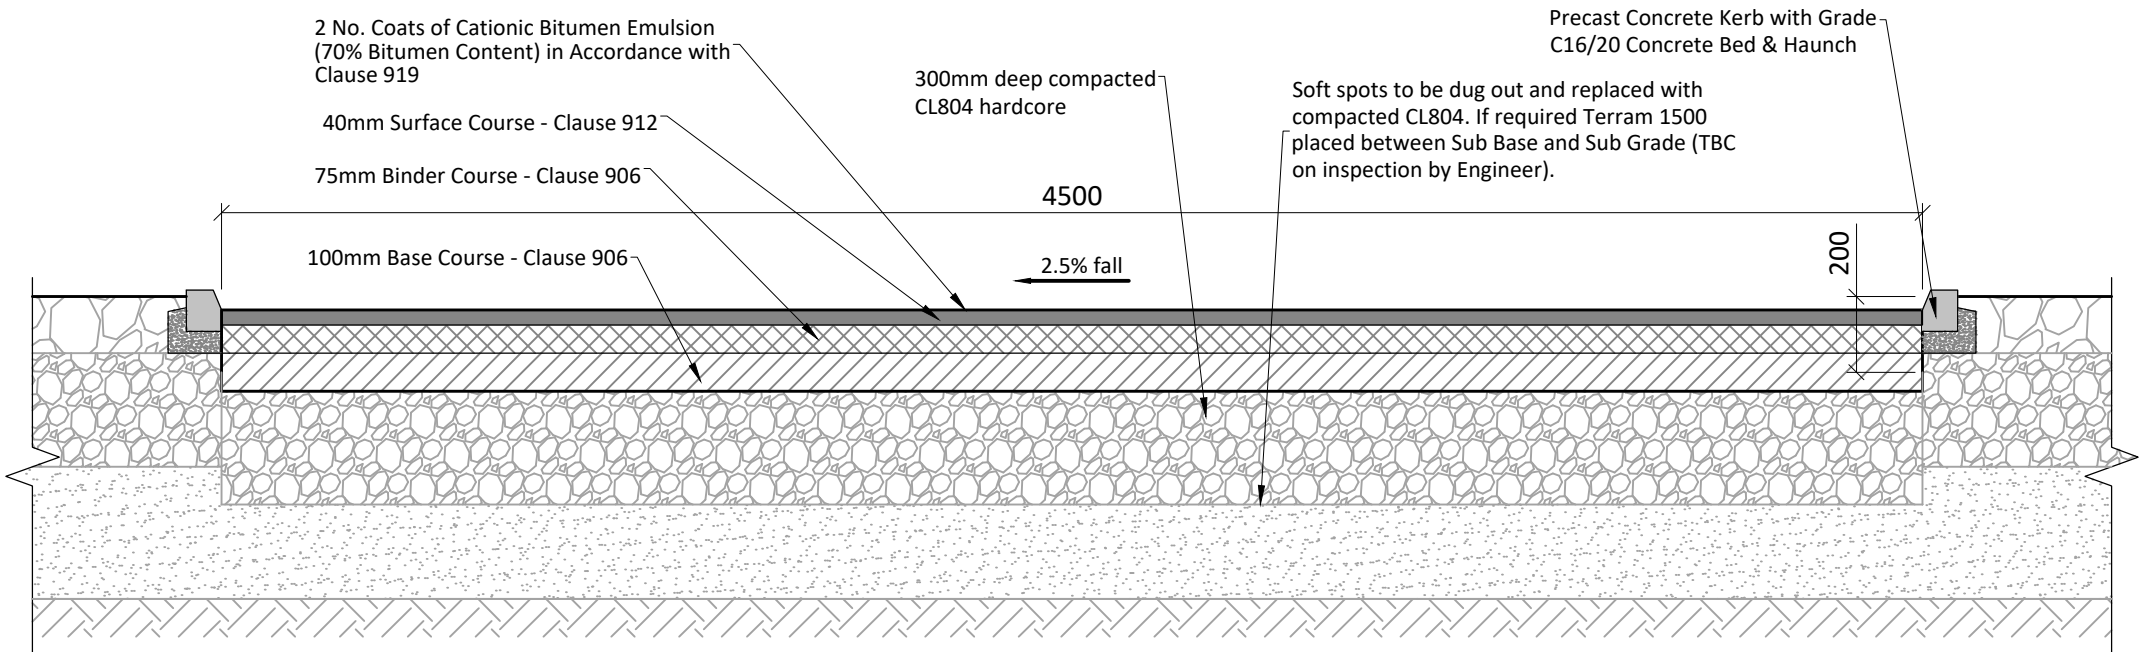

**Typical Section - Asphalt Access Road**  
SCALE 1:20

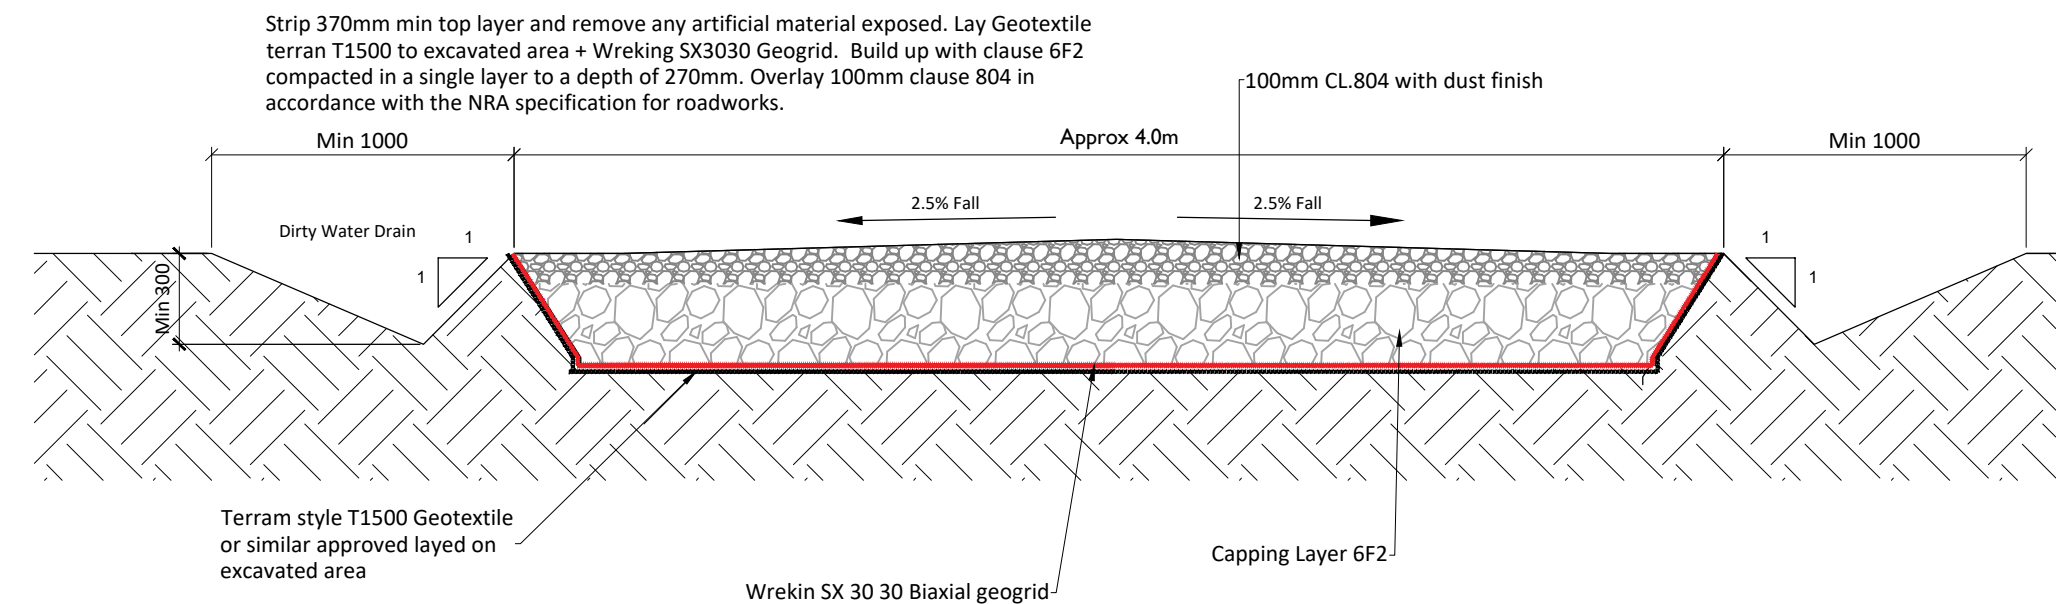

**Typical Section - Gravel Access Road**  
Scale : 1:25

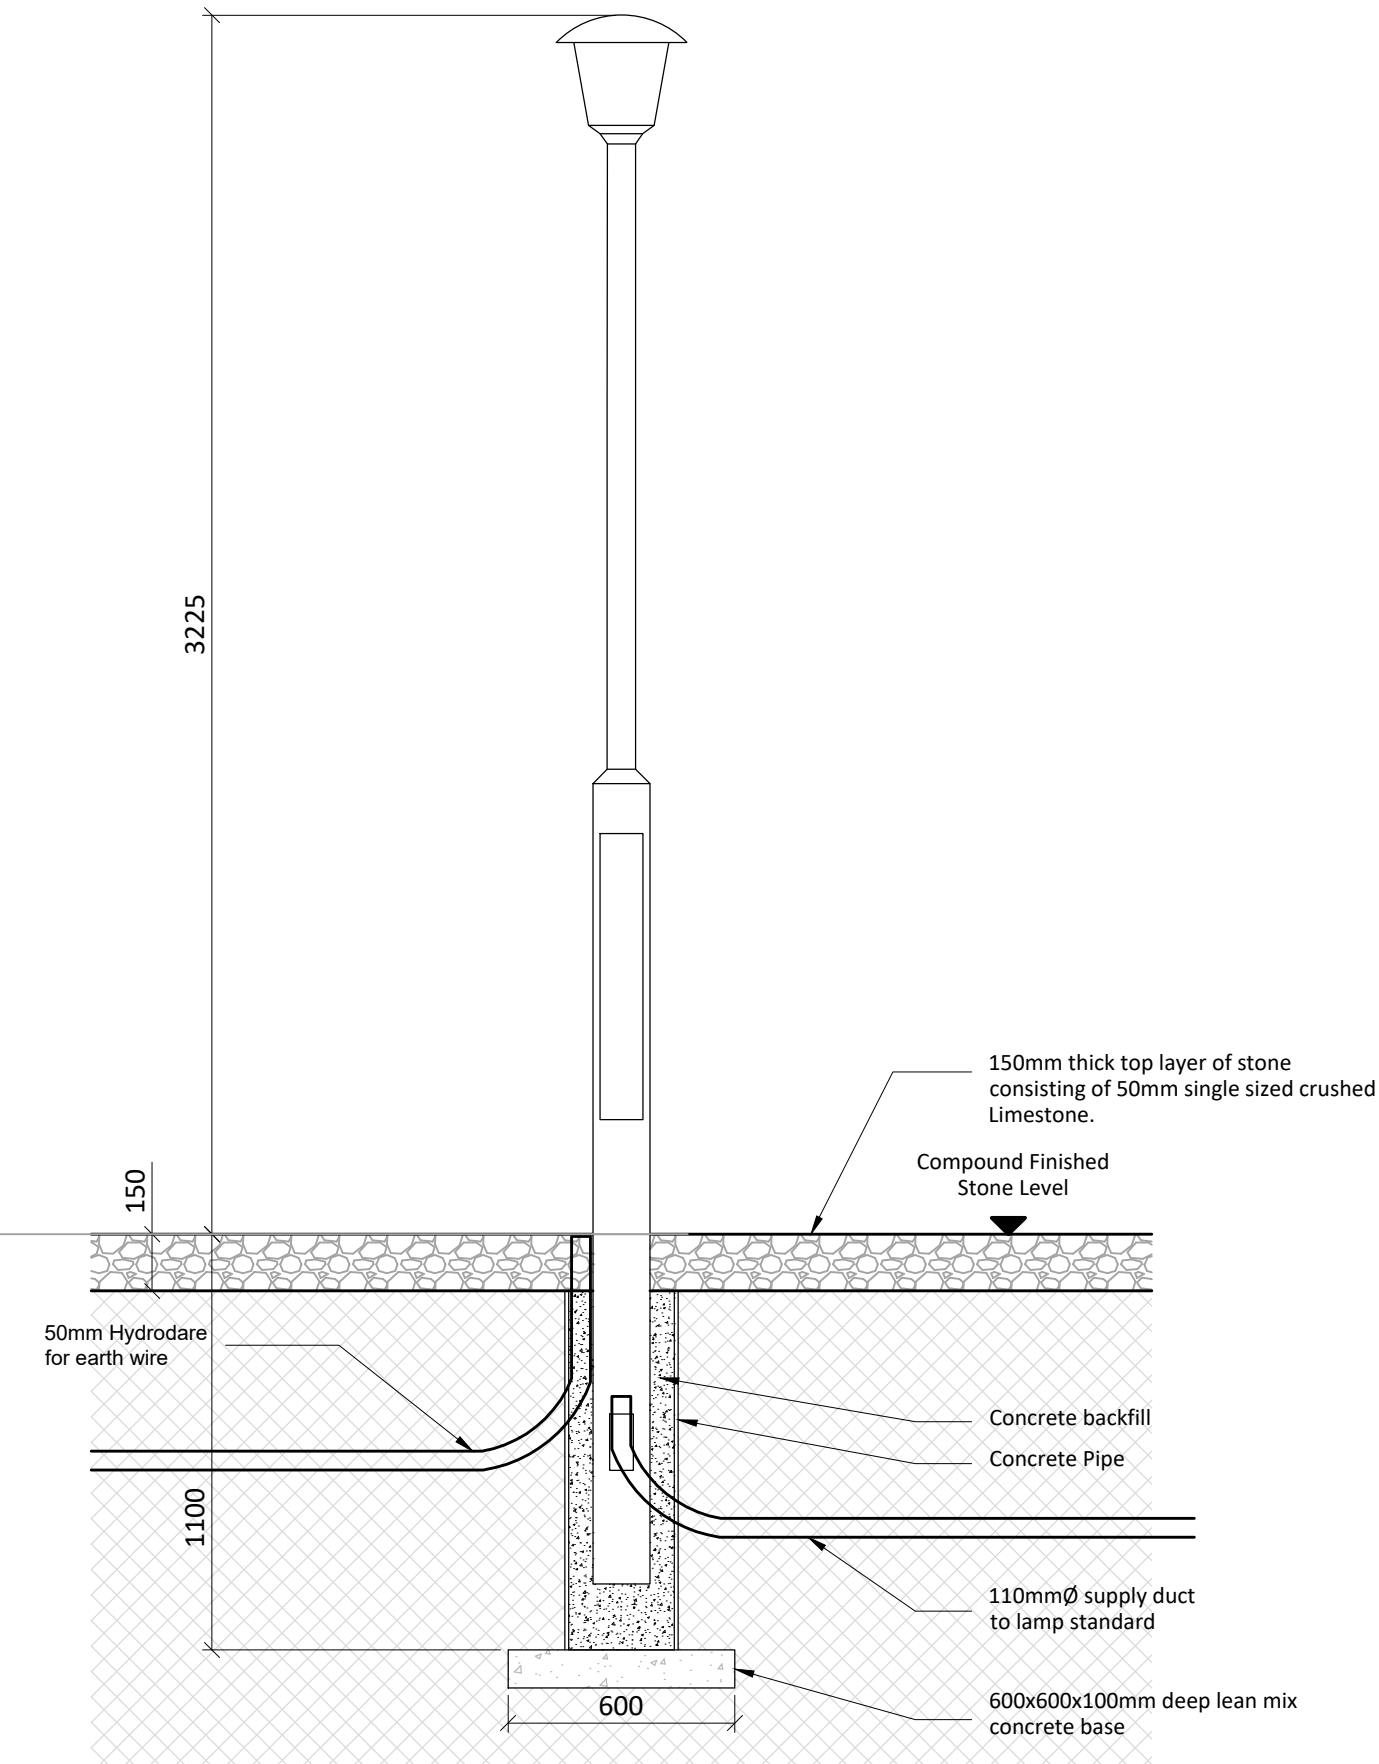

**Lighting Column & Surround Detail**  
SCALE 1:20

PROJECT

Tincurry 110kV Substation  
and Grid Connection

CLIENT

Lodgewood Solar Farm  
Limited

CONSULTANTS

**TOBIN**  
CONSULTING ENGINEERS

NOTES: -

- This drawing is to be read in conjunction with relevant engineering drawings, specifications and reports
- Dimensions are in millimeters, unless noted otherwise
- Drawings are not to be scaled use figured dimensions only

LEGEND: -

ISSUE/REVISION

| NO. | DATE     | DESCRIPTION            |
|-----|----------|------------------------|
| P2  | 21.11.25 | Issued for Planning    |
| P1  | 02.09.25 | Issued for Planning    |
| N1  | 18.06.25 | Issued for Information |
| I/R | DATE     | DESCRIPTION            |

PROJECT NUMBER

300-101236

SHEET TITLE

Site Compound Details Proposed  
Amended Infrastructure

SHEET NUMBER

300101236-DR-109