

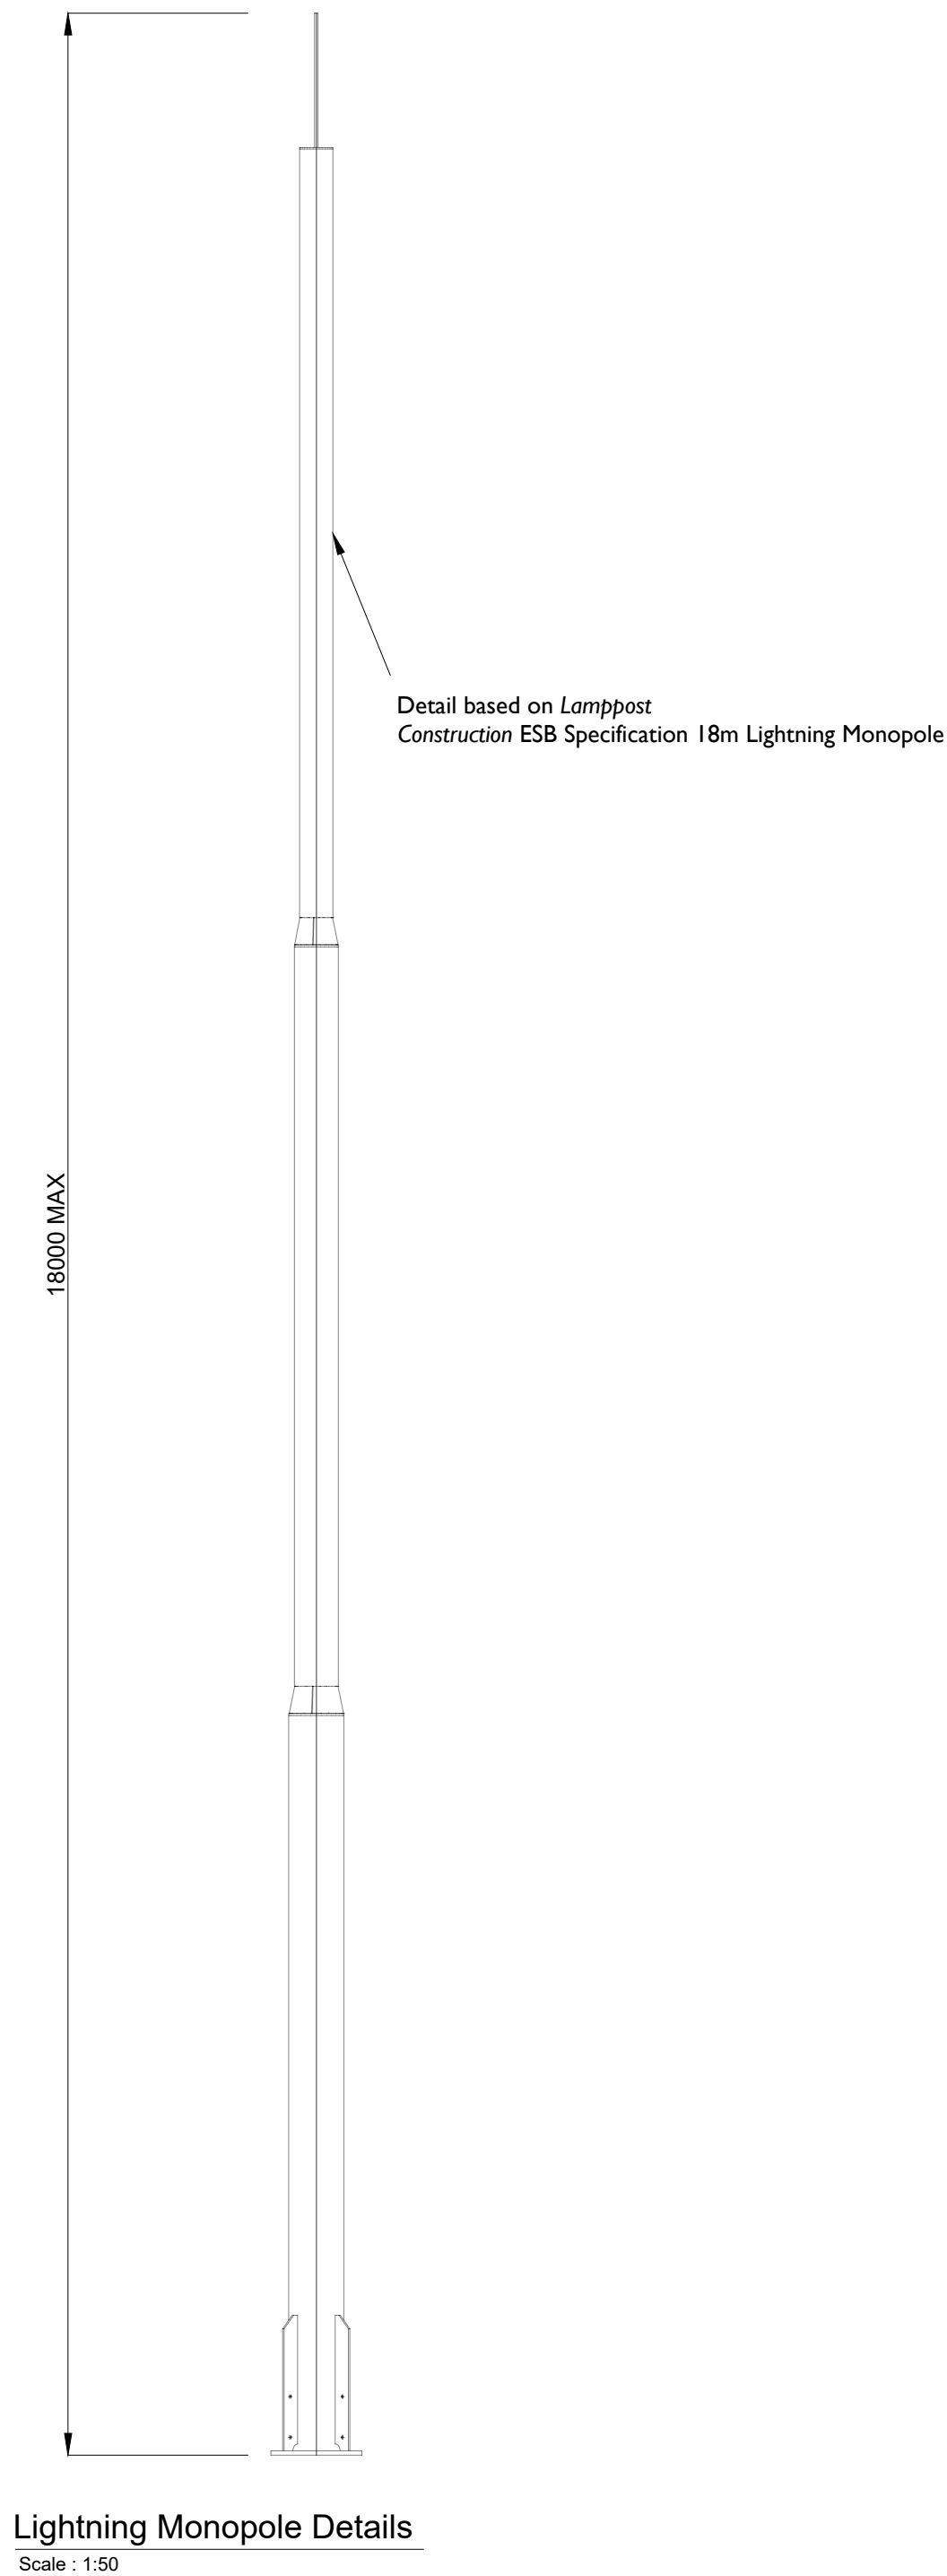
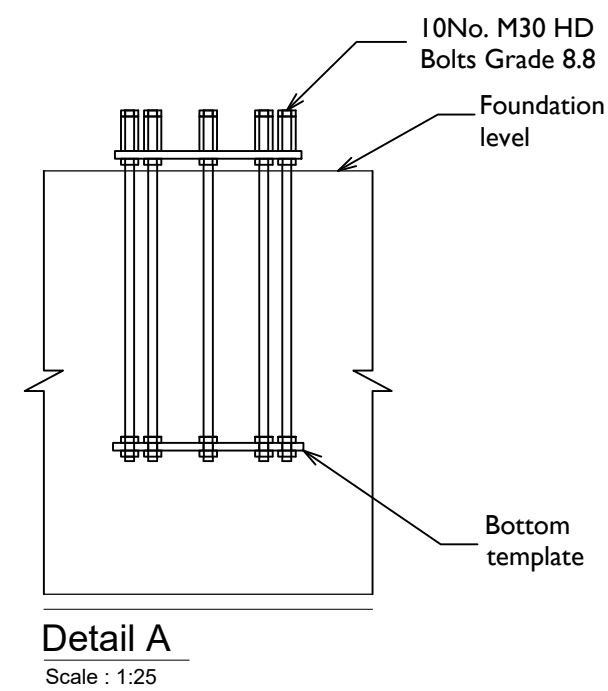
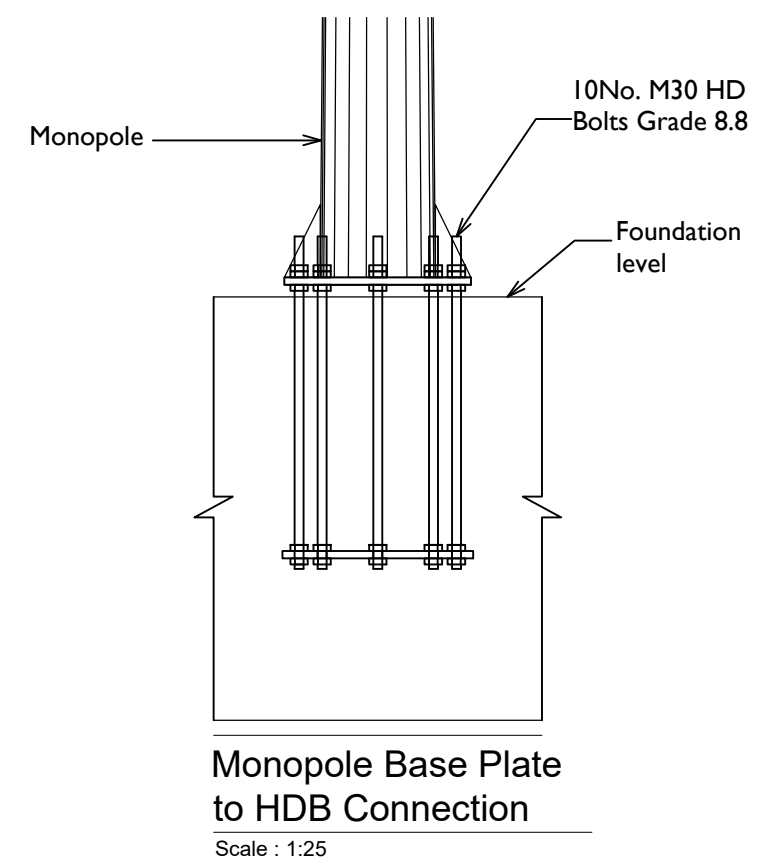


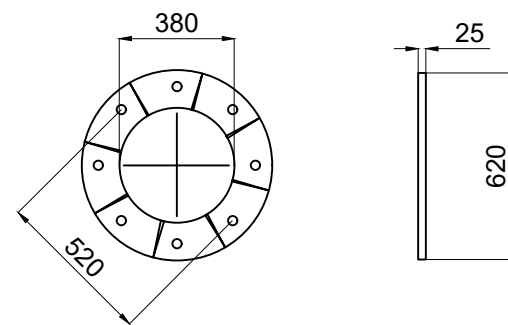

Foundation Details

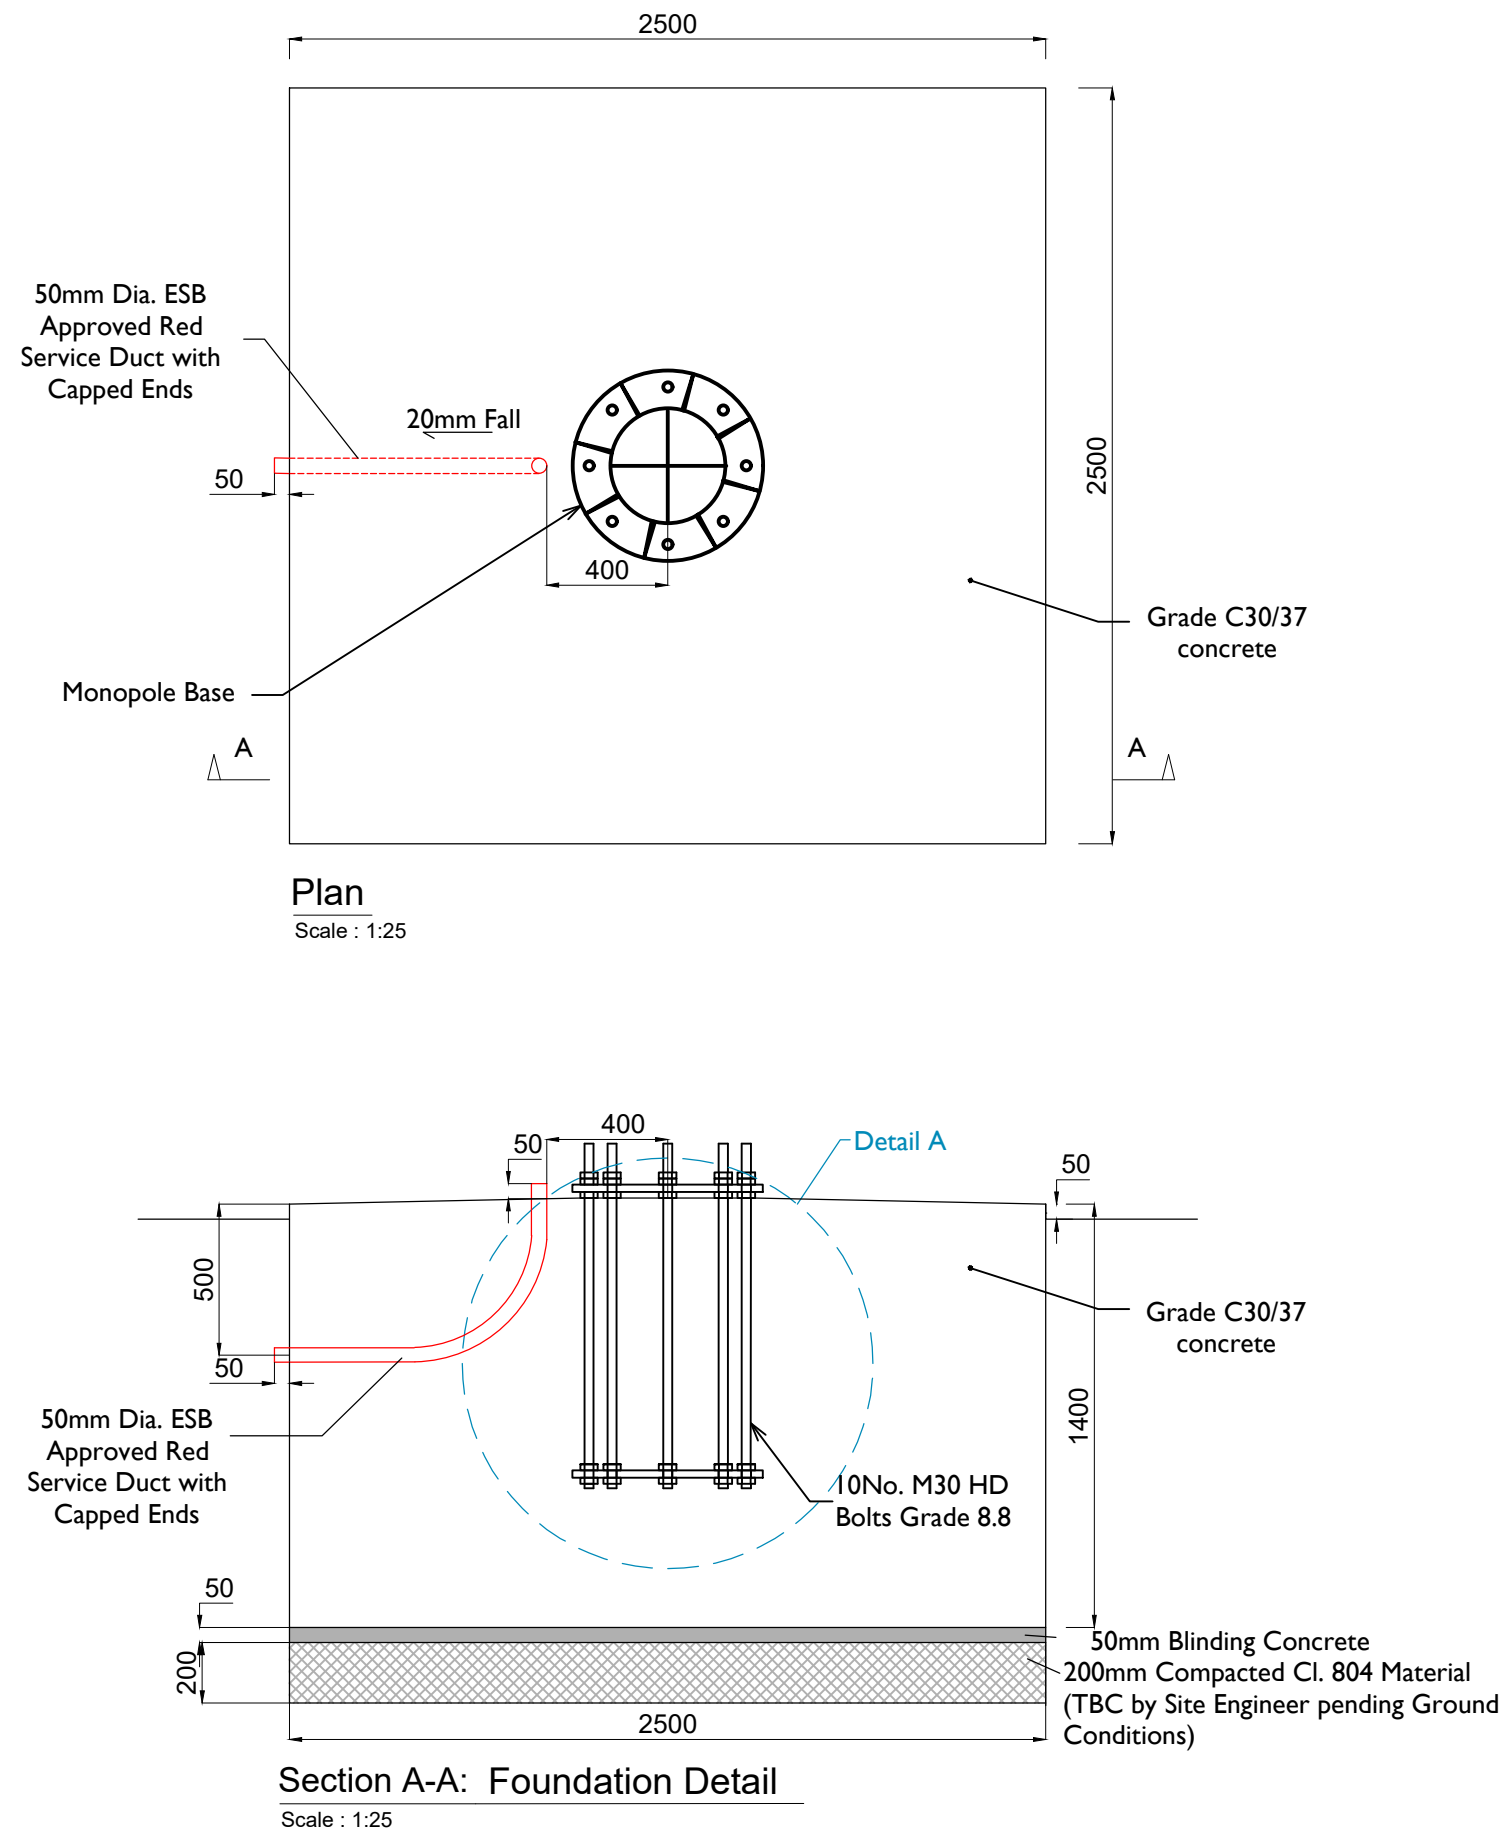

GENERAL NOTES:

- ALL DRAWINGS TO BE READ IN CONJUNCTION WITH THE SPECIFICATION AND ALL ENGINEERS AND ARCHITECTS DRAWINGS
 - ALL CONCRETE TO BE IN ACCORDANCE WITH I.S. EN 206-1:2002 WITH THE MIX DESIGNS SHOWN IN TABLE 1
 - CONCRETE FINISHES TO BE IN ACCORDANCE WITH TABLE 6.1 OF THE ESBI SPECIFICATION CS17-SO1-005.
 - ALL REINFORCEMENT SHALL BE IN ACCORDANCE WITH BS4449 AND SCHEDULED IN ACCORDANCE WITH BS.8666. 300MM LAPS FOR A142 MESH 600MM MIN LAPS FOR A393 MESH.
 - REFER ALWAYS TO RELEVANT EARTH GRID DRAWING PRIOR TO EXCAVATIONS & CONCRETE POURS
 - GEOMETRICAL TOLERANCES TO BE IN ACCORDANCE WITH TABLE 6.2 OF ESBI SPECIFICATION CS17-SO1-005
- FOUNDATION NOTES:**
- GROUND TO HAVE A MINIMUM BEARING CAPACITY OF 100 kN/M².
 - FORMATION LEVEL AND FOUNDATIONS TO BE INSPECTED AND APPROVED BY THE ENGINEER PRIOR TO ANY CONCRETE BEING POURED.
 - ALL FOUNDATIONS ARE TO BE BLINDED IMMEDIATELY AFTER EXCAVATION WITH 50MM OF C16/20 CONCRETE BLINDING.
 - REFER ALWAYS TO THE RELEVANT EARTH WORK DRAWINGS PRIOR TO EXCAVATIONS & CONCRETE POURS.

PROJECT

Tincurry 110kV Substation
and Grid Connection

CLIENT

Lodgewood Solar Farm
Limited

CONSULTANTS

TOBIN
CONSULTING ENGINEERS

NOTES: -

- This drawing is to be read in conjunction with relevant engineering drawings, specifications and reports
- Dimensions are in millimeters, unless noted otherwise
- Drawings are not to be scaled use figured dimensions only

LEGEND: -

ISSUE/REVISION

NO.	DATE	DESCRIPTION
P2	21.11.25	Issued for Planning
P1	02.09.25	Issued for Planning
N1	18.06.25	Issued for Information
I/R	DATE	DESCRIPTION

PROJECT NUMBER

300-101236

SHEET TITLE

Lightning Monopole Details Porposed
Amended Infrastructure

SHEET NUMBER

300101236-DR-110