



ISO A1 594mm x 841mm
Project Management Initials: Designer: JC Checked: DB Approved: RG

Map Series:
Prime Data Vector
ITM Centre Point Co-ordinate:
X,Y = 699263.60 648468.48
Tailte Éireann Licence No.
CYAL50261649
Copyright:
© Tailte Éireann, 2025

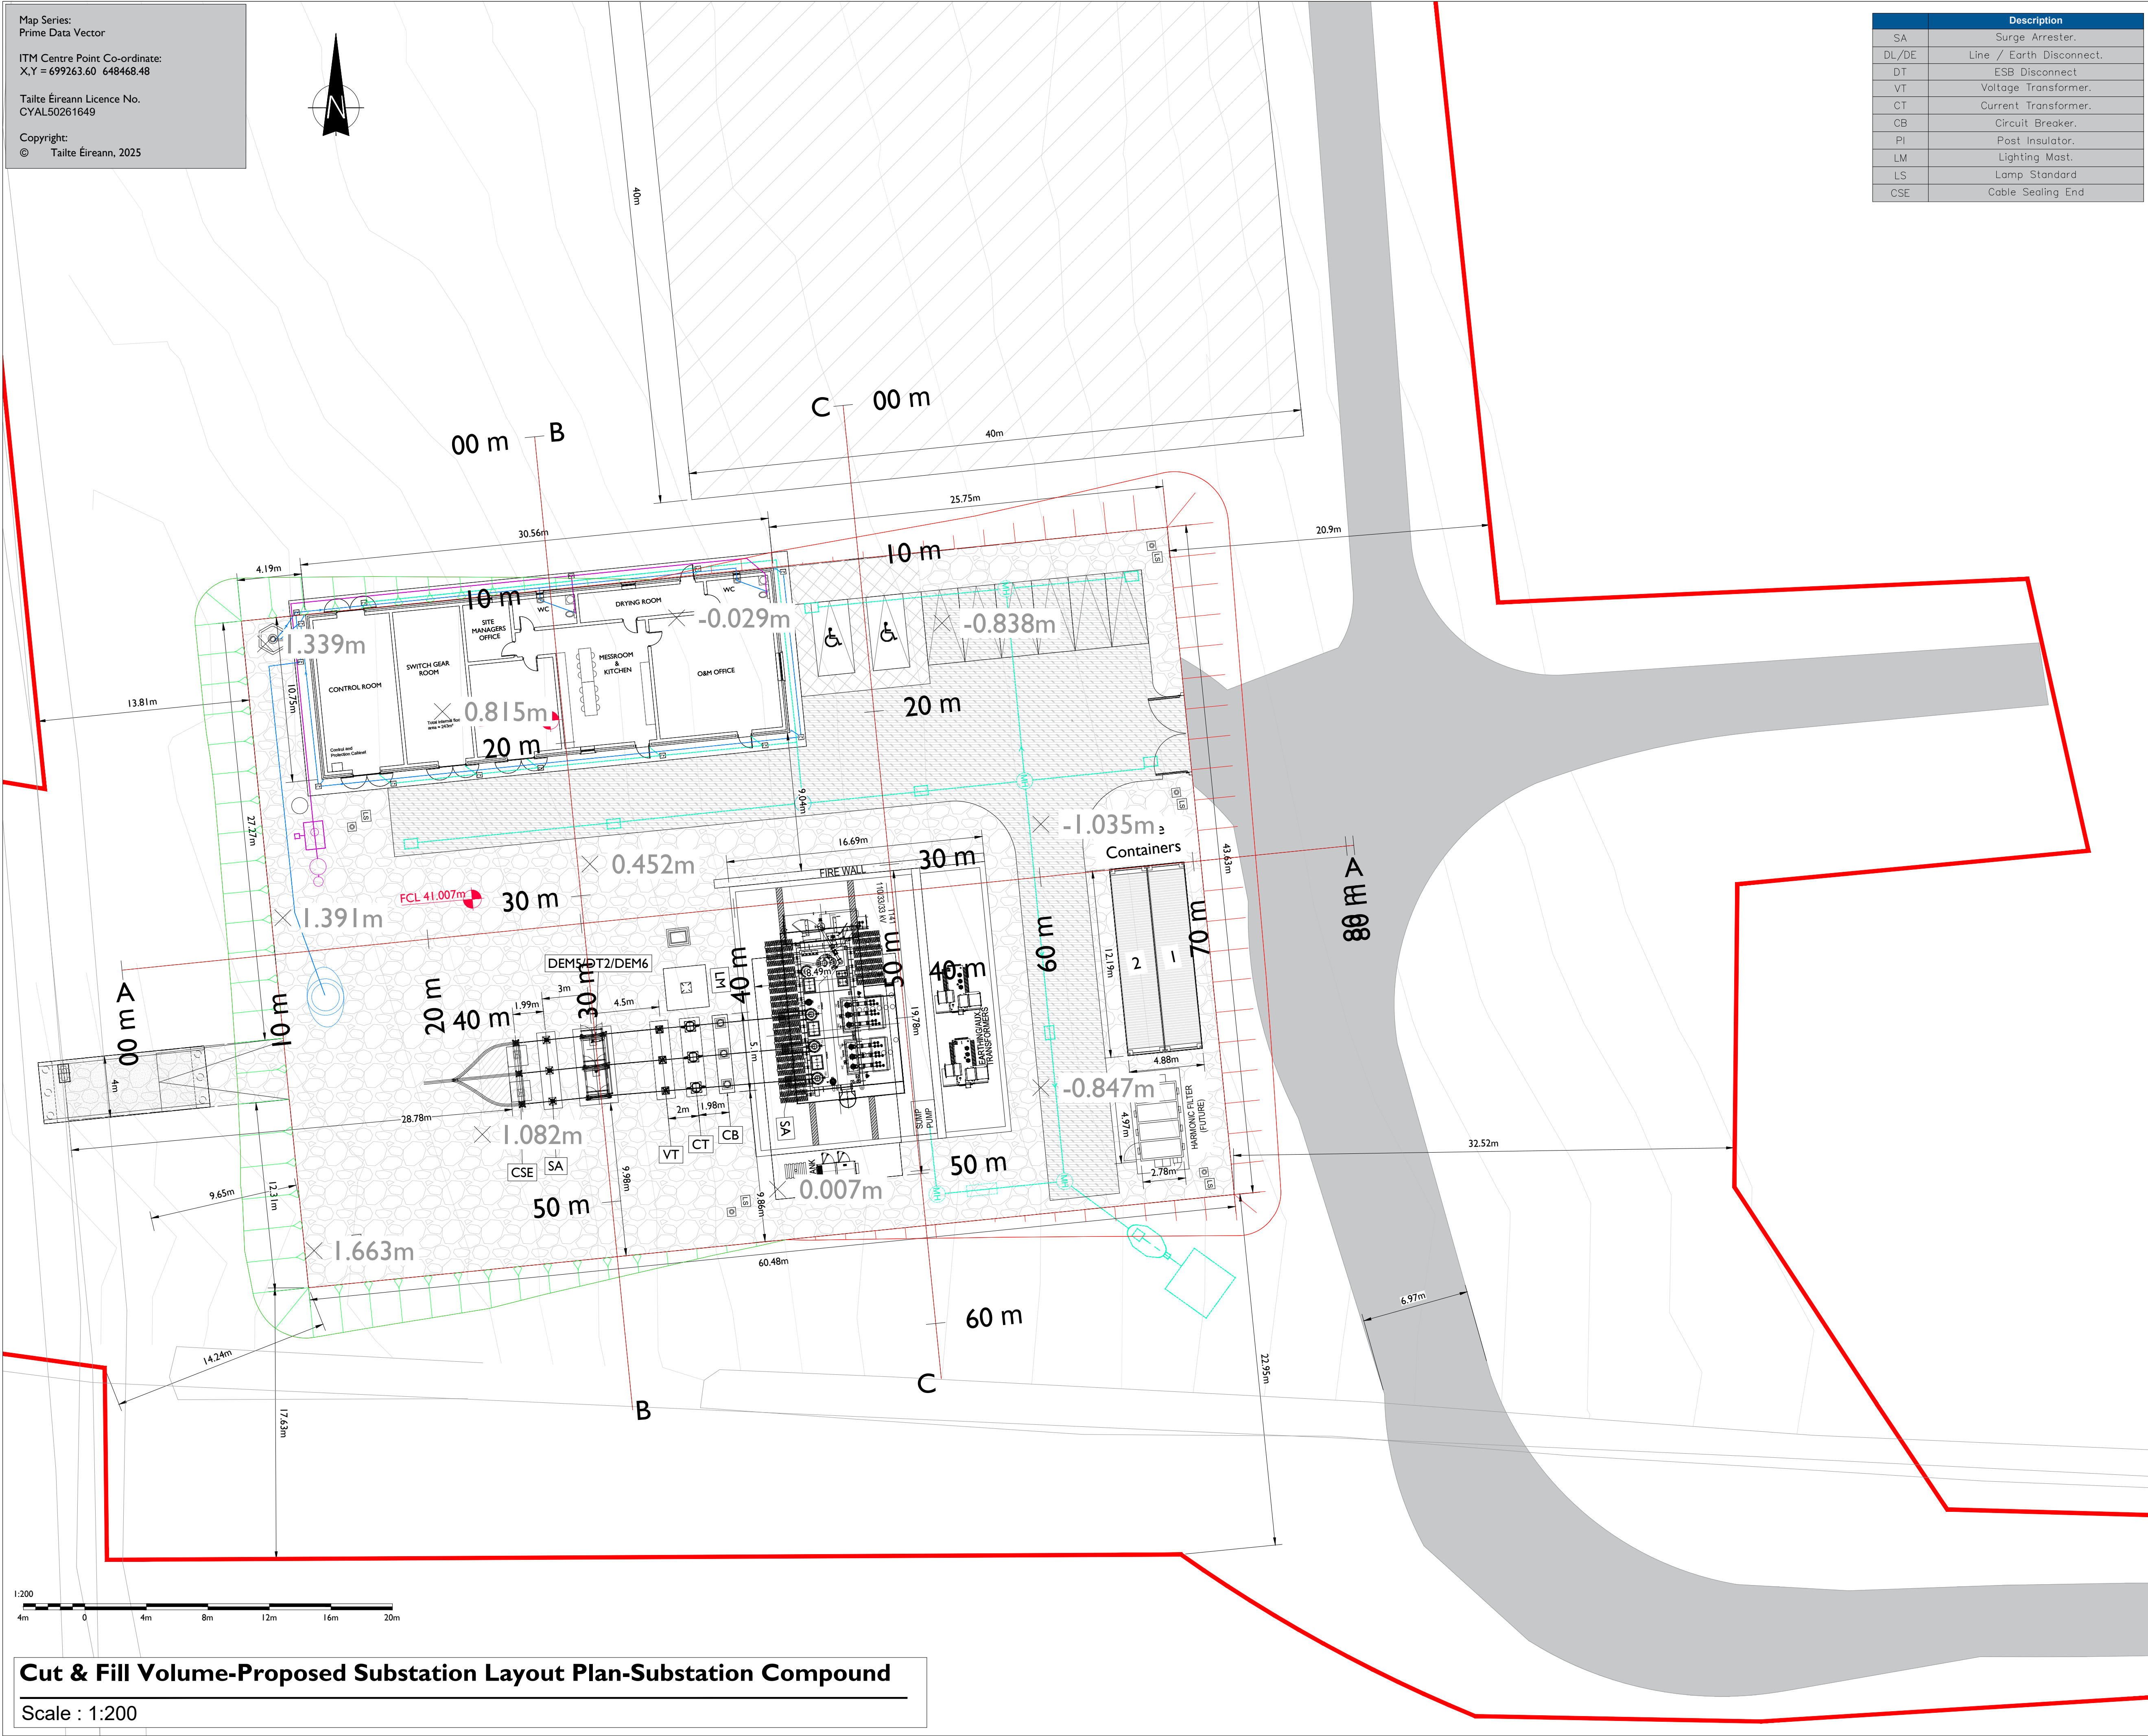

	Description
SA	Surge Arrester.
DL/DE	Line / Earth Disconnect.
DT	ESB Disconnect
VT	Voltage Transformer.
CT	Current Transformer.
CB	Circuit Breaker.
PI	Post Insulator.
LM	Lighting Mast.
LS	Lamp Standard
CSE	Cable Sealing End



Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

Regional Office
Basepoint Business Centre
Stroudley Road, Basingstoke,
Hampshire,
RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

Tincurry 110kV Substation
and Grid Connection

CLIENT

Lodgewood Solar Farm
Limited

CONSULTANTS

TOBIN
CONSULTING ENGINEERS

NOTES: -

LEGEND: -

- Proposed Cut Volume shown thus □
- Proposed Fill Volume shown thus □
- Red Line Planning Boundary shown thus —
- Existing Level shown thus x 239.750m
- Contours — 14.0

ISSUE/REVISION

P3	19.12.25	Issued for Planning
P2	21.11.25	Issued for Planning
P1	05.09.25	Issued for Planning
I/R	DATE	DESCRIPTION

PROJECT NUMBER

300101236

SHEET TITLE

Cut & Fill Volume - Proposed Substation
Layout Plan - Substation Compound
Proposed Amended Infrastructure

SHEET NUMBER

300101236-DR-113

Cut & Fill Volume-Proposed Substation Layout Plan-Substation Compound

Scale : 1:200