


ISO A1 594mm x 841mm

Project Management Initials: Designer: JC Checked: DB Approved: RG




Map Series:
Prime Data Vector


ITM Centre Point Co-ordinate:
X,Y = 699263.60 648468.48

Tailte Éireann Licence No.
CYAL50261649


Copyright:
© Tailte Éireann, 2025

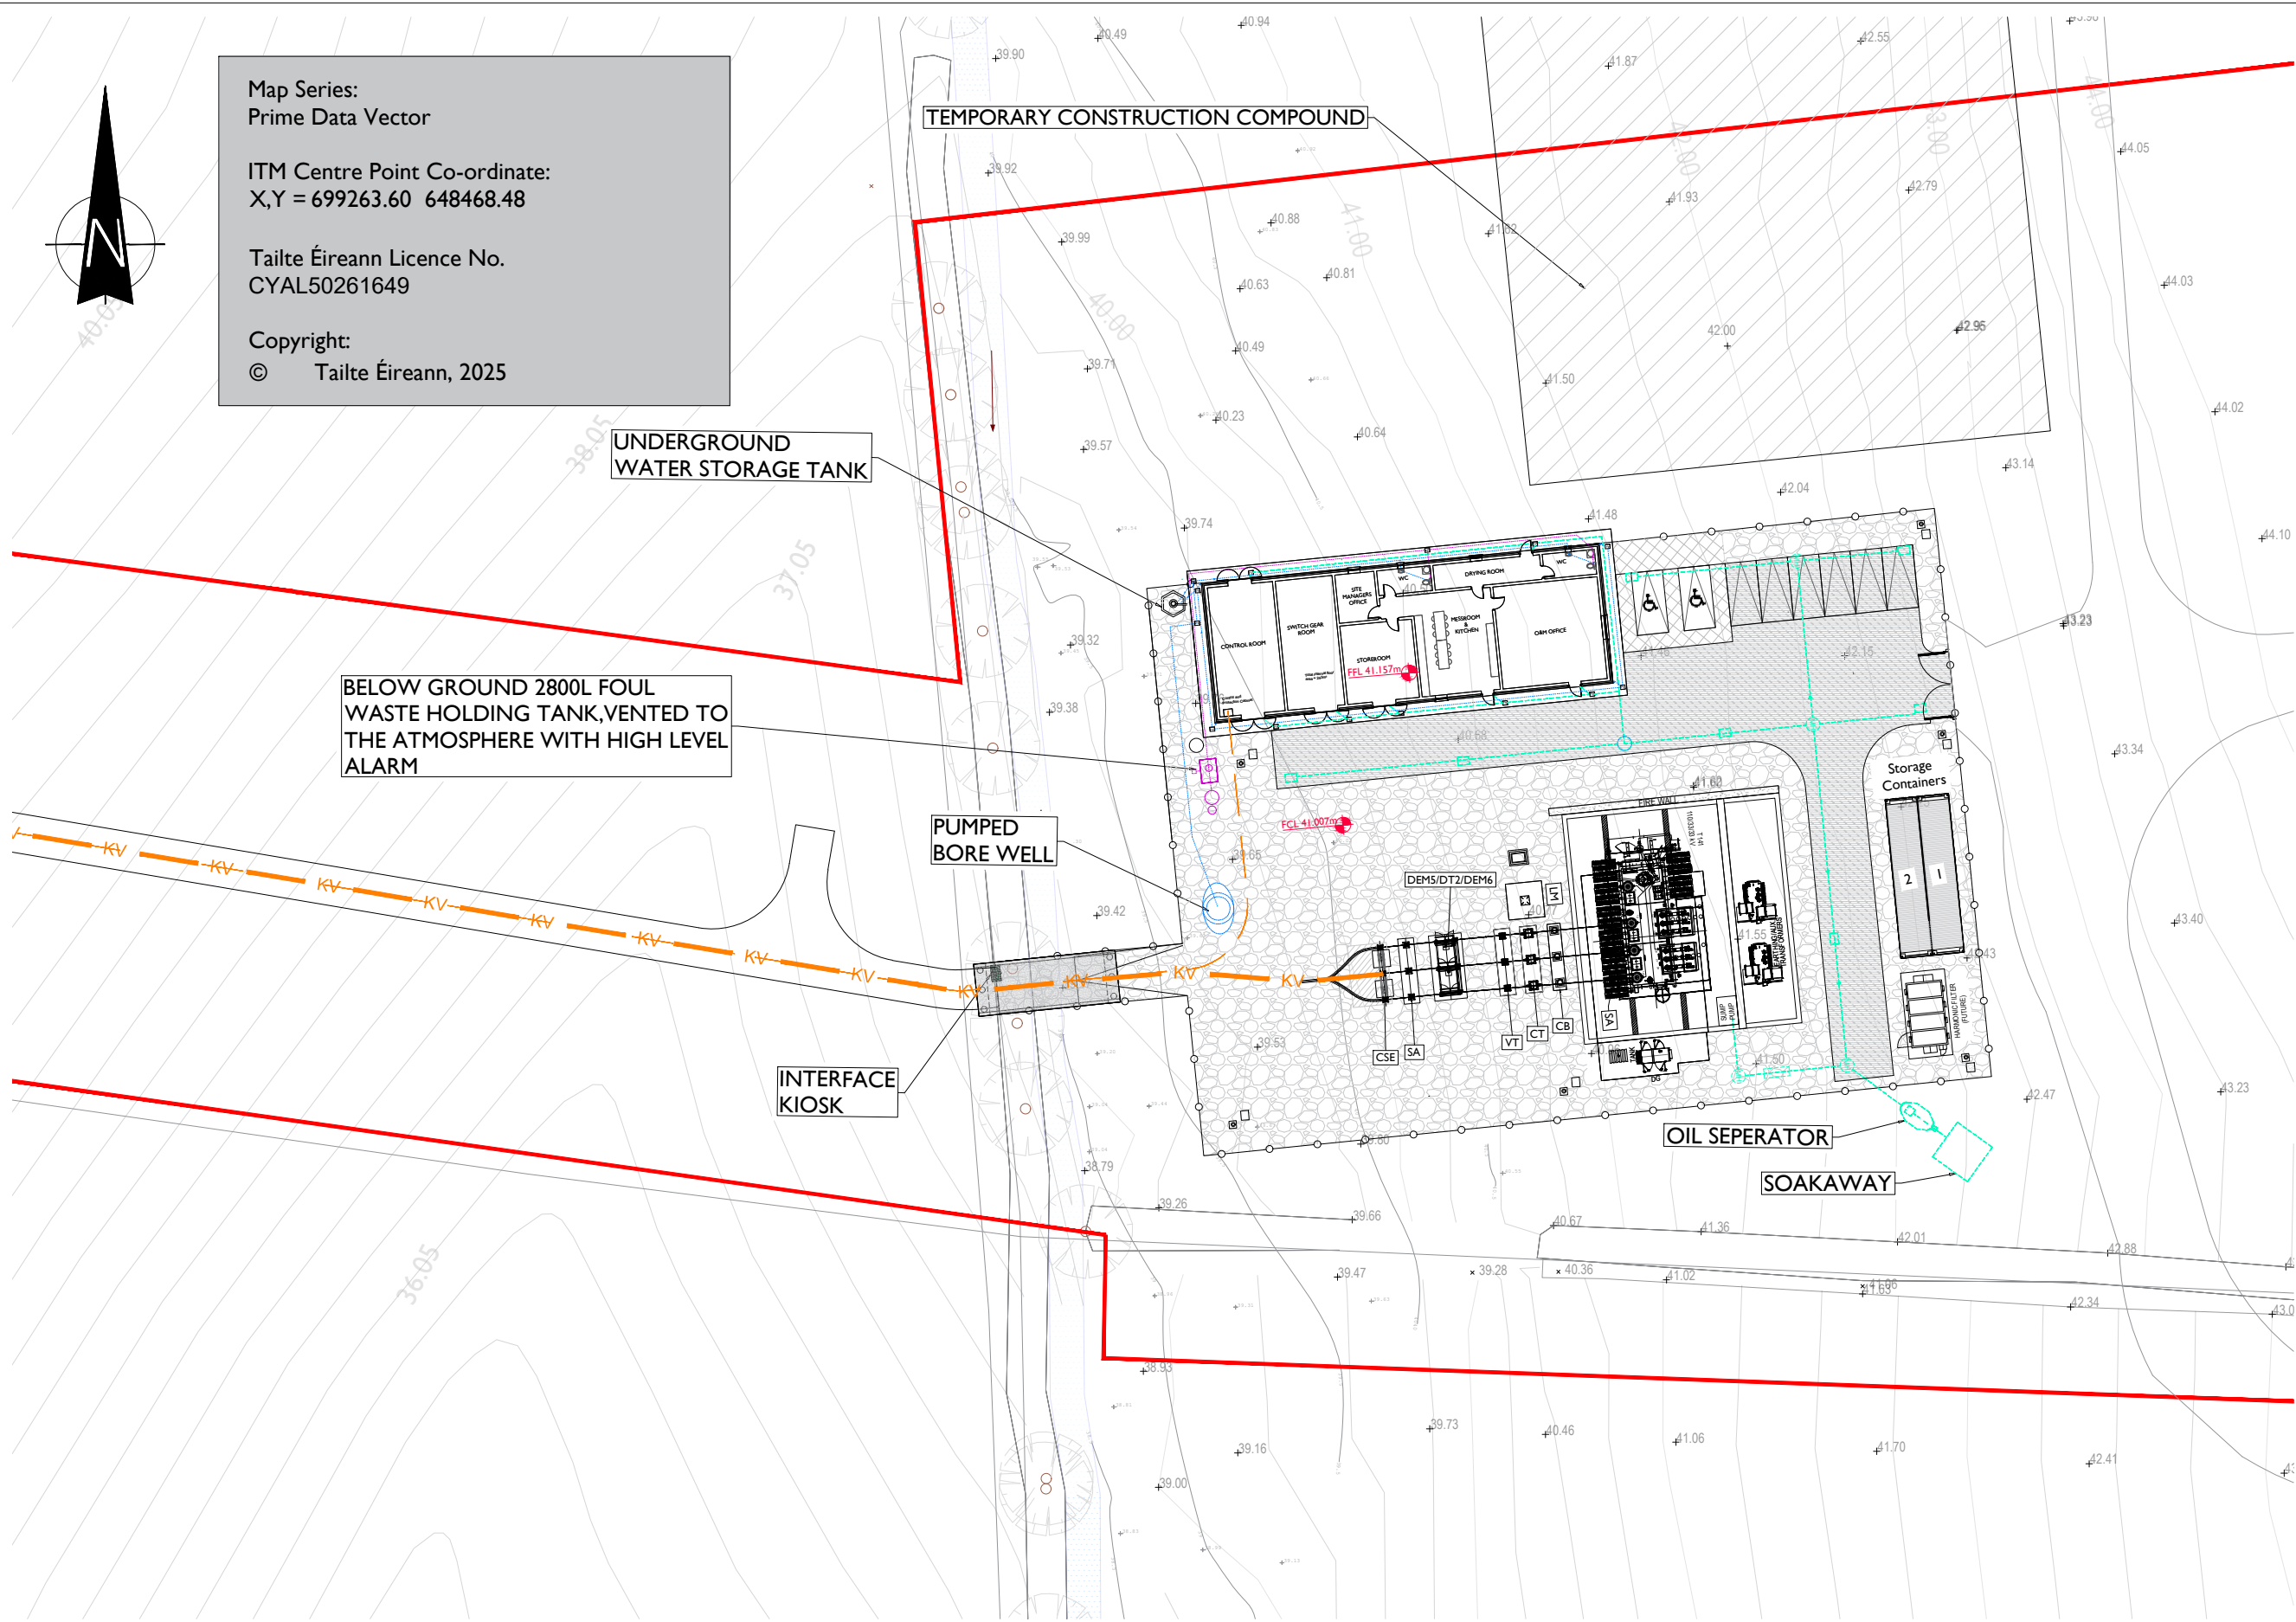


Key Plan
SCALE - 1:500

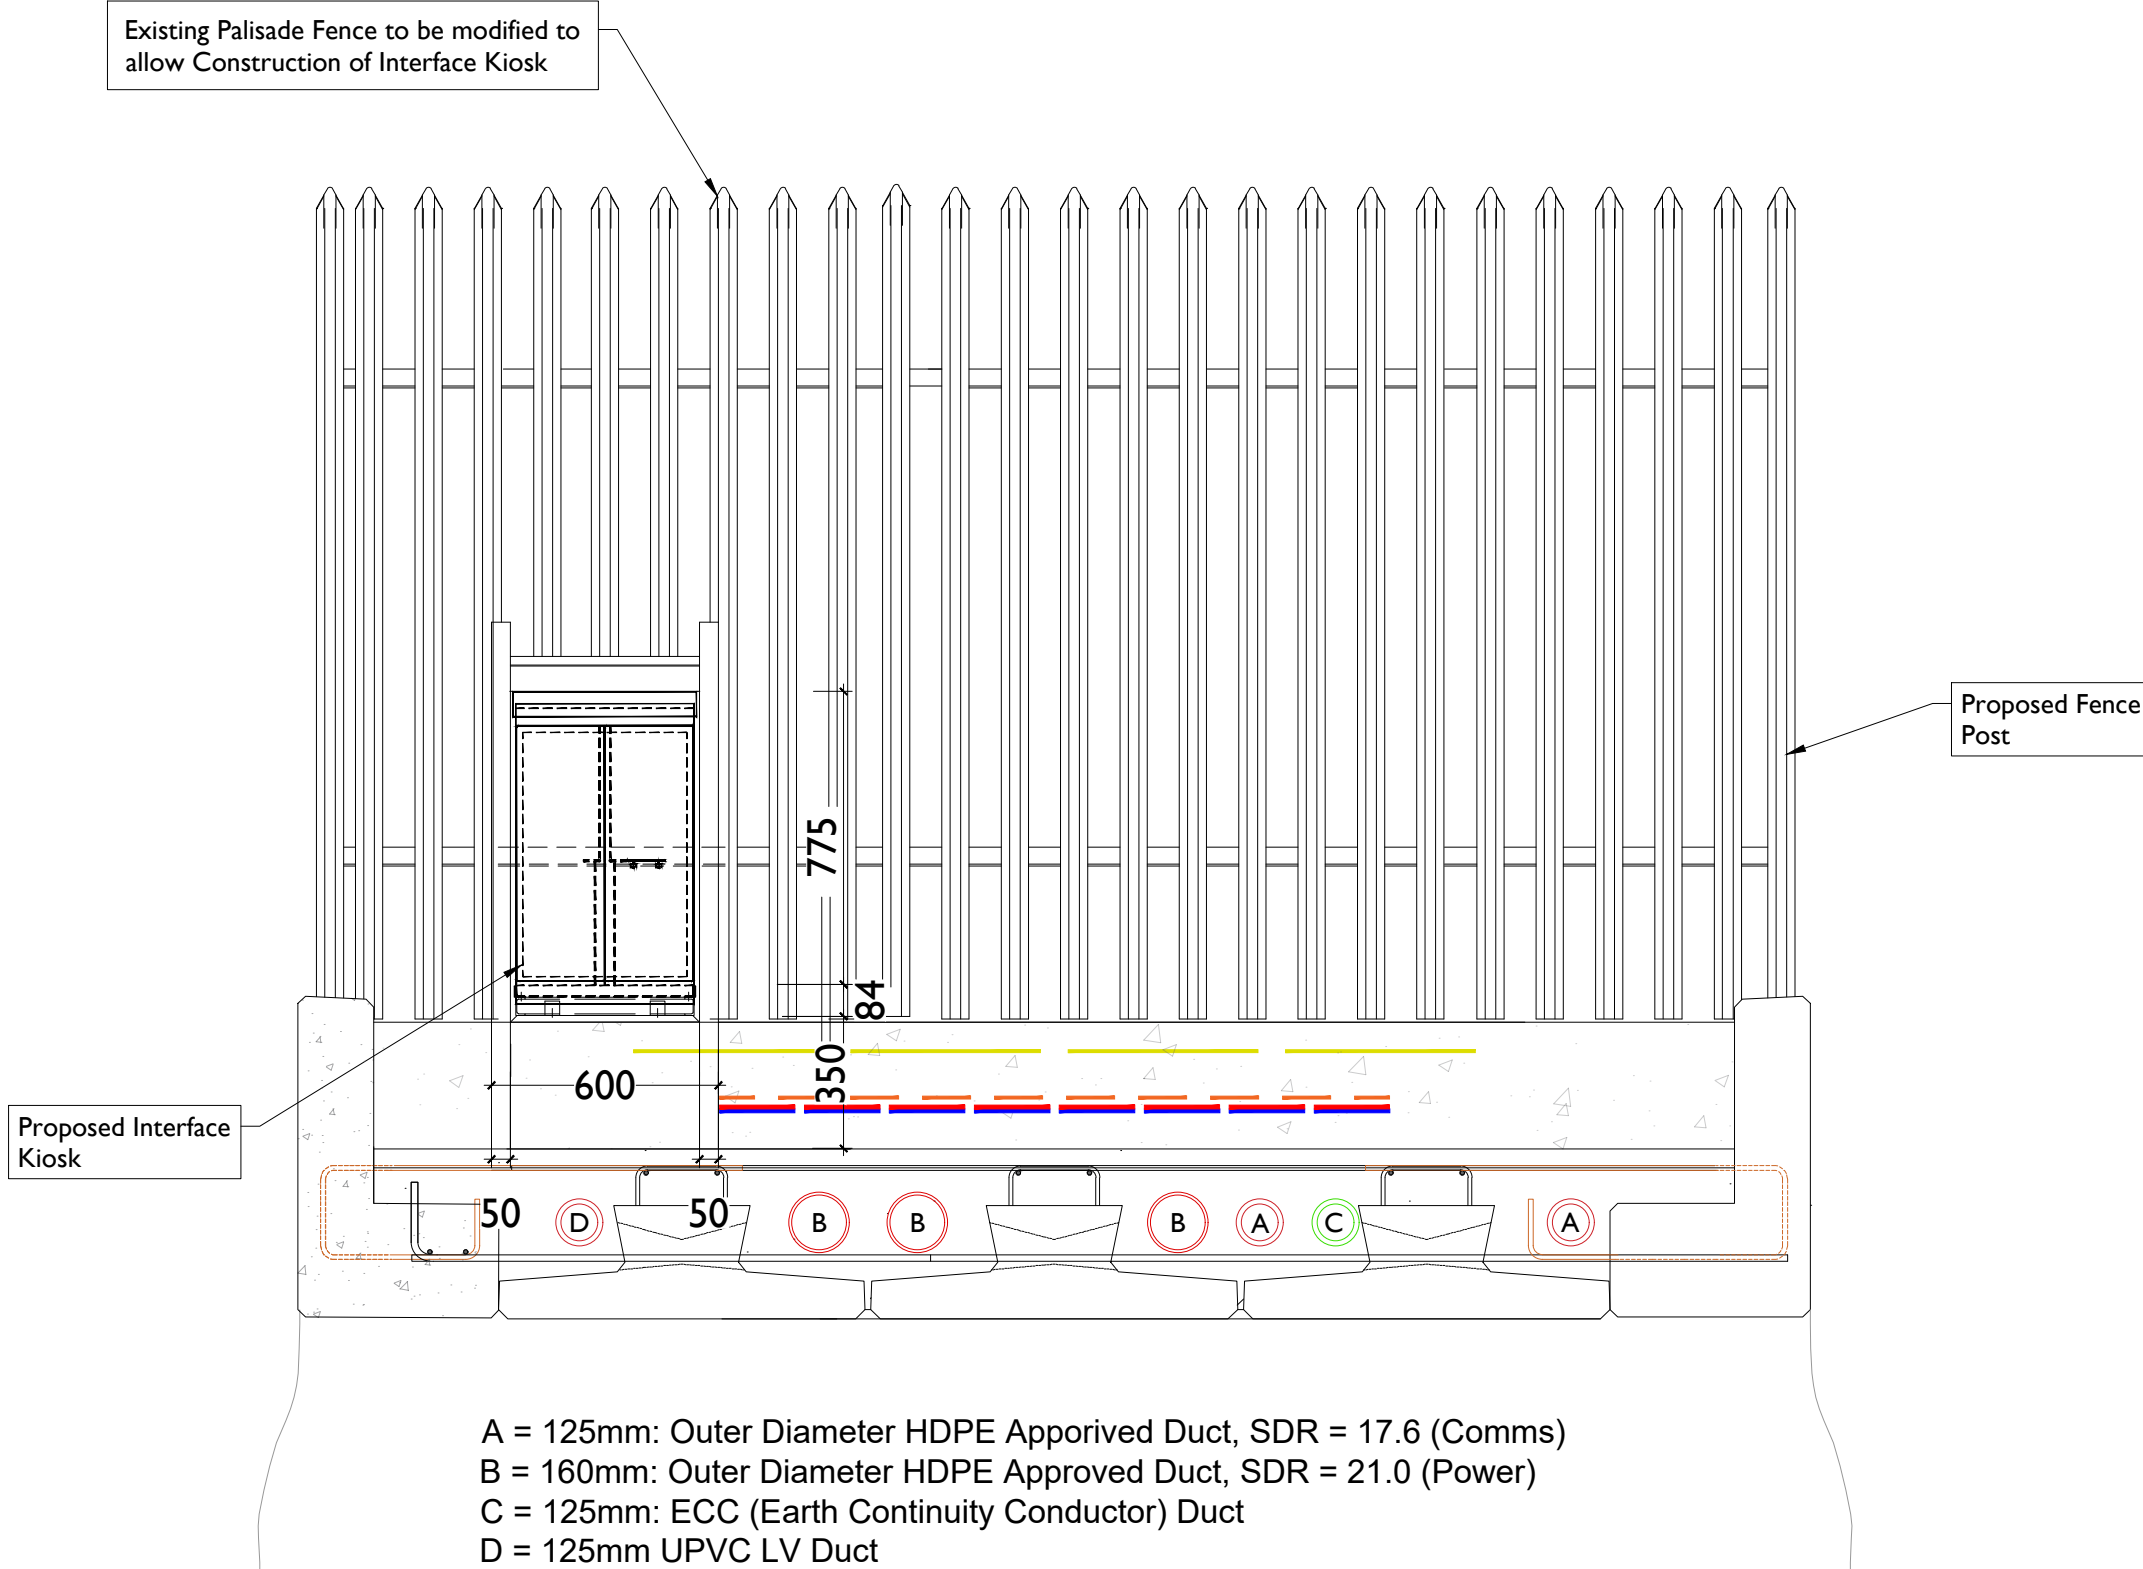

Interface Kiosk - Front & Rear View
SCALE - 1:20

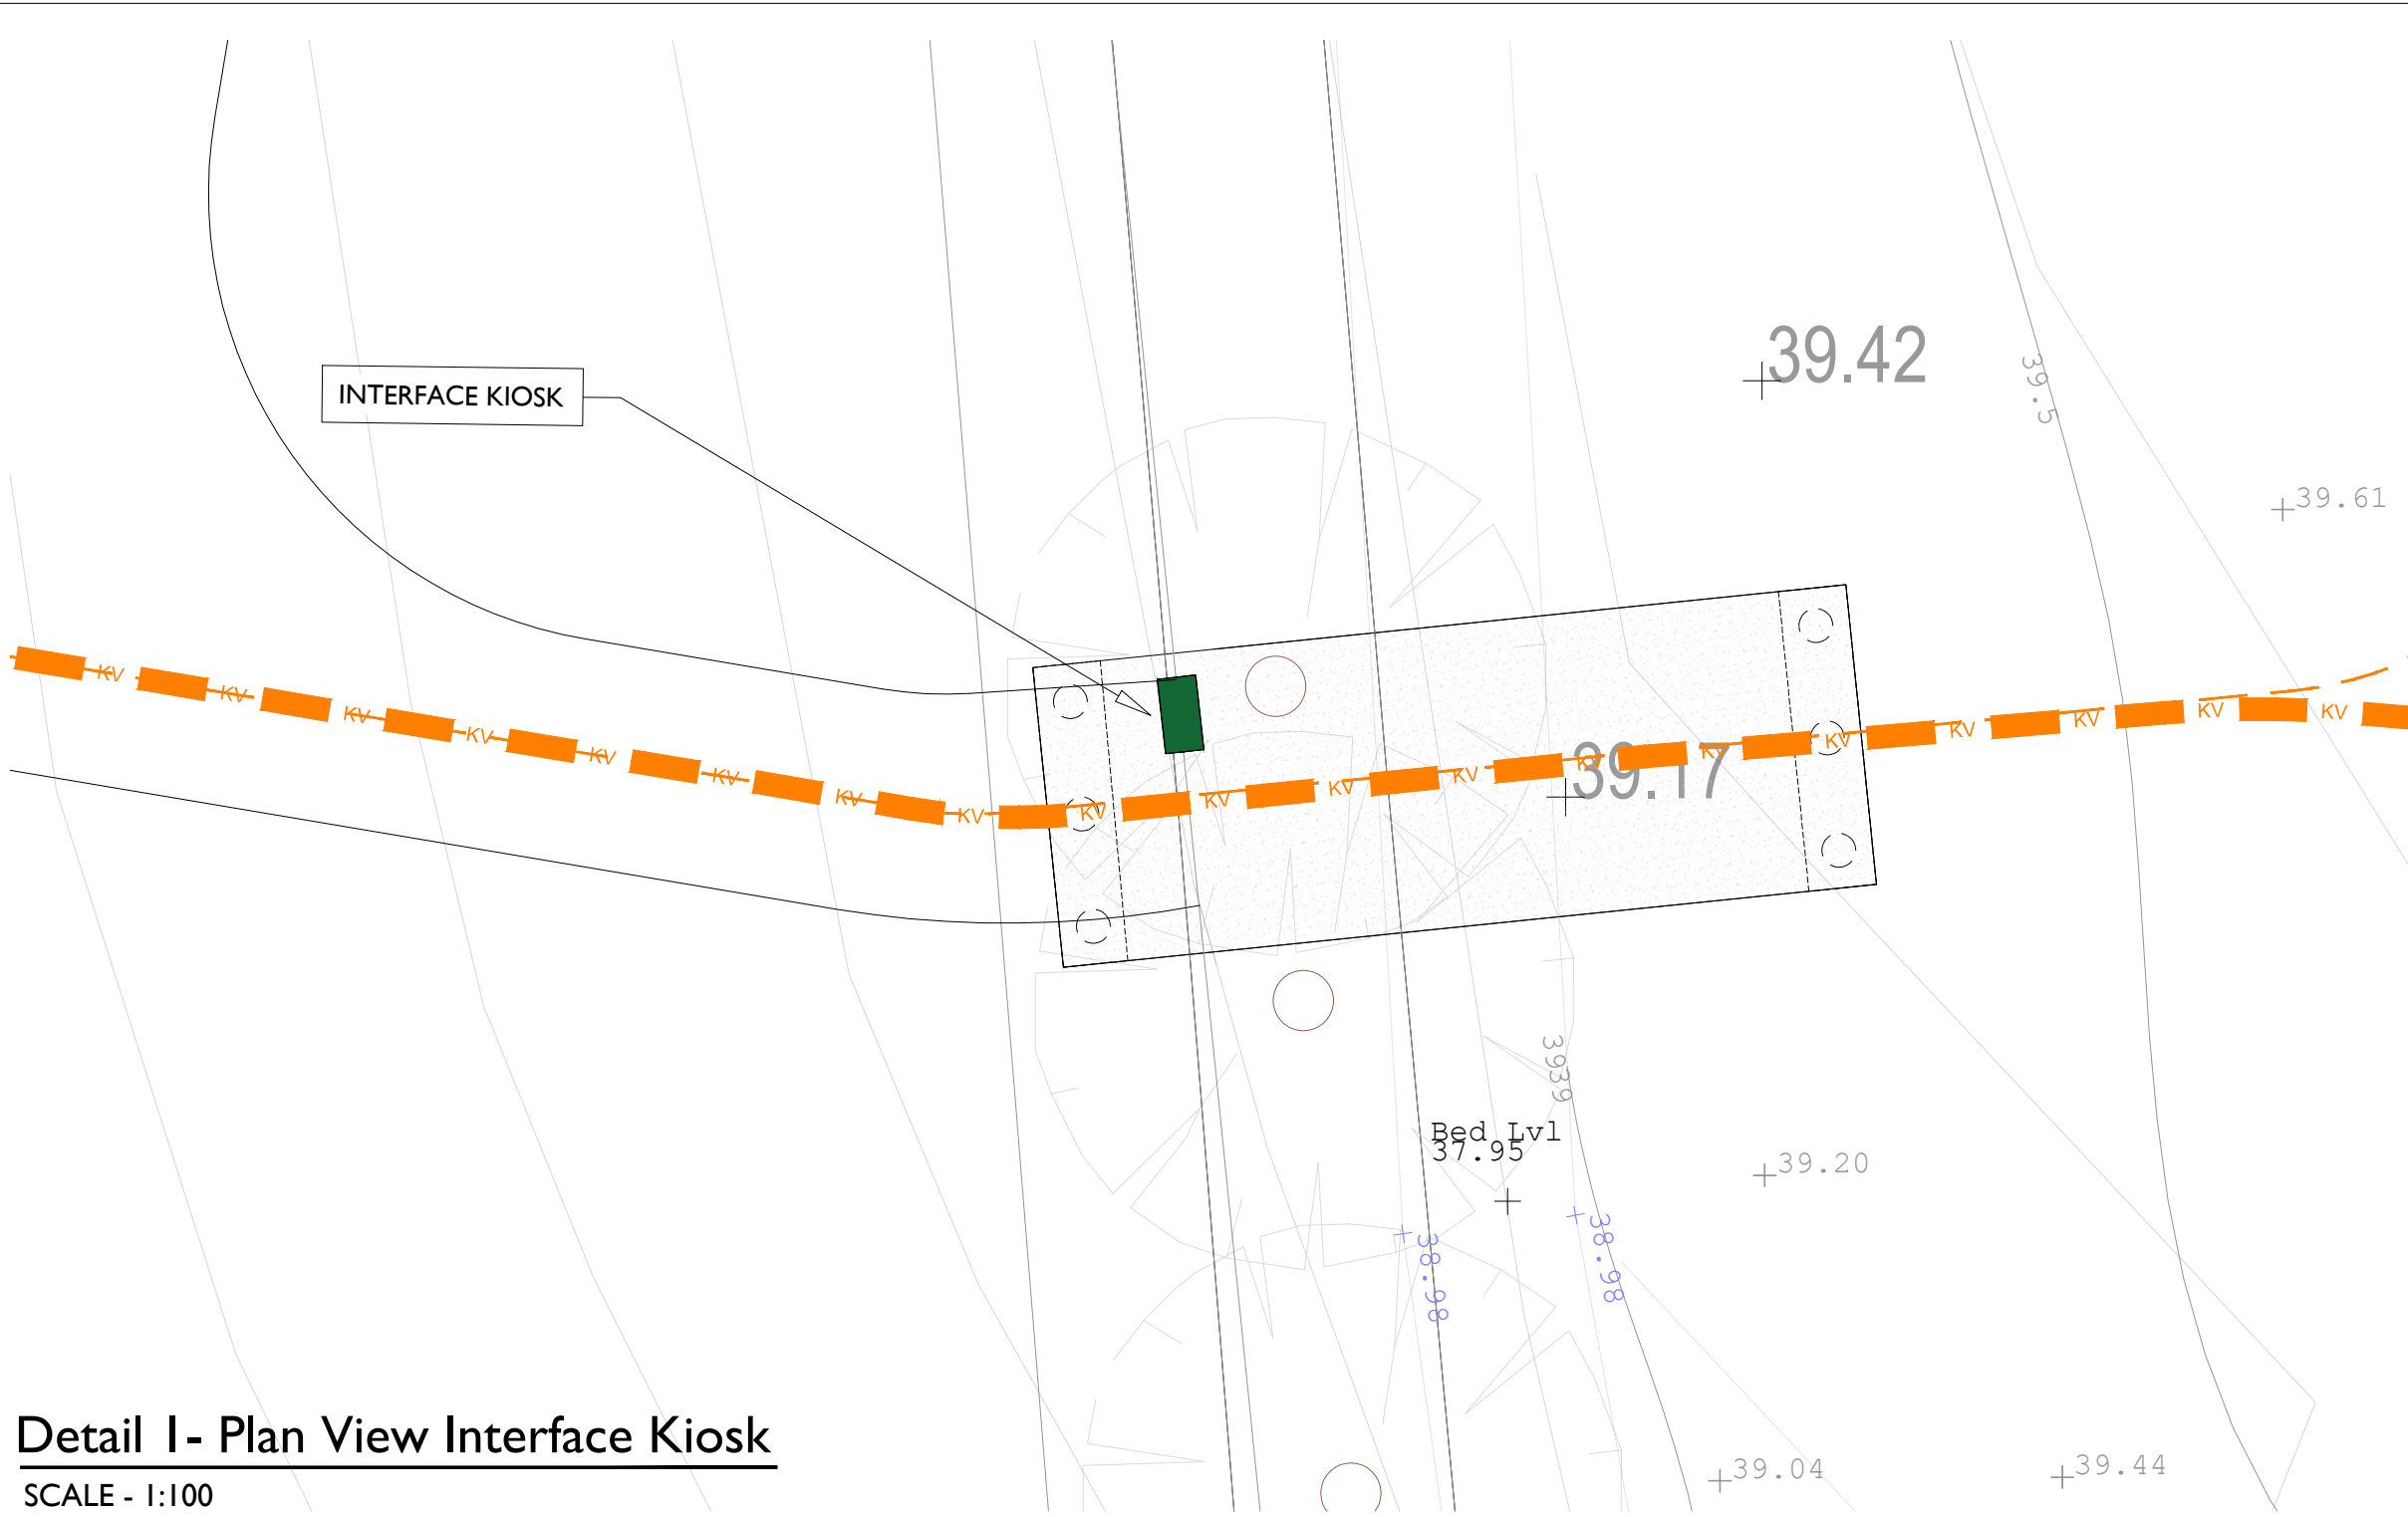

Detail I - Plan View Interface Kiosk
SCALE - 1:100

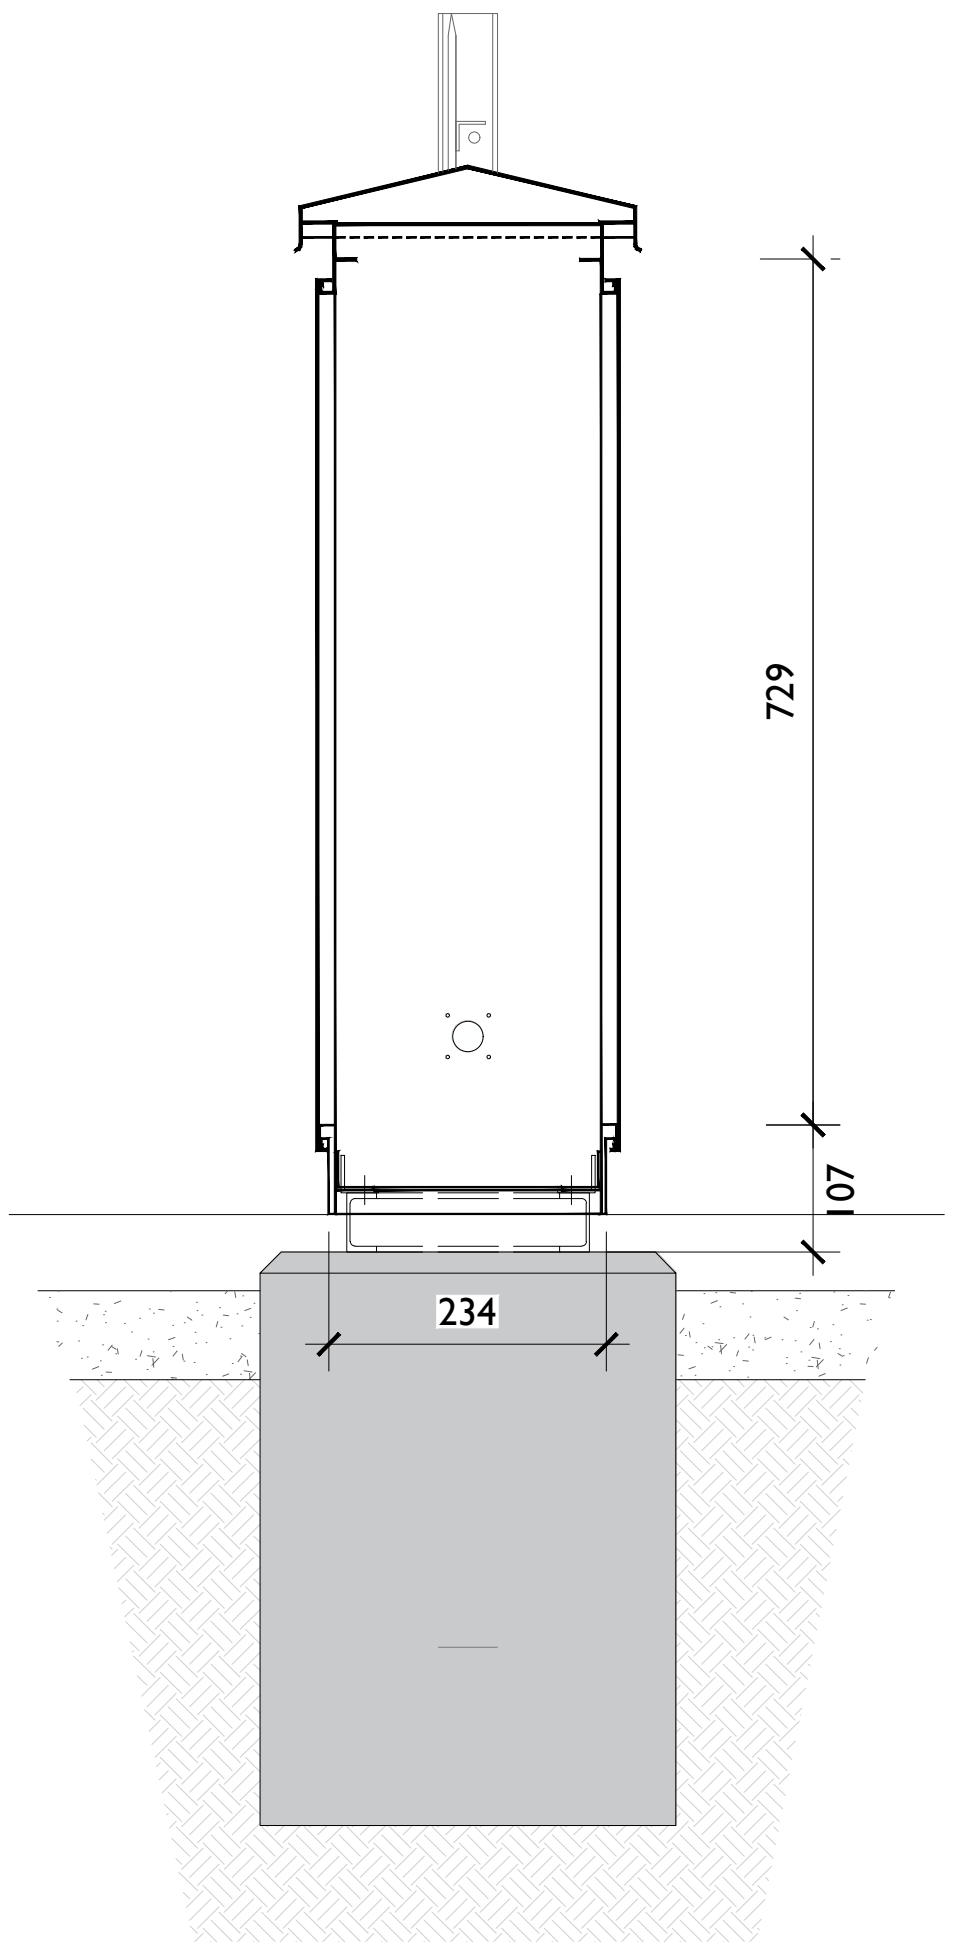

Interface Kiosk - Side View
SCALE - 1:10

EXCAVATION SAFETY NOTES

1. NO EXCAVATIONS TO TAKE PLACE WITHOUT A PERMIT TO EXCAVATE UNDER CMP 13.
2. ALL KNOWN OR SUSPECTED BURIED SERVICES SHALL BE CLEARLY MARKED ON THE GROUND. EXCAVATIONS CLOSE TO BURIED SERVICES SHALL ONLY BE CARRIED OUT BY HAND.
3. PICW TO BE PRESENT DURING ALL EXCAVATIONS SUBJECT TO AGREEMENT WITH ESNB AND COMPLETION OF RISK ASSESSMENT.
4. NO EXCAVATION WORK SHALL COMMENCE UNTIL THE CONTRACTOR HAS CONSULTED UP-TO-DATE SERVICES DRAWINGS AND CARRIED OUT AN ELECTROMAGNETIC LOCATOR (EMI) SCAN.
5. BASED ON A RISK ASSESSMENT OF THE WORKS AREA THE ESNB PICW SHALL CONFIRM THE DWA (DESIGNATED WORK AREA) METHODOLOGY AND ESTABLISH SAME ON SITE IN ADVANCE OF THE WORKS COMMENCING. DETAILS OF ANY REQUIRED DWA SHALL BE CAPTURED IN AN ELECTRICAL INTERFACE AGREEMENT, PRODUCED BY ESNB AND AGREED WITH THE CONTRACTOR, AND COMMUNICATED AS PART OF A SITE SPECIFIC INDUCTION BY ESNB PRE START UP OR IN A BRIEFING DURING THE WORKS SHOULD THE DWA CHANGE.



Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

Regional Office
Basepoint Business Centre
Stroudley Road, Basingstoke,
Hampshire,
RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

**Tincurry 110kV Substation
and Grid Connection**

CLIENT

**Lodgewood Solar Farm
Limited**

CONSULTANTS

NOTES: -

- This drawing is to be read in conjunction with relevant drawings, specifications and reports
- Dimensions are in millimetres, unless noted otherwise
- Drawings are not to be scaled use figured dimensions only

LEGEND: -

- Proposed UGC Grid Connection Route (0.221km) — KV —
- Proposed Control and Protection Cable Route (0.232km) — — —
- Planning Boundary shown thus — — —
- Proposed Interface Kiosk ■

ISSUE/REVISION

P3	19.12.25	Issued for Planning
P2	21.11.25	Issued for Planning
P1	05.09.25	Issued for Approval
I/R	DATE	DESCRIPTION

PROJECT NUMBER

300-101236

SHEET TITLE

Interface Kiosk & Fencing Proposed
Amended Infrastructure

SHEET NUMBER

300101236-DR-117