


ISO A2 420mm x 594mm

Project Management Initials: Designer: EIM Checked: JC Approved: DB

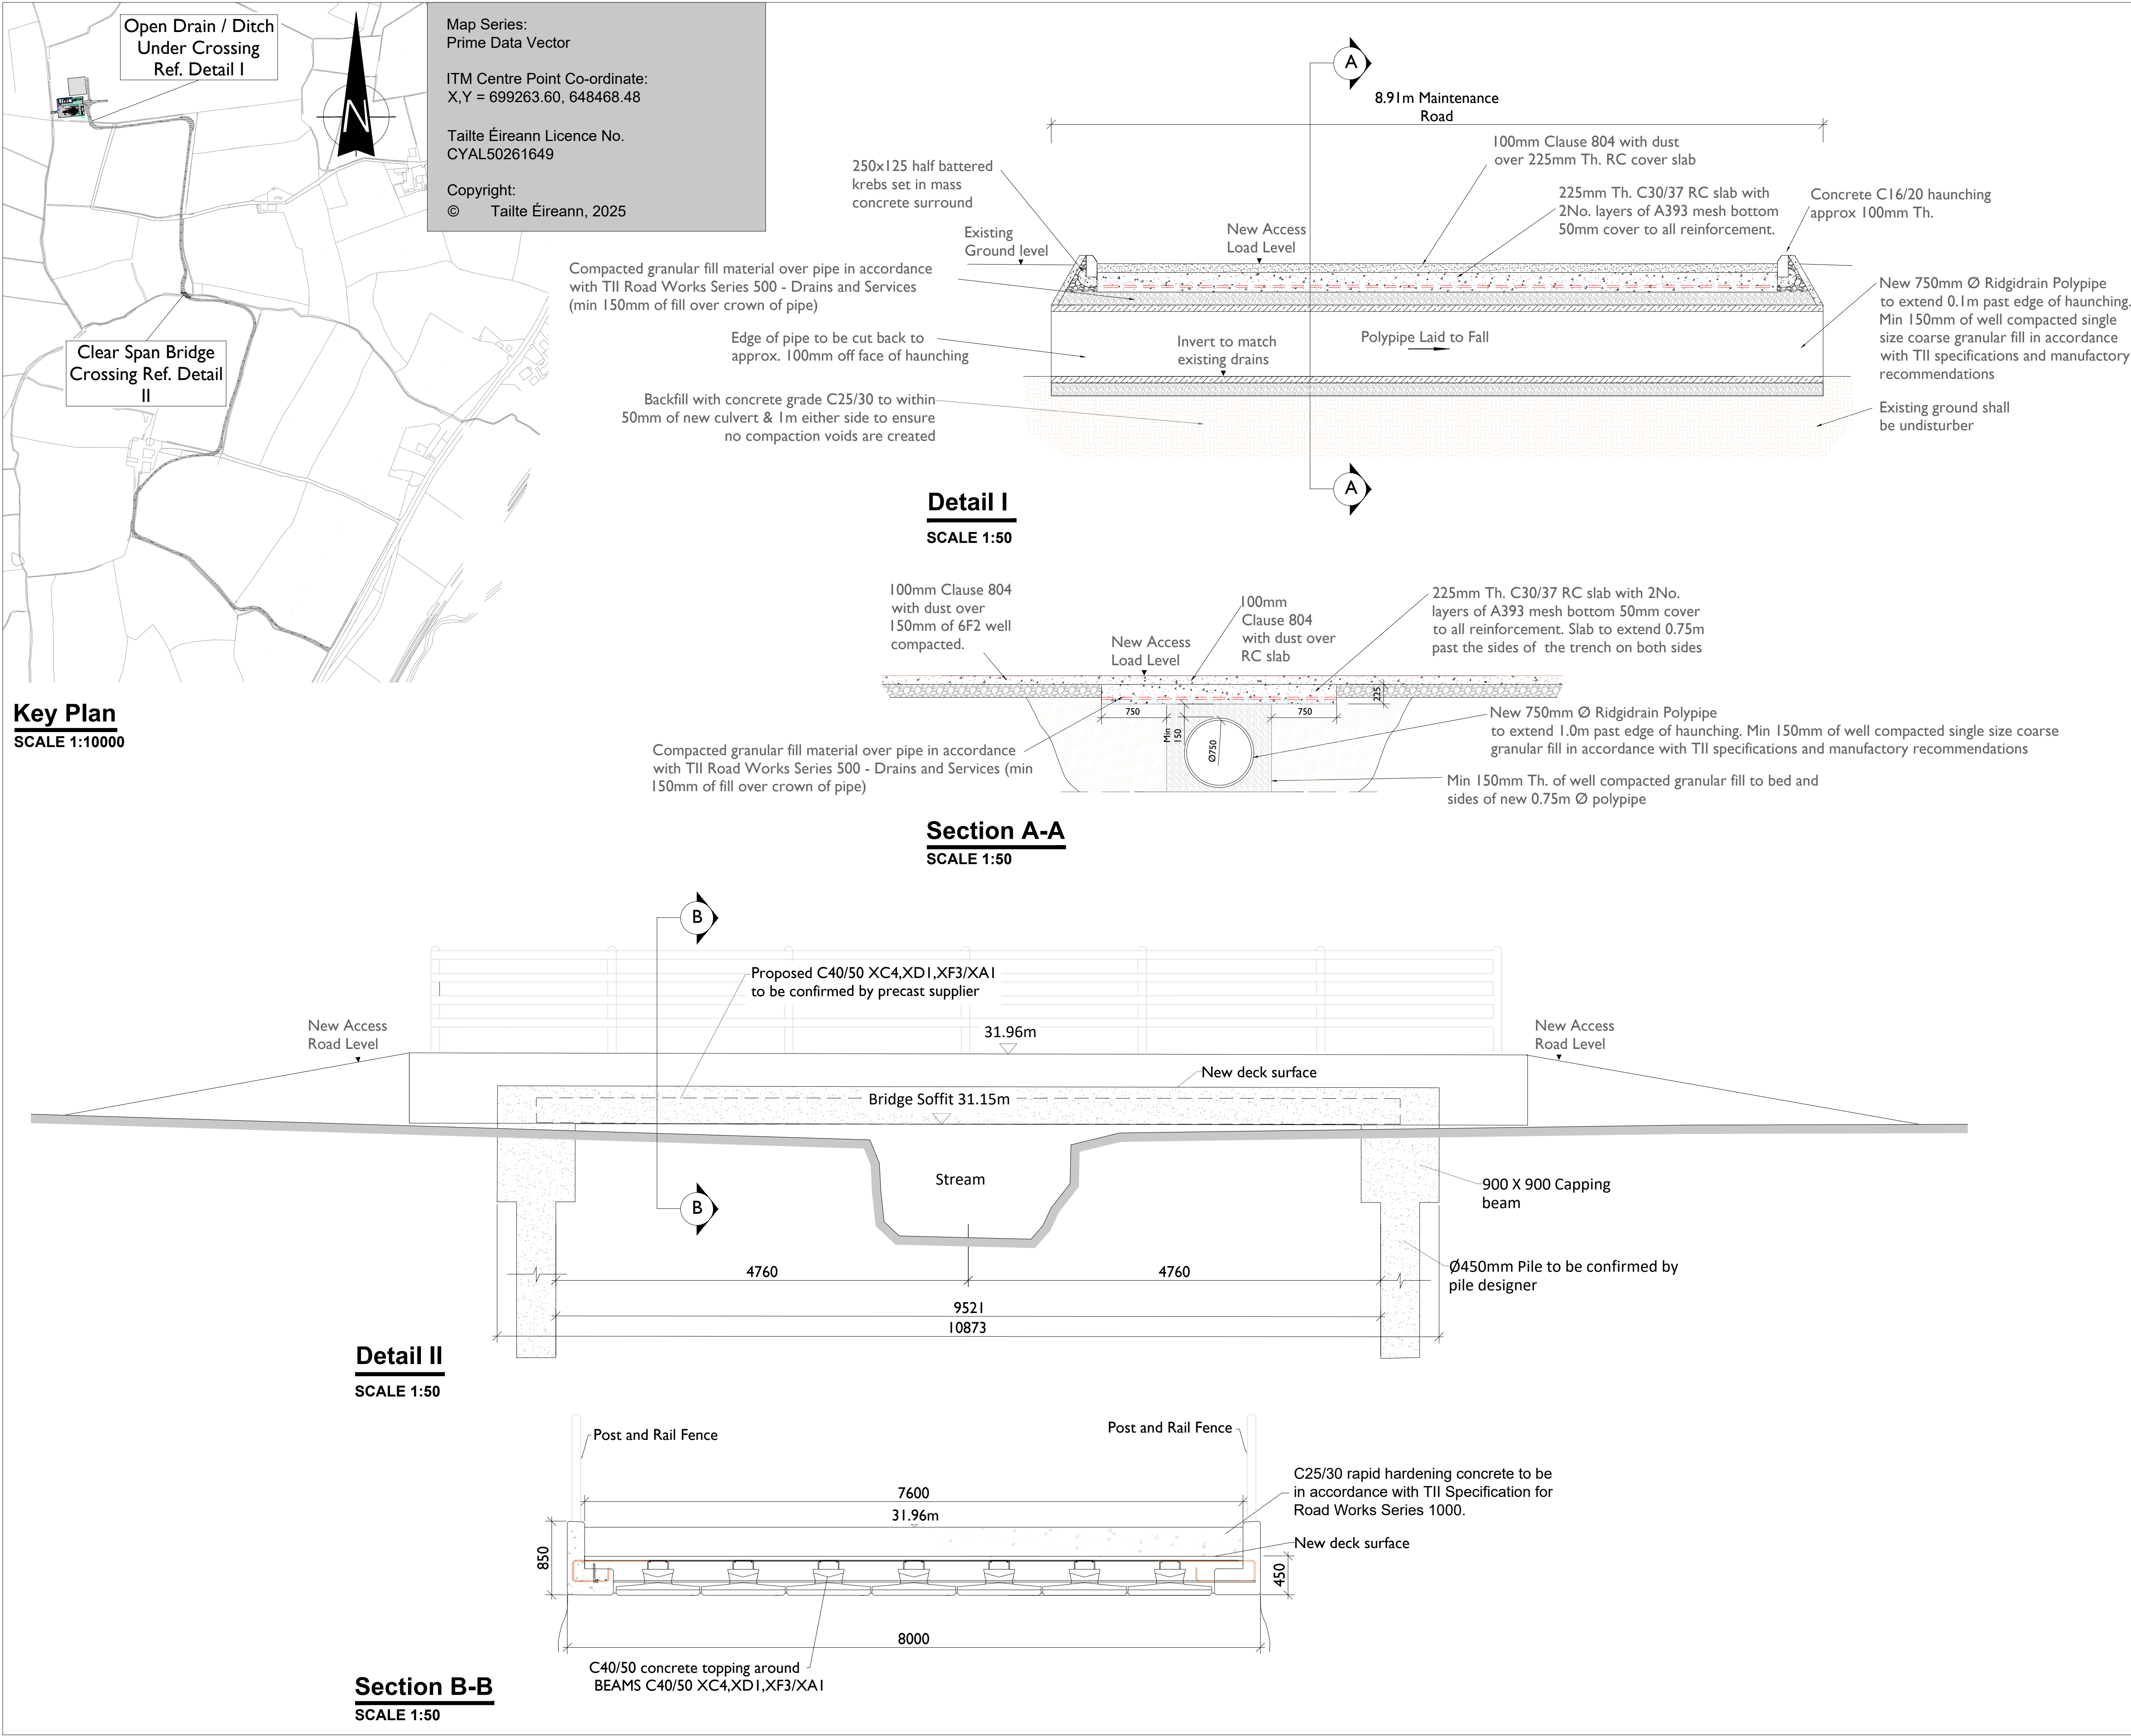

Head Office
Beenreigh, Abbeydorney,
Tralee, Co. Kerry, Ireland
Tel: 00353 66 7135710

PROJECT

Tincurry 110kV Substation and Grid Connection

CLIENT

Lodgewood Solar Farm Limited

CONSULTANTS

NOTES: -

- No structural surveys have been carried out and the proposals are subject to detailed design.
- Crossings are in compliance with EirGrid specification requirements for shallow formation, min depth, etc.
- Additional culverts may be encountered on the route.

LEGEND: -

ISSUE/REVISION		
P3	08.01.26	Issued for Planning
P2	19.12.25	Issued for Planning
P1	21.11.25	Issued for Planning
I/R	DATE	DESCRIPTION

PROJECT NUMBER

300-101236

SHEET TITLE

Drain Crossing Details

SHEET NUMBER

300101236-DR-119