


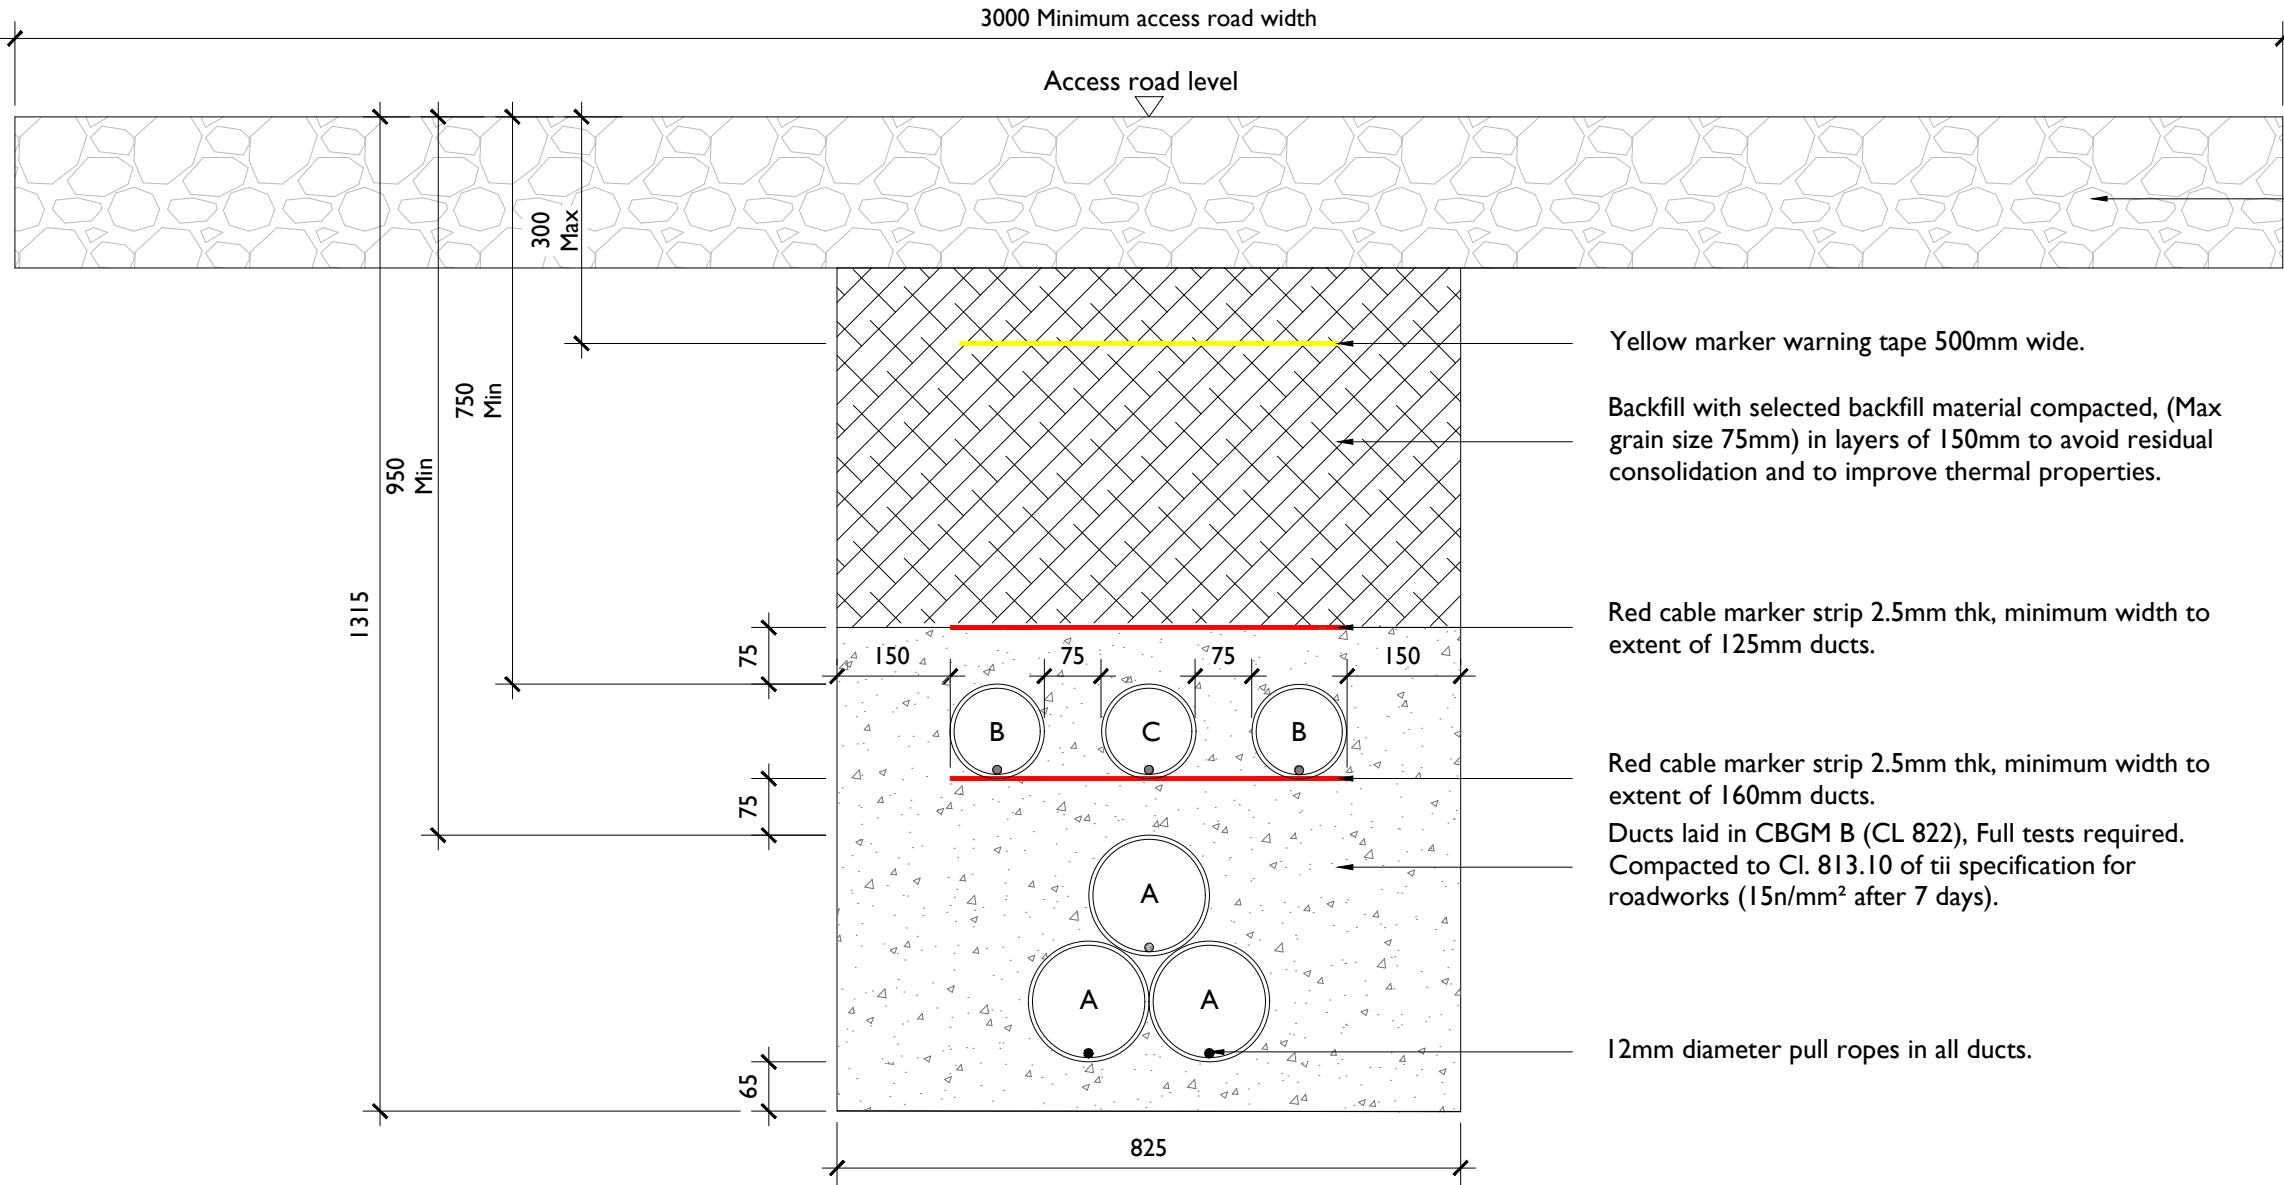

A = 160mm: Outer Diameter HDPE ESB Approved Duct, SDR=21 (Power) [ESB Code: 9317552]
B = 125mm: Outer Diameter HDPE ESB Approved Duct, SDR=17.6 (Comms) [ESB Code: 9317552]
C = 125mm: Outer Diameter HDPE ESB Approved Duct, SDR=17.6 (ECC) [ESB Code: 9317552]

Typical Section Through Off Road Section

Scale 1:10

- Note:
- This drawing is subject to EirGrid design approval and should not be used for construction.
 - This drawing is to be read in conjunction with relevant drawings, specifications and reports.
 - Dimensions are in millimeters, unless noted otherwise.
 - Drawings are not to be scaled use figured dimensions only.
 - Access road design to be confirmed as part of detailed design.
 - No change from permitted development ABP. Ref. 317706

PROGRESS PRINT
NOT FOR CONSTRUCTION
02.03.2026

**ALL REINSTATEMENT WORKS ARE TO BE IN ACCORDANCE
WITH LANDOWNER REQUIREMENTS**



Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

CLIENT



PROJECT

Ballinrea 110kV Grid Route
SI46B Alteration Application

PROJECT NUMBER
300 - 101179

SHEET NUMBER
300101179-DR-807

SHEET TITLE

110kV Ducting Through Access Track
With ECC

DRAWING STATUS
For Planning Amendment

ISSUE/REVISION

I/R	DATE	DESCRIPTION
P3	02.03.26	Issued For Planning Amendment
P2	25.02.26	Issued For Planning Amendment
P1	12.12.25	Issued For Planning Amendment