Reinstate Ground to Landowner Requirements

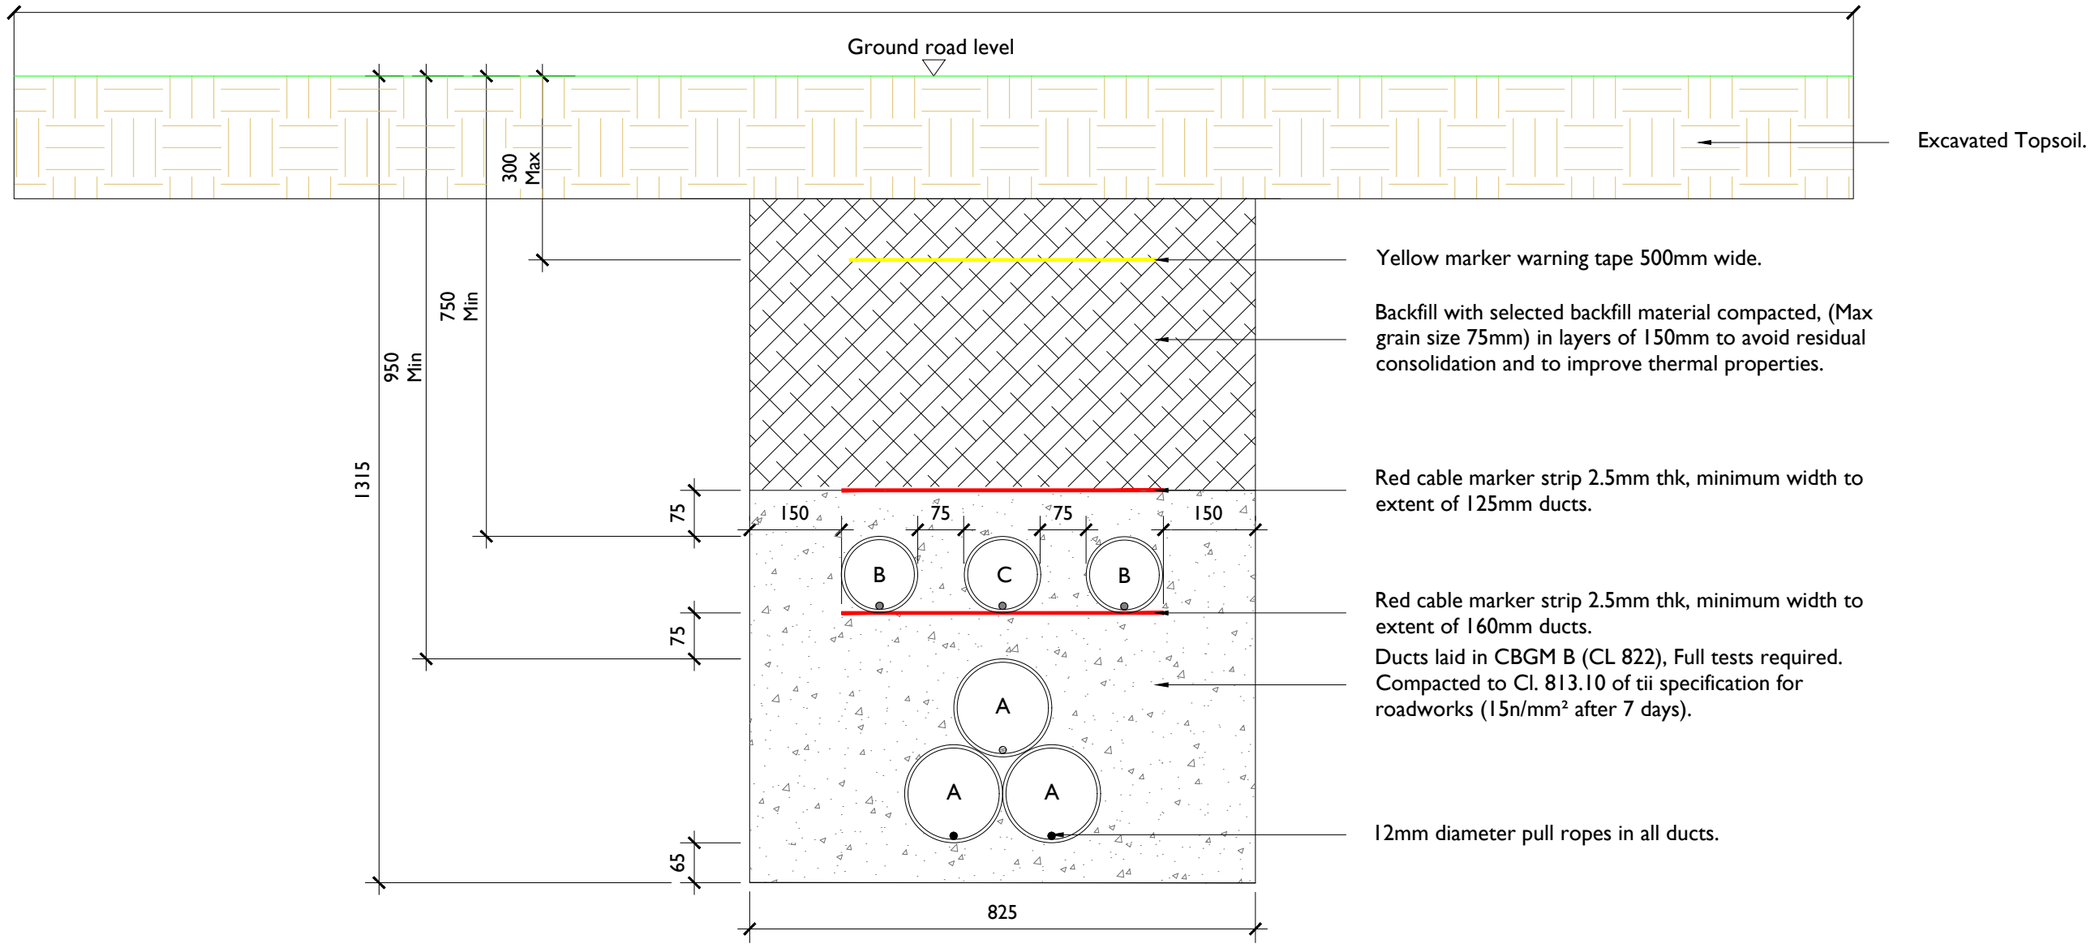

A = 160mm: Outer Diameter HDPE ESB Approved Duct, SDR=21 (Power) [ESB Code: 9317552]
B = 125mm: Outer Diameter HDPE ESB Approved Duct, SDR=17.6 (Comms) [ESB Code: 9317552]
C = 125mm: Outer Diameter HDPE ESB Approved Duct, SDR=17.6 (ECC) [ESB Code: 9317552]

Typical Section Through Off Road Section

Scale 1:10

Note:
- This drawing is subject to EirGrid design approval and should not be used for construction.
- This drawing is to be read in conjunction with relevant drawings, specifications and reports.
- Dimensions are in millimeters, unless noted otherwise.
- Drawings are not to be scaled use figured dimensions only.
- Access road design to be confirmed as part of detailed design.
- No change from permitted development ABP. Ref. 317706

PROGRESS PRINT
NOT FOR CONSTRUCTION
02.03.2026

ALL REINSTATEMENT WORKS ARE TO BE IN ACCORDANCE WITH LANDOWNER REQUIREMENTS

tli GROUP
Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

CLIENT
kirby engineering & construction

PROJECT
Ballinrea 110kV Grid Route
S146B Alteration Application

PROJECT NUMBER
300 - 101179

SHEET NUMBER
300101179-DR-808

SHEET TITLE
110kV Trench through Off Road Sections - ECC

DRAWING STATUS
For Planning Amendment

ISSUE/REVISION

I/R	DATE	DESCRIPTION
P3	02.03.26	Issued For Planning Amendment
P2	25.02.26	Issued For Planning Amendment
P1	12.12.25	Issued For Planning Amendment