



ISO A2 420mm x 594mm

Project Management Initials: Designer: POS Checked: ER Approved: DB


ALL REINSTATEMENT WORKS ARE TO BE IN ACCORDANCE WITH LOCAL AREA ENGINEERS REQUIREMENTS AND GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS

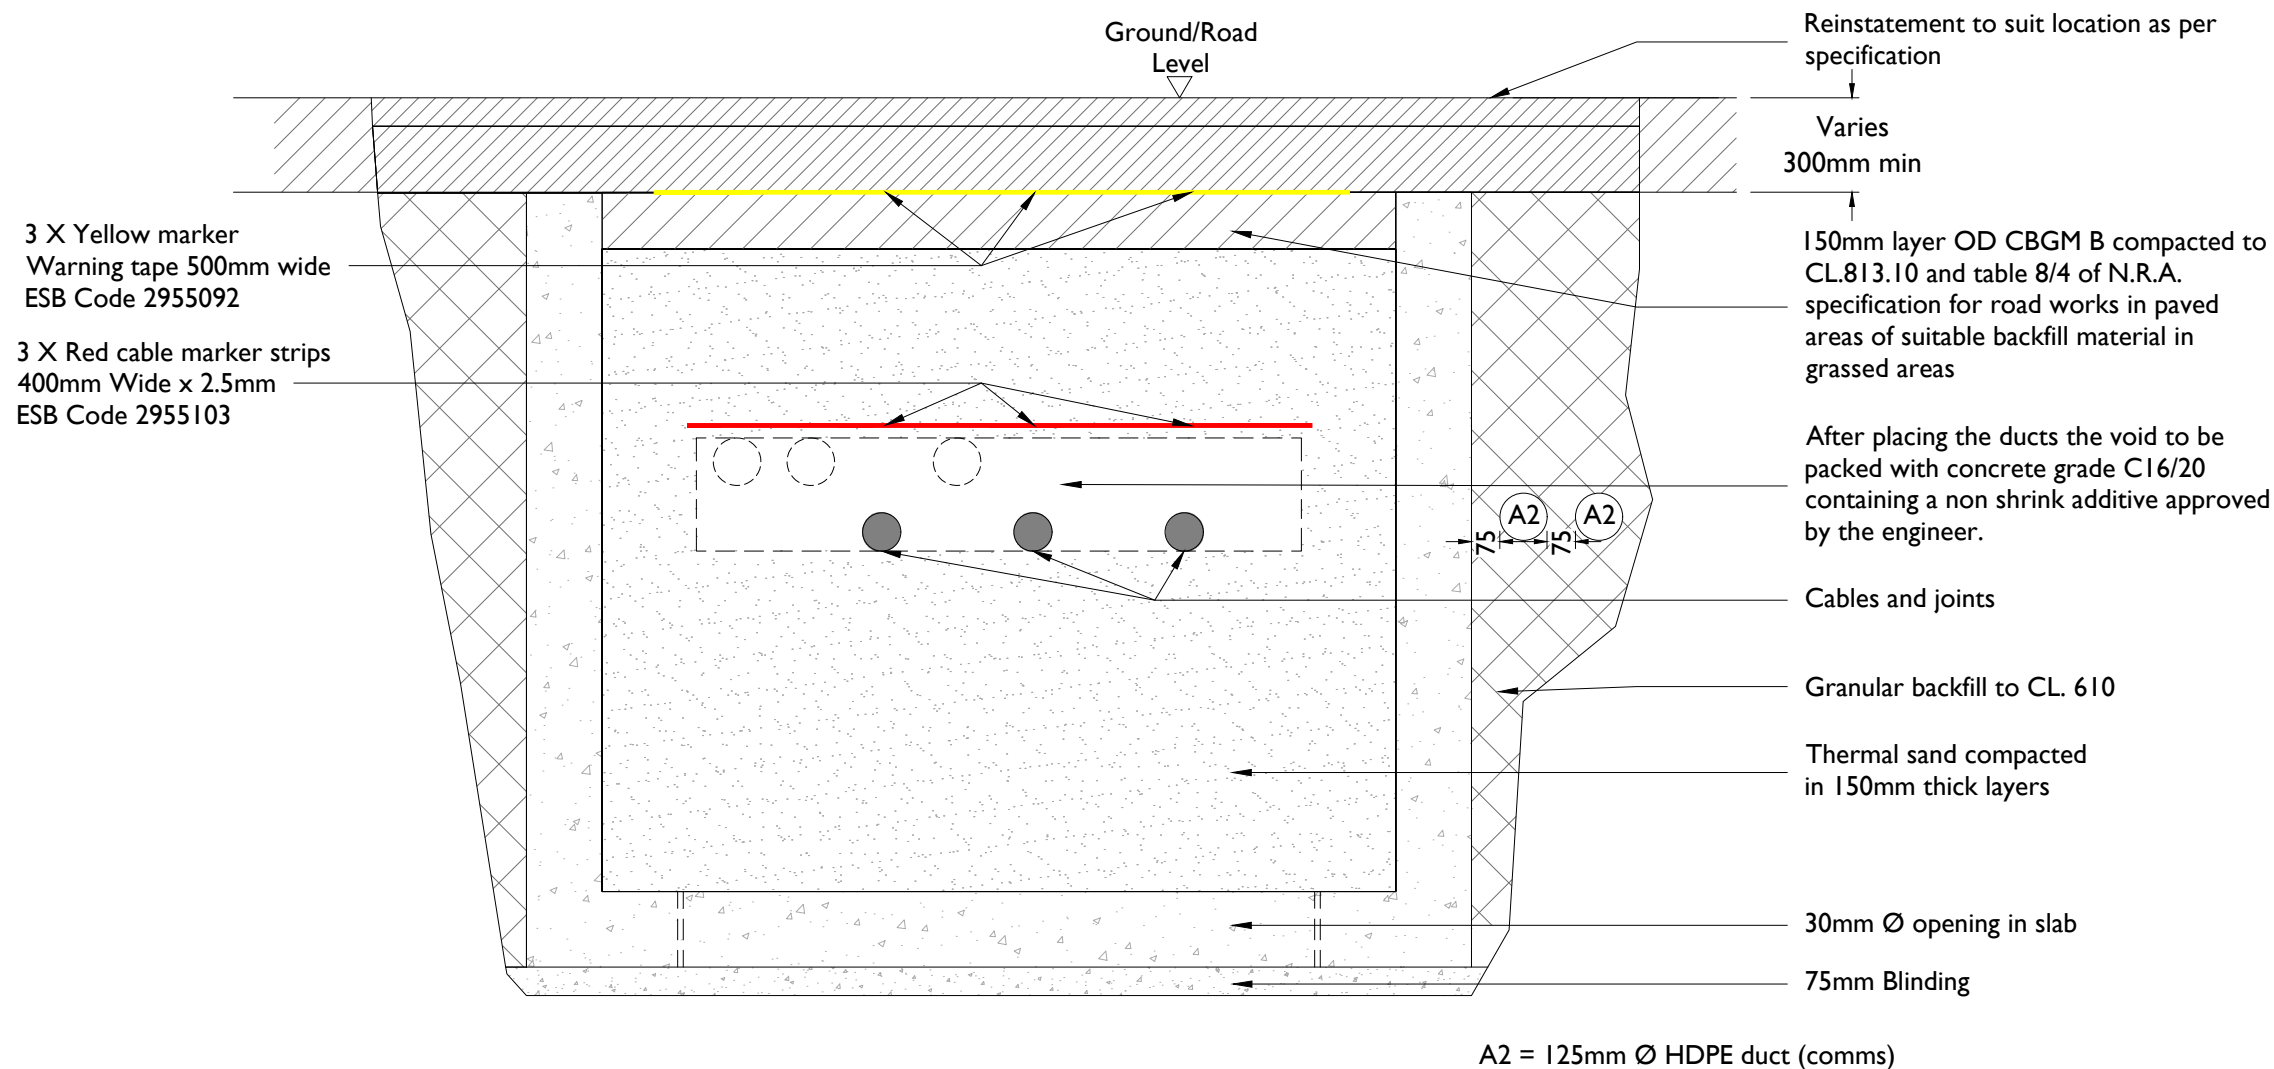

Section A-A Permanent Reinstatement
Scale 1:20

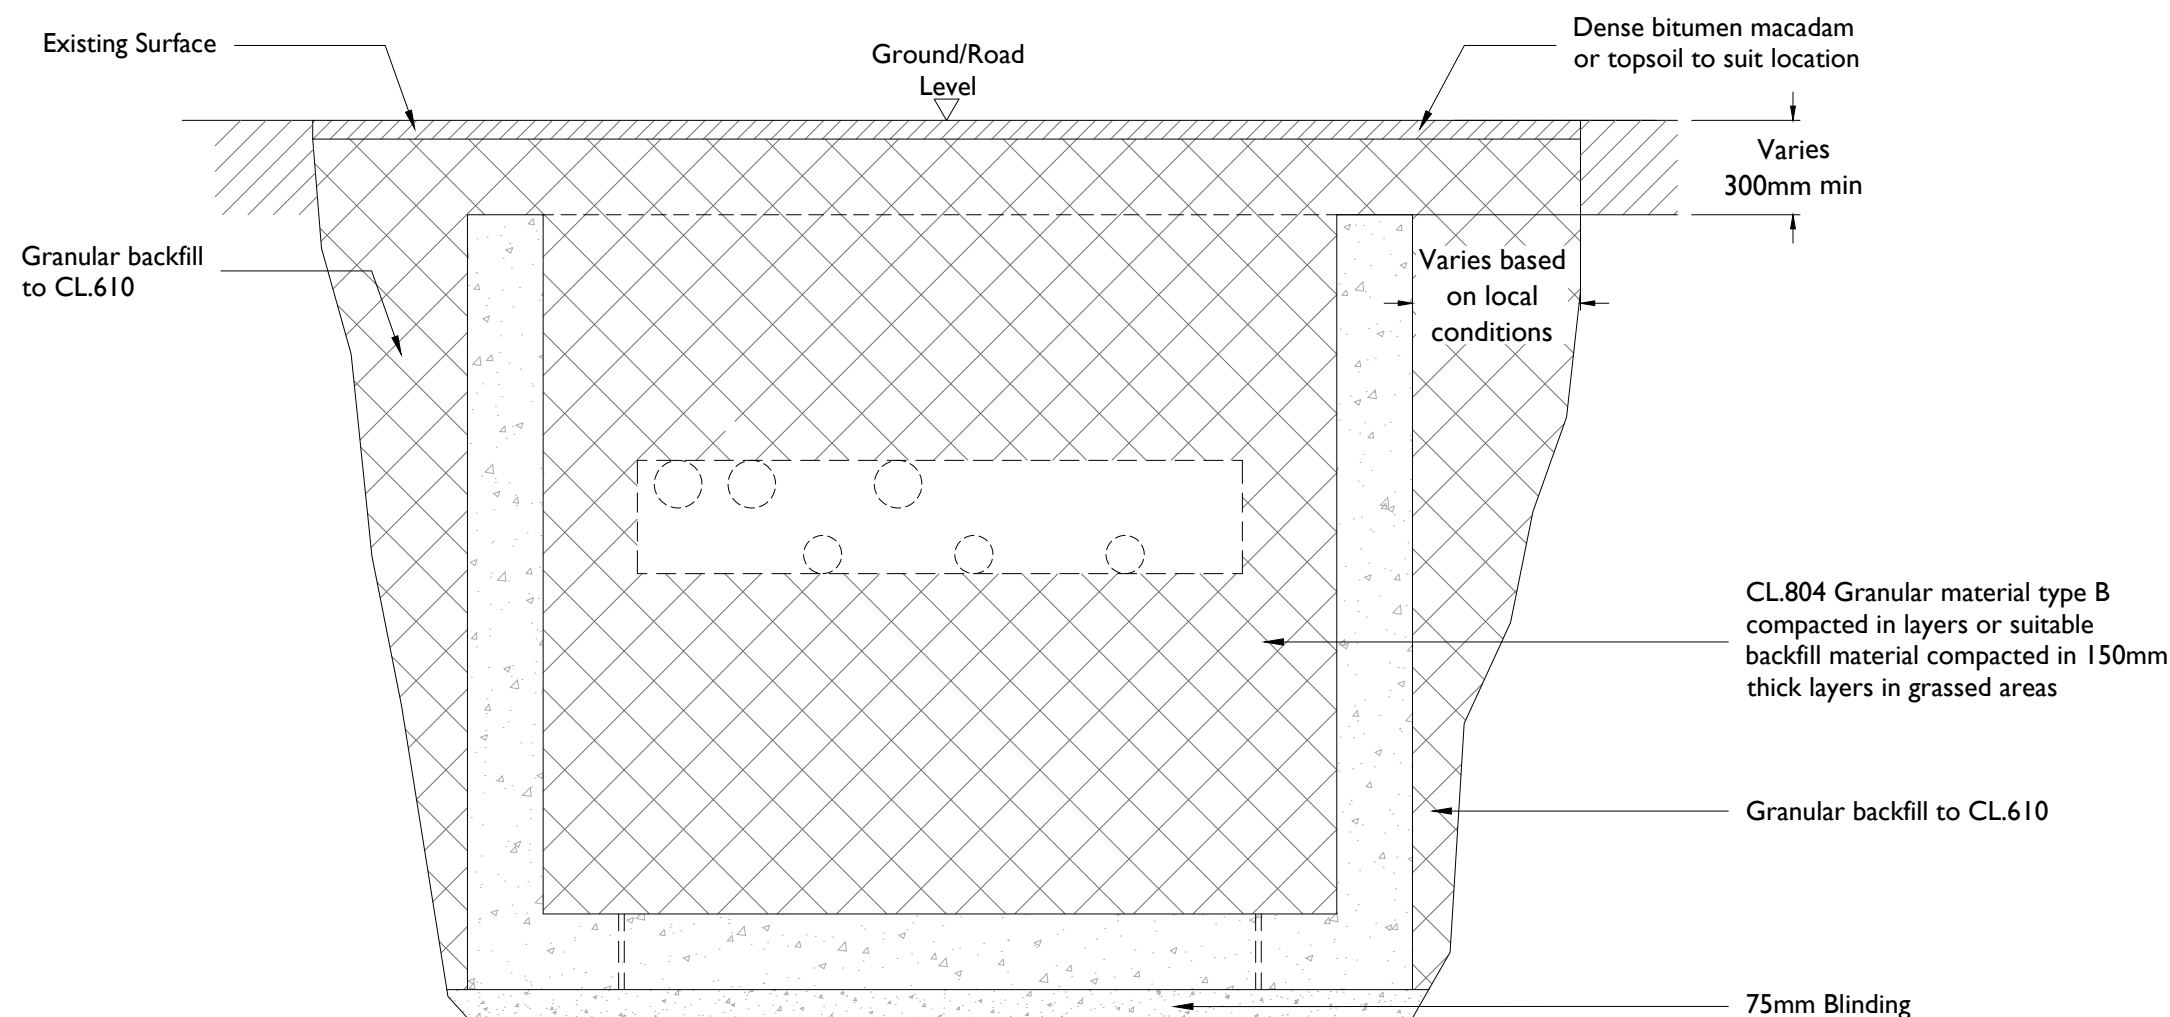

Section A-A Temporary Reinstatement
Scale 1:20

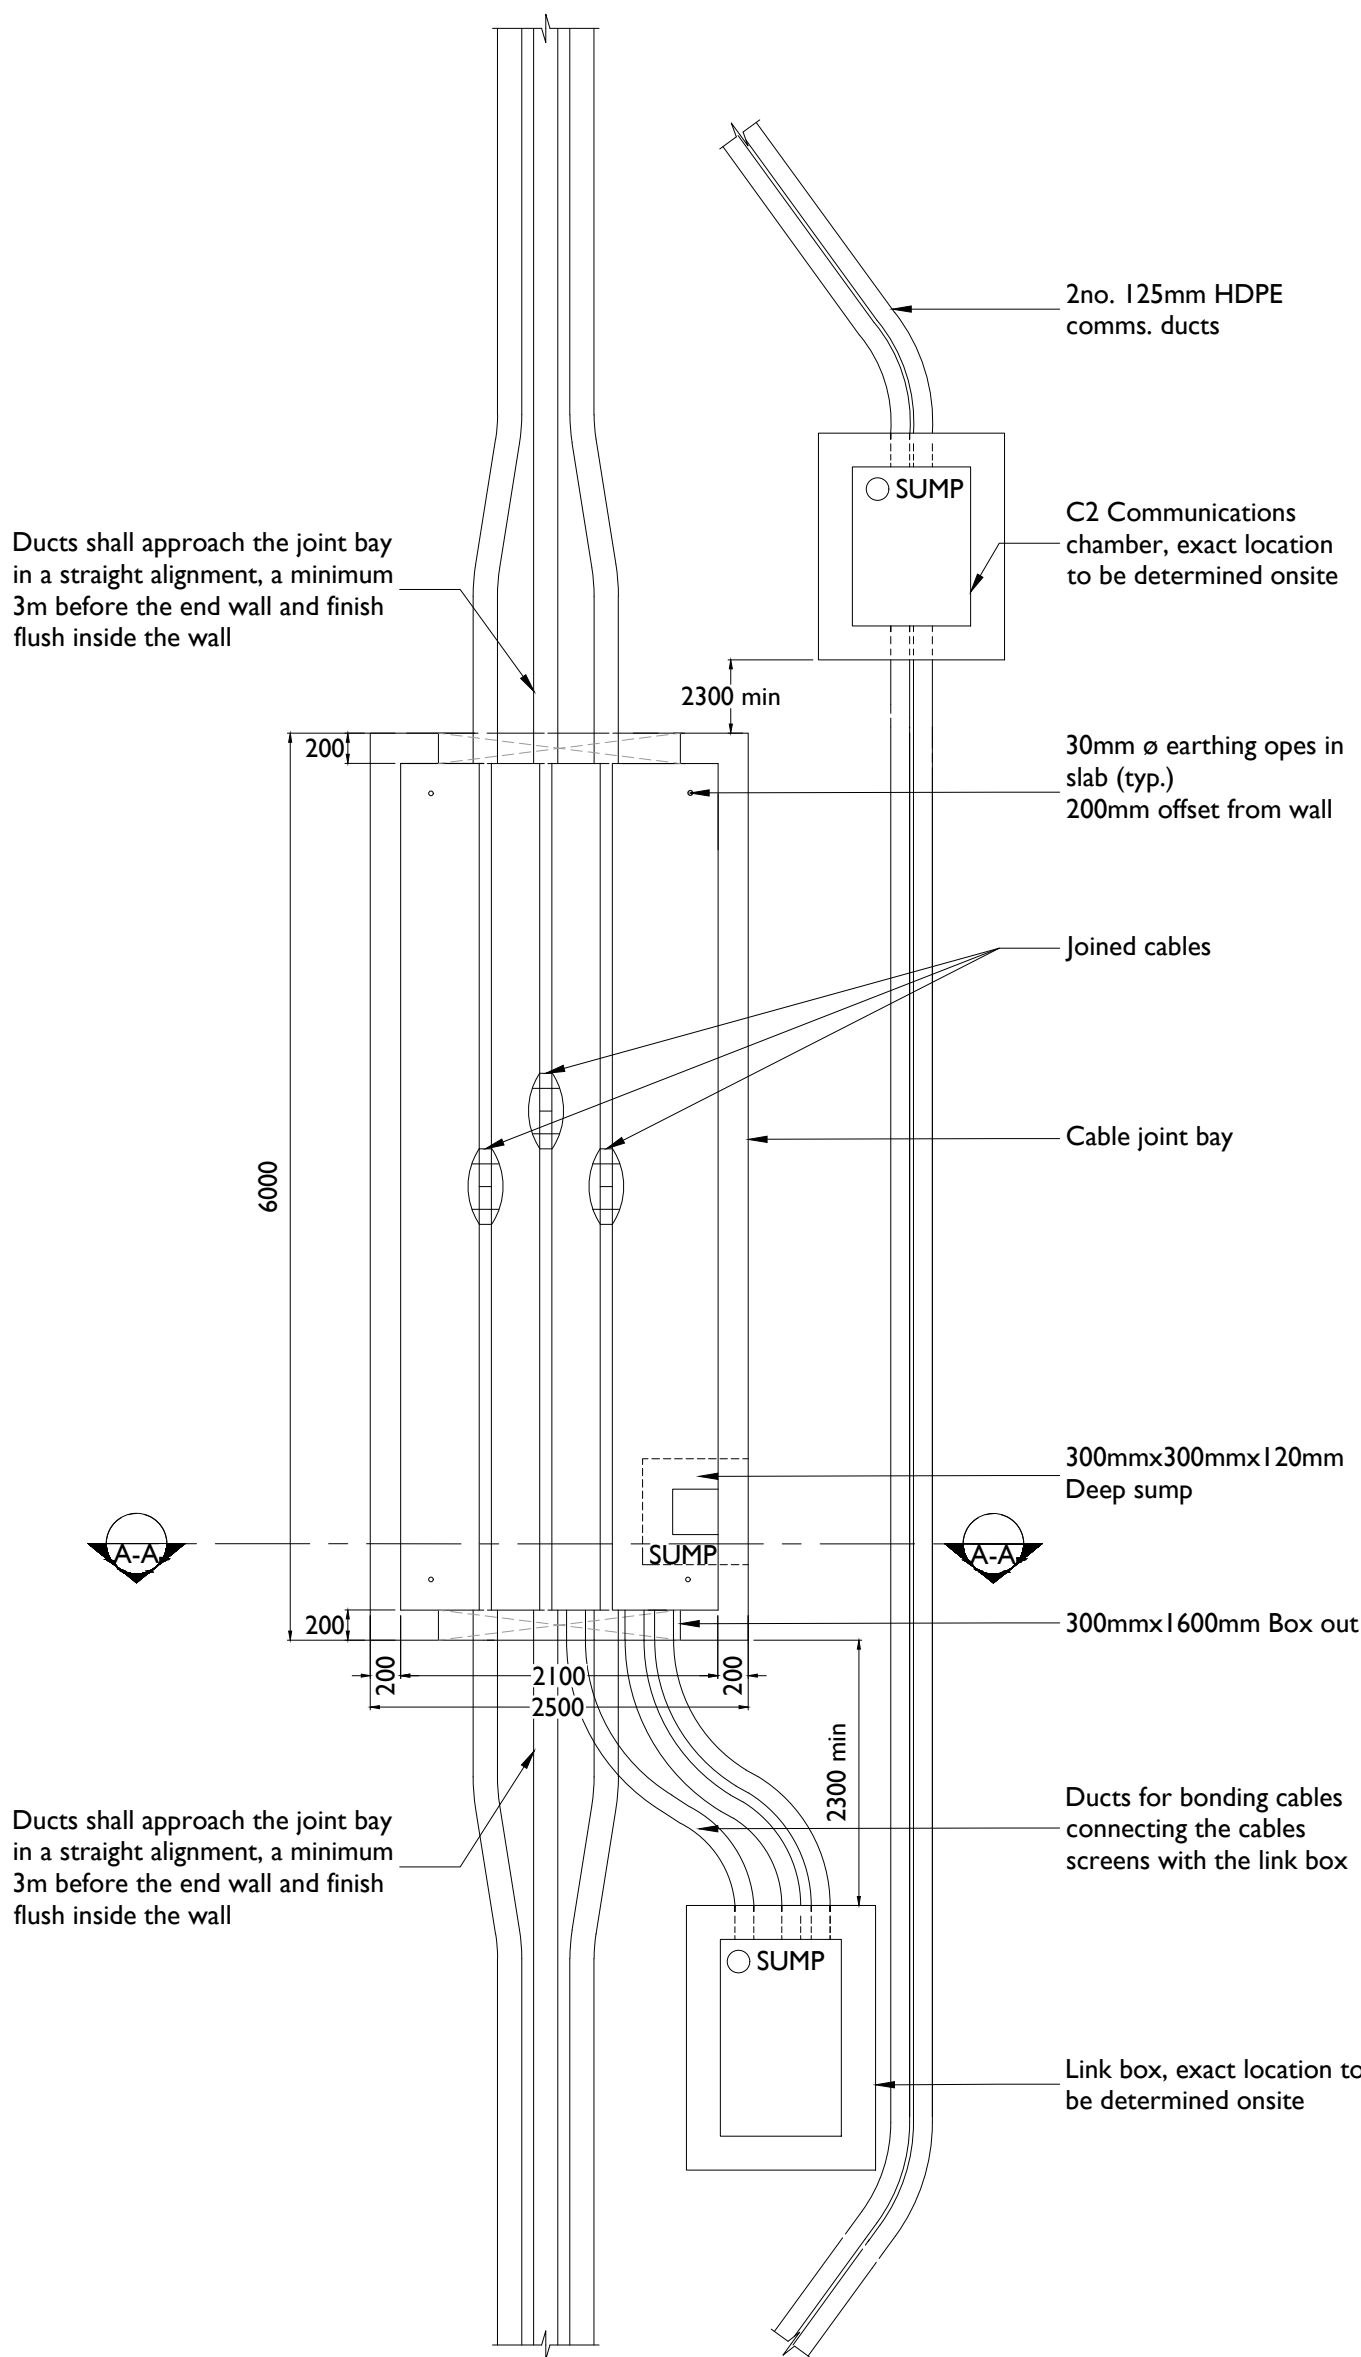

Typical Plan of Joint Bay in Road
Scale 1:50



Head Office
Beenreigh, Abbeydorney,
Tralee, Co. Kerry, Ireland
Tel: 00353 66 7135710

PROJECT

Ballinrea Solar Farm
110 kV Grid Connection

CLIENT



CONSULTANTS

NOTES: -

- This drawing is to be read in conjunction with relevant drawings, specifications and reports.
- Dimensions are in millimeters, unless noted otherwise.
- Drawings are not to be scaled use figured dimensions only.
- The compaction of backfill material around the cables shall be carried out by hand.
- The contractor shall provide test certificates confirming that the thermal resistivity of the thermal sand is maximum 1.k.m/W.

LEGEND: -

Progress Print
Not Issued for Construction
12.12.25

ISSUE/REVISION

NO.	DATE	DESCRIPTION
P1	12.12.25	Issued For Planning Amendment
I/R	DATE	DESCRIPTION

PROJECT NUMBER

300-101179

SHEET TITLE

Joint Bay-
Reinstatement
No ECC Duct

SHEET NUMBER

300101179-DR-811