




APPENDIX 4-2

*SITE LAYOUT DRAWINGS -
PROPOSED WIND FARM*

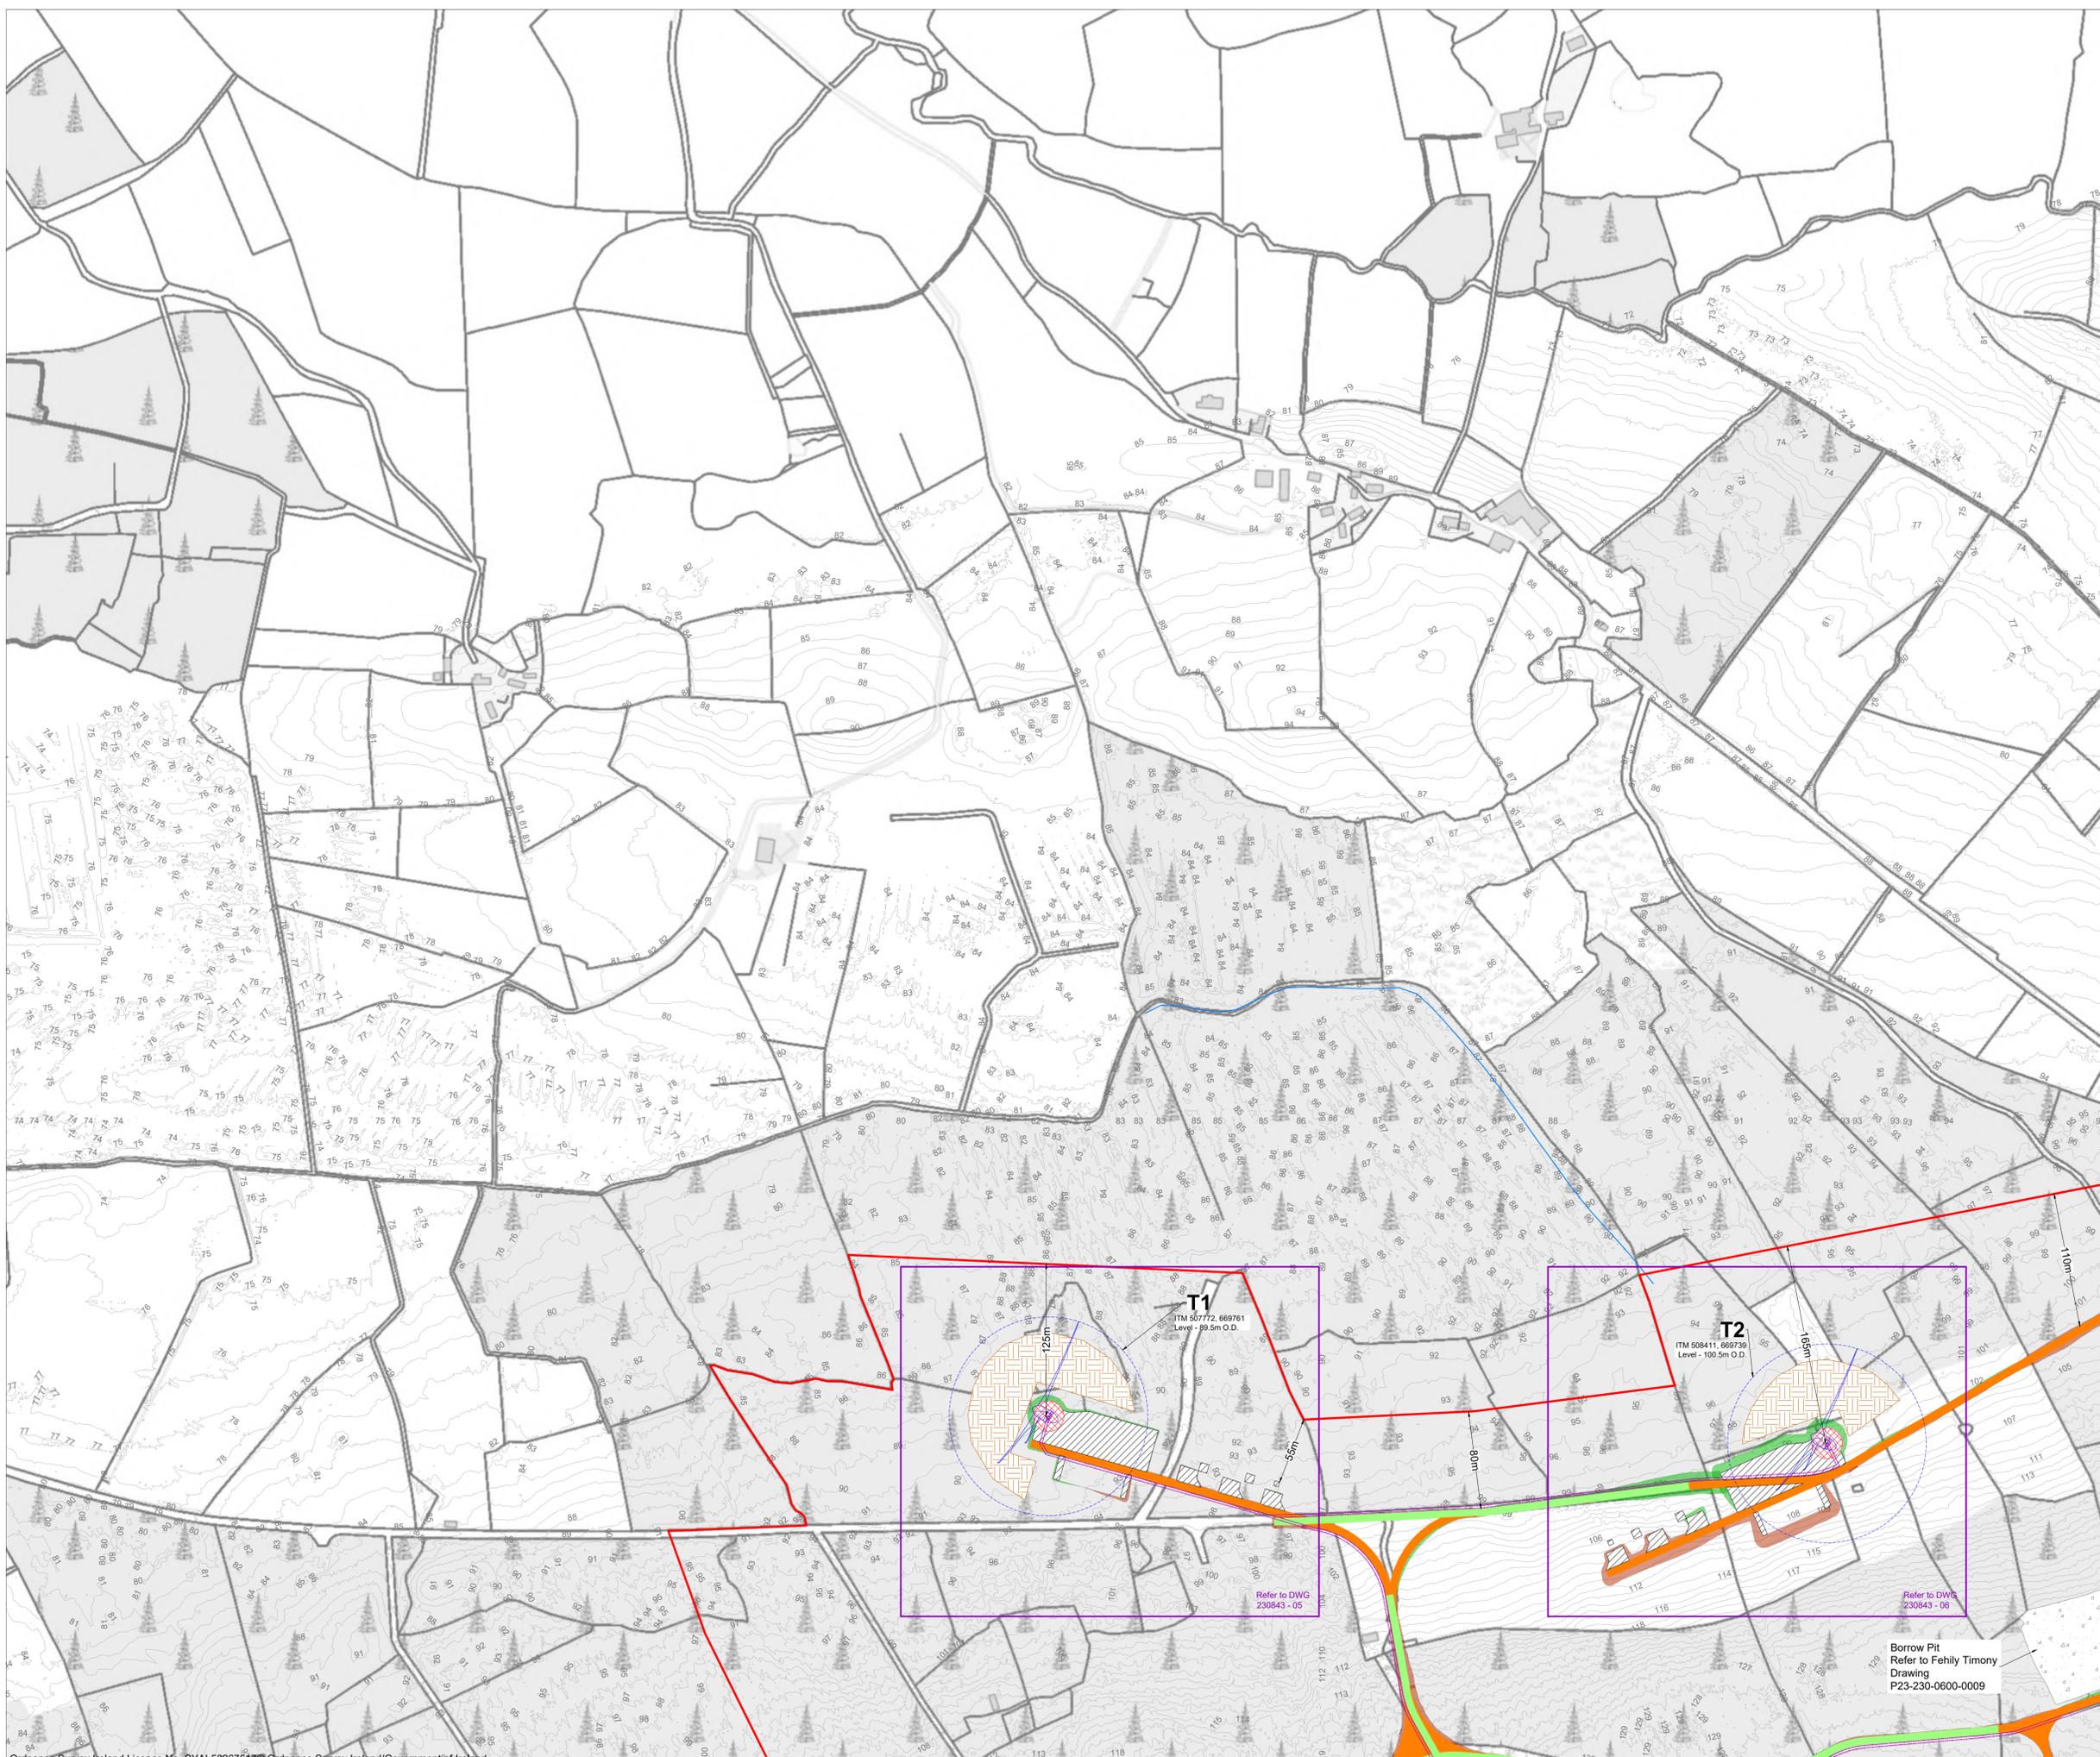

- Project Design Drawing Notes**
1. Drawings issued are for planning application purposes only.
 2. Drawings not to be used for construction/contract conditions.
 3. Copyright, all rights reserved. No part herewith may be copied or reproduced partially or wholly in any form whatsoever without the prior notice of the copyright owner McCarthy Keville O'Sullivan.
 4. Do not scale off this drawing. Figured metric dimensions only should be taken off this drawing.
 5. All contractors, whether main or sub-contractors, must visit the site and are responsible for taking and checking any and all dimensions and levels that relate to the works.
 6. The use of or reliance upon this drawing shall be deemed to be acceptance of these conditions of use unless otherwise agreed in writing, such written agreement to be sought from and issued by the copyright holder to the use or reliance upon this drawing.
 7. Layout plans show typical Turbine rotor diameter as per turbine drawing.
 8. Final levels may vary depending on local ground conditions.

- Drawing Legend**
- Planning Application Boundary
 - Existing Road to be Upgraded
 - Proposed Road
 - Electrical Cable Trench
 - Watercourse
 - Hardstand
 - Turbine Foundation
 - Turbine Sweep Area
 - Borrow Pit
 - Peat Storage
 - Cut
 - Fill



PROJECT TITLE: Proposed Cahermurphy West Wind Farm, Co. Clare		
DRAWING TITLE: Site Layout Plan Sheet 1 of 10		
PROJECT No.: 230843	DRAWING No.: 230843 - 04A	SCALE: 1:2,500 @ A1
DRAWN BY: JOB	CHECKED BY: AC	DATE: 11.03.2026
		REVISION: D01
OS SHEET No.: 4373, 4374, 4375, 4431, 4432, 4433, 4490, 4491, 4492, 4550, 4551, 4552, 4609, 4610, 4611		



Email: info@www.mkoireland.ie / Website: www.mkoireland.ie


T1
ITM 507772, 669761
Level - 89.5m O.D.

T2
ITM 508411, 669739
Level - 100.5m O.D.

Refer to DWG
230843 - 05

Refer to DWG
230843 - 06

Borrow Pit
Refer to Fehily Timony
Drawing
P23-230-0600-0009

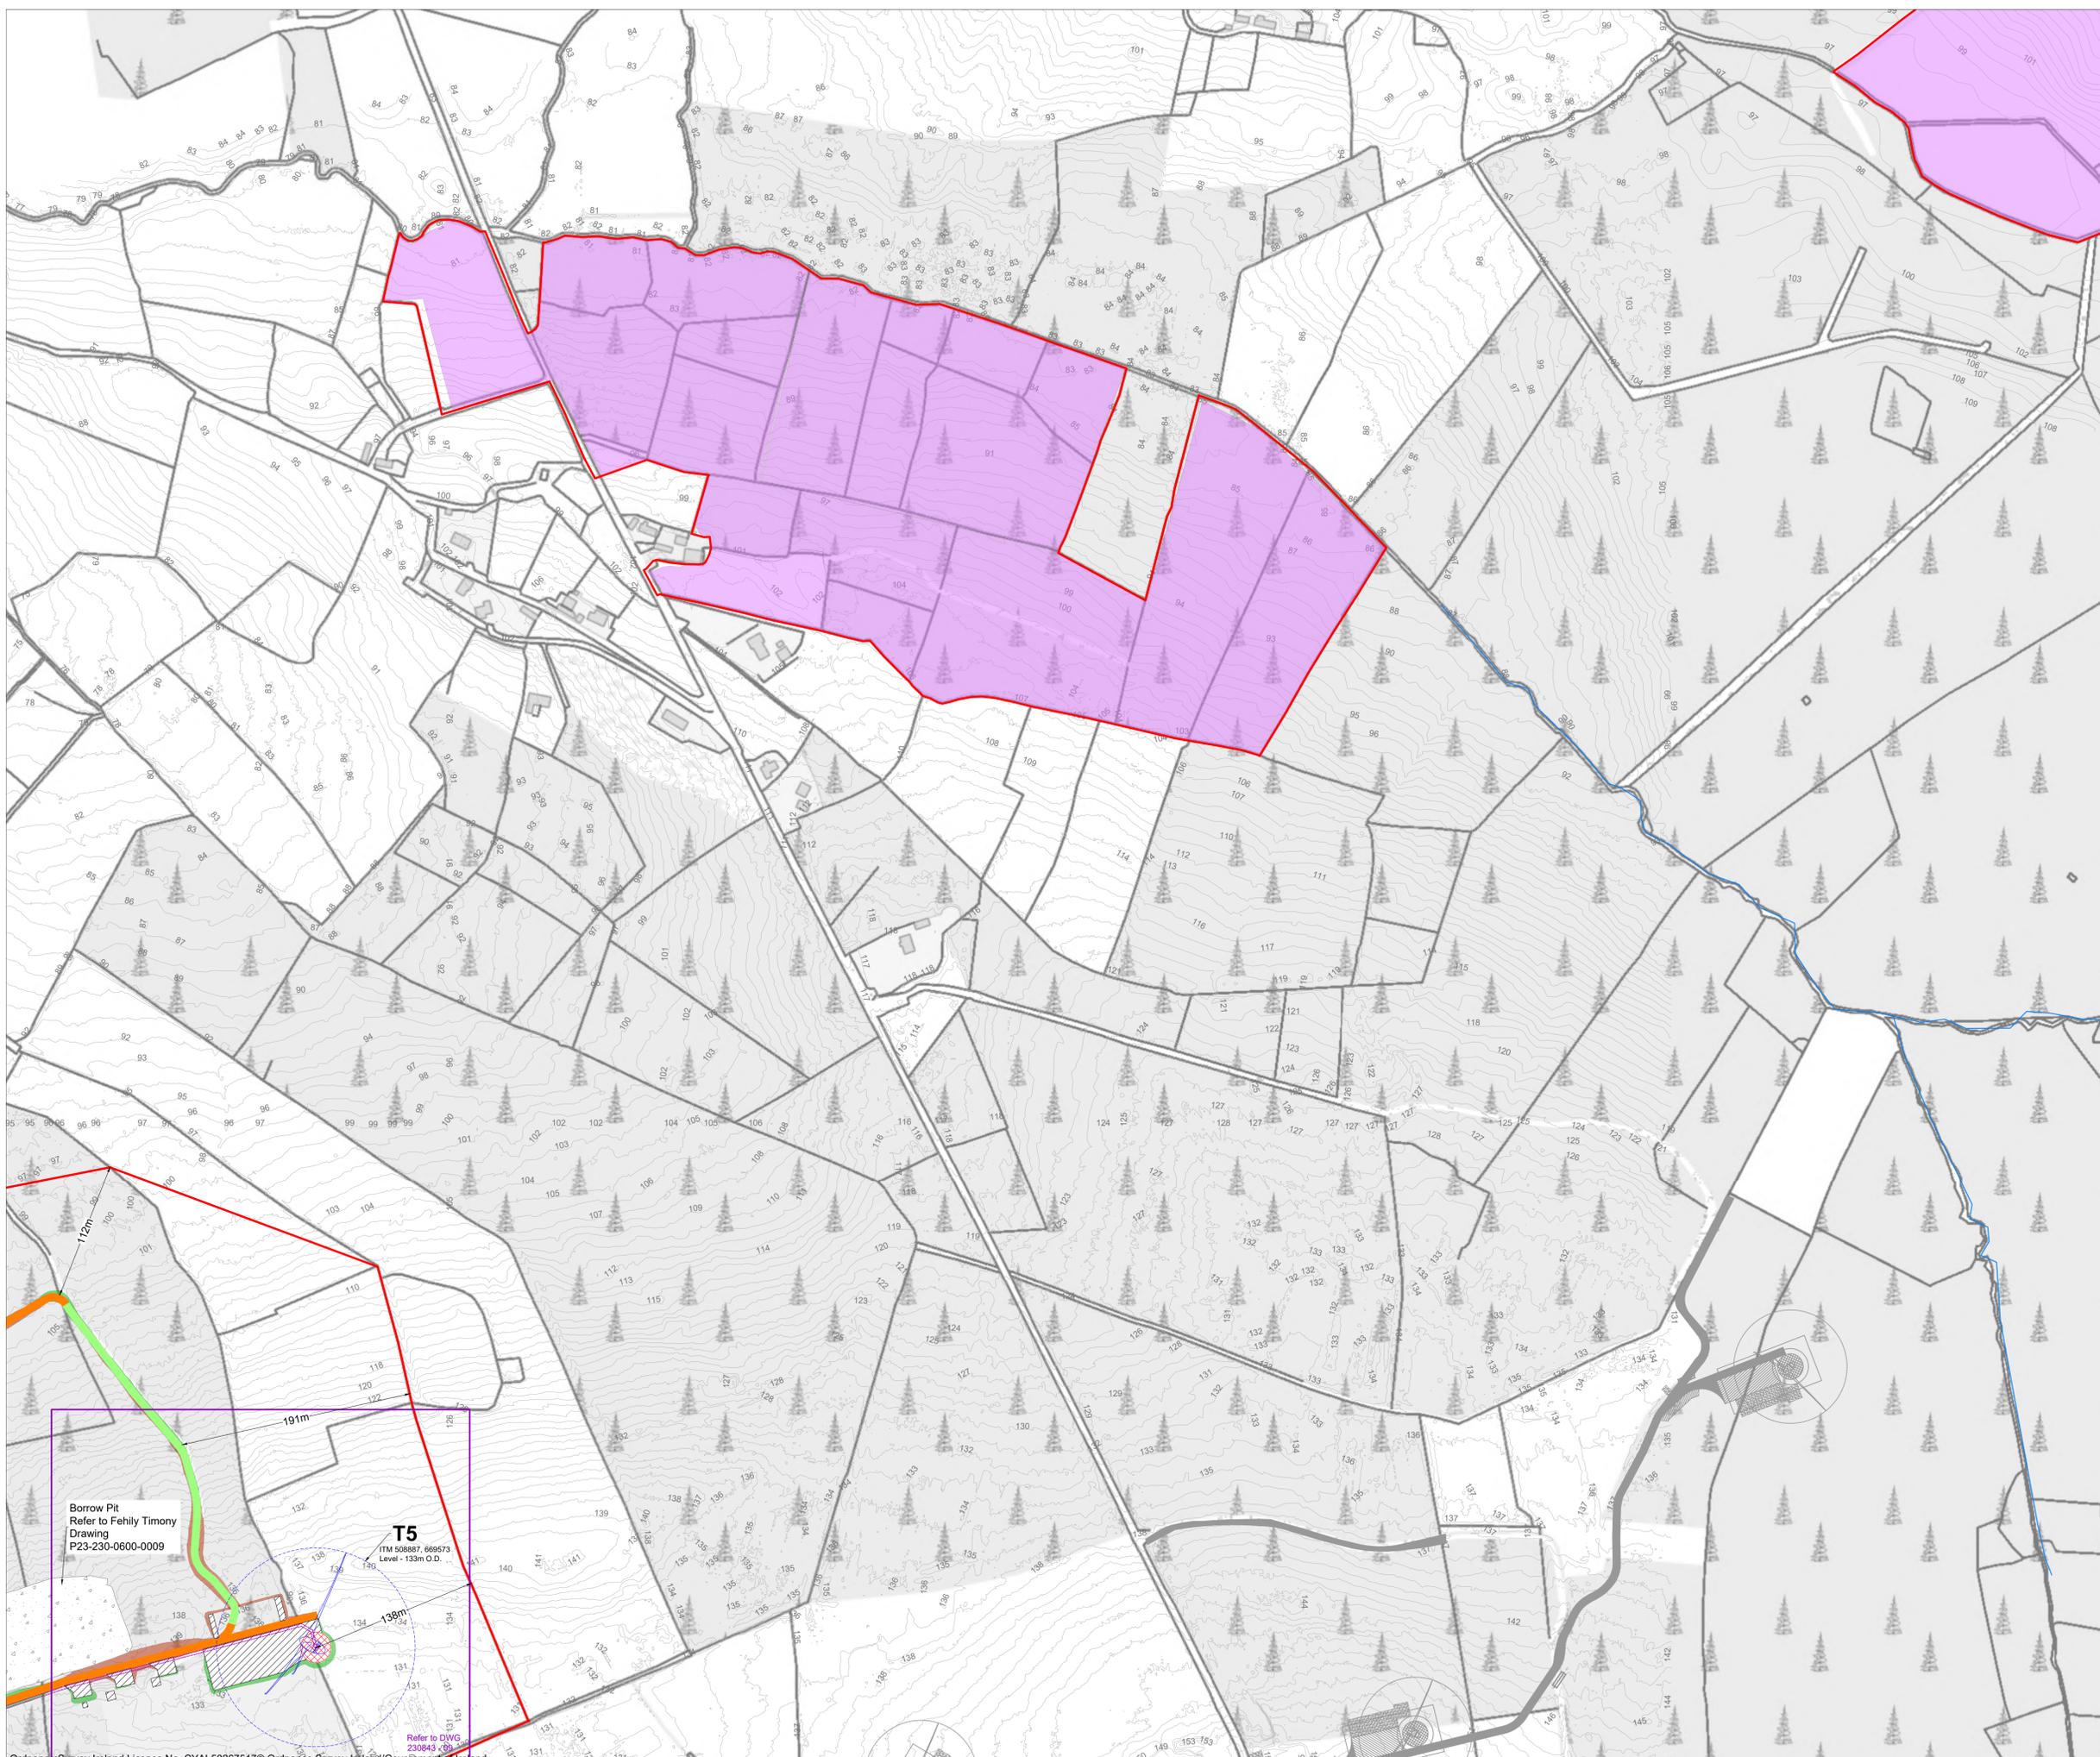

- Project Design Drawing Notes**
1. Drawings issued are for planning application purposes only.
 2. Drawings not to be used for construction/contract conditions.
 3. Copyright, all rights reserved. No part hereof may be copied or reproduced partially or wholly in any form whatsoever without the prior notice of the copyright owner McCarthy Keville O'Sullivan.
 4. Do not scale off this drawing. Figured metric dimensions only should be taken off this drawing.
 5. All contractors, whether main or sub-contractors, must visit the site and are responsible for taking and checking any and all dimensions and levels that relate to the works.
 6. The use of or reliance upon this drawing shall be deemed to be acceptance of these conditions of use unless otherwise agreed in writing, such written agreement to be sought from and issued by the copyright holder to the use or reliance upon this drawing.
 7. Layout plans show typical Turbine rotor diameter as per turbine drawing.
 8. Final levels may vary depending on local ground conditions.

- Drawing Legend**
- Planning Application Boundary
 - Existing Road to be Upgraded
 - Proposed Road
 - Electrical Cable Trench
 - Watercourse
 - Hardstand
 - Turbine Foundation
 - Turbine Sweep Area
 - Borrow Pit
 - Biodiversity Enhancement Areas
 - Cut
 - Fill



PROJECT TITLE: **Proposed Cahermurphy West Wind Farm, Co. Clare**

DRAWING TITLE: **Site Layout Plan Sheet 2 of 10**

PROJECT No.: 230843	DRAWING No.: 230843 - 04B	SCALE: 1:2,500 @ A1
DRAWN BY: JOB	CHECKED BY: AC	REVISION:.
DATE: 11.03.2026		D01

OS SHEET No.: 4373, 4374, 4375, 4431, 4432, 4433, 4490, 4491, 4492, 4550, 4551, 4552, 4609, 4610, 4611

Borrow Pit Refer to Fehily Timony Drawing P23-230-0600-0009

T5

ITM 508887, 669573
Level - 133m O.D.

139m

131

131


131

131

131

131



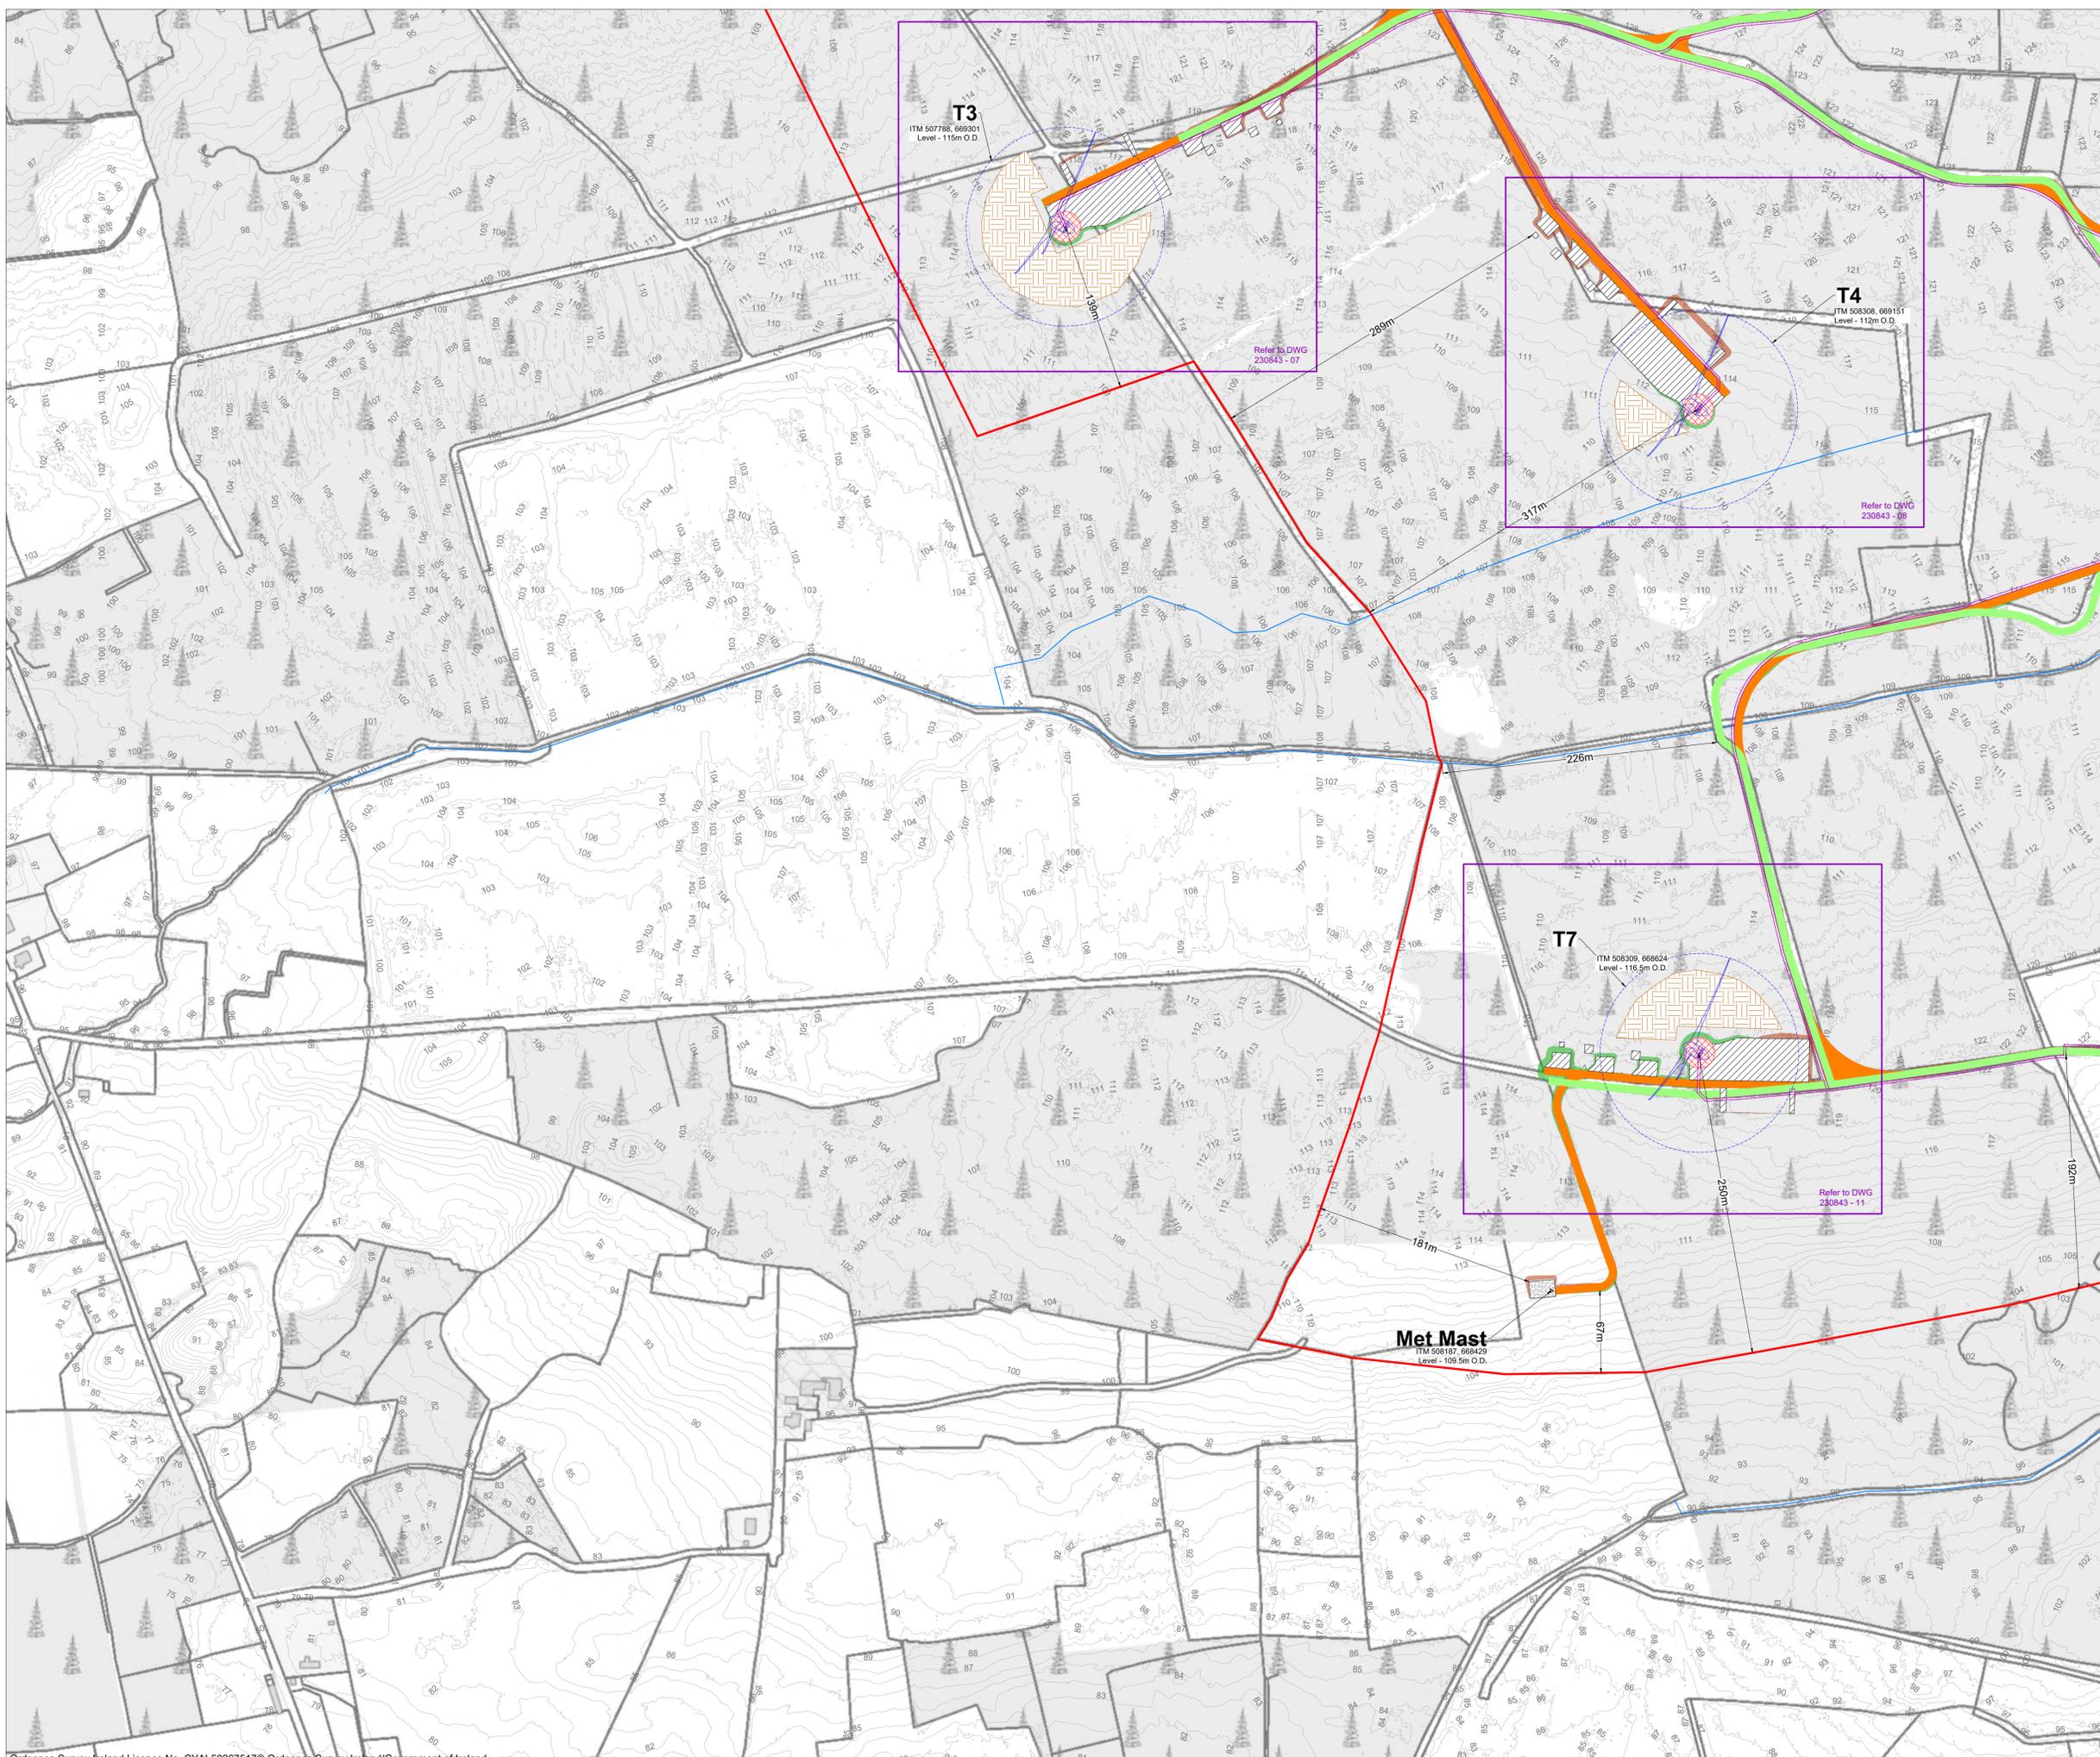

- Project Design Drawing Notes**
1. Drawings issued are for planning application purposes only.
 2. Drawings not to be used for construction/contract conditions.
 3. Copyright, all rights reserved. No part here with may be copied or reproduced partially or wholly in any form whatsoever without the prior notice of the copyright owner McCarthy Keville O'Sullivan.
 4. Do not scale off this drawing. Figured metric dimensions only should be taken off this drawing.
 5. All contractors, whether main or sub-contractors, must visit the site and are responsible for taking and checking any and all dimensions and levels that relate to the works.
 6. The use of or reliance upon this drawing shall be deemed to be acceptance of these conditions of use unless otherwise agreed in writing, such written agreement to be sought from and issued by the copyright holder to the use or reliance upon this drawing.
 7. Layout plans show typical Turbine rotor diameter as per turbine drawing.
 8. Final levels may vary depending on local ground conditions.

- Drawing Legend**
- Planning Application Boundary
 - Existing Road to be Upgraded
 - Proposed Road
 - Electrical Cable Trench
 - Watercourse
 - Hardstand
 - Turbine Foundation
 - Turbine Sweep Area
 - Borrow Pit
 - Peat Storage
 - Cut
 - Fill


PROJECT TITLE: **Proposed Cahermurphy West Wind Farm, Co. Clare**

DRAWING TITLE: **Site Layout Plan Sheet 3 of 10**

PROJECT No.: 230843	DRAWING No.: 230843 - 04C	SCALE: 1:2,500 @ A1
DRAWN BY: JOB	CHECKED BY: AC	DATE: 16.03.2026
		REVISION: D01

OS SHEET No.: 4373, 4374, 4375, 4431, 4432, 4433, 4490, 4491, 4492, 4550, 4551, 4552, 4609, 4610, 4611



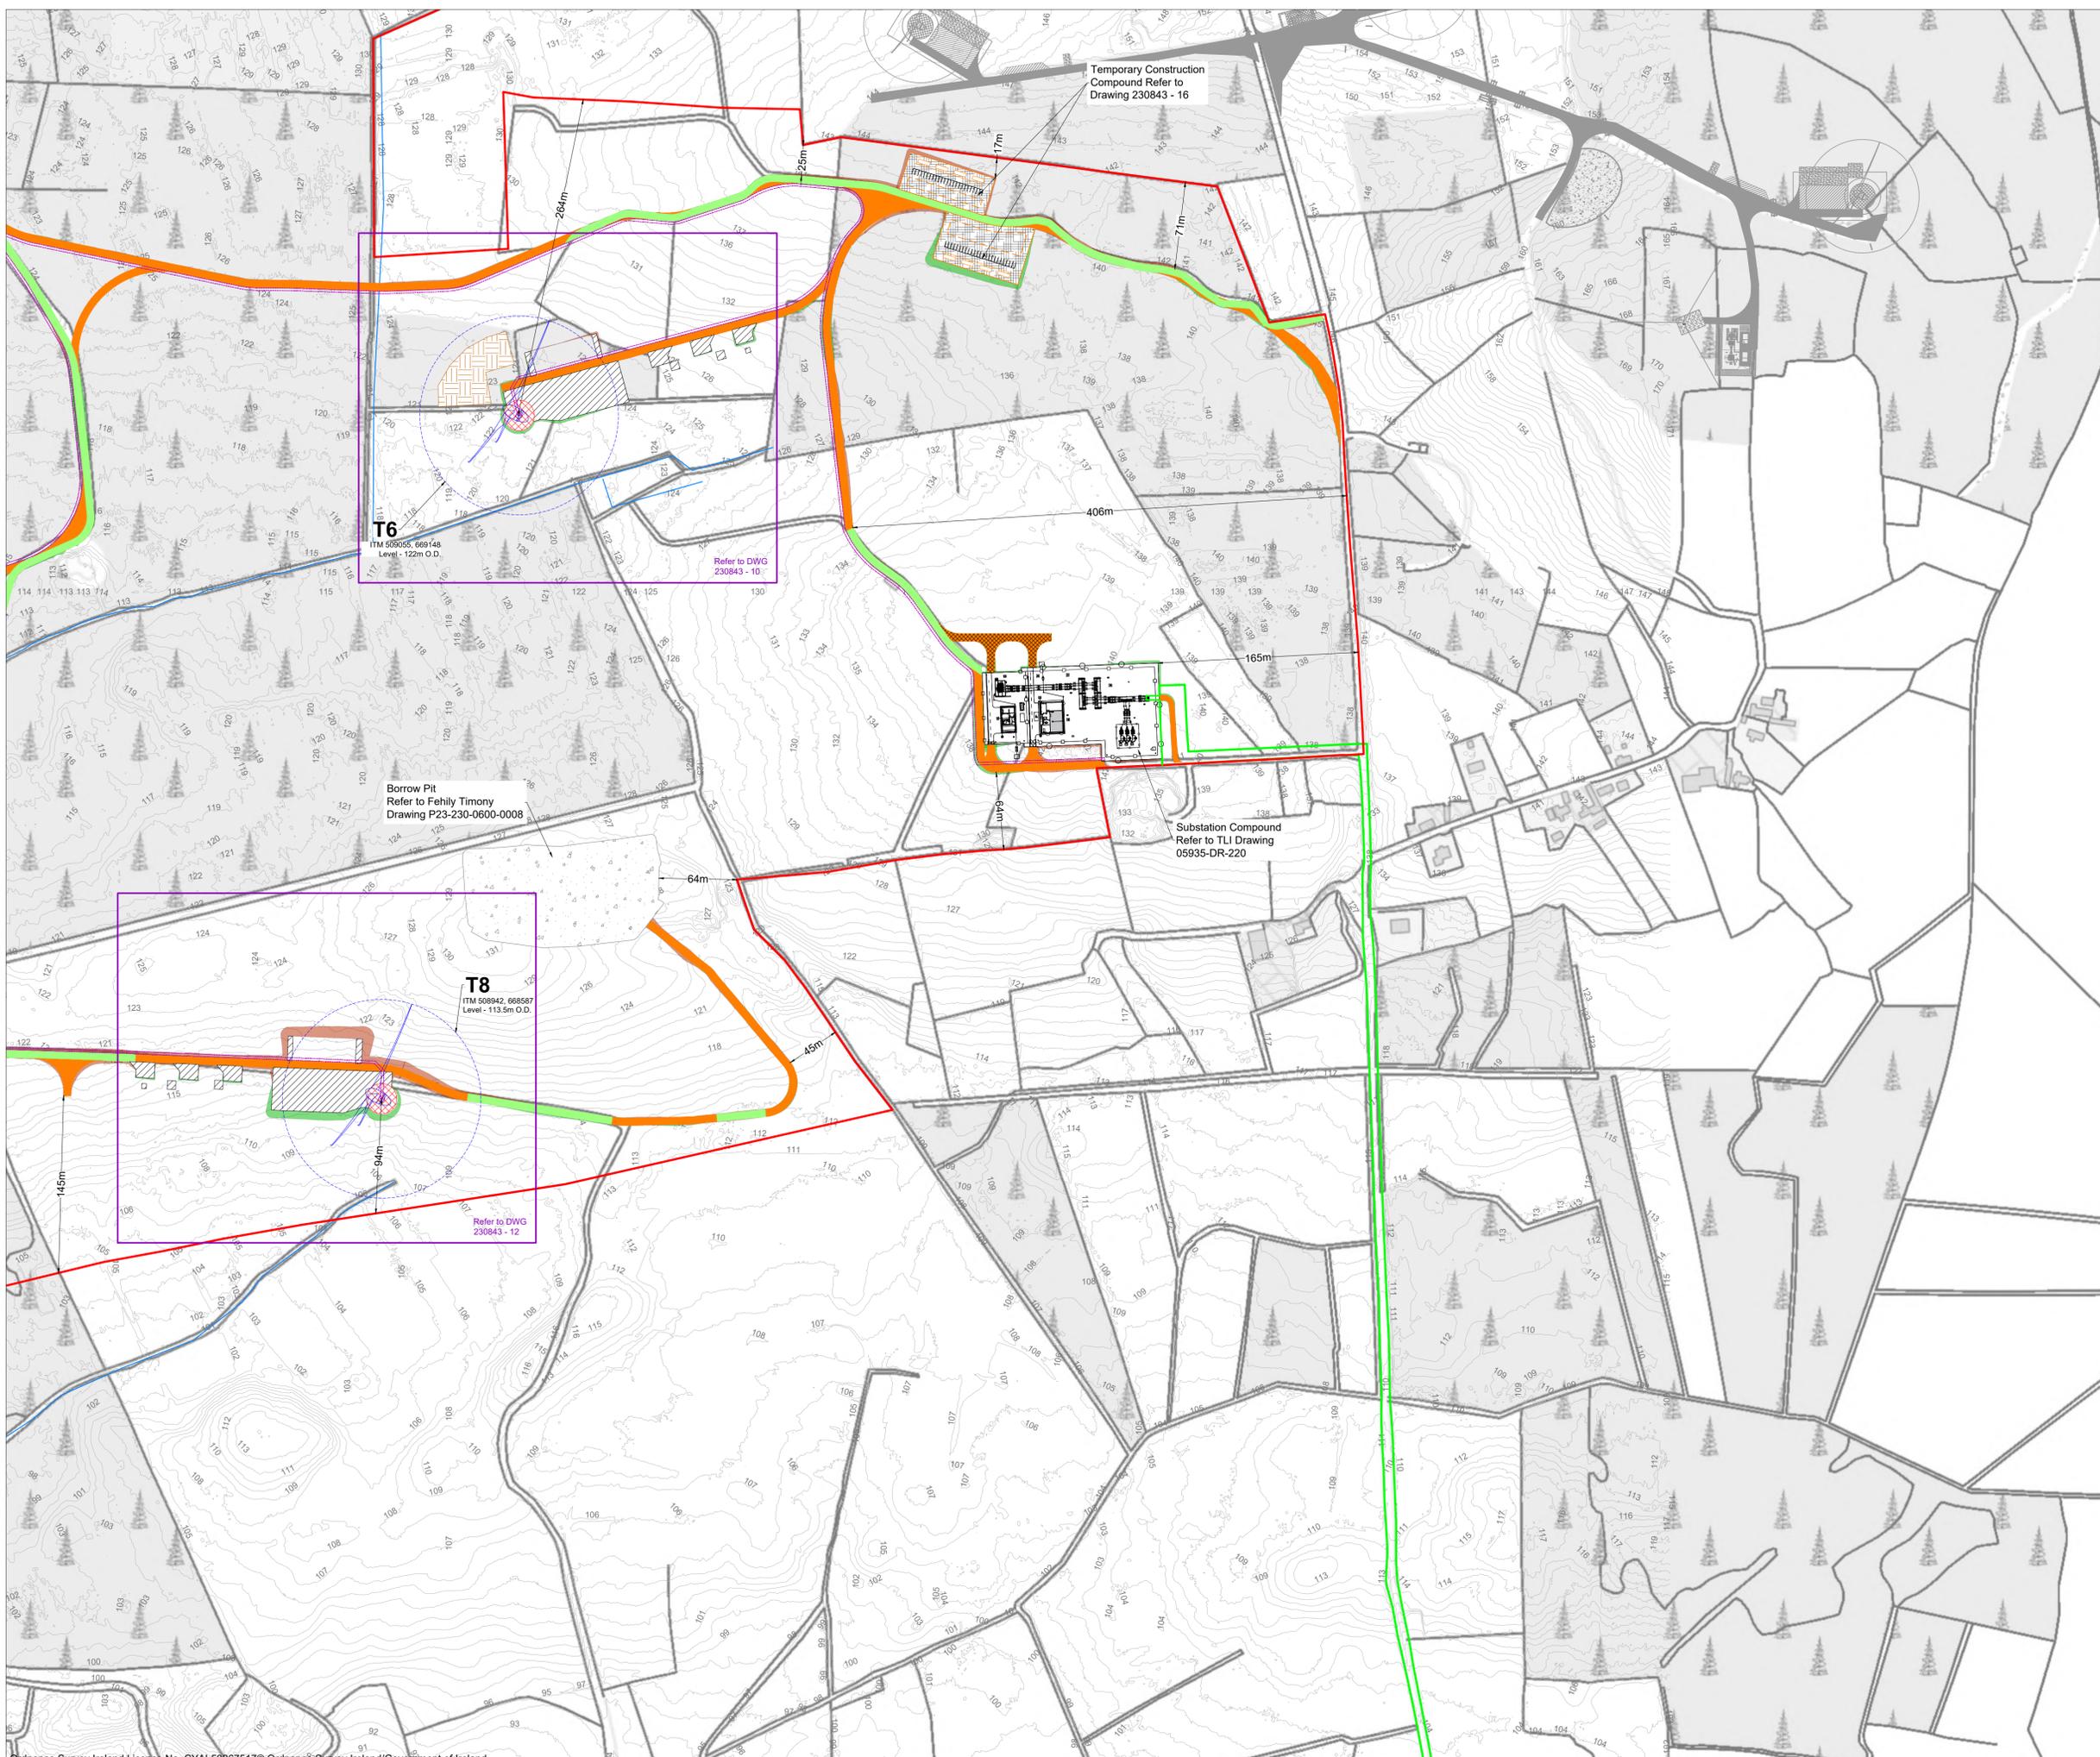

- Project Design Drawing Notes**
1. Drawings issued are for planning application purposes only.
 2. Drawings not to be used for construction/contract conditions.
 3. Copyright, all rights reserved. No part herewith may be copied or reproduced partially or wholly in any form whatsoever without the prior notice of the copyright owner McCarthy Keville O'Sullivan.
 4. Do not scale off this drawing. Figured metric dimensions only should be taken off this drawing.
 5. All contractors, whether main or sub-contractors, must visit the site and are responsible for taking and checking any and all dimensions and levels that relate to the works.
 6. The use of or reliance upon this drawing shall be deemed to be acceptance of these conditions of use unless otherwise agreed in writing, such written agreement to be sought from and issued by the copyright holder to the use or reliance upon this drawing.
 7. Layout plans show typical Turbine rotor diameter as per turbine drawing.
 8. Final levels may vary depending on local ground conditions.


- Drawing Legend**
- Planning Application Boundary
 - Existing Road to be Upgraded
 - Proposed Road
 - Temporary Delivery Access Road
 - Electrical Cable Trench
 - Watercourse
 - Hardstand
 - Turbine Foundation
 - Turbine Sweep Area
 - Borrow Pit
 - Peat Storage
 - Biodiversity Enhancement Areas
 - Cahermurphy West 110kV Grid Connection Application Boundary



PROJECT TITLE: Proposed Cahermurphy West Wind Farm, Co. Clare		
DRAWING TITLE: Site Layout Plan Sheet 4 of 10		
PROJECT No.: 230843	DRAWING No.: 230843 - 04D	SCALE: 1:2,500 @ A1
DRAWN BY: JOB	CHECKED BY: AC	DATE: 16.03.2026
		REVISION: D01
OS SHEET No.: 4373, 4374, 4375, 4431, 4432, 4433, 4490, 4491, 4492, 4550, 4551, 4552, 4609, 4610, 4611		



Email: info@www.mkoireland.ie / Website: www.mkoireland.ie

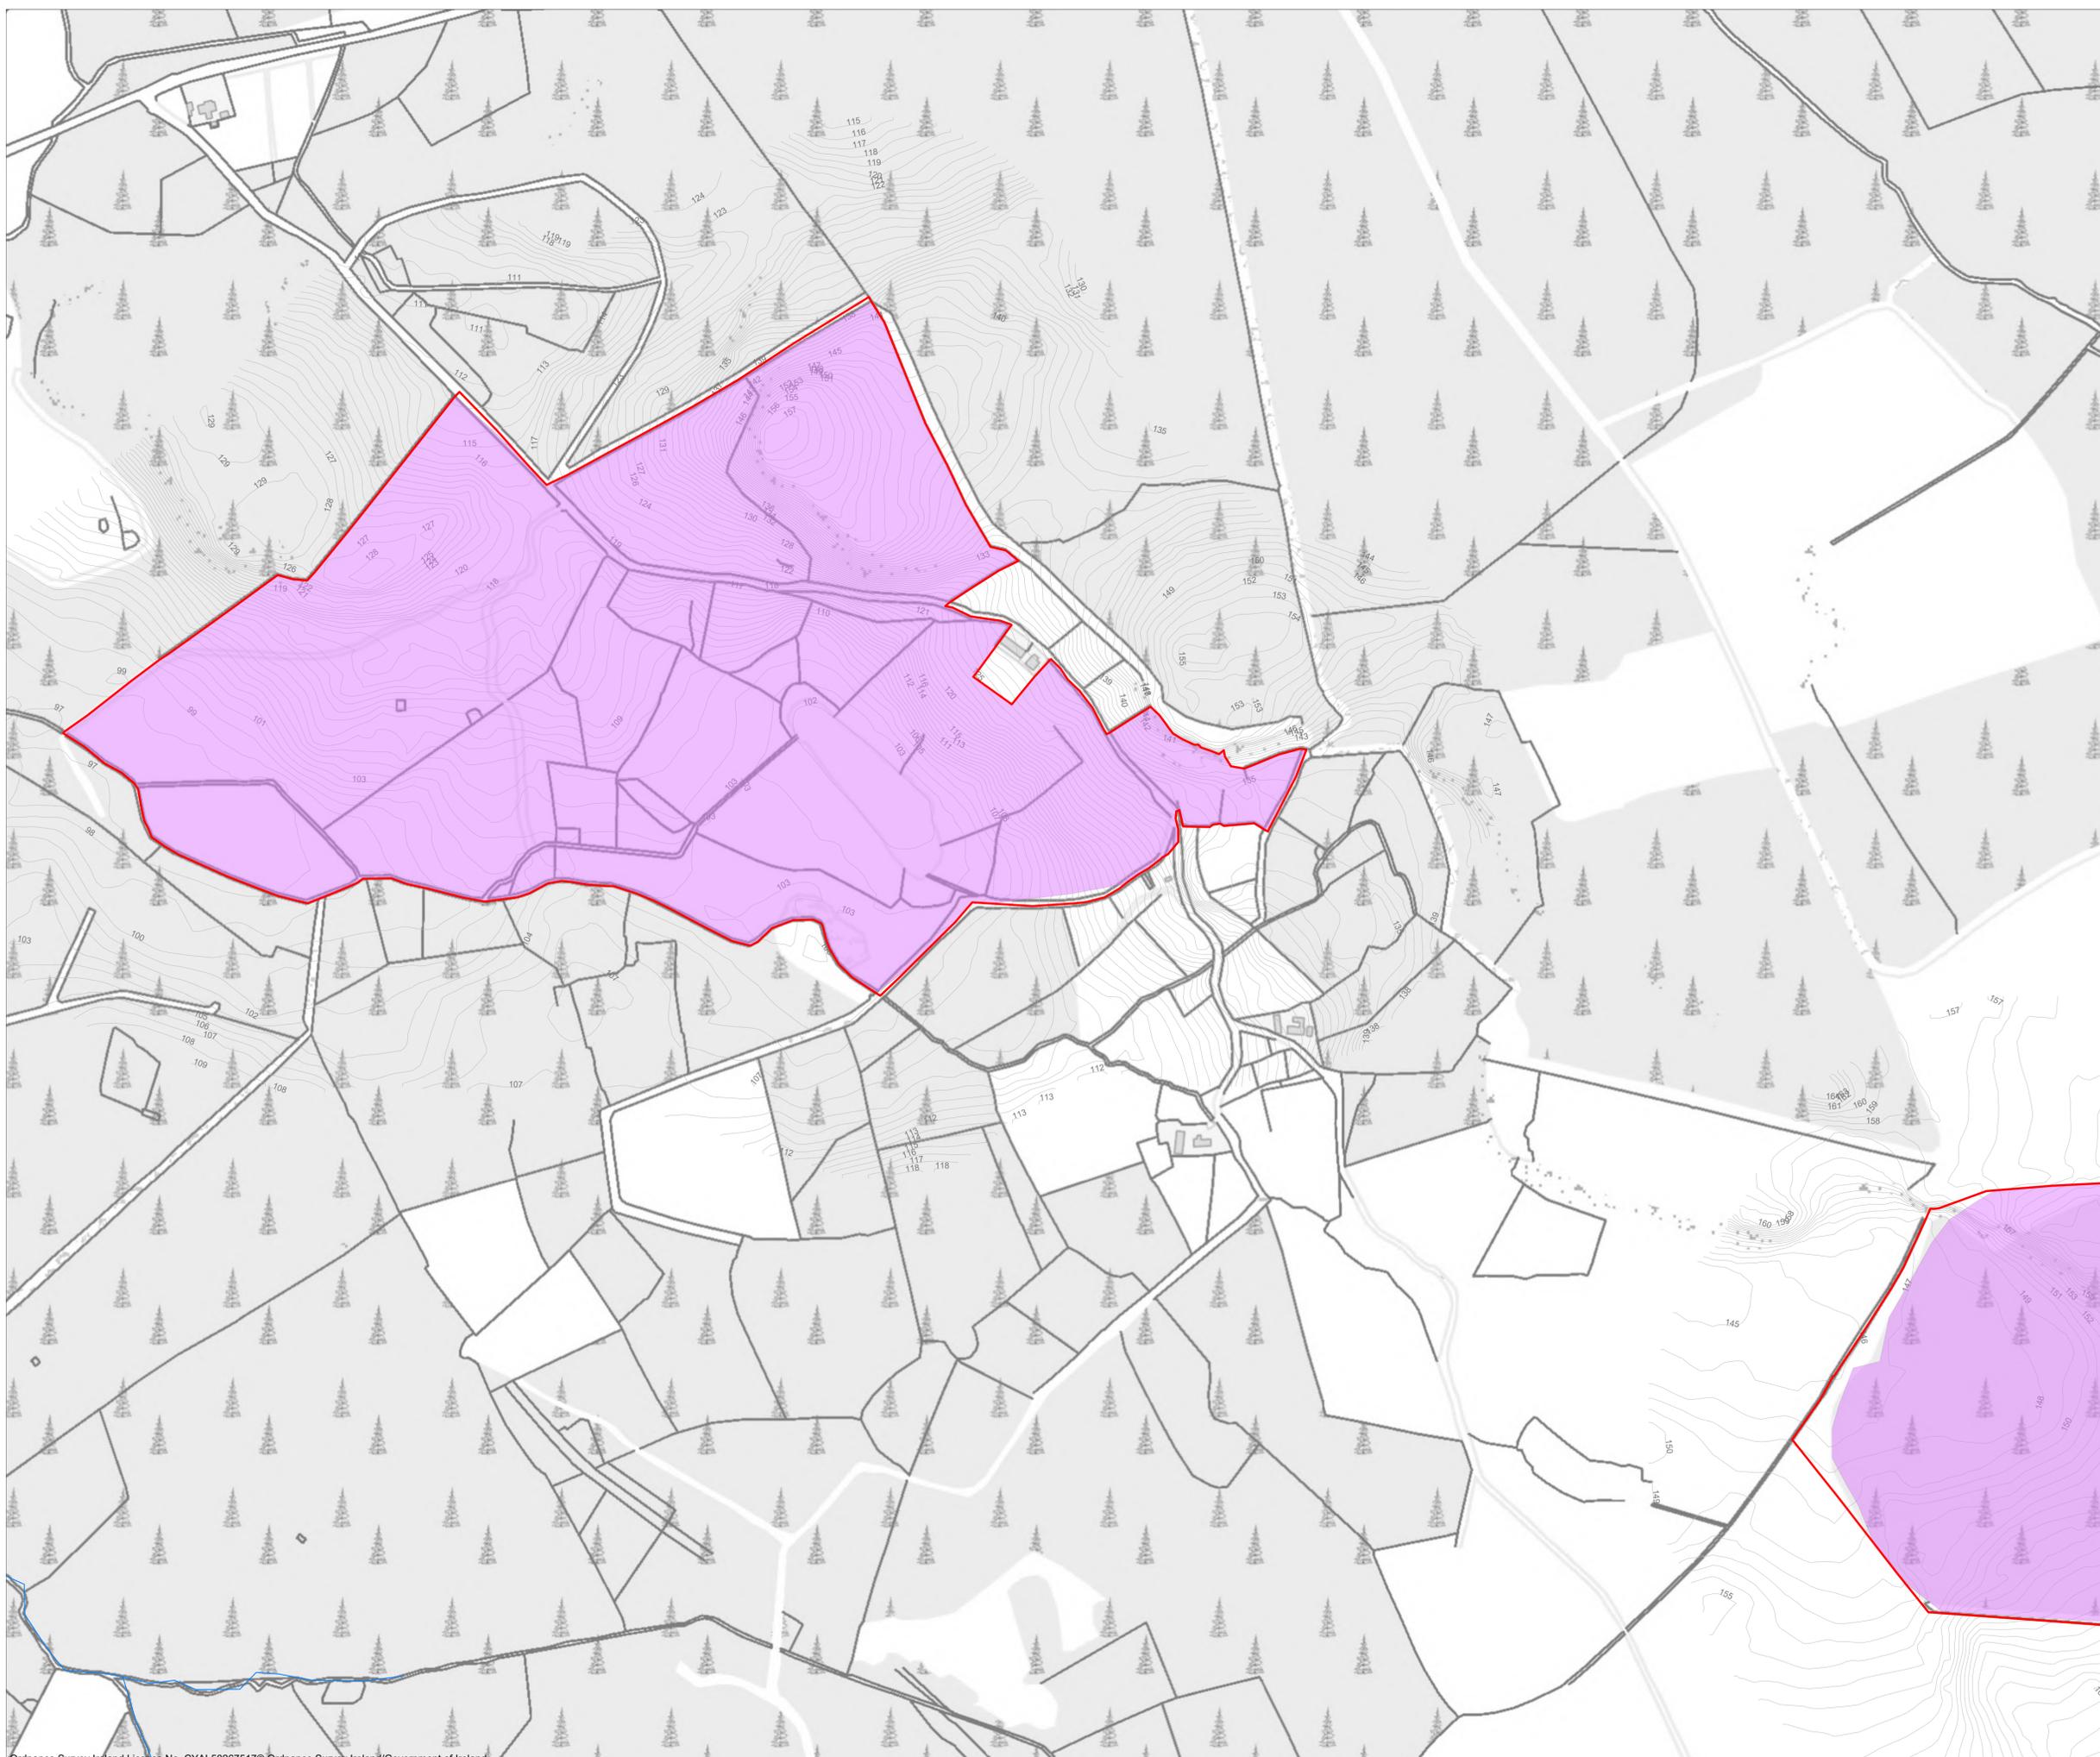

- Project Design Drawing Notes**
1. Drawings issued are for planning application purposes only.
 2. Drawings not to be used for construction/contract conditions.
 3. Copyright, all rights reserved. No part herewith may be copied or reproduced partially or wholly in any form whatsoever without the prior notice of the copyright owner McCarthy Keville O'Sullivan.
 4. Do not scale off this drawing. Figured metric dimensions only should be taken off this drawing.
 5. All contractors, whether main or sub-contractors, must visit the site and are responsible for taking and checking any and all dimensions and levels that relate to the works.
 6. The use of or reliance upon this drawing shall be deemed to be acceptance of these conditions of use unless otherwise agreed in writing, such written agreement to be sought from and issued by the copyright holder to the use or reliance upon this drawing.
 7. Layout plans show typical Turbine rotor diameter as per turbine drawing.
 8. Final levels may vary depending on local ground conditions.

- Drawing Legend**
- Planning Application Boundary
 - Biodiversity Enhancement Areas
 - Watercourse



PROJECT TITLE: **Proposed Cahermurphy West Wind Farm, Co. Clare**


DRAWING TITLE: **Site Layout Plan Sheet 5 of 10**

PROJECT No.: 230843	DRAWING No.: 230843 - 04E	SCALE: 1:2,500 @ A1
DRAWN BY: JOB	CHECKED BY: AC	DATE: 11.03.2026
		REVISION: D01

OS SHEET No.: 4373, 4374, 4375, 4431, 4432, 4433, 4490, 4491, 4492, 4550, 4551, 4552, 4609, 4610, 4611



Email: info@www.mkoireland.ie / Website: www.mkoireland.ie

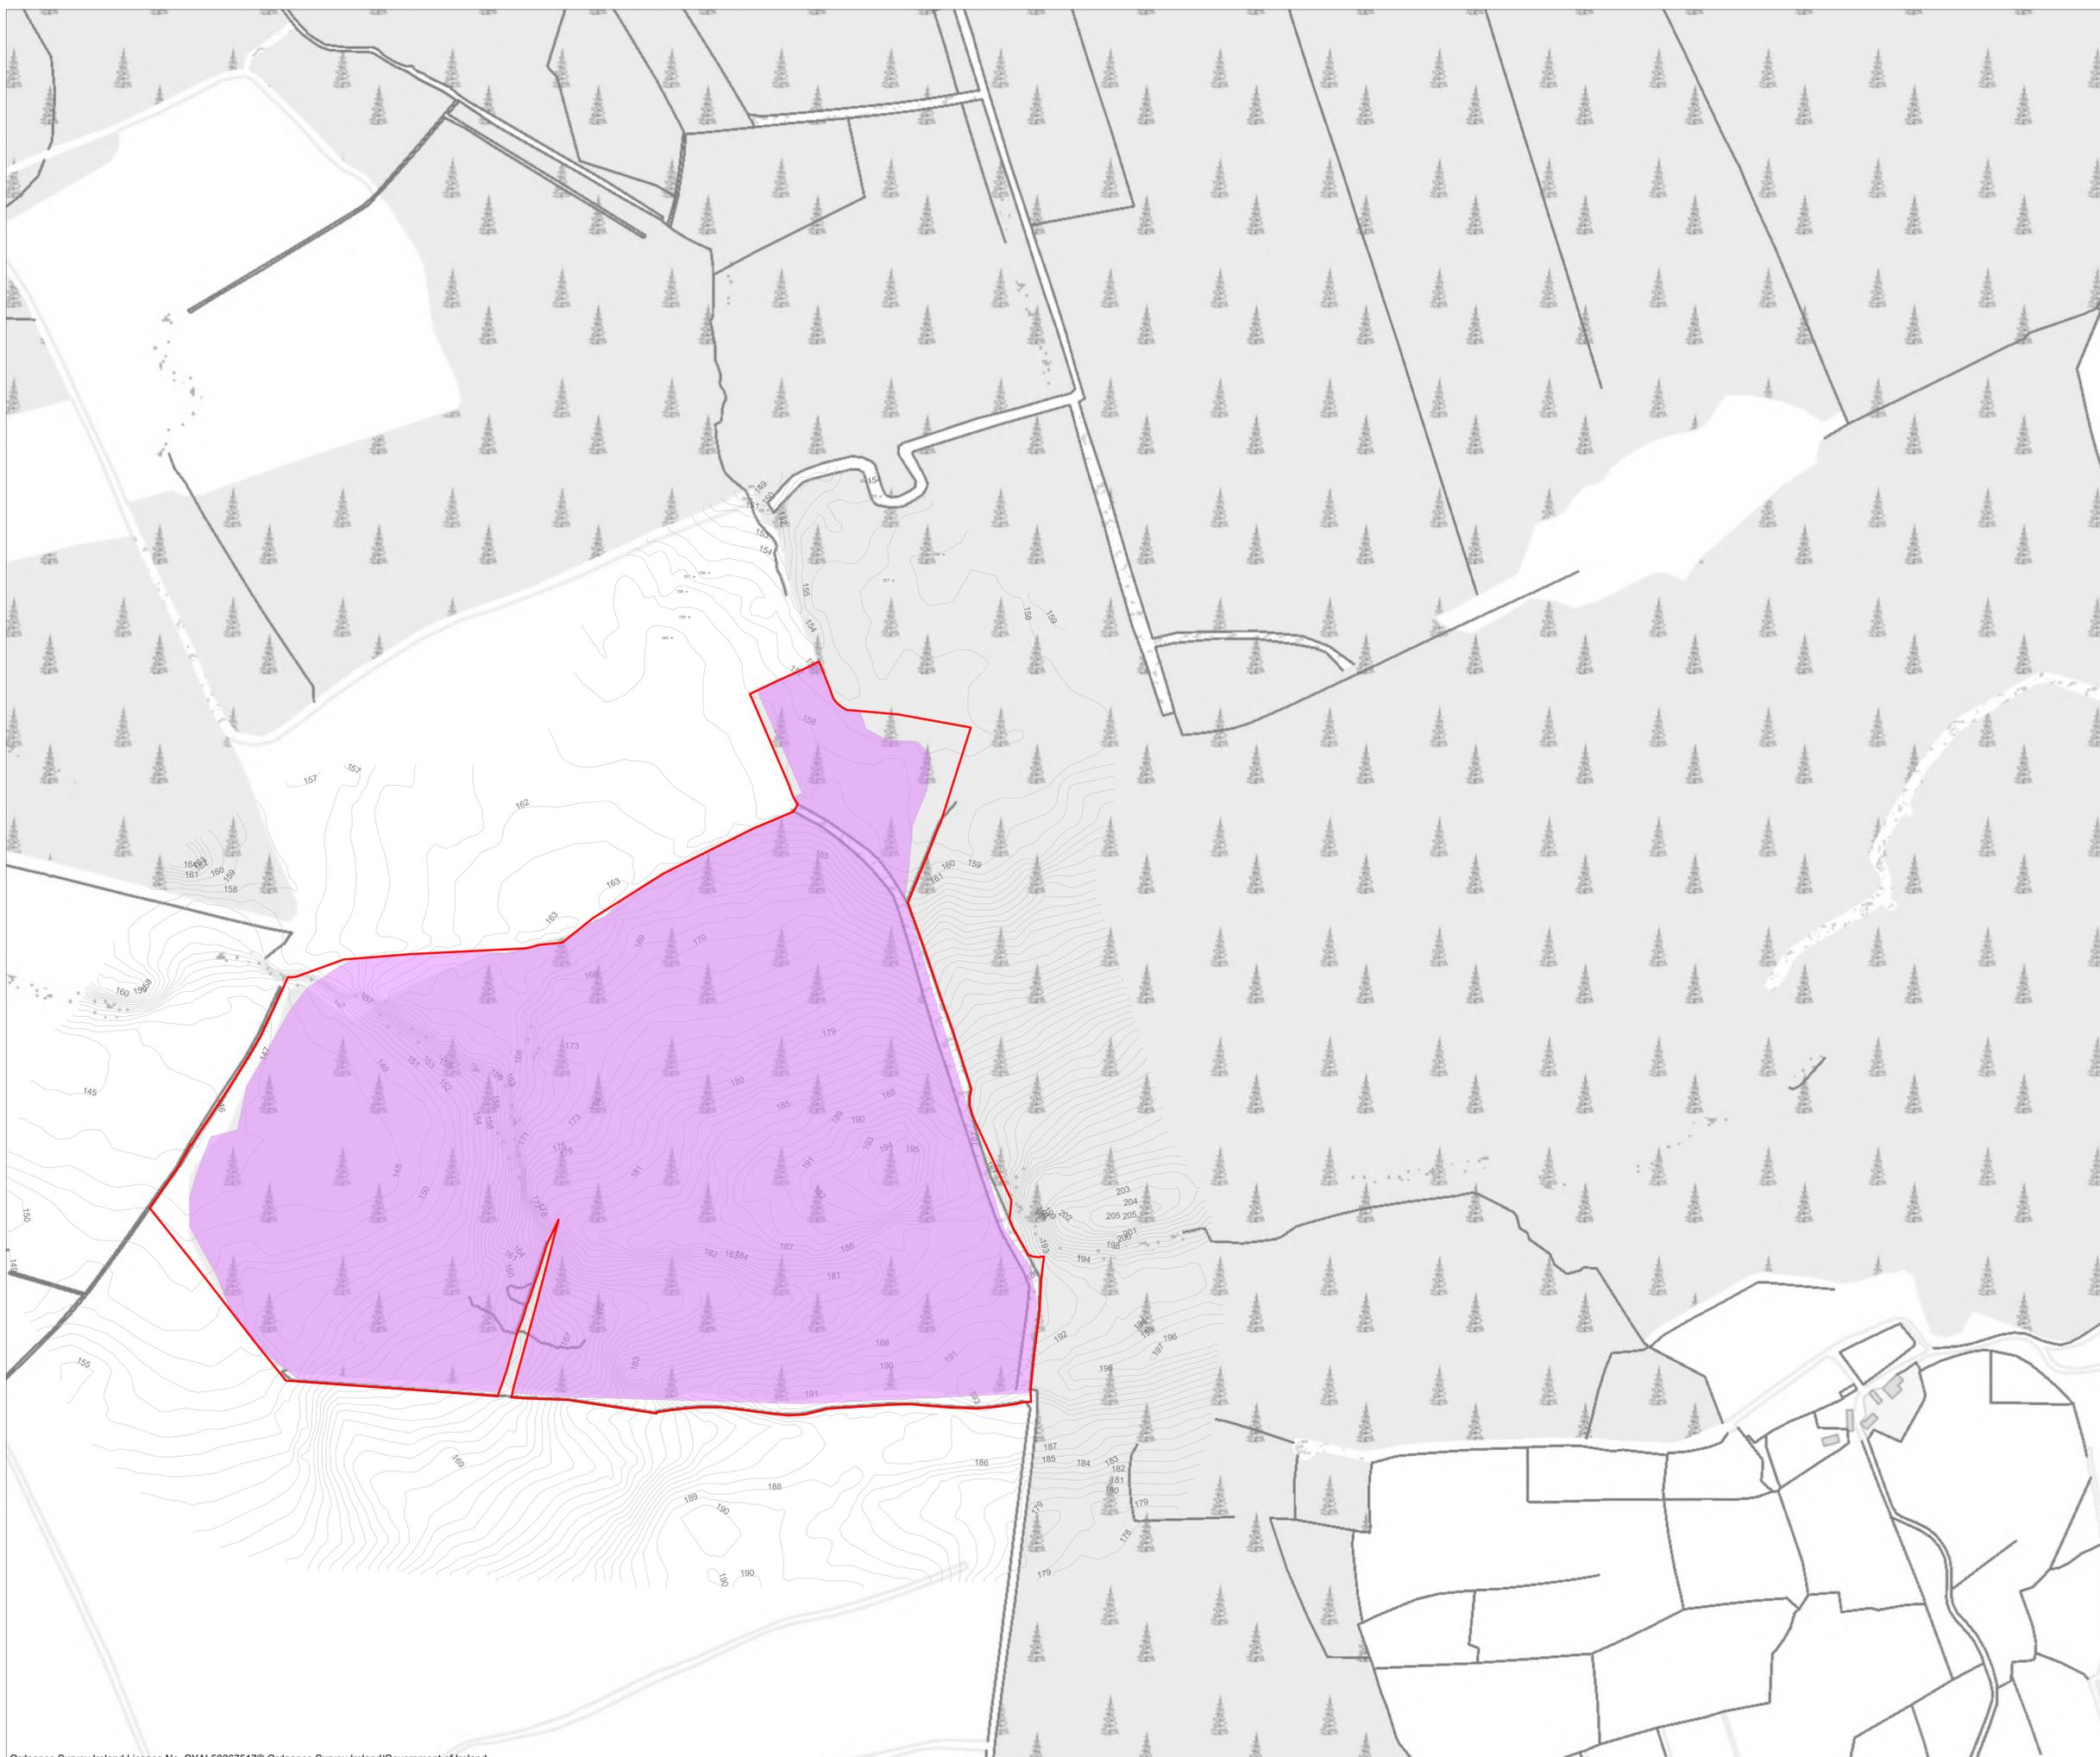

- Project Design Drawing Notes**
1. Drawings issued are for planning application purposes only.
 2. Drawings not to be used for construction/contract conditions.
 3. Copyright, all rights reserved. No part herewith may be copied or reproduced partially or wholly in any form whatsoever without the prior notice of the copyright owner McCarthy Keville O'Sullivan.
 4. Do not scale off this drawing. Figured metric dimensions only should be taken off this drawing.
 5. All contractors, whether main or sub-contractors, must visit the site and are responsible for taking and checking any and all dimensions and levels that relate to the works.
 6. The use of or reliance upon this drawing shall be deemed to be acceptance of these conditions of use unless otherwise agreed in writing, such written agreement to be sought from and issued by the copyright holder to the use or reliance upon this drawing.
 7. Layout plans show typical Turbine rotor diameter as per turbine drawing.
 8. Final levels may vary depending on local ground conditions.

- Drawing Legend**
- Planning Application Boundary
 - Biodiversity Enhancement Areas



PROJECT TITLE: **Proposed Cahermurphy West Wind Farm, Co. Clare**


DRAWING TITLE: **Site Layout Plan Sheet 6 of 10**

PROJECT No.: 230843	DRAWING No.: 230843 - 04F	SCALE: 1:2,500 @ A1
DRAWN BY: JOB	CHECKED BY: AC	DATE: 11.03.2026
		REVISION: D01

OS SHEET No.: 4373, 4374, 4375, 4431, 4432, 4433, 4490, 4491, 4492, 4550, 4551, 4552, 4609, 4610, 4611



Email: info@www.mkoireland.ie / Website: www.mkoireland.ie

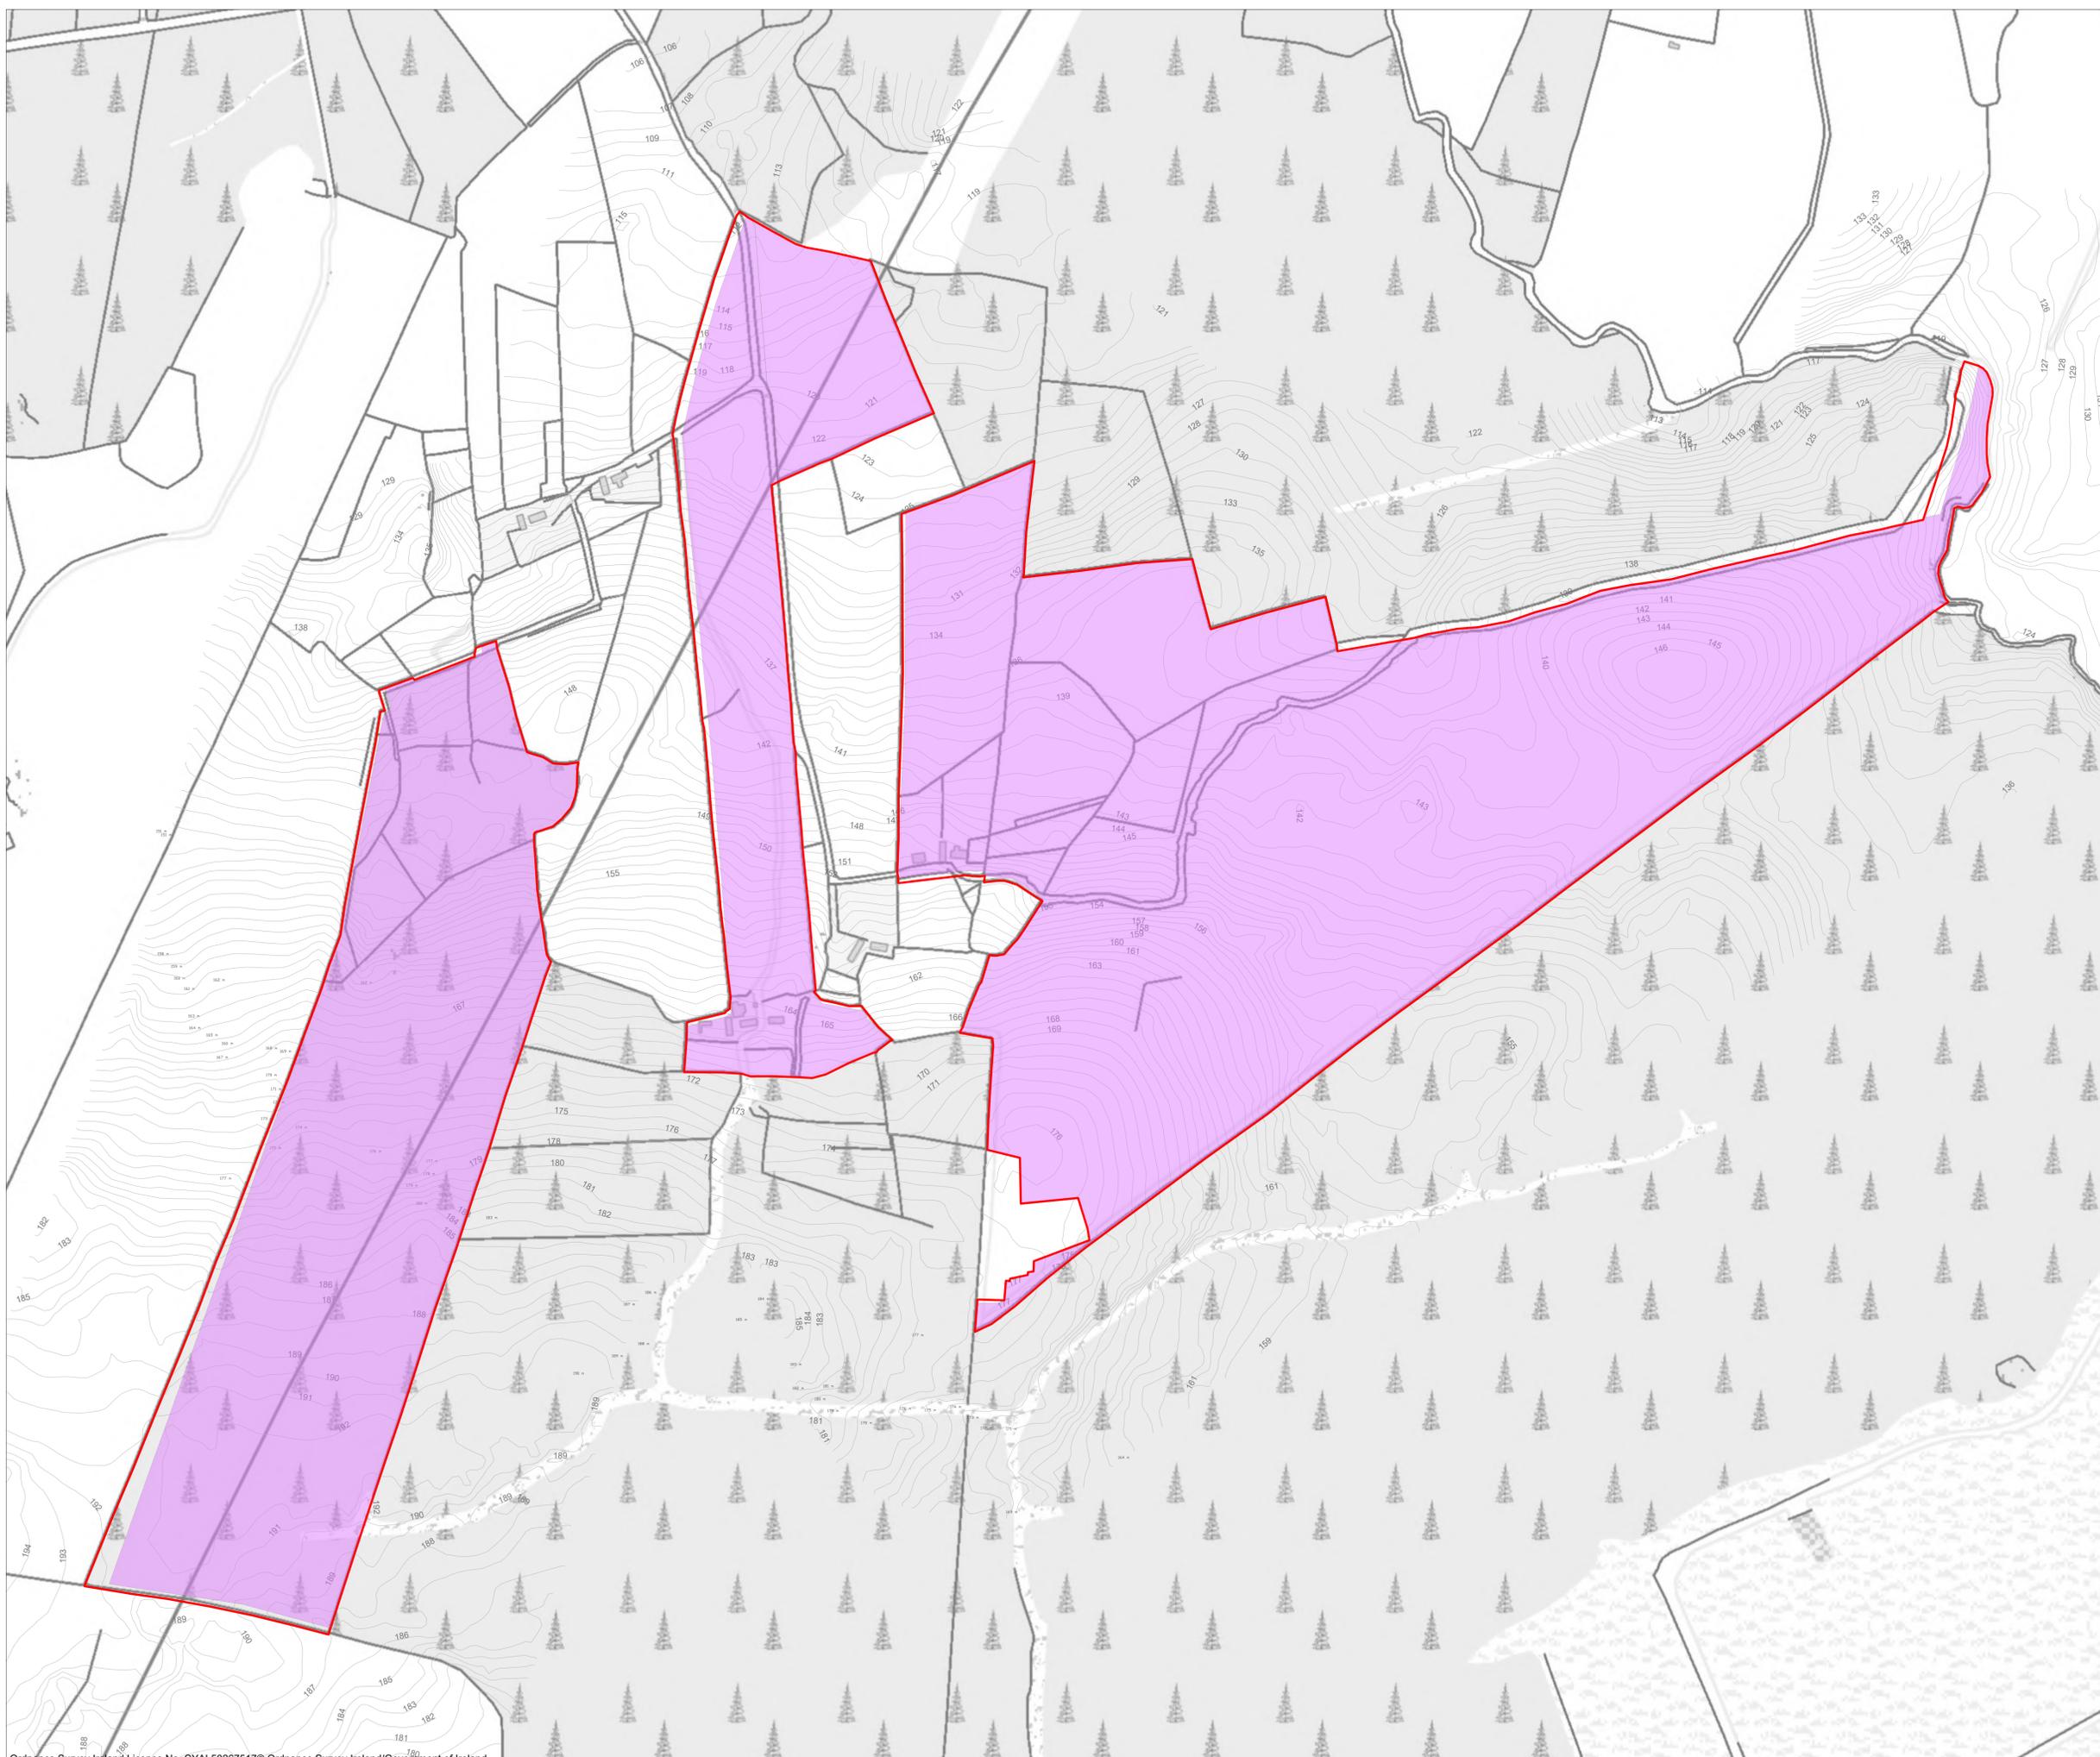

- Project Design Drawing Notes**
1. Drawings issued are for planning application purposes only.
 2. Drawings not to be used for construction/contract conditions.
 3. Copyright, all rights reserved. No part herewith may be copied or reproduced partially or wholly in any form whatsoever without the prior notice of the copyright owner McCarthy Keville O'Sullivan.
 4. Do not scale off this drawing. Figured metric dimensions only should be taken off this drawing.
 5. All contractors, whether main or sub-contractors, must visit the site and are responsible for taking and checking any and all dimensions and levels that relate to the works.
 6. The use of or reliance upon this drawing shall be deemed to be acceptance of these conditions of use unless otherwise agreed in writing, such written agreement to be sought from and issued by the copyright holder to the use or reliance upon this drawing.
 7. Layout plans show typical Turbine rotor diameter as per turbine drawing.
 8. Final levels may vary depending on local ground conditions.

- Drawing Legend**
- Planning Application Boundary
 - Biodiversity Enhancement Areas



PROJECT TITLE: **Proposed Cahermurphy West Wind Farm, Co. Clare**

DRAWING TITLE: **Site Layout Plan Sheet 7 of 10**

PROJECT No.: 230843	DRAWING No.: 230843 - 04G	SCALE: 1:2,500 @ A1
DRAWN BY: JOB	CHECKED BY: AC	REVISION: D01
DATE: 11.03.2026		

OS SHEET No.: 4373, 4374, 4375, 4431, 4432, 4433, 4490, 4491, 4492, 4550, 4551, 4552, 4609, 4610, 4611



Email: info@www.mkoireland.ie / Website: www.mkoireland.ie



- Project Design Drawing Notes**
1. Drawings issued are for planning application purposes only.
 2. Drawings not to be used for construction/contract conditions.
 3. Copyright, all rights reserved. No part herewith may be copied or reproduced partially or wholly in any form whatsoever without the prior notice of the copyright owner McCarthy Keville O'Sullivan.
 4. Do not scale off this drawing. Figured metric dimensions only should be taken off this drawing.
 5. All contractors, whether main or sub-contractors, must visit the site and are responsible for taking and checking any and all dimensions and levels that relate to the works.
 6. The use of or reliance upon this drawing shall be deemed to be acceptance of these conditions of use unless otherwise agreed in writing, such written agreement to be sought from and issued by the copyright holder to the use or reliance upon this drawing.
 7. Layout plans show typical Turbine rotor diameter as per turbine drawing.
 8. Final levels may vary depending on local ground conditions.

- Drawing Legend**
- Planning Application Boundary
 - Proposed Road
 - ▨ Temporary Delivery Access Road
 - Temporary Fence Removal
 - Cahermurphy West 110kV Grid Connection Application Boundary

PROJECT TITLE:			Proposed Cahermurphy West Wind Farm, Co. Clare
DRAWING TITLE:			Site Layout Plan Sheet 8 of 10
PROJECT No.:	DRAWING No.:	SCALE:	
230843	230843 - 04H	1:2,500 @ A3	
DRAWN BY:	CHECKED BY:	DATE:	REVISION.:
JOB	AC	11.03.2026	D01
OS SHEET No.:			
4373, 4374, 4375, 4431, 4432, 4433, 4490, 4491, 4492, 4550, 4551, 4552, 4609, 4610, 4611			



Email: info@www.mkoireland.ie / Website: www.mkoireland.ie



- Project Design Drawing Notes**
1. Drawings issued are for planning application purposes only.
 2. Drawings not to be used for construction/contract conditions.
 3. Copyright, all rights reserved. No part herewith may be copied or reproduced partially or wholly in any form whatsoever without the prior notice of the copyright owner McCarthy Keville O'Sullivan.
 4. Do not scale off this drawing. Figured metric dimensions only should be taken off this drawing.
 5. All contractors, whether main or sub-contractors, must visit the site and are responsible for taking and checking any and all dimensions and levels that relate to the works.
 6. The use of or reliance upon this drawing shall be deemed to be acceptance of these conditions of use unless otherwise agreed in writing, such written agreement to be sought from and issued by the copyright holder to the use or reliance upon this drawing.
 7. Layout plans show typical Turbine rotor diameter as per turbine drawing.
 8. Final levels may vary depending on local ground conditions.

- Drawing Legend**
- Planning Application Boundary
 - ▨ Temporary Delivery Access Road
 - ~ Vegetation Trimming
 - - - Temporary Hedgerow Removal

PROJECT TITLE: **Proposed Cahermurphy West Wind Farm, Co. Clare**

DRAWING TITLE: **Site Layout Plan Sheet 9 of 10**

PROJECT No.: 230843	DRAWING No.: 230843 - 041	SCALE: 1:2,500 @ A3
DRAWN BY: JOB	CHECKED BY: AC	DATE: 11.03.2026
OS SHEET No.: 4373, 4374, 4375, 4431, 4432, 4433, 4490, 4491, 4492, 4550, 4551, 4552, 4609, 4610, 4611		REVISION: D01



Email: info@www.mkoireland.ie / Website: www.mkoireland.ie



- Project Design Drawing Notes**
1. Drawings issued are for planning application purposes only.
 2. Drawings not to be used for construction/contract conditions.
 3. Copyright, all rights reserved. No part herewith may be copied or reproduced partially or wholly in any form whatsoever without the prior notice of the copyright owner McCarthy Keville O'Sullivan.
 4. Do not scale off this drawing. Figured metric dimensions only should be taken off this drawing.
 5. All contractors, whether main or sub-contractors, must visit the site and are responsible for taking and checking any and all dimensions and levels that relate to the works.
 6. The use of or reliance upon this drawing shall be deemed to be acceptance of these conditions of use unless otherwise agreed in writing, such written agreement to be sought from and issued by the copyright holder to the use or reliance upon this drawing.
 7. Layout plans show typical Turbine rotor diameter as per turbine drawing.
 8. Final levels may vary depending on local ground conditions.

- Drawing Legend**
- Planning Application Boundary
 - Wall to be Temporarily Removed



PROJECT TITLE:
**Proposed Cahermurphy
 West Wind Farm, Co. Clare**


DRAWING TITLE:
**Site Layout Plan
 Sheet 10 of 10**

PROJECT No.: 230843	DRAWING No.: 230843 - 04J	SCALE: 1:2,500 @ A3
DRAWN BY: JOB	CHECKED BY: AC	DATE: 11.03.2026
		REVISION: D01

OS SHEET No.: 4373, 4374, 4375, 4431, 4432, 4433, 4490, 4491, 4492, 4550, 4551, 4552, 4609, 4610, 4611



Email: info@www.mkoireland.ie / Website: www.mkoireland.ie

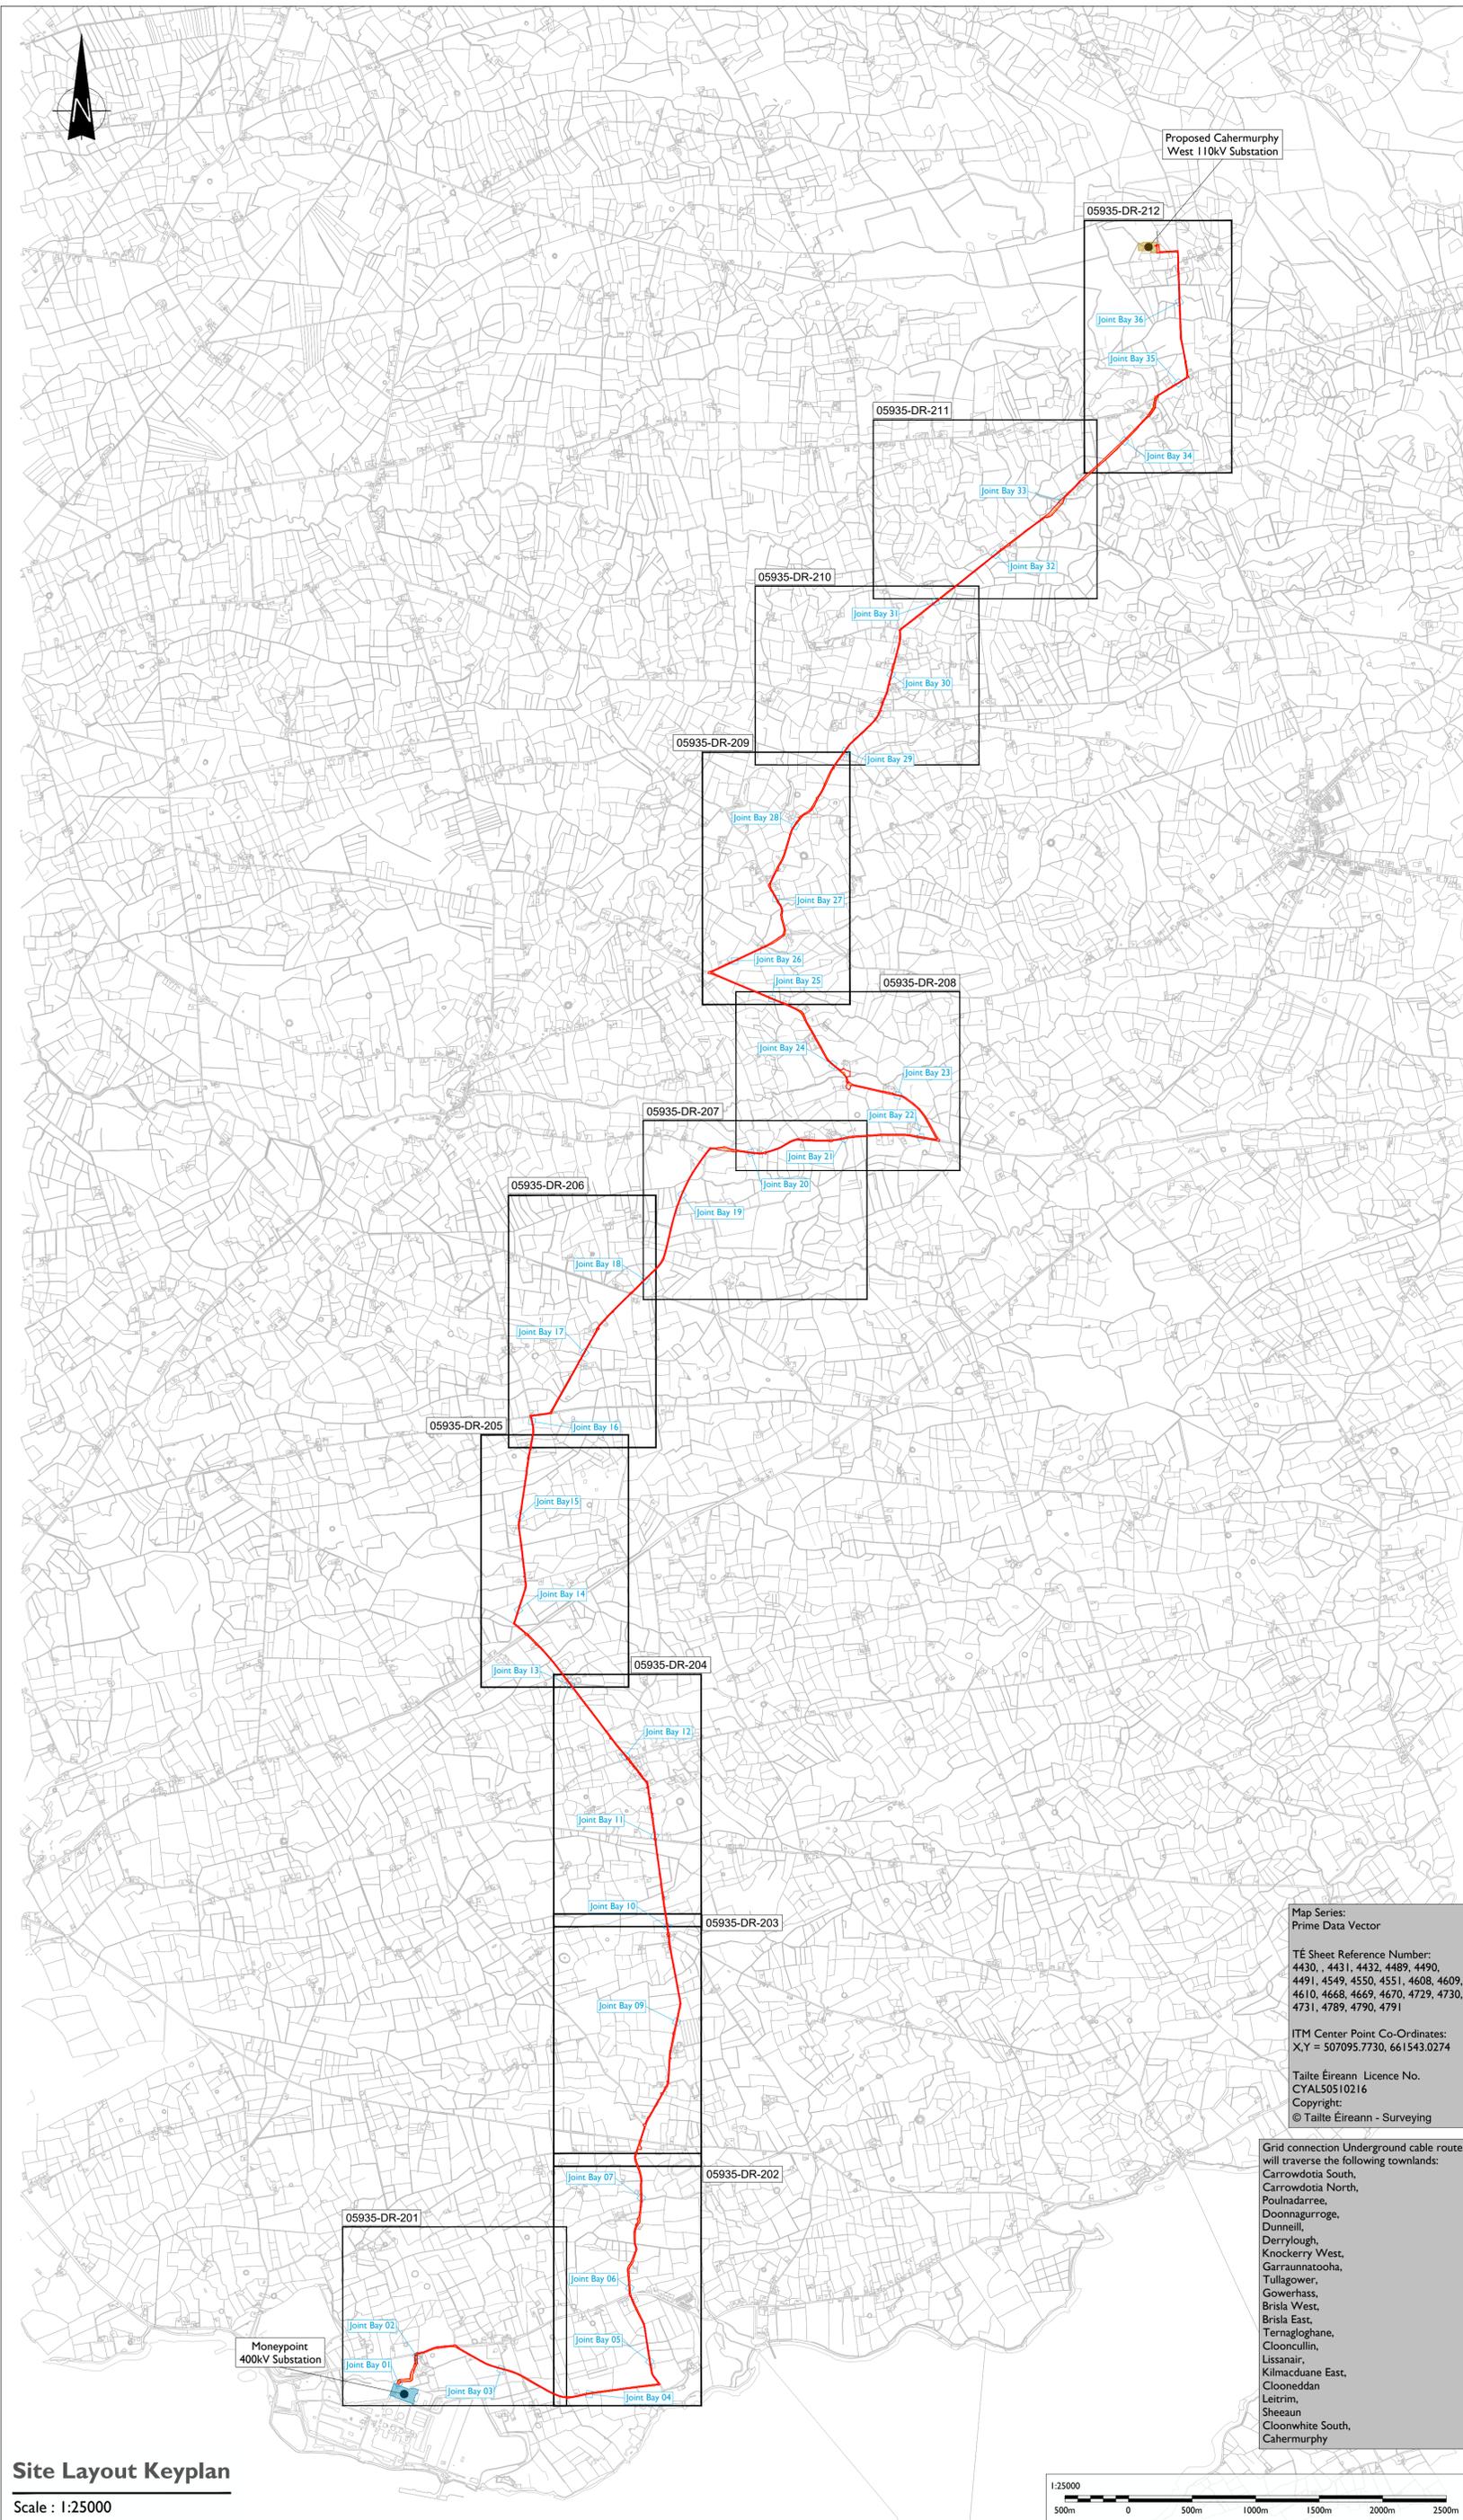

LEGEND: -

- Existing Moneypoint 400kV Substation Location [Blue hatched box]
- Proposed Cahermurphy West 110kV Substation Location [Yellow hatched box]
- Grid Connection Underground Cable Route - Approx 25.005km [Red line]
- Red Line Planning Boundary [Red dashed line]

Grid connection Underground cable route will traverse the following townlands:
 Carrowdota South,
 Carrowdota North,
 Poulindarree,
 Doonagurroe,
 Dunneil,
 Derrylough,
 Knockerry West,
 Garraunatooha,
 Tullagower,
 Gowerhass,
 Brisla West,
 Brisla East,
 Ternagloghane,
 Clooncullin,
 Lissanair,
 Kilmacduane East,
 Cloonedan
 Leitrim,
 Sheeuan
 Cloonwhite South,
 Cahermurphy

NOTES: -

- This drawing is to be used only for the purpose of the planning application and is subject to detailed design.
- Position of underground cable and location of joint bays, links boxes and comms chambers may vary depending on site conditions.
- Position of link boxes and comms chambers is to be agreed onsite with EirGrid/ESB.
- Other services may be encountered on the route.
- Position of HDD launch/reception shown points are indicative only and will be subject to site investigation works and detailed design.
- Contours derived from DTM elevations referenced to Mean Head Vertical Datum



Head Office: Beenreigh, Abbeydorney, Tralee, Co. Kerry, Ireland, Tel: 00353 66 7135710
 Regional Office: Basepoint Business Centre, Stroudley Road, Basingstoke, Hampshire, RG24 8UP, UK, Tel: 00 44 1256406664

PROJECT
Cahermurphy West
Wind Farm 110kV
Grid Connection

CLIENT
FuturaEnergy Ireland

CONSULTANTS
MKO

ISSUE/REVISION

NO	DATE	DESCRIPTION
P3	13.03.26	Issued for Planning
P2	5.03.26	Issued for Planning
P1	12.12.25	Issued for Planning
N3	03.11.25	Issued for Information
N2	03.10.25	Issued for Information
N1	15.08.25	Issued for Information

PROJECT NUMBER
 05-935

SHEET TITLE
 Site Layout Keyplan

SHEET NUMBER
 05935-DR-200

Map Series:
 Prime Data Vector


TÉ Sheet Reference Number:
 4430, 4431, 4432, 4489, 4490,
 4491, 4549, 4550, 4551, 4608, 4609,
 4610, 4668, 4669, 4670, 4729, 4730,
 4731, 4789, 4790, 4791

ITM Center Point Co-Ordinates:
 X,Y = 507095.7730, 661543.0274

Tailte Éireann Licence No.
 CYALS0510216
 Copyright:
 © Tailte Éireann - Surveying

Grid connection Underground cable route will traverse the following townlands:
 Carrowdota South,
 Carrowdota North,
 Poulindarree,
 Doonagurroe,
 Dunneil,
 Derrylough,
 Knockerry West,
 Garraunatooha,
 Tullagower,
 Gowerhass,
 Brisla West,
 Brisla East,
 Ternagloghane,
 Clooncullin,
 Lissanair,
 Kilmacduane East,
 Cloonedan
 Leitrim,
 Sheeuan
 Cloonwhite South,
 Cahermurphy

Site Layout Keyplan
 Scale : 1:25000





Map Series:
Prime Data Vector

OSI Sheet Reference Number:
4430, 4431, 4432, 4489, 4490,
4491, 4549, 4550, 4551, 4608, 4609,
4610, 4668, 4669, 4670, 4729, 4730,
4731, 4789, 4790, 4791

ITM Center Point Co-Ordinates:
X,Y = 507095.7730, 661543.0274

Taithe Éireann Licence No.
CYAL50492393

Copyright:
© Taithe Éireann - Surveying



Head Office
Beenrigh,
Abbeydonney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

Regional Office
Basepoint Business Centre
Stroudley Road, Basingstoke,
Hampshire,
RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

**Cahermurphy West
Wind Farm 110kV
Grid Connection**

CLIENT



CONSULTANTS



NOTES: -

- This drawing is to be used only for the purpose of the planning application and is subject to detailed design.
- Position of underground cable and location of joint bays, links boxes and comms chambers may vary depending on site conditions.
- Position of link boxes and comms chambers is to be agreed onsite with EirGrid/ESB.
- Other services may be encountered on the route.
- Position of HDD launch/reception shown points are indicative only and will be subject to site investigation works and detailed design.

LEGEND: -

- Existing Moneypoint 400kV Substation Location
- Red Line Planning Boundary
- Existing ESB OHL HV Network
- Existing ESB OHL LV/MV Networks
- Optioned Landownership Boundary shown thus
- Existing River Network shown thus
- Recorded Monuments & Associated Zone of Notifications shown thus
- Recorded Architectural Heritage Building (Listed Building) shown thus
- Access Track shown thus
- Irish Water Infrastructure shown thus

ISSUE/REVISION

NO	DATE	DESCRIPTION
P1	12.12.25	Issued for Planning
N3	03.11.25	Issued for Information
N2	03.10.25	Issued for Information
N1	15.08.25	Issued for Information
I/R	DATE	DESCRIPTION

PROJECT NUMBER


05-935


SHEET TITLE

Site Layout Plan -
Sheet 1 of 12

SHEET NUMBER

05935-DR-201

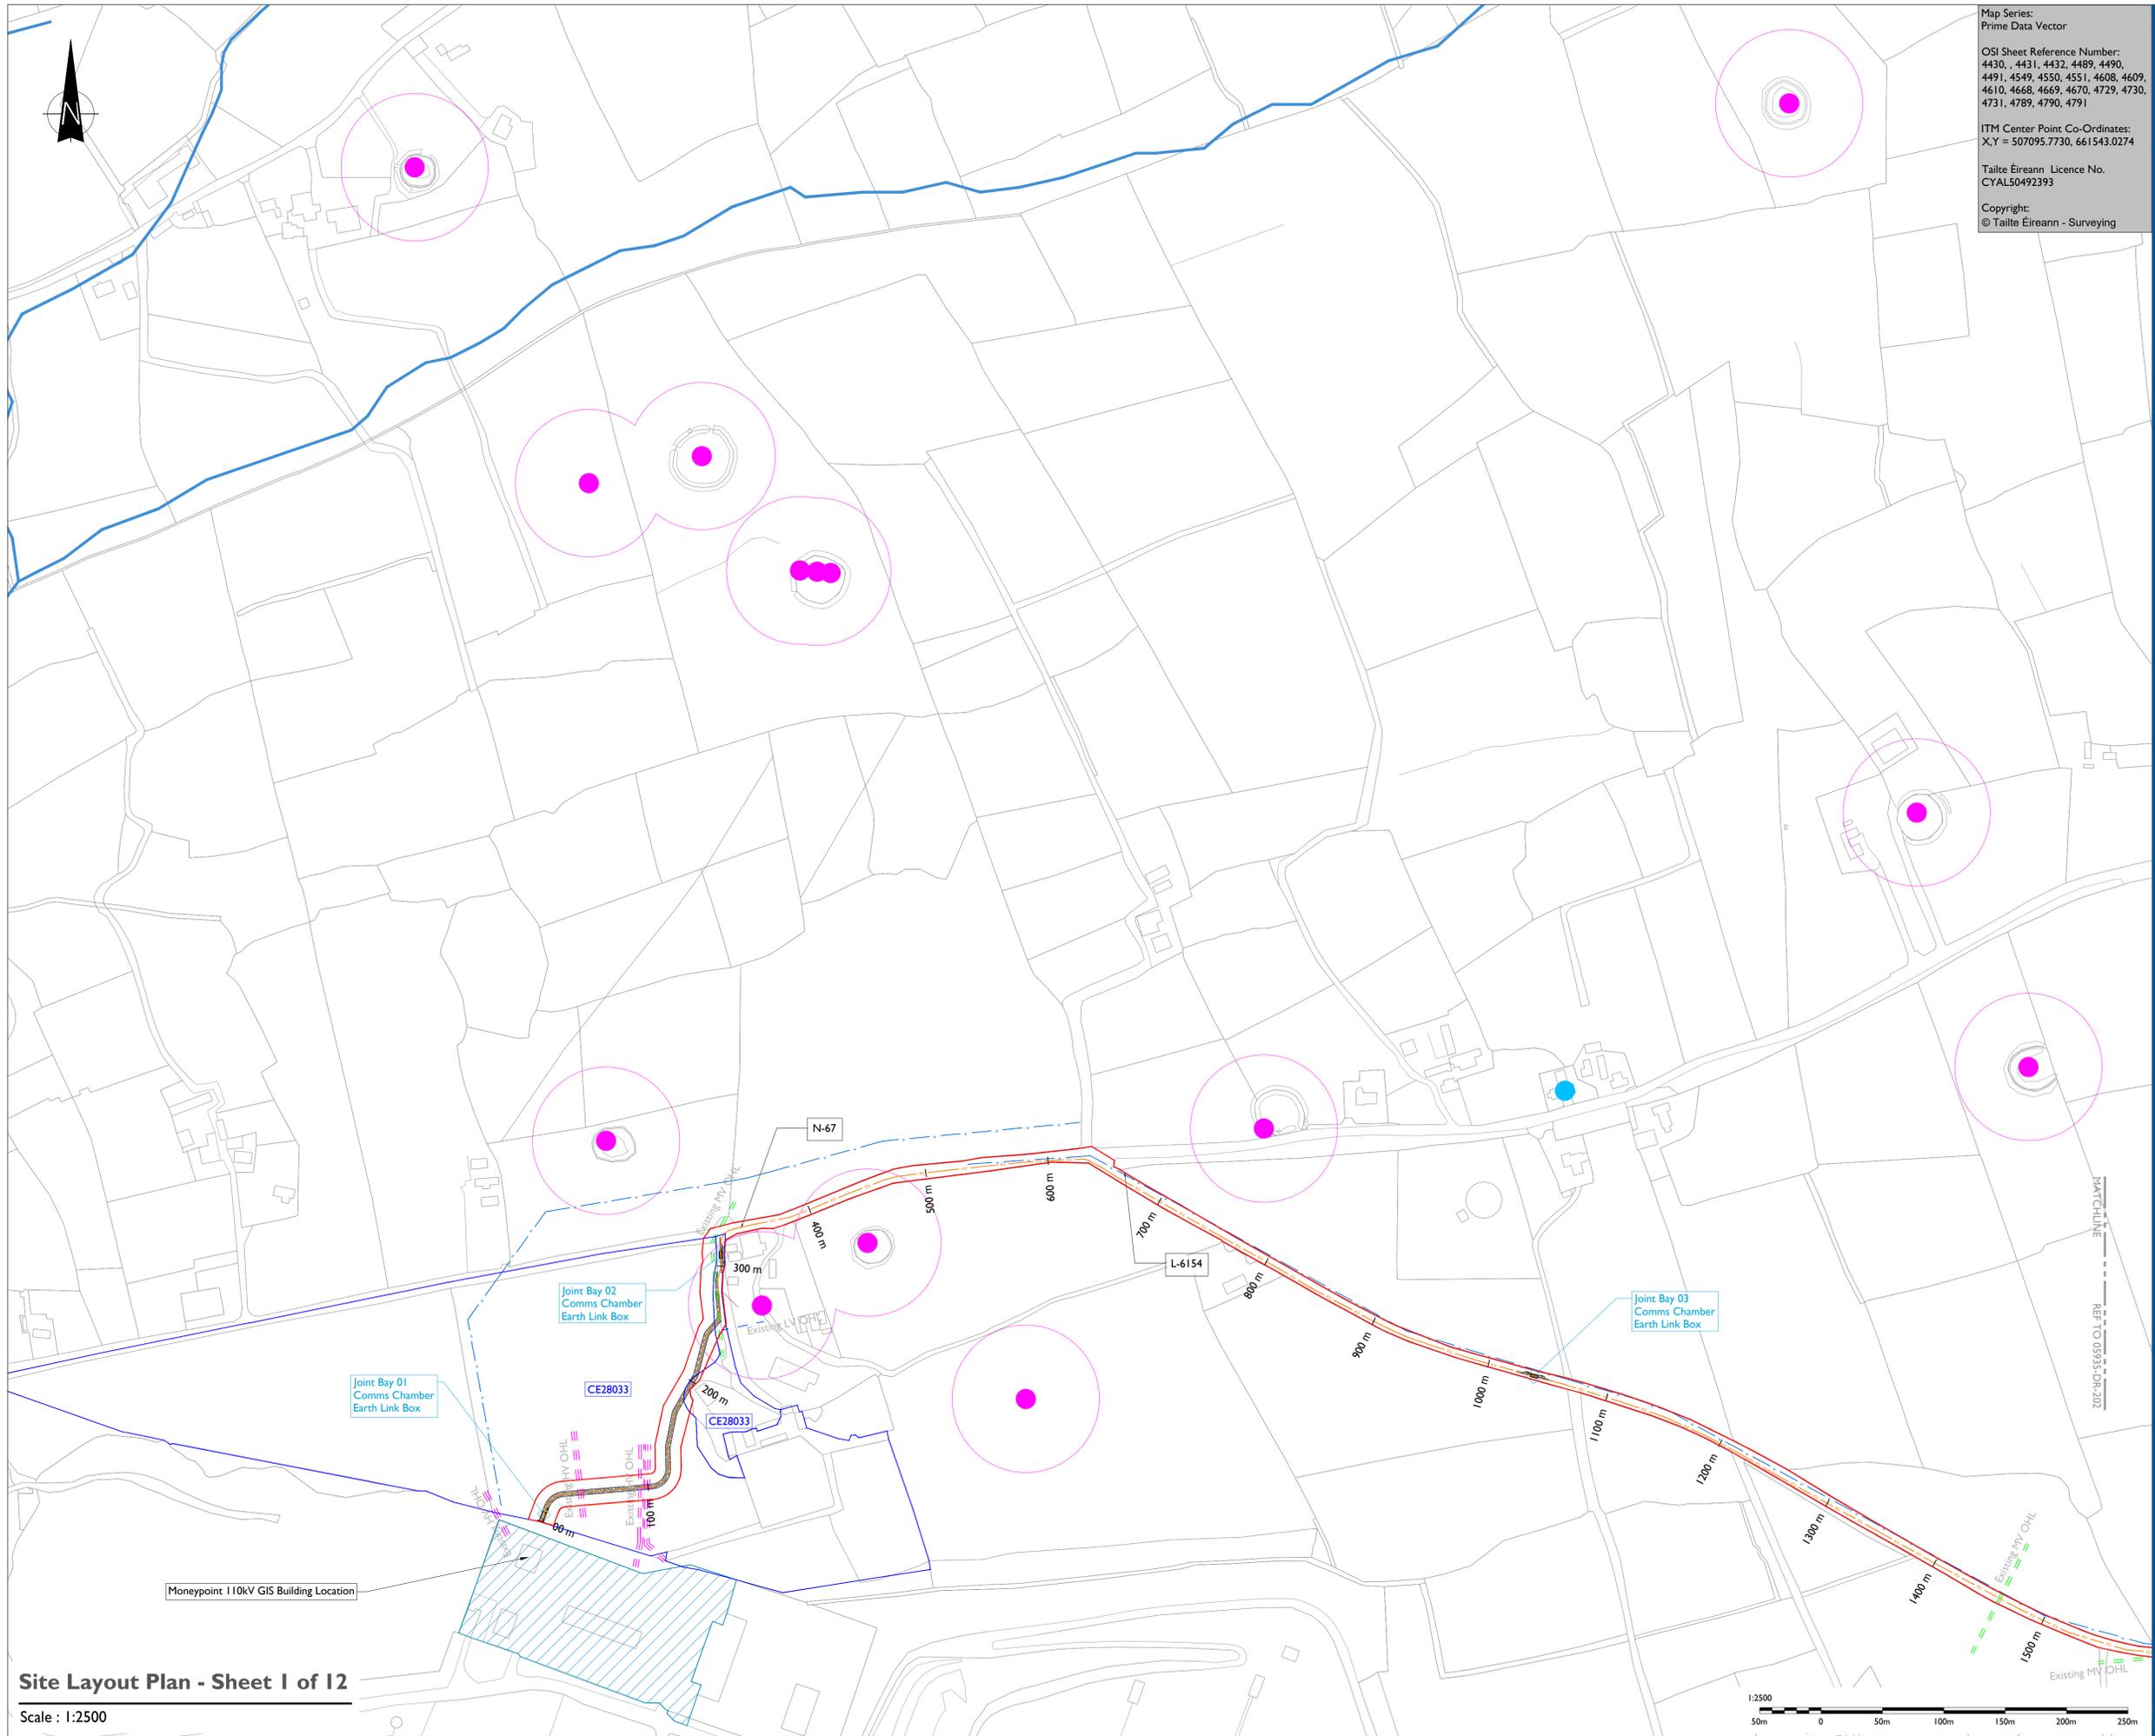

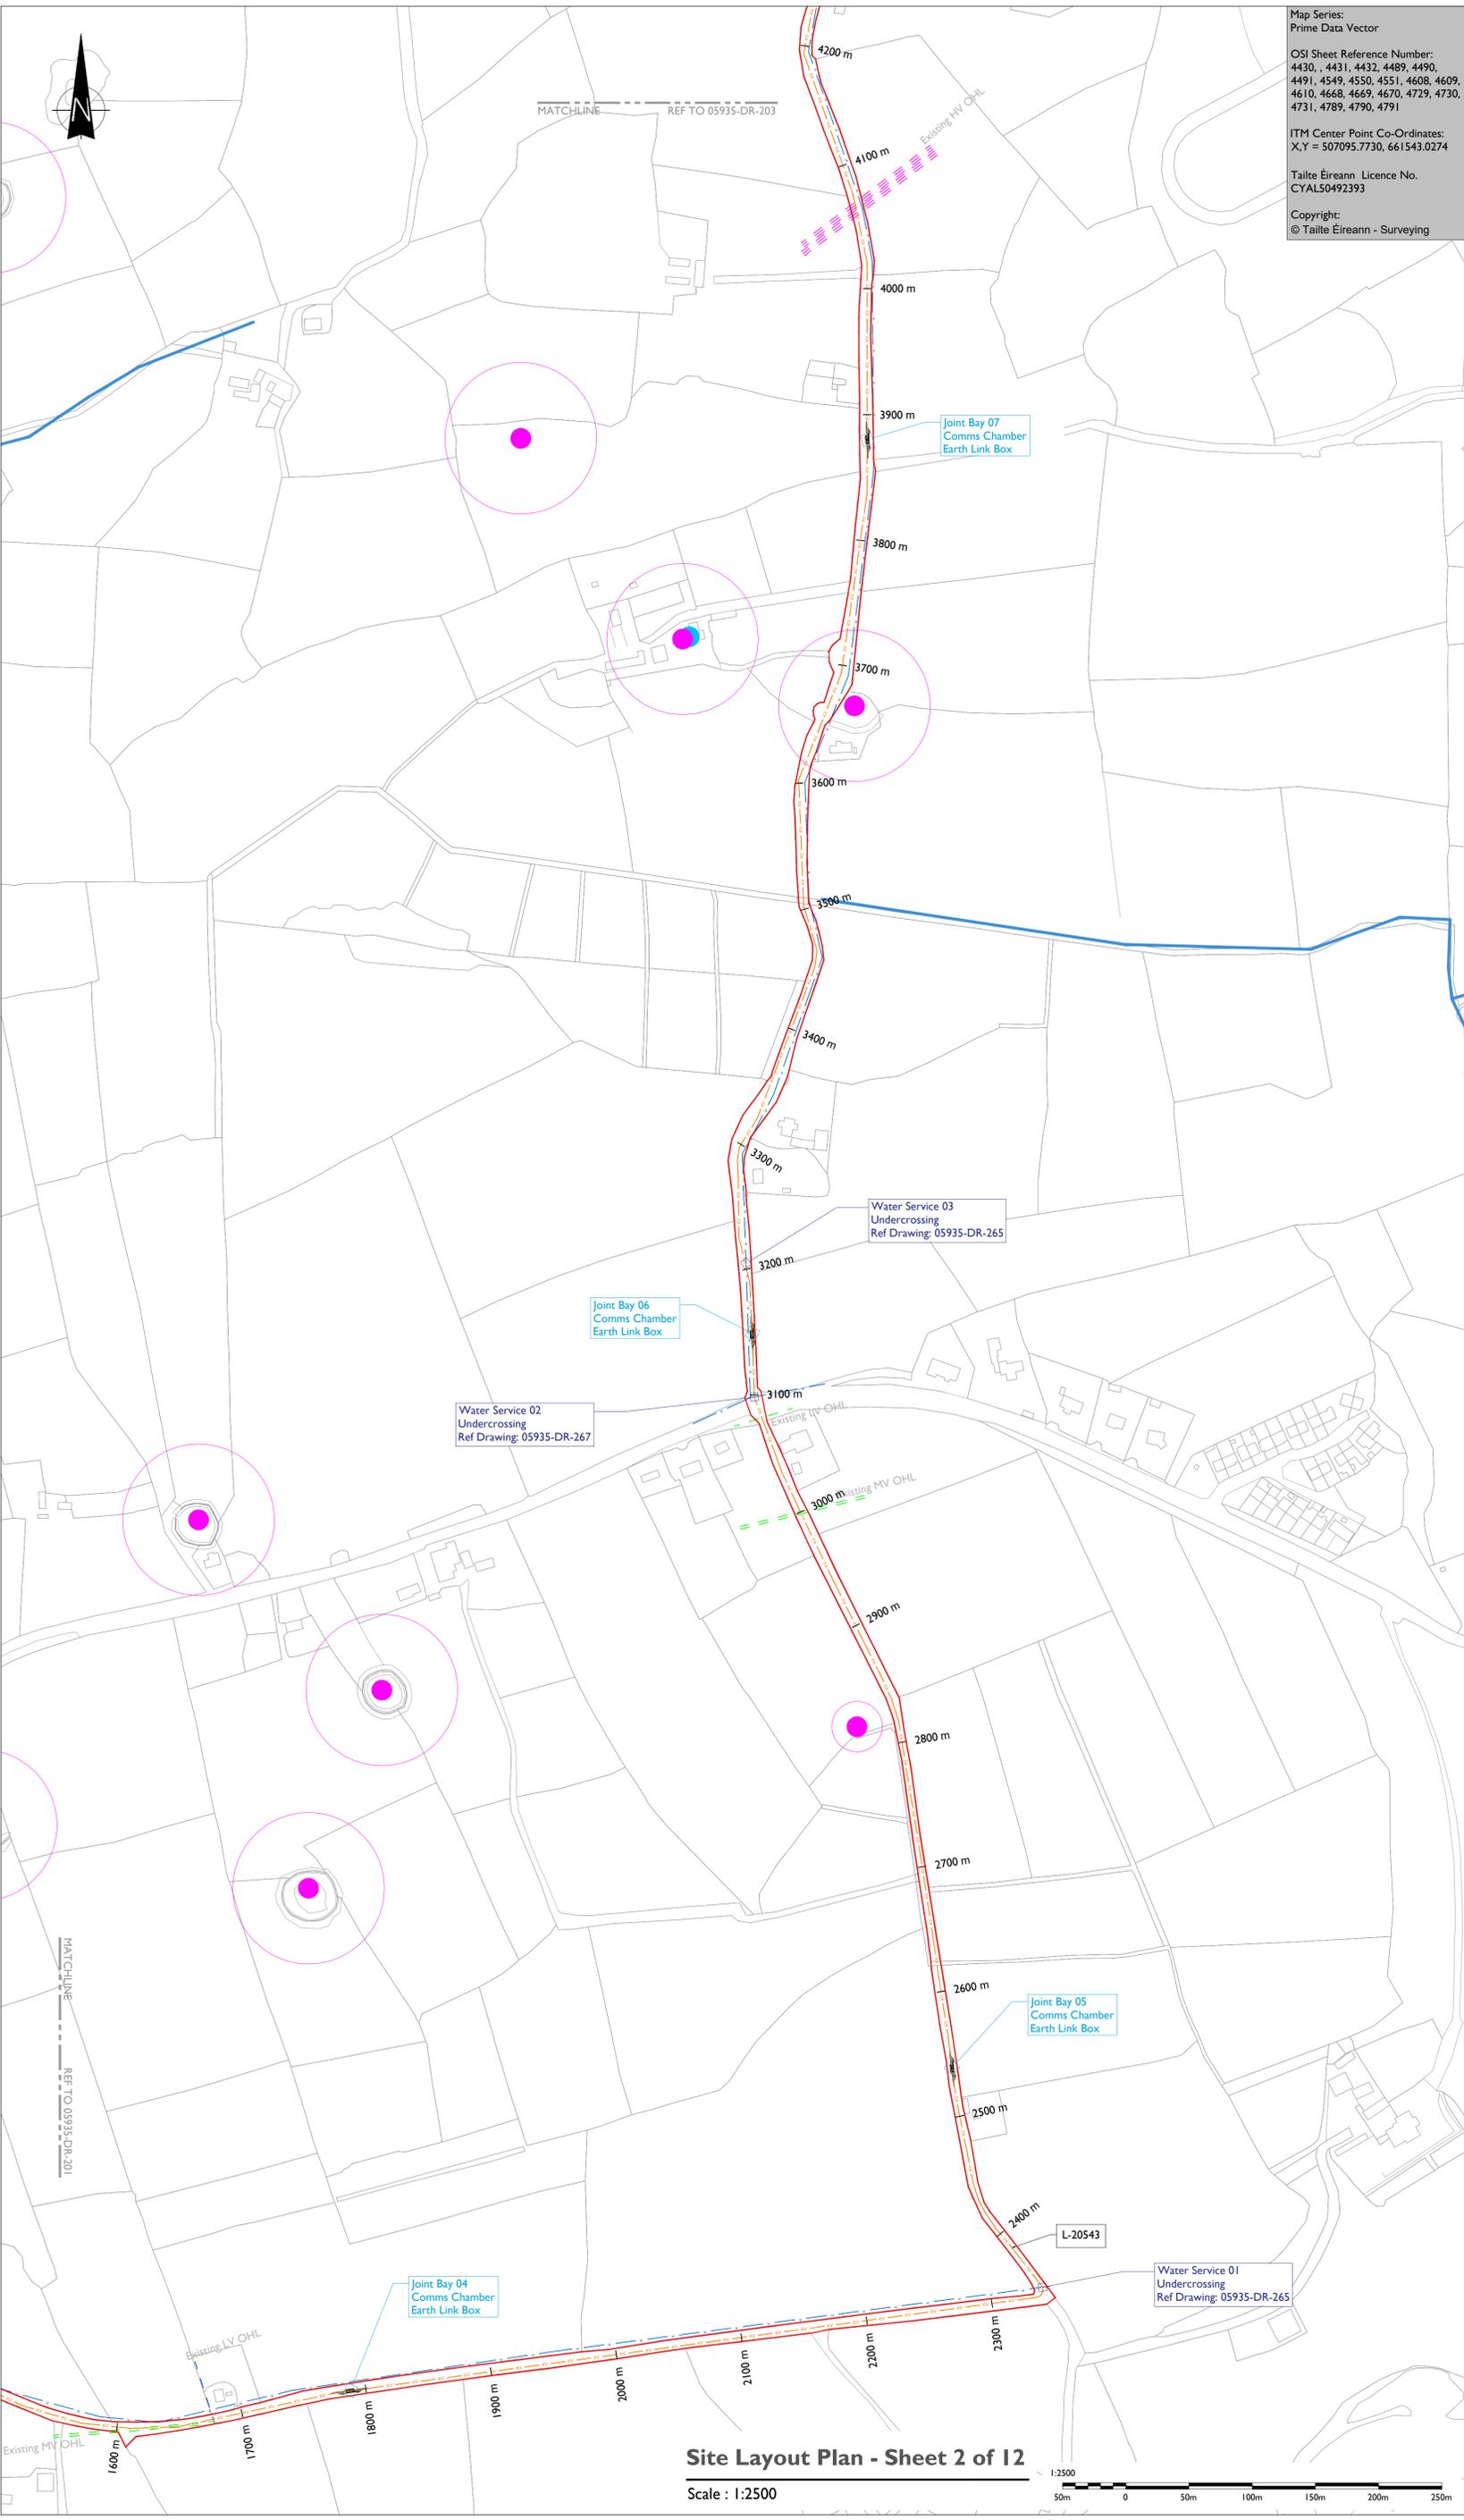

Map Series:
Prime Data Vector

OSI Sheet Reference Number:
4430, 4431, 4432, 4489, 4490,
4491, 4549, 4550, 4551, 4608, 4609,
4610, 4668, 4669, 4670, 4729, 4730,
4731, 4789, 4790, 4791

ITM Center Point Co-Ordinates:
X,Y = 507095.7730, 661543.0274

Tailte Éireann Licence No.
CYAL50492393

Copyright:
© Tailte Éireann - Surveying

LEGEND: -

Grid Connection Underground Cable Route - Approx 25.005km	
Red Line Planning Boundary	
Existing ESB OHL HV Network	
Existing ESB OHL LV/MV Networks	
Existing River Network shown thus	
Recorded Monuments & Associated Zone of Notifications shown thus	
Recorded Architectural Heritage Building (Listed Building) shown thus	
Irish Water Infrastructure shown thus	

- NOTES: -**
- This drawing is to be used only for the purpose of the planning application and is subject to detailed design.
 - Position of underground cable and location of joint bays, links boxes and comms chambers may vary depending on site conditions.
 - Position of link boxes and comms chambers is to be agreed onsite with EirGrid/ESB.
 - Other services may be encountered on the route.
 - Position of HDD launch/reception shown points are indicative only and will be subject to site investigation works and detailed design.

tli GROUP

Head Office: Beenreigh, Abbeydorney, Tralee, Co. Kerry, Ireland
Tel: 00353 66 7135710

Regional Office: Basepoint Business Centre, Stroudley Road, Basingstoke, Hampshire, RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

**Cahermurphy West
Wind Farm 110kV
Grid Connection**

CLIENT

FuturEnergy Ireland

CONSULTANTS

MKO

ISSUE/REVISION

NO	DATE	DESCRIPTION
P1	12.12.25	Issued for Planning
N3	03.11.25	Issued for Information
N2	03.10.25	Issued for Information
N1	15.08.25	Issued for Information
I/R	DATE	DESCRIPTION

PROJECT NUMBER
05-935


SHEET TITLE
Site Layout Plan -
Sheet 2 of 12

SHEET NUMBER
05935-DR-202

Site Layout Plan - Sheet 2 of 12

Scale : 1:2500

0 50m 100m 150m 200m 250m

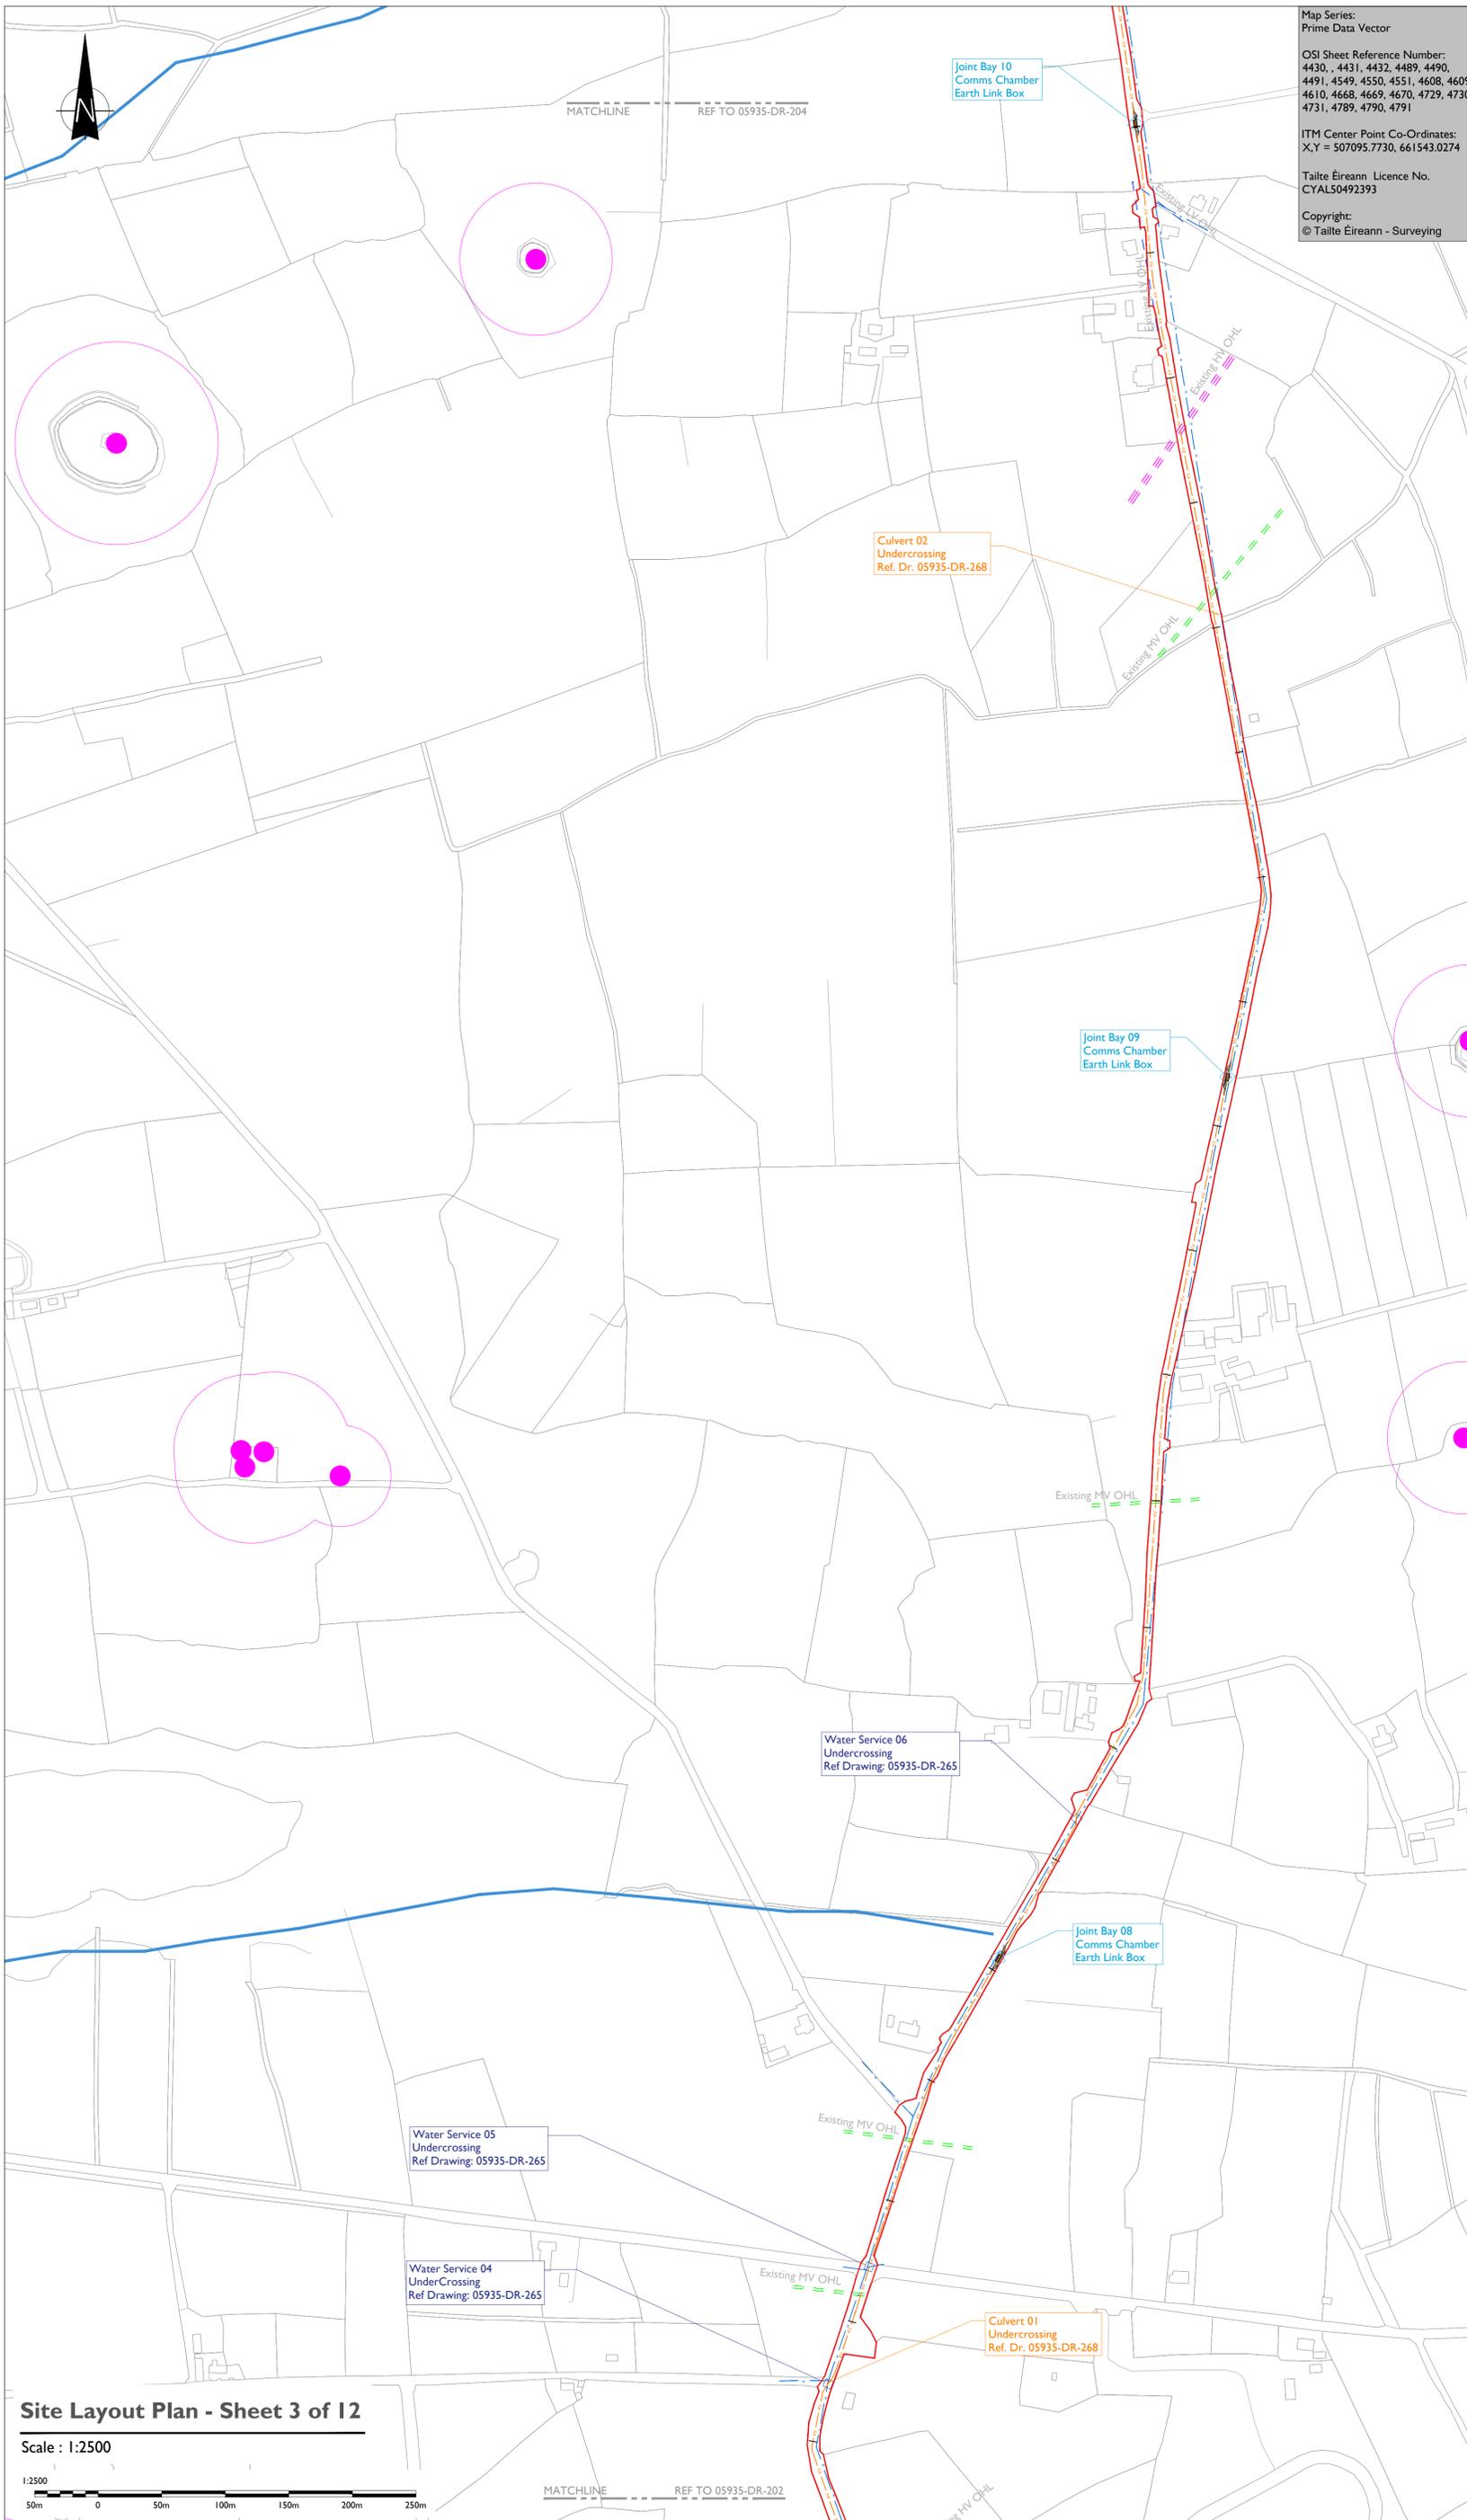

Map Series:
Prime Data Vector

OSI Sheet Reference Number:
4430, 4431, 4432, 4489, 4490,
4491, 4549, 4550, 4551, 4608, 4609,
4610, 4668, 4669, 4670, 4729, 4730,
4731, 4789, 4790, 4791

ITM Center Point Co-Ordinates:
X,Y = 507095.7730, 661543.0274

Taitte Éireann Licence No.
CYAL50492393

Copyright:
© Taitte Éireann - Surveying

LEGEND: -

Grid Connection Underground Cable	
Route - Approx 25.005km	
Red Line Planning Boundary	
Existing ESB OHL HV Network	
Existing ESB OHL LV/MV Networks	
Existing River Network shown thus	
Recorded Monuments & Associated Zone of Notifications shown thus	
Irish Water Infrastructure shown thus	

- NOTES: -**
- This drawing is to be used only for the purpose of the planning application and is subject to detailed design.
 - Position of underground cable and location of joint bays, links boxes and comms chambers may vary depending on site conditions.
 - Position of link boxes and comms chambers is to be agreed onsite with EirGrid/ESB.
 - Other services may be encountered on the route.
 - Position of HDD launch/reception shown points are indicative only and will be subject to site investigation works and detailed design.

Head Office: Breenreigh, Abbeydorney, Tralee, Co. Kerry, Ireland. Tel: 00353 66 7135710

Regional Office: Basepoint Business Centre, Stroudley Road, Basingstoke, Hampshire, RG24 8UP, UK. Tel: 00 44 1256406664

PROJECT

Cahermurphy West Wind Farm 110kV Grid Connection

CLIENT

FuturEnergy Ireland

CONSULTANTS

ISSUE/REVISION


NO	DATE	DESCRIPTION
P1	12.12.25	Issued for Planning
N3	03.11.25	Issued for Information
N2	03.10.25	Issued for Information
N1	15.08.25	Issued for Information
I/R	DATE	DESCRIPTION


PROJECT NUMBER
05-935

SHEET TITLE
Site Layout Plan - Sheet 3 of 12

SHEET NUMBER
05935-DR-203

Site Layout Plan - Sheet 3 of 12



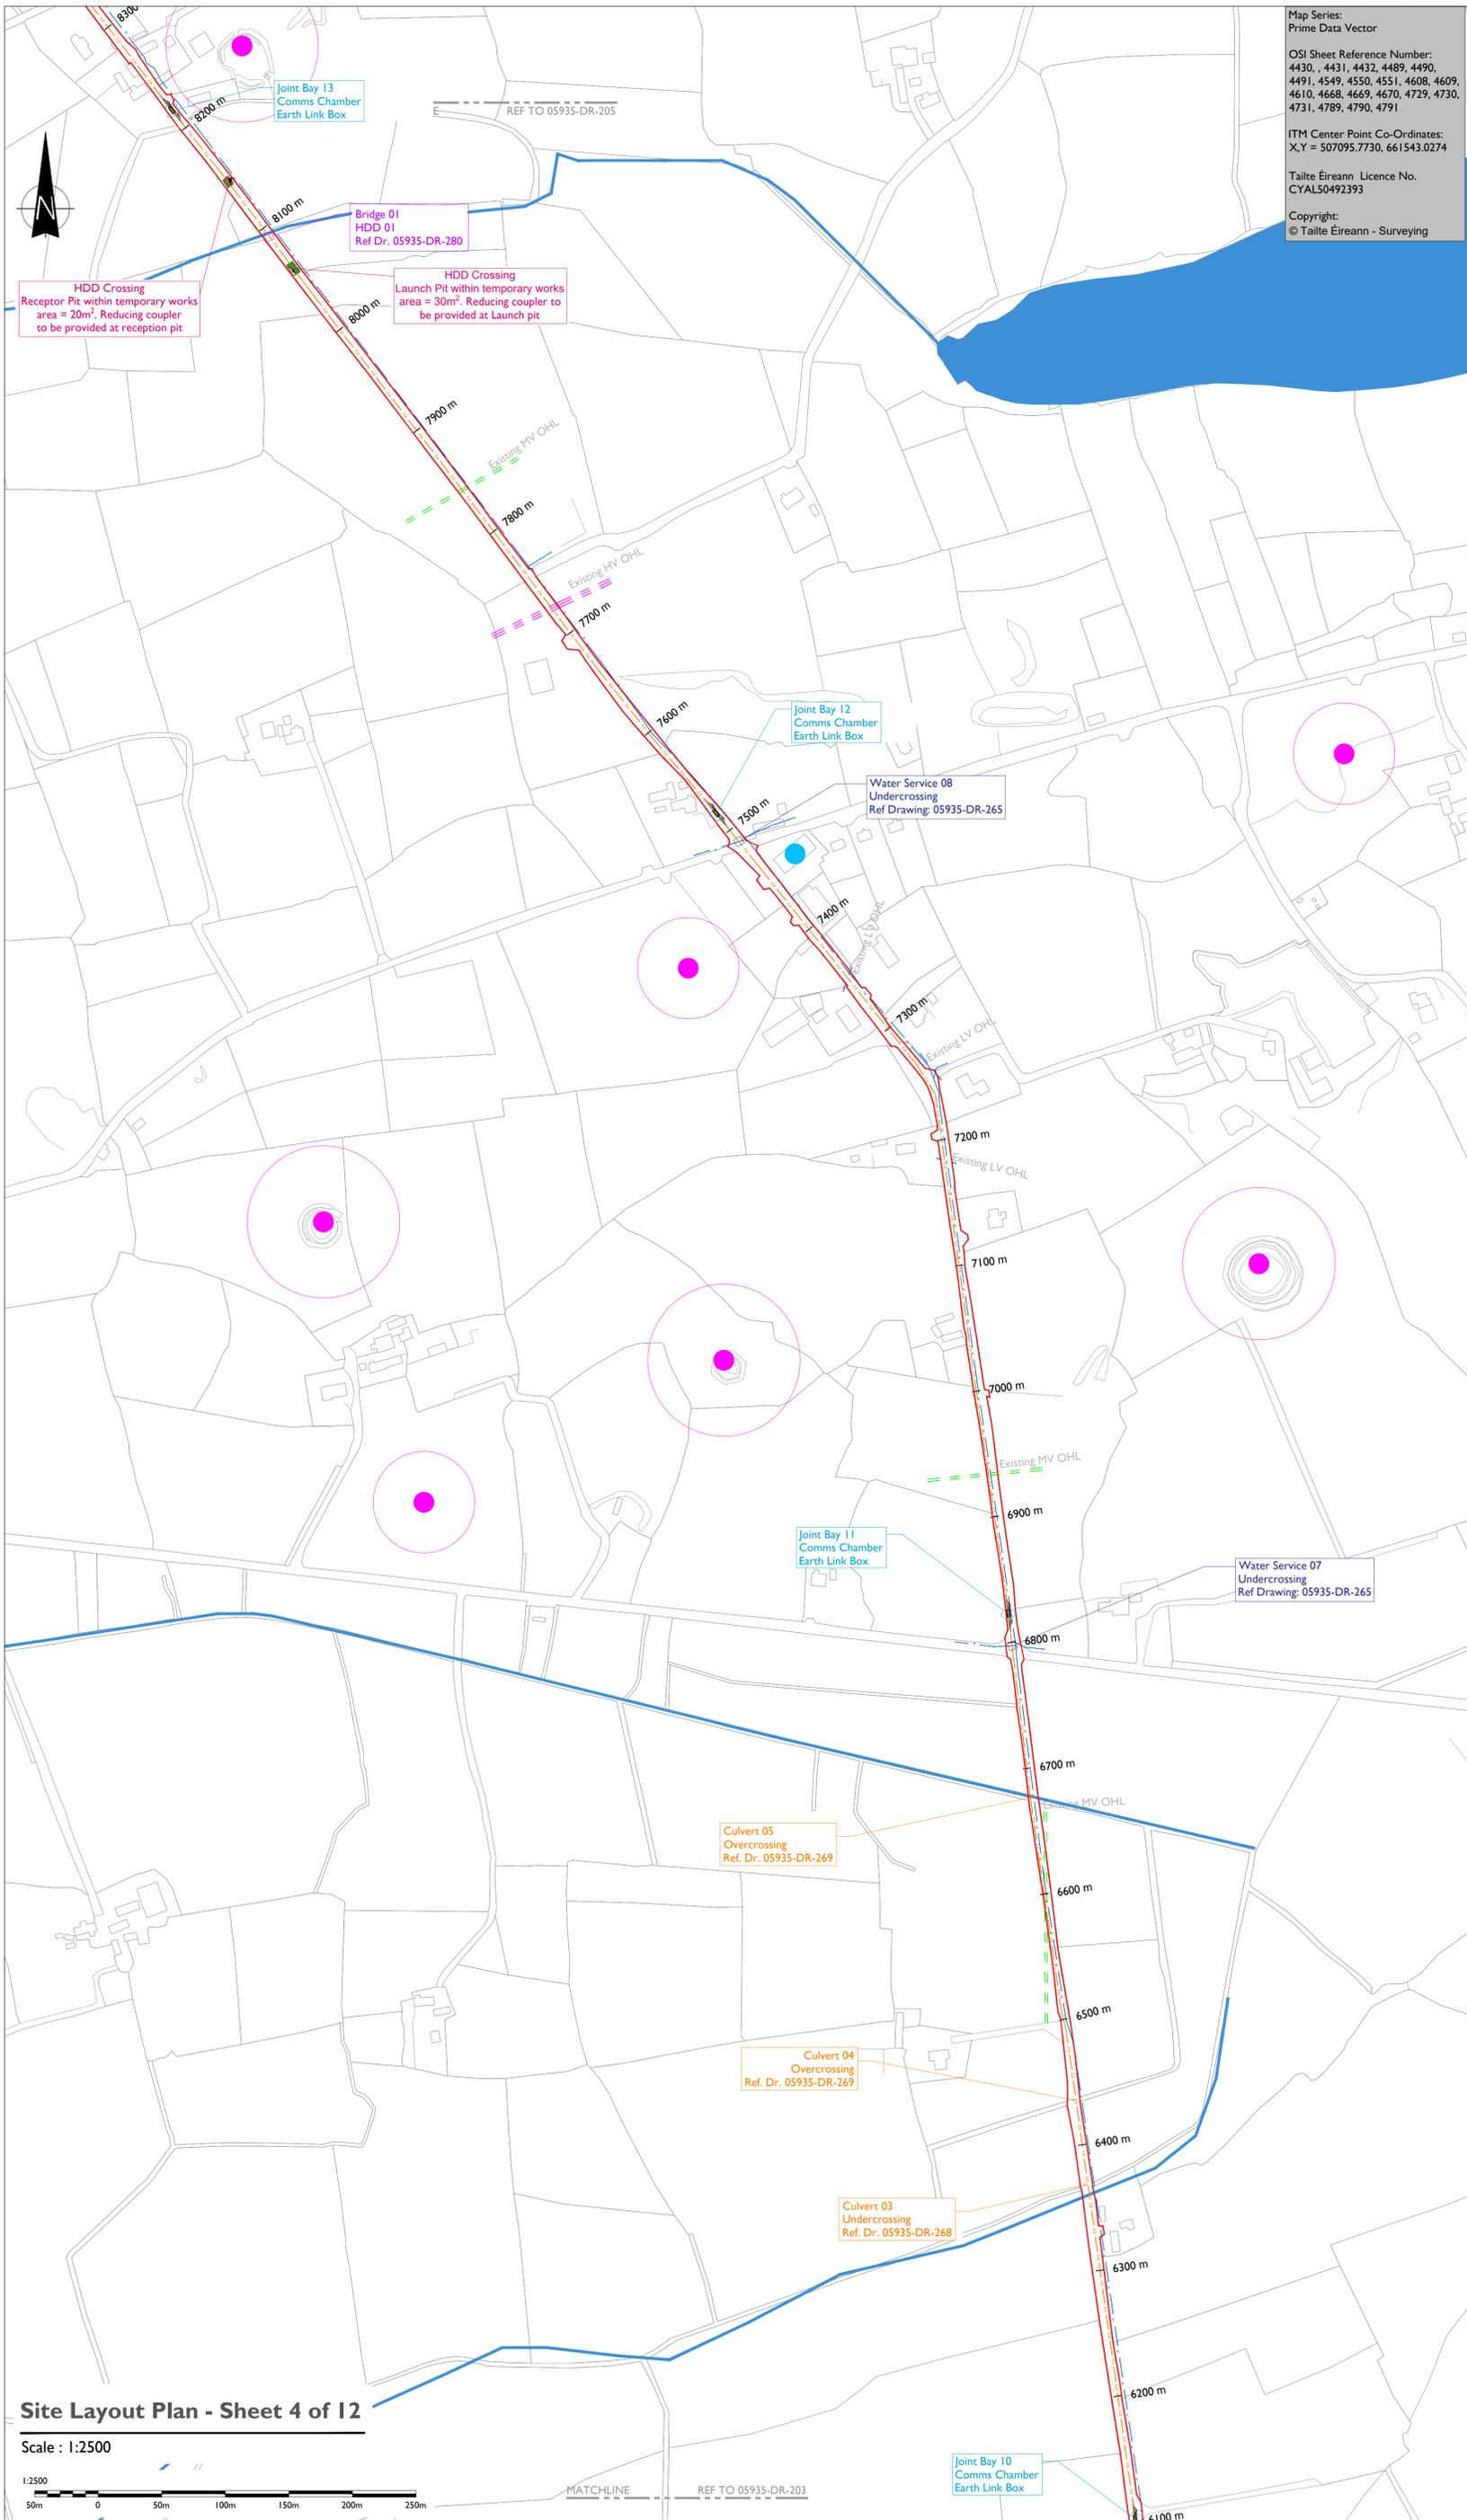

Map Series:
Prime Data Vector

OSI Sheet Reference Number:
4430, 4431, 4432, 4489, 4490,
4491, 4549, 4550, 4551, 4608, 4609,
4610, 4668, 4669, 4670, 4729, 4730,
4731, 4789, 4790, 4791

ITM Center Point Co-Ordinates:
X,Y = 507095.7730, 661543.0274

Tailte Éireann Licence No.
CYAL50492393

Copyright:
© Tailte Éireann - Surveying

LEGEND: -

Grid Connection Underground Cable	— — — — —
Route - Approx 25.005km	— — — — —
Red Line Planning Boundary	— — — — —
Existing ESB OHL HV Network	— — — — —
Existing ESB OHL LV/MV Networks	— — — — —
Existing River Network shown thus	— — — — —
Recorded Monuments & Associated Zone of Notifications shown thus	○
Recorded Architectural Heritage Building (Listed Building) shown thus	●
Irish Water Infrastructure shown thus	— — — — —

- NOTES: -**
- This drawing is to be used only for the purpose of the planning application and is subject to detailed design.
 - Position of underground cable and location of joint bays, links boxes and comms chambers may vary depending on site conditions.
 - Position of link boxes and comms chambers is to be agreed onsite with EirGrid/ESB.
 - Other services may be encountered on the route.
 - Position of HDD launch/reception shown points are indicative only and will be subject to site investigation works and detailed design.

tli GROUP

Head Office: Beenreigh, Abbeydorney, Tralee, Co. Kerry, Ireland
Tel: 00353 66 7135710

Regional Office: Basepoint Business Centre, Stroudley Road, Basingstoke, Hampshire, RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

Cahermurphy West Wind Farm 110kV Grid Connection

CLIENT

FuturEnergy

CONSULTANTS

MKO

ISSUE/REVISION


NO	DATE	DESCRIPTION
P1	12.12.25	Issued for Planning
N3	03.11.25	Issued for Information
N2	03.10.25	Issued for Information
N1	15.08.25	Issued for Information
I/R	DATE	DESCRIPTION


PROJECT NUMBER
05-935

SHEET TITLE
Site Layout Plan - Sheet 4 of 12

SHEET NUMBER
05935-DR-204

Site Layout Plan - Sheet 4 of 12



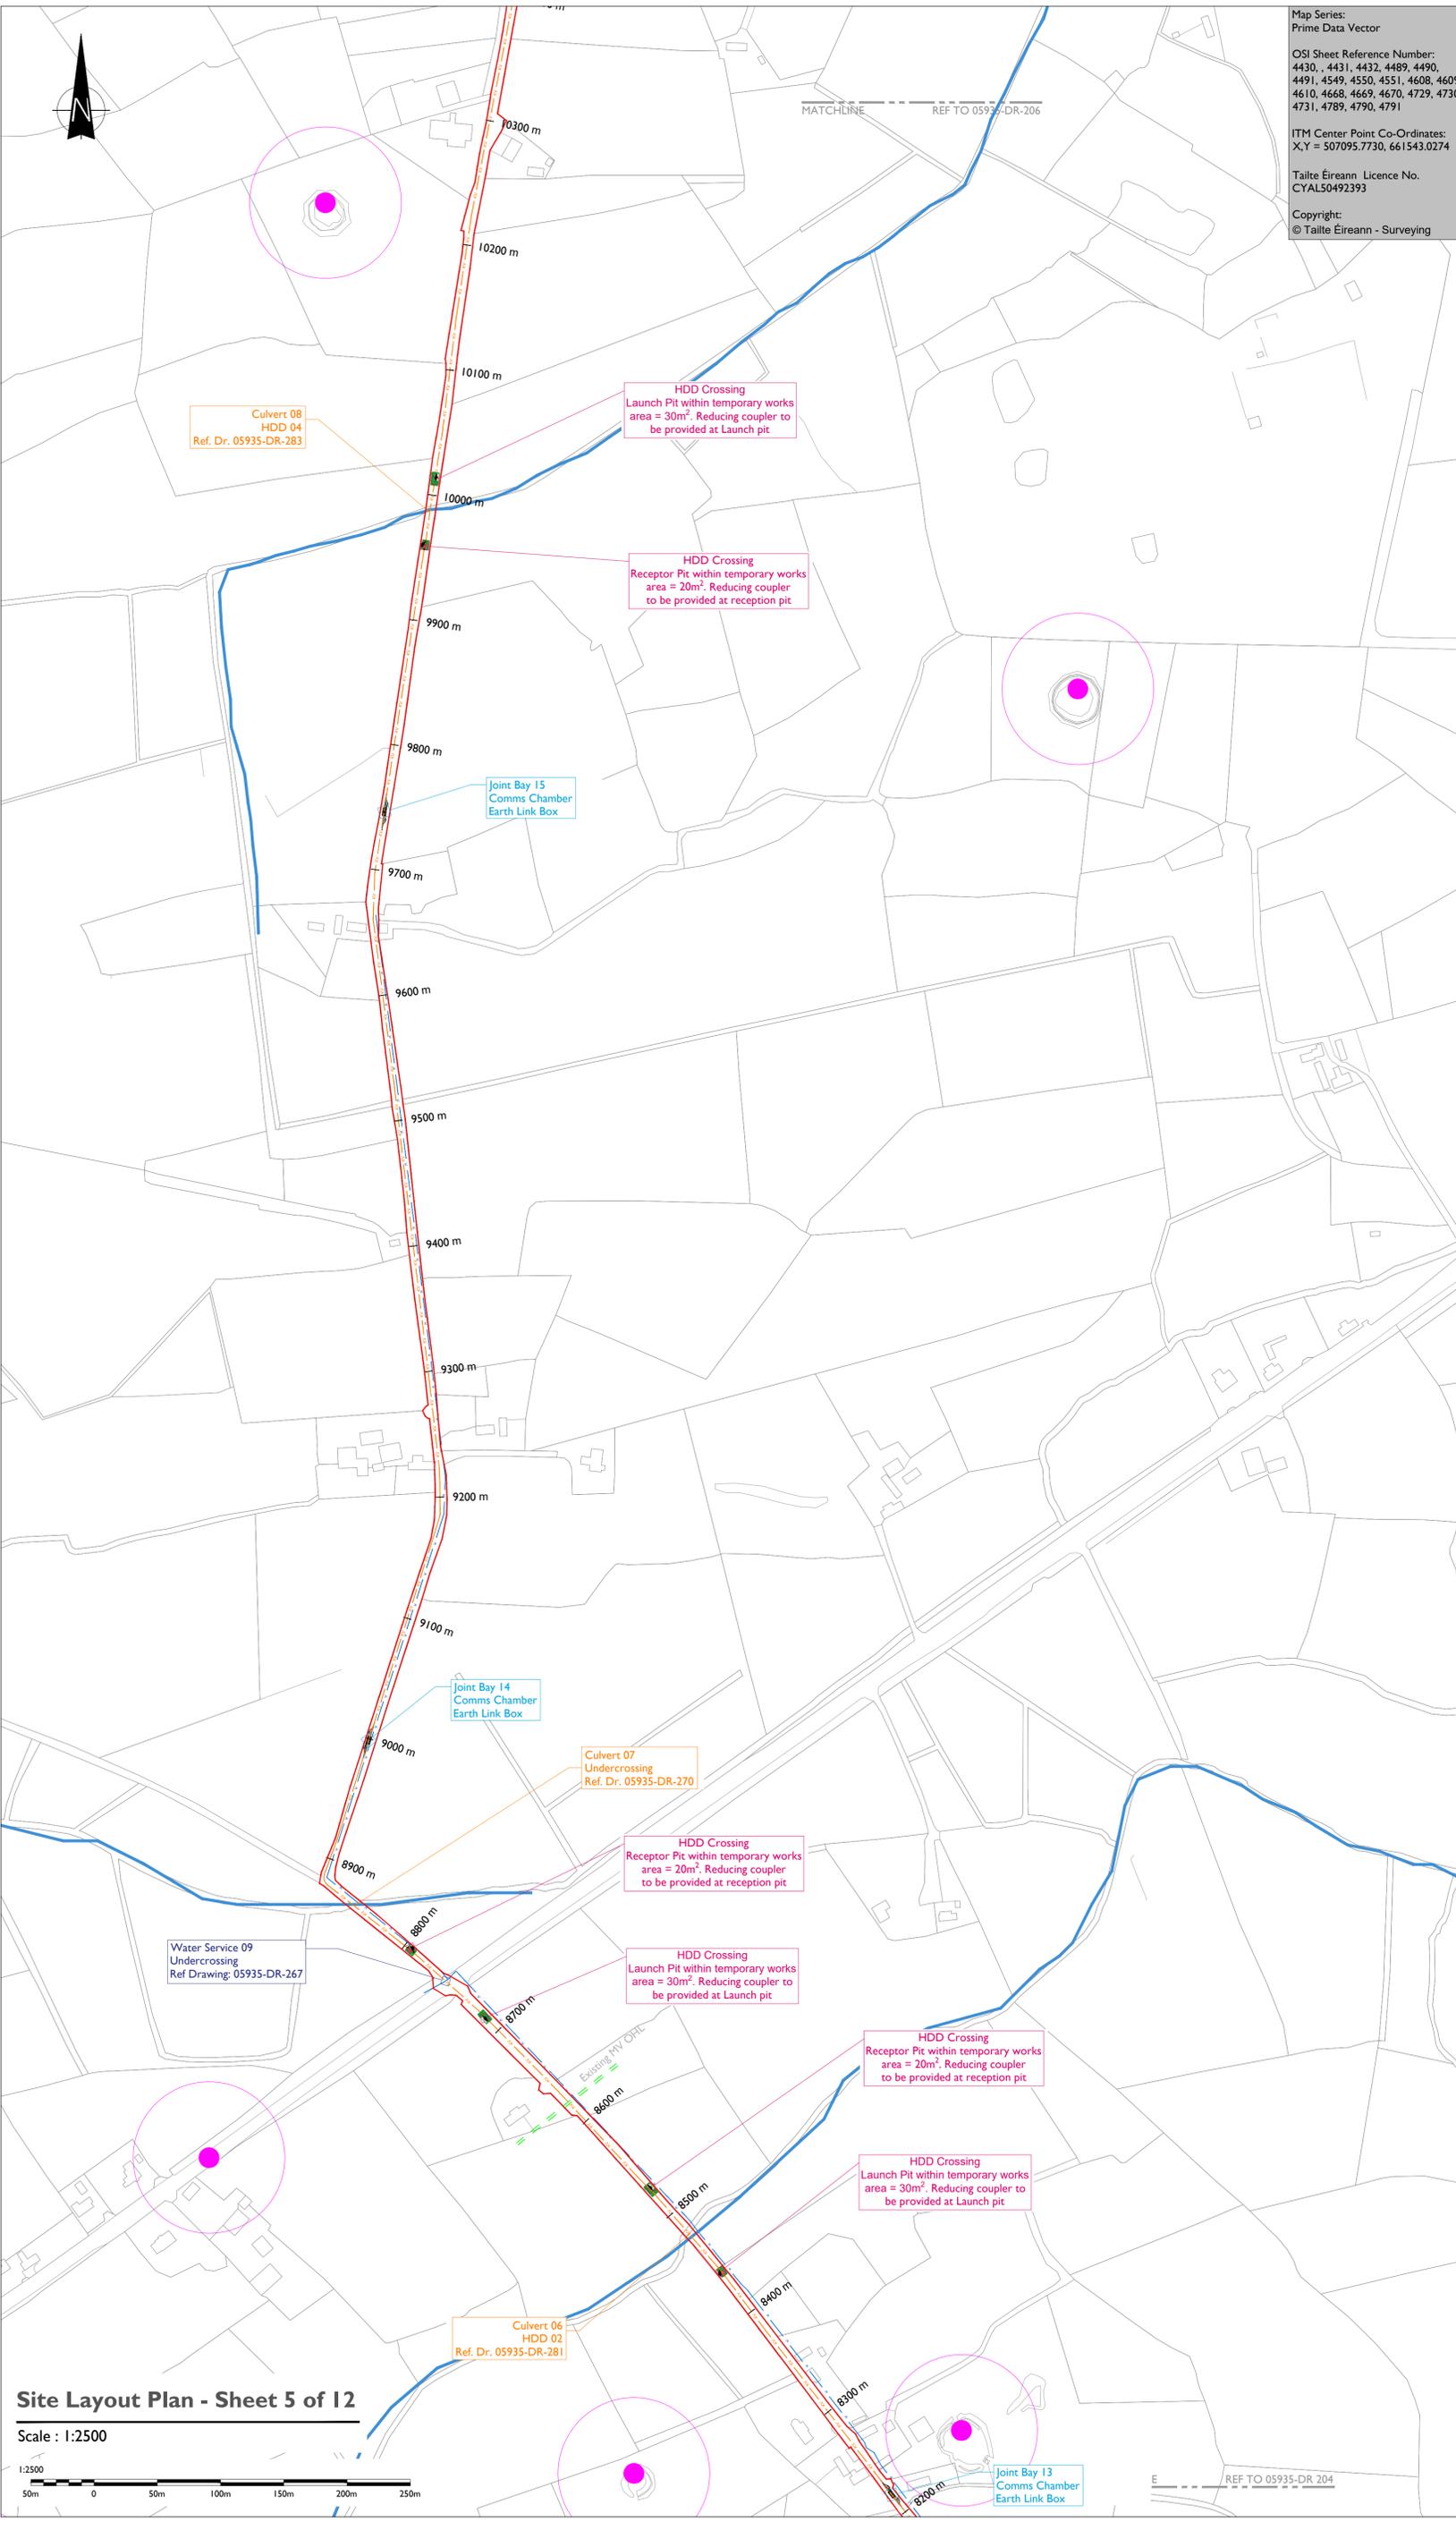

Map Series:
Prime Data Vector

OSI Sheet Reference Number:
4430, 4431, 4432, 4489, 4490,
4491, 4549, 4550, 4551, 4608, 4609,
4610, 4668, 4669, 4670, 4729, 4730,
4731, 4789, 4790, 4791

ITM Center Point Co-Ordinates:
X,Y = 507095.7730, 661543.0274

Tailte Éireann Licence No.
CYAL50492393

Copyright:
© Tailte Éireann - Surveying

LEGEND: -

Grid Connection Underground Cable
Route - Approx 25.005km

Red Line Planning Boundary

Existing ESB OHL LV/MV Networks

Existing River Network shown thus

Recorded Monuments & Associated
Zone of Notifications shown thus

Irish Water Infrastructure
shown thus

NOTES: -

- This drawing is to be used only for the purpose of the planning application and is subject to detailed design.
- Position of underground cable and location of joint bays, links boxes and comms chambers may vary depending on site conditions.
- Position of link boxes and comms chambers is to be agreed onsite with EirGrid/ESB.
- Other services may be encountered on the route.
- Position of HDD launch/reception shown points are indicative only and will be subject to site investigation works and detailed design.

tli GROUP

Head Office: Beenreigh, Abbeydorney, Tralee, Co. Kerry, Ireland
Tel: 00353 66 7135710

Regional Office: Basepoint Business Centre, Stroudley Road, Basingstoke, Hampshire, RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

**Cahermurphy West
Wind Farm 110kV
Grid Connection**

CLIENT

FuturaEnergy Ireland

CONSULTANTS

MKO

ISSUE/REVISION


Issue/Revision	Date	Description
P1	12.12.25	Issued for Planning
N3	03.11.25	Issued for Information
N2	03.10.25	Issued for Information
N1	15.08.25	Issued for Information
I/R	DATE	DESCRIPTION


PROJECT NUMBER
05-935

SHEET TITLE
Site Layout Plan -
Sheet 5 of 12

SHEET NUMBER
05935-DR-205

Site Layout Plan - Sheet 5 of 12



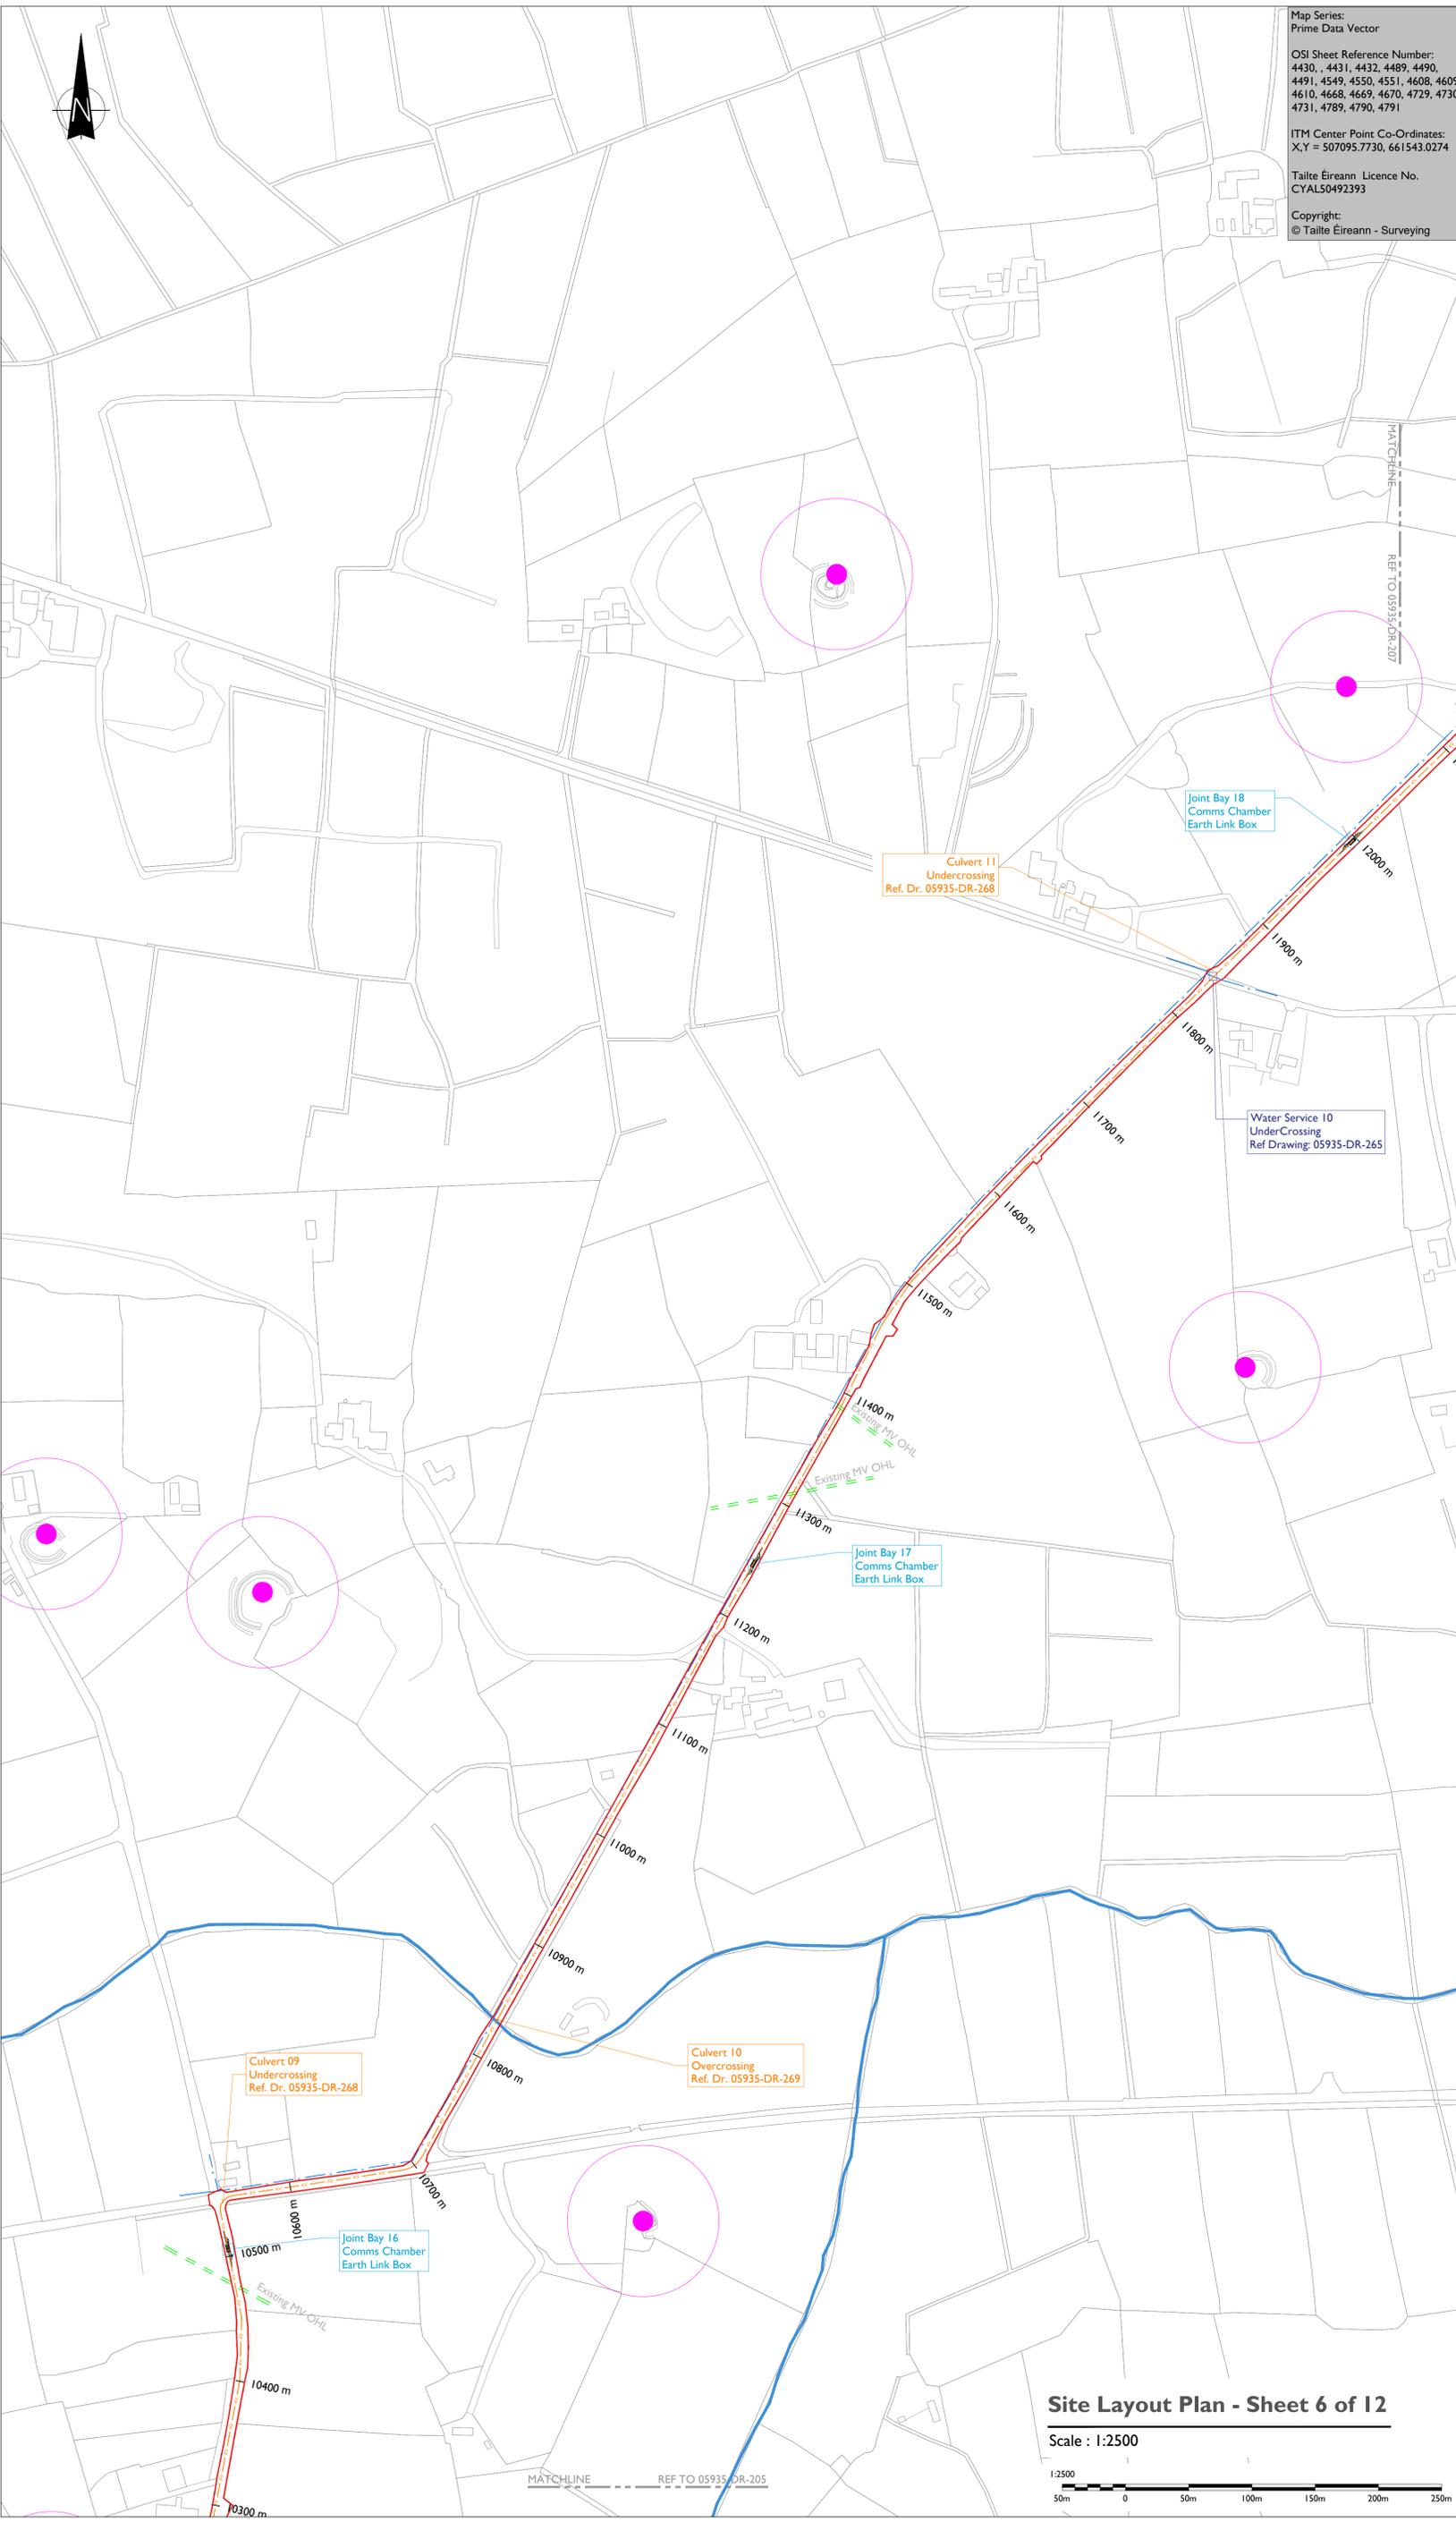

Map Series:
Prime Data Vector

OSI Sheet Reference Number:
4430, 4431, 4432, 4489, 4490,
4491, 4549, 4550, 4551, 4608, 4609,
4610, 4668, 4669, 4670, 4729, 4730,
4731, 4789, 4790, 4791

ITM Center Point Co-Ordinates:
X,Y = 507095.7730, 661543.0274

Tailte Éireann Licence No.
CYAL50492393

Copyright:
© Tailte Éireann - Surveying

LEGEND: -

Grid Connection Underground Cable Route - Approx 25.005km	
Red Line Planning Boundary	
Existing ESB OHL LV/MV Networks	
Existing River Network shown thus	
Recorded Monuments & Associated Zone of Notifications shown thus	
Irish Water Infrastructure shown thus	

- NOTES: -**
- This drawing is to be used only for the purpose of the planning application and is subject to detailed design.
 - Position of underground cable and location of joint bays, links boxes and comms chambers may vary depending on site conditions.
 - Position of link boxes and comms chambers is to be agreed onsite with EirGrid/ESB.
 - Other services may be encountered on the route.
 - Position of HDD launch/reception shown points are indicative only and will be subject to site investigation works and detailed design.

tli GROUP

Head Office: Breenreigh, Abbeydorney, Tralee, Co. Kerry, Ireland
Tel: 00353 66 7135710

Regional Office: Basepoint Business Centre, Stroudley Road, Basingstoke, Hampshire, RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

Cahermurphy West Wind Farm 110kV Grid Connection

CLIENT

FuturEnergy Ireland

CONSULTANTS

MKO

ISSUE/REVISION

NO	DATE	DESCRIPTION
P1	12.12.25	Issued for Planning
N3	03.11.25	Issued for Information
N2	03.10.25	Issued for Information
N1	15.08.25	Issued for Information
I/R	DATE	DESCRIPTION


PROJECT NUMBER
05-935

SHEET TITLE
Site Layout Plan - Sheet 6 of 12

SHEET NUMBER
05935-DR-206

Site Layout Plan - Sheet 6 of 12

Scale : 1:2500




Map Series:
Prime Data Vector

OSI Sheet Reference Number:
4430, 4431, 4432, 4489, 4490,
4491, 4549, 4550, 4551, 4608, 4609,
4610, 4668, 4669, 4670, 4729, 4730,
4731, 4789, 4790, 4791

ITM Center Point Co-Ordinates:
X,Y = 507095.7730, 661543.0274

Tailte Éireann Licence No.
CYAL50492393

Copyright:
© Tailte Éireann - Surveying

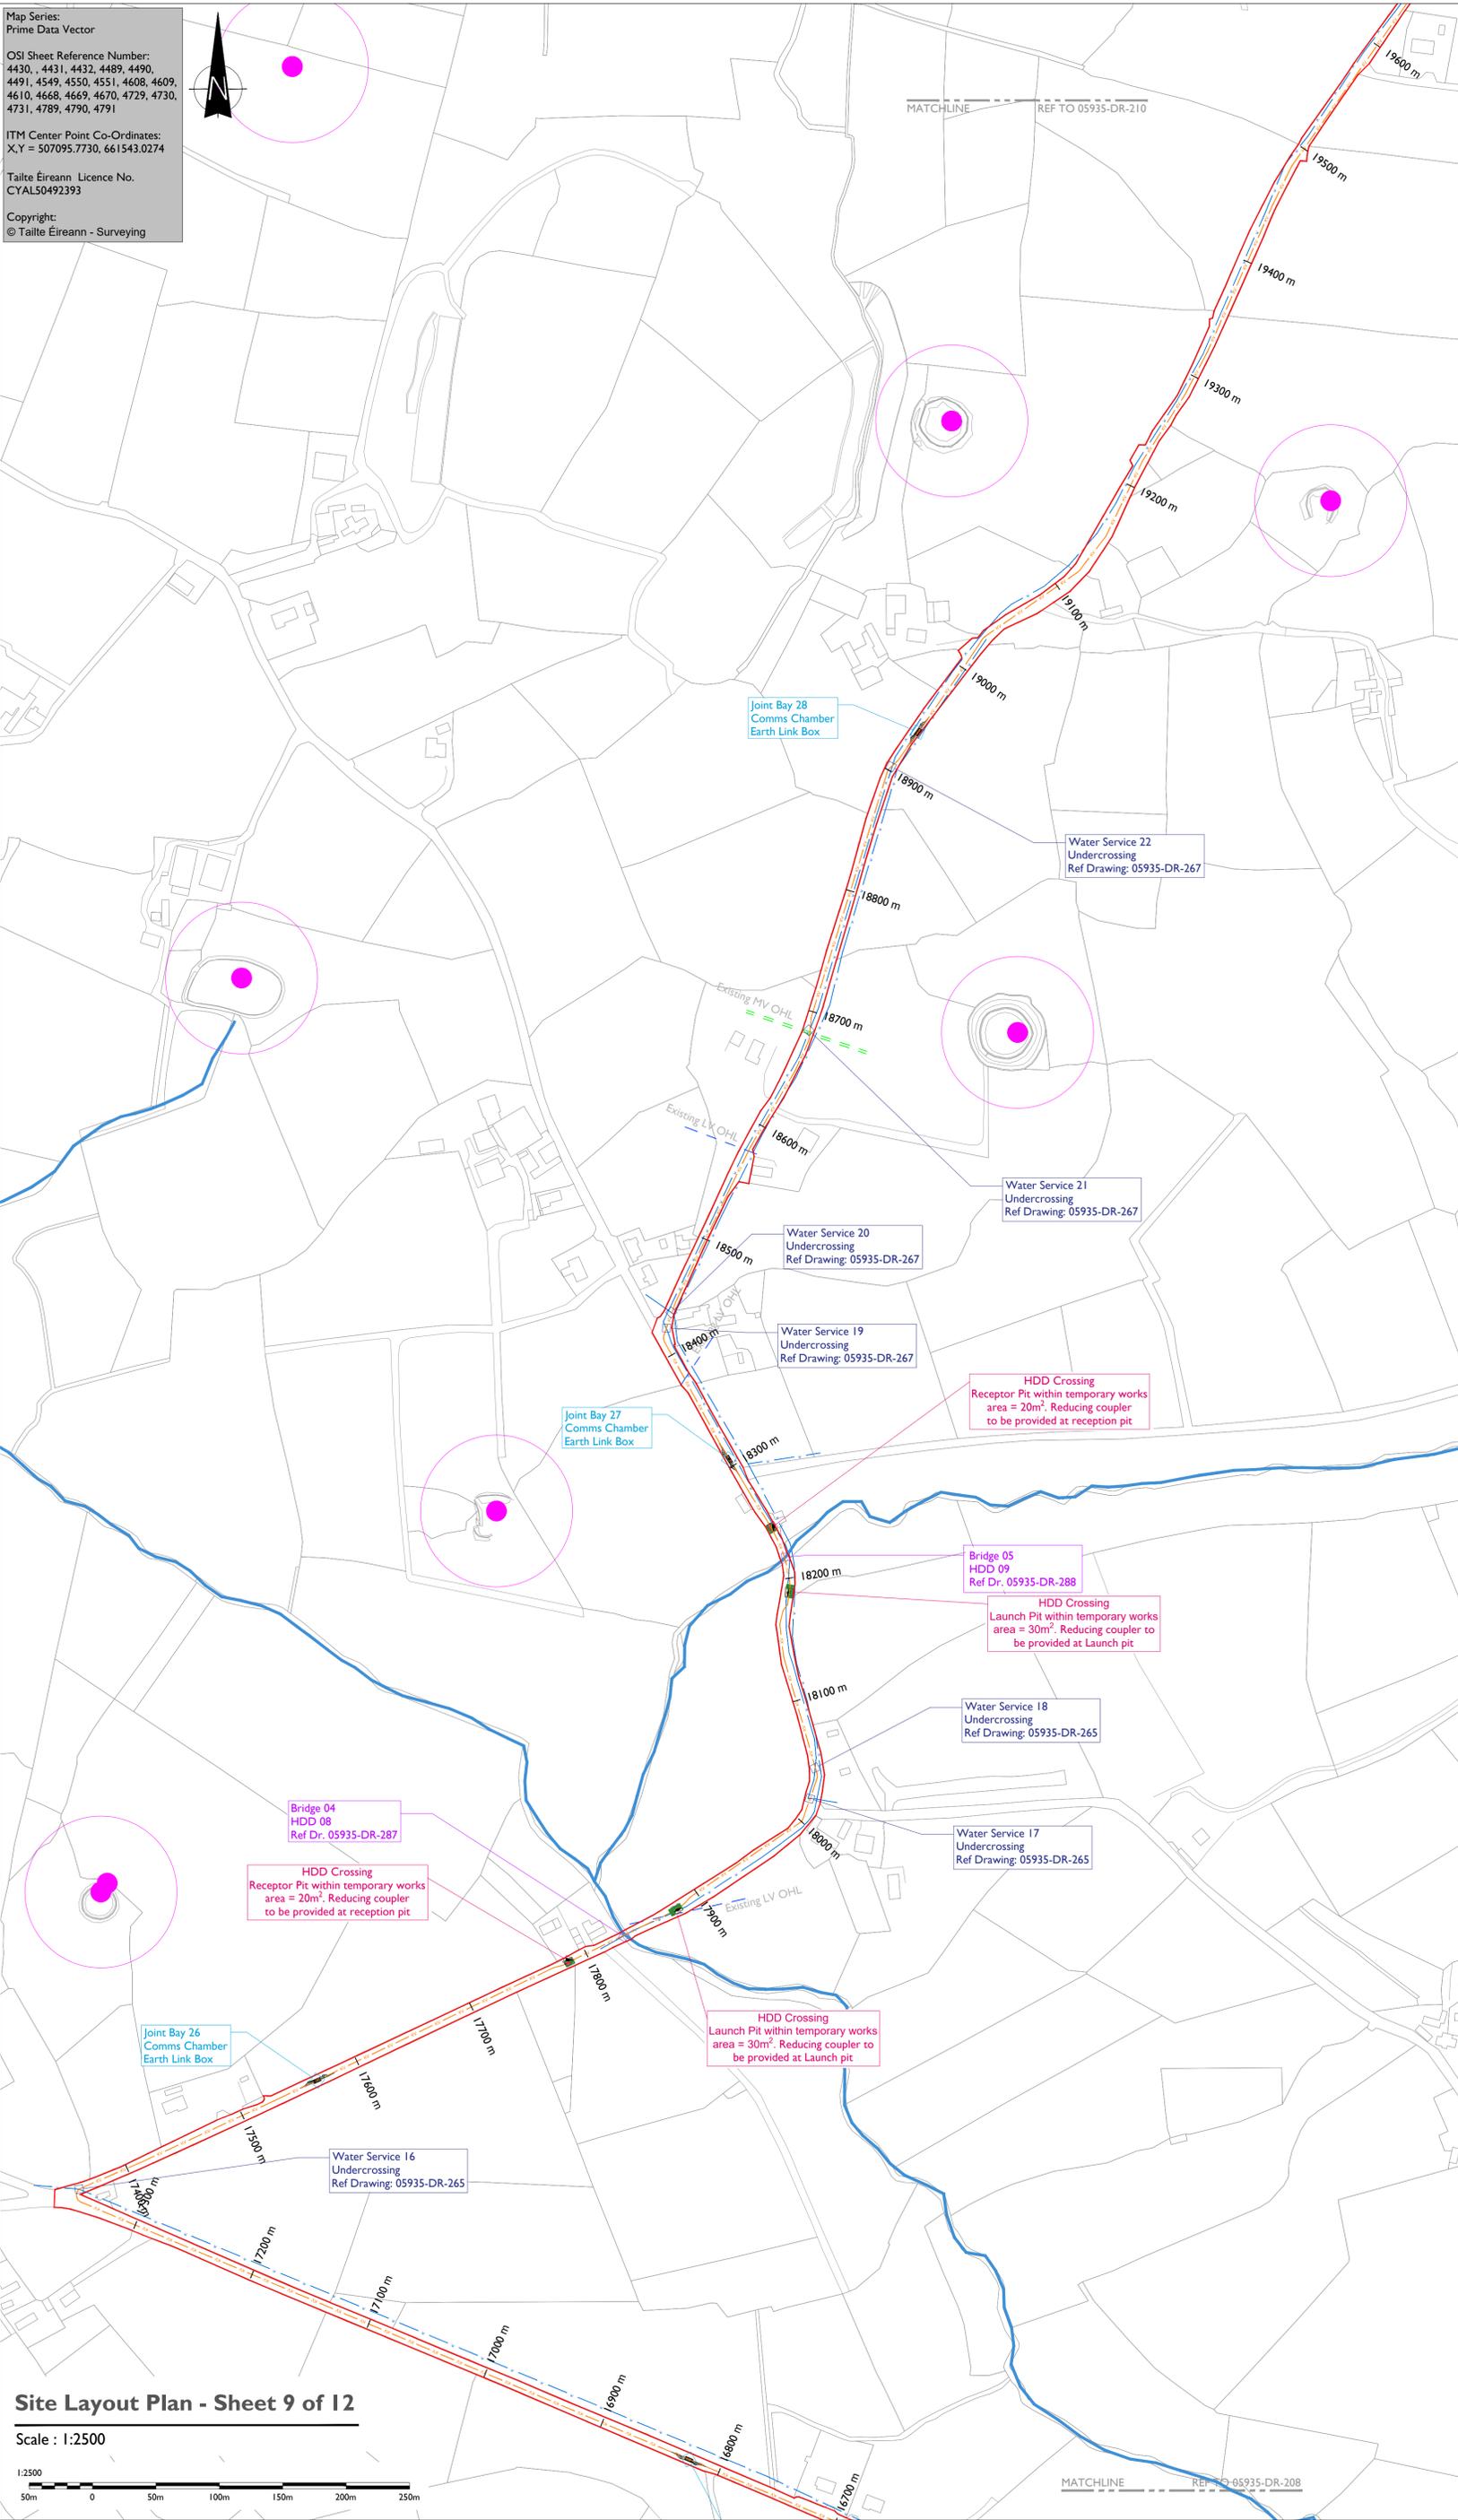

- LEGEND: -**
- Grid Connection Underground Cable Route - Approx. 25.005km —
 - Red Line Planning Boundary —
 - Existing ESB OHL LV/MV Networks —
 - Existing River Network shown thus —
 - Recorded Monuments & Associated Zone of Notifications shown thus ○
 - Irish Water Infrastructure shown thus —

- NOTES: -**
- This drawing is to be used only for the purpose of the planning application and is subject to detailed design.
 - Position of underground cable and location of joint bays, links boxes and comms chambers may vary depending on site conditions.
 - Position of link boxes and comms chambers is to be agreed onsite with EirGrid/ESB.
 - Other services may be encountered on the route.
 - Position of HDD launch/reception shown points are indicative only and will be subject to site investigation works and detailed design.

tli GROUP

Head Office: Breenreigh, Abbeydooney, Tralee, Co. Kerry, Ireland
Tel: 00353 66 7135710

Regional Office: Basepoint Business Centre, Stroudley Road, Basingstoke, Hampshire, RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

Cahermurphy West Wind Farm 110kV Grid Connection

CLIENT

FuturEnergy

CONSULTANTS

MKO

ISSUE/REVISION


NO	DATE	DESCRIPTION
P1	12.12.25	Issued for Planning
N3	03.11.25	Issued for Information
N2	03.10.25	Issued for Information
N1	15.08.25	Issued for Information
I/R	DATE	DESCRIPTION

PROJECT NUMBER
05-935

SHEET TITLE
Site Layout Plan - Sheet 9 of 12

SHEET NUMBER
05935-DR-209

Site Layout Plan - Sheet 9 of 12





Map Series:
Prime Data Vector

OSI Sheet Reference Number:
4430, 4431, 4432, 4489, 4490,
4491, 4549, 4550, 4551, 4608, 4609,
4610, 4668, 4669, 4670, 4729, 4730,
4731, 4789, 4790, 4791

ITM Center Point Co-Ordinates:
X,Y = 507095.7730, 661543.0274

Tailte Éireann Licence No.
CYAL50492393

Copyright:
© Tailte Éireann - Surveying



Head Office
Beenrigh,
Abbeydonney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

Regional Office
Basepoint Business Centre
Stroudley Road, Basingstoke,
Hampshire,
RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

**Cahermurphy West
Wind Farm 110kV
Grid Connection**

CLIENT

FuturaEnergy Ireland

CONSULTANTS

MKO

NOTES: -

- This drawing is to be used only for the purpose of the planning application and is subject to detailed design.
- Position of underground cable and location of joint bays, link boxes and comms chambers may vary depending on site conditions.
- Position of link boxes and comms chambers is to be agreed onsite with EirGrid/ESB.
- Other services may be encountered on the route.
- Position of HDD launch/reception shown points are indicative only and will be subject to site investigation works and detailed design.

LEGEND: -

- Grid Connection Underground Cable Route - Approx 25.005km
- Red Line Planning Boundary
- Existing ESB OHL HV Network
- Existing ESB OHL LV/MV Networks
- Optioned Landownership Boundary shown thus
- Existing River Network shown thus
- Recorded Monuments & Associated Zone of Notifications shown thus
- Irish Water Infrastructure shown thus


ISSUE/REVISION

NO	DATE	DESCRIPTION
P1	12.12.25	Issued for Planning
N3	03.11.25	Issued for Information
N2	03.10.25	Issued for Information
N1	15.08.25	Issued for Information
I/R	DATE	DESCRIPTION

PROJECT NUMBER
05-935

SHEET TITLE
Site Layout Plan -
Sheet 8 of 12


SHEET NUMBER
05935-DR-208

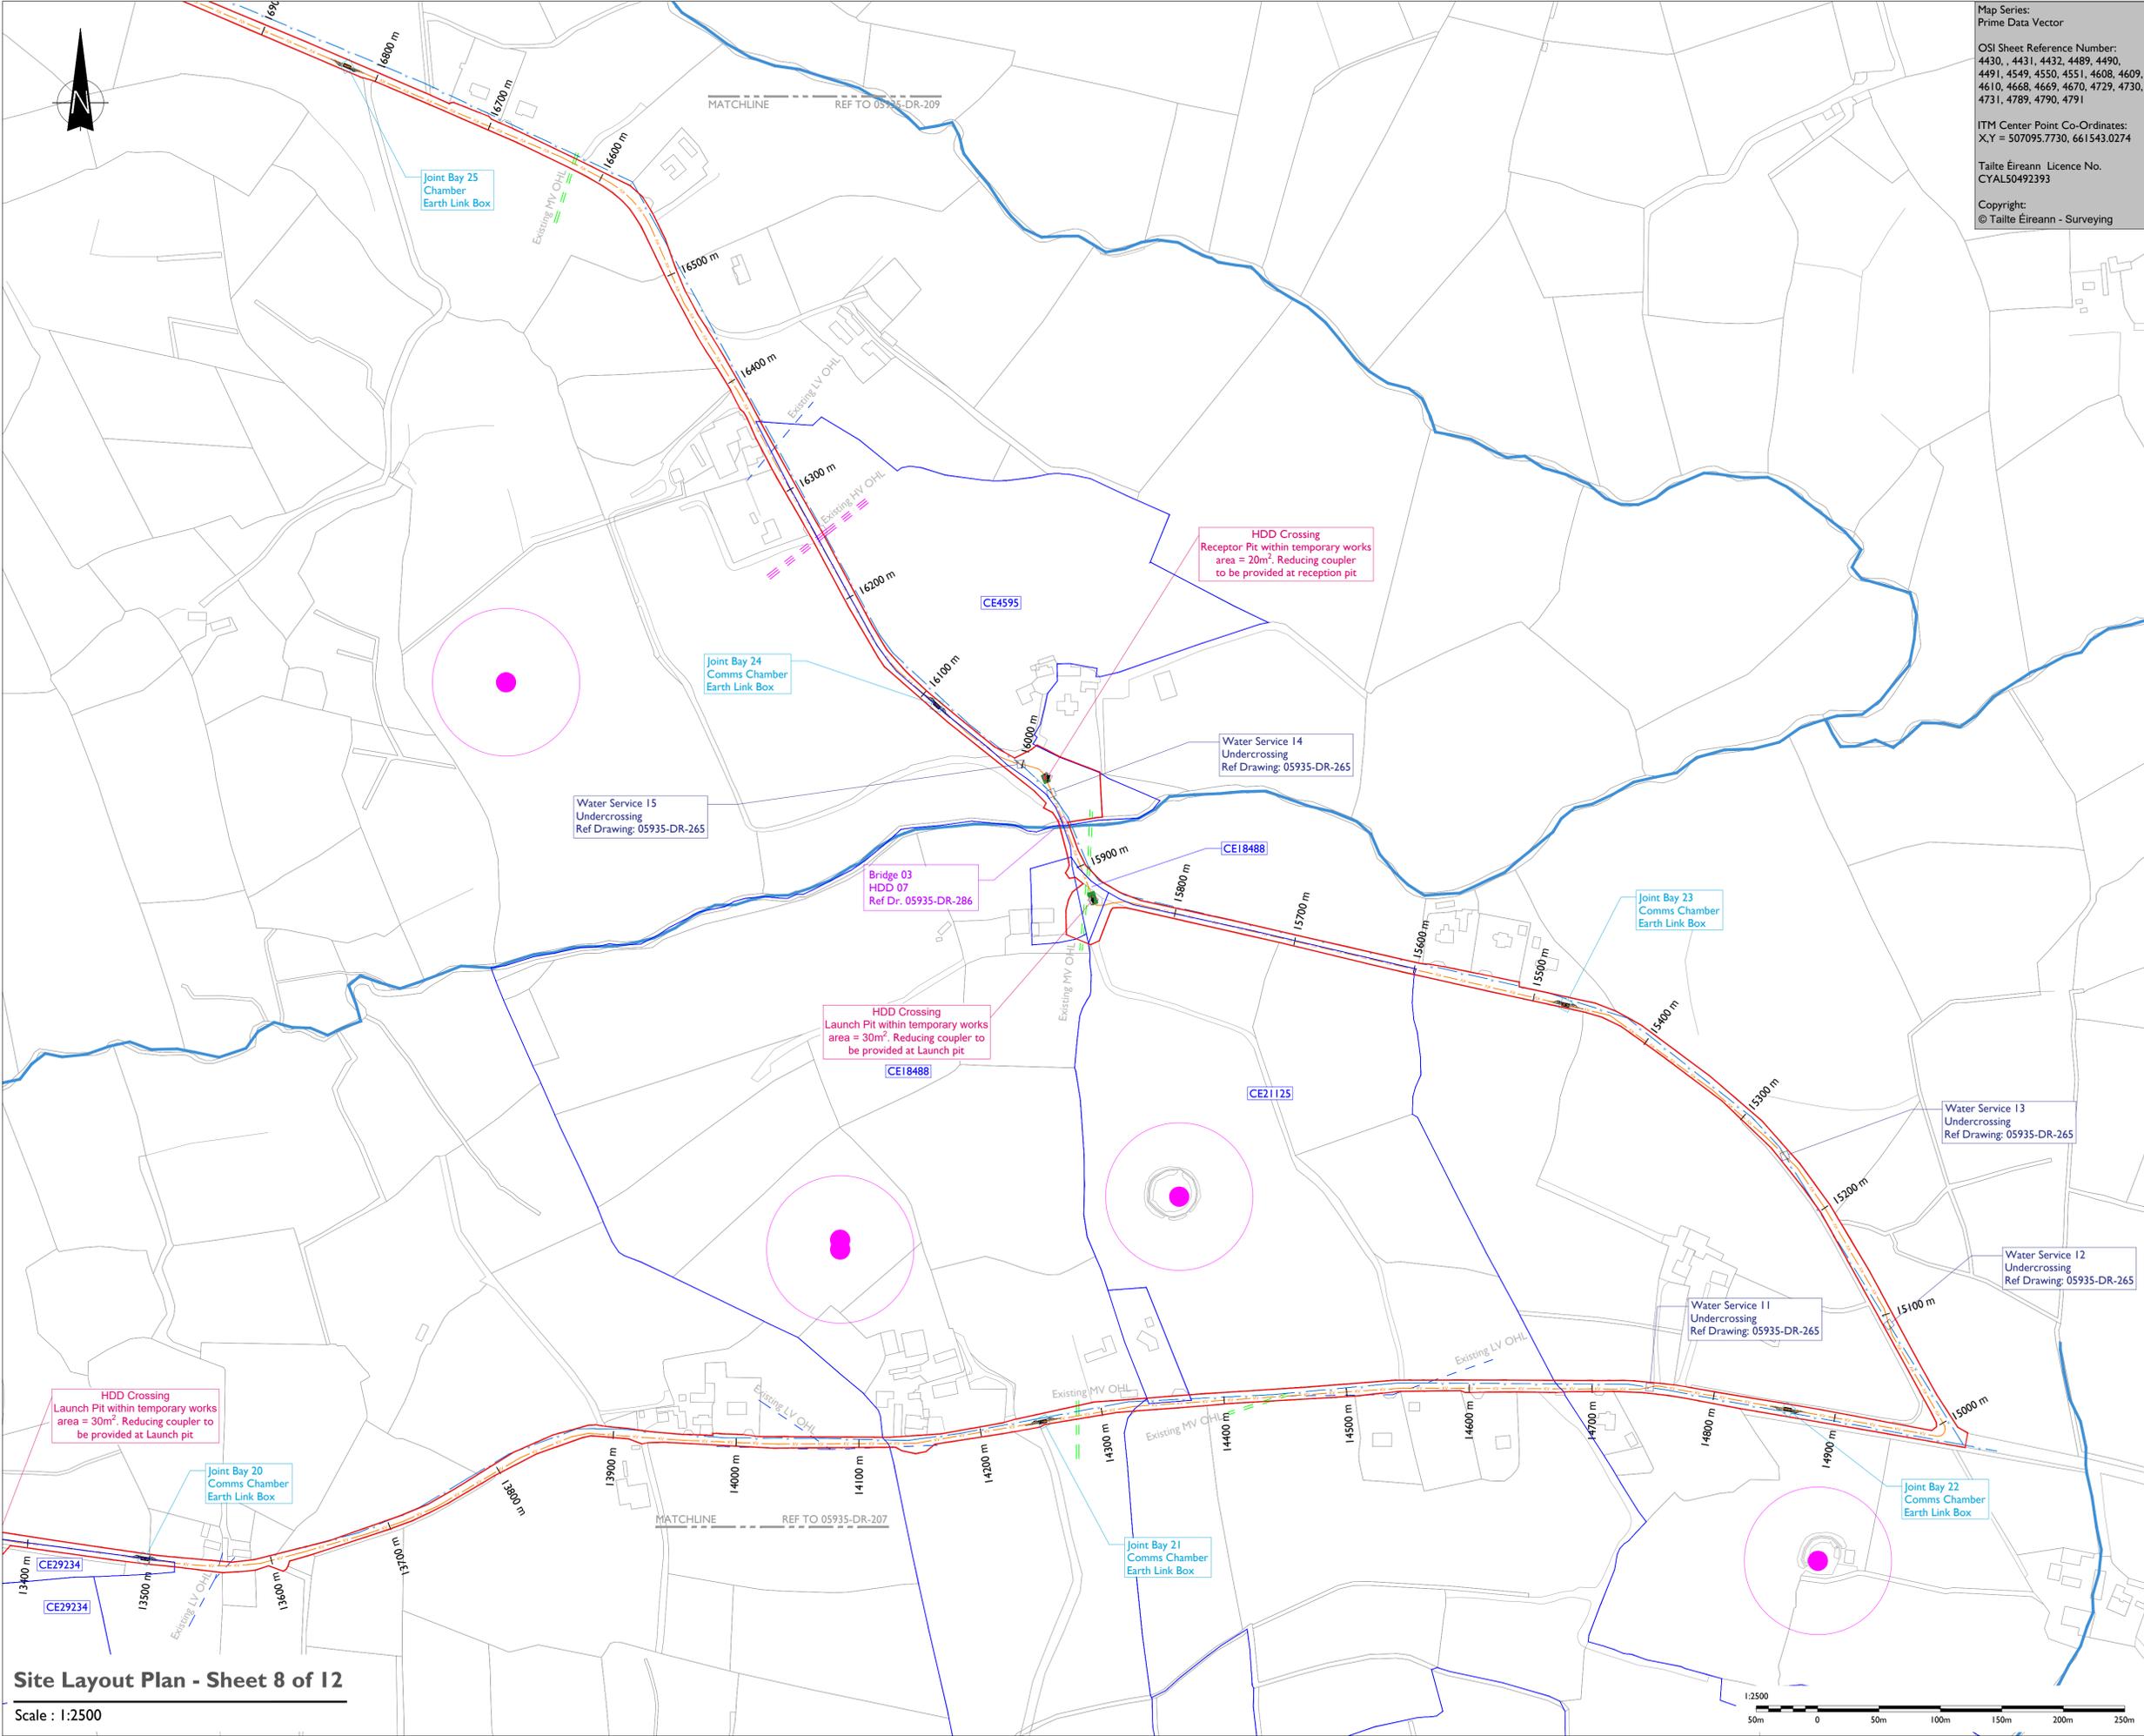


Project Management Initials: Designer: DMB Checked: DB Approved: RG

Site Layout Plan - Sheet 8 of 12
Scale : 1:2500

ISO A1 594mm x 841mm
 Prime Data Vector
 OSJ Sheet Reference Number:
 4430, 4431, 4432, 4489, 4490,
 4491, 4549, 4550, 4551, 4608, 4609,
 4610, 4668, 4669, 4670, 4729, 4730,
 4731, 4789, 4790, 4791
 ITM Center Point Co-Ordinates:
 X,Y = 507095.7730, 661543.0274
 Tailte Éireann Licence No.
 CYALS0492393
 Copyright:
 © Tailte Éireann - Surveying

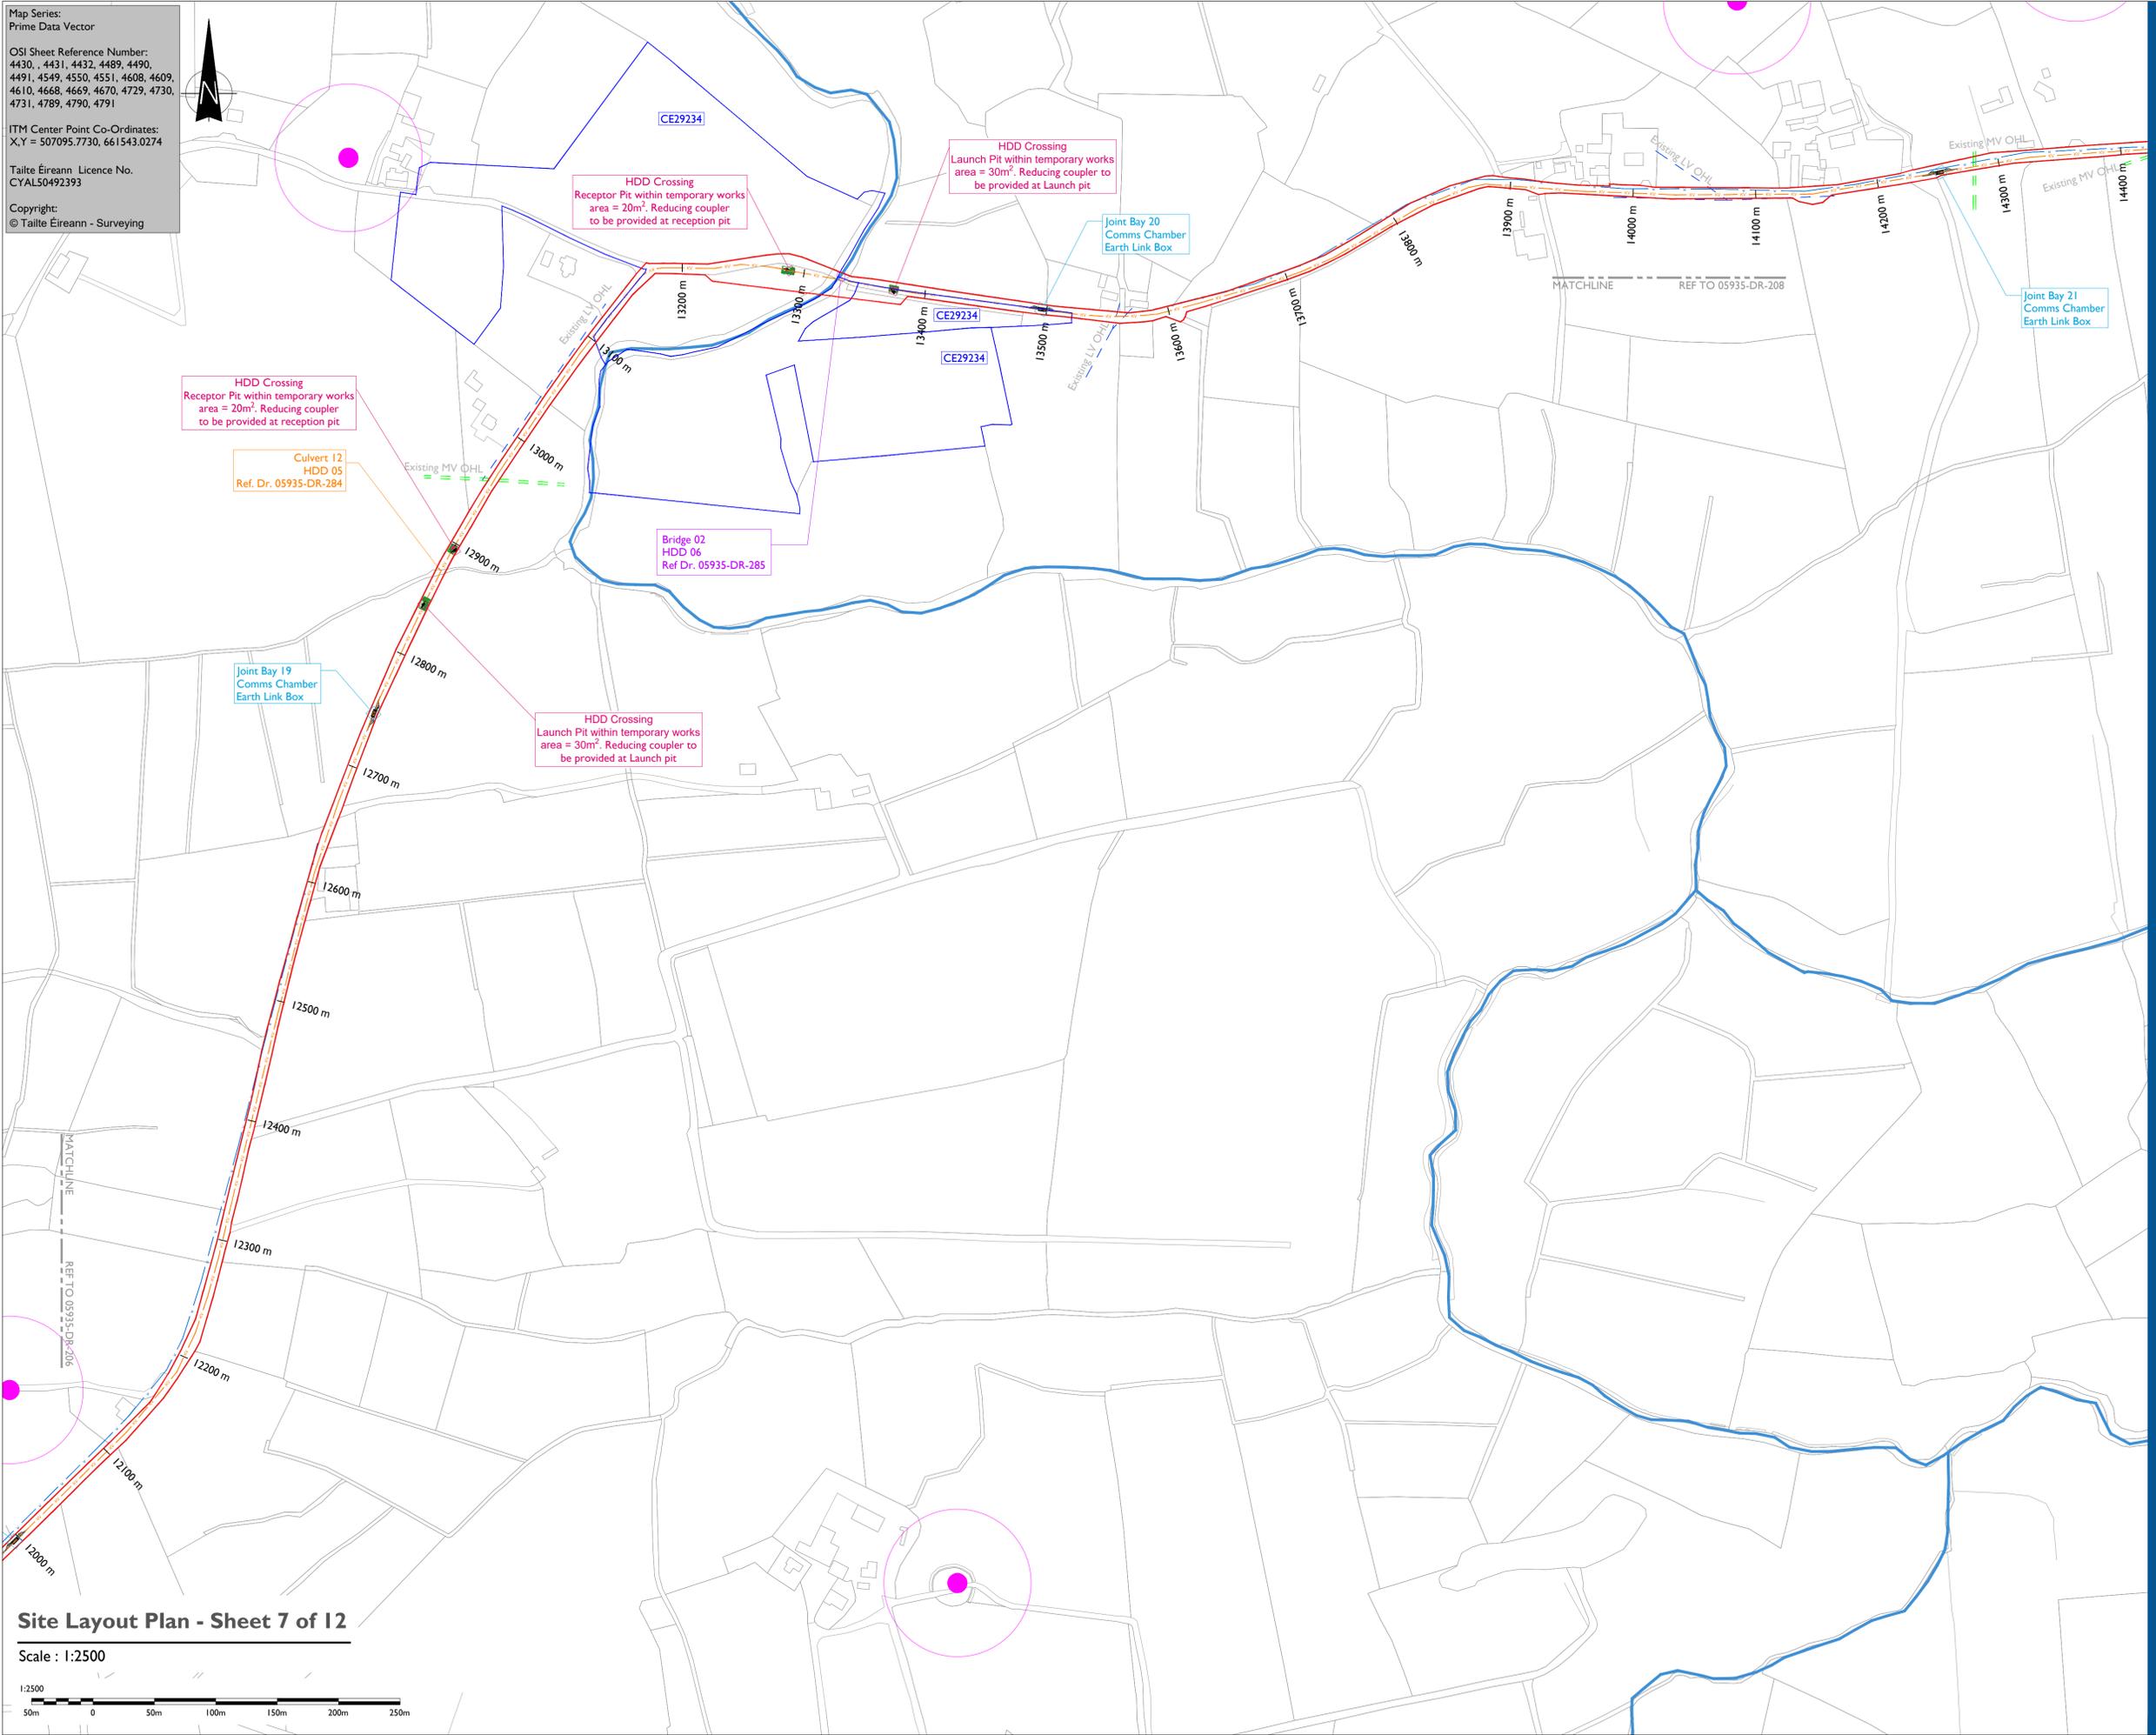

Site Layout Plan - Sheet 7 of 12
 Scale : 1:2500



Project Management Initials: Designer: DMB Checked: DB Approved: RG



Head Office
 Beenrigh,
 Abbeydonney,
 Tralee, Co. Kerry
 Ireland
 Tel: 00353 66 7135710

Regional Office
 Basepoint Business Centre
 Stroudley Road, Basingstoke,
 Hampshire,
 RG24 8UP, UK
 Tel: 00 44 1256406664

PROJECT
Cahermurphy West
Wind Farm 110kV
Grid Connection

CLIENT
FuturaEnergy Ireland



- NOTES: -**
- This drawing is to be used only for the purpose of the planning application and is subject to detailed design.
 - Position of underground cable and location of joint bays, links boxes and comms chambers may vary depending on site conditions.
 - Position of link boxes and comms chambers is to be agreed onsite with EirGrid/ESB.
 - Other services may be encountered on the route.
 - Position of HDD launch/reception shown points are indicative only and will be subject to site investigation works and detailed design.

- LEGEND: -**
- Grid Connection Underground Cable Route - Approx 25.005km
 - Red Line Planning Boundary
 - Existing ESB OHL LV/MV Networks
 - Optioned Landownership Boundary shown thus
 - Existing River Network shown thus
 - Recorded Monuments & Associated Zone of Notifications shown thus
 - Irish Water Infrastructure shown thus

ISSUE/REVISION


NO	DATE	DESCRIPTION
P1	12.12.25	Issued for Planning
N3	03.11.25	Issued for Information
N2	03.10.25	Issued for Information
N1	15.08.25	Issued for Information
I/R	DATE	DESCRIPTION

PROJECT NUMBER
05-935

SHEET TITLE
 Site Layout Plan -
 Sheet 7 of 12

SHEET NUMBER
05935-DR-207

ISO A1 594mm x 841mm
 Prime Data Vector
 OSJ Sheet Reference Number:
 4430, 4431, 4432, 4489, 4490,
 4491, 4549, 4550, 4551, 4608, 4609,
 4610, 4668, 4669, 4670, 4729, 4730,
 4731, 4789, 4790, 4791
 ITM Center Point Co-Ordinates:
 X,Y = 507095.7730, 661543.0274
 Tailte Éireann Licence No.
 CYAL50492393
 Copyright:
 © Tailte Éireann - Surveying

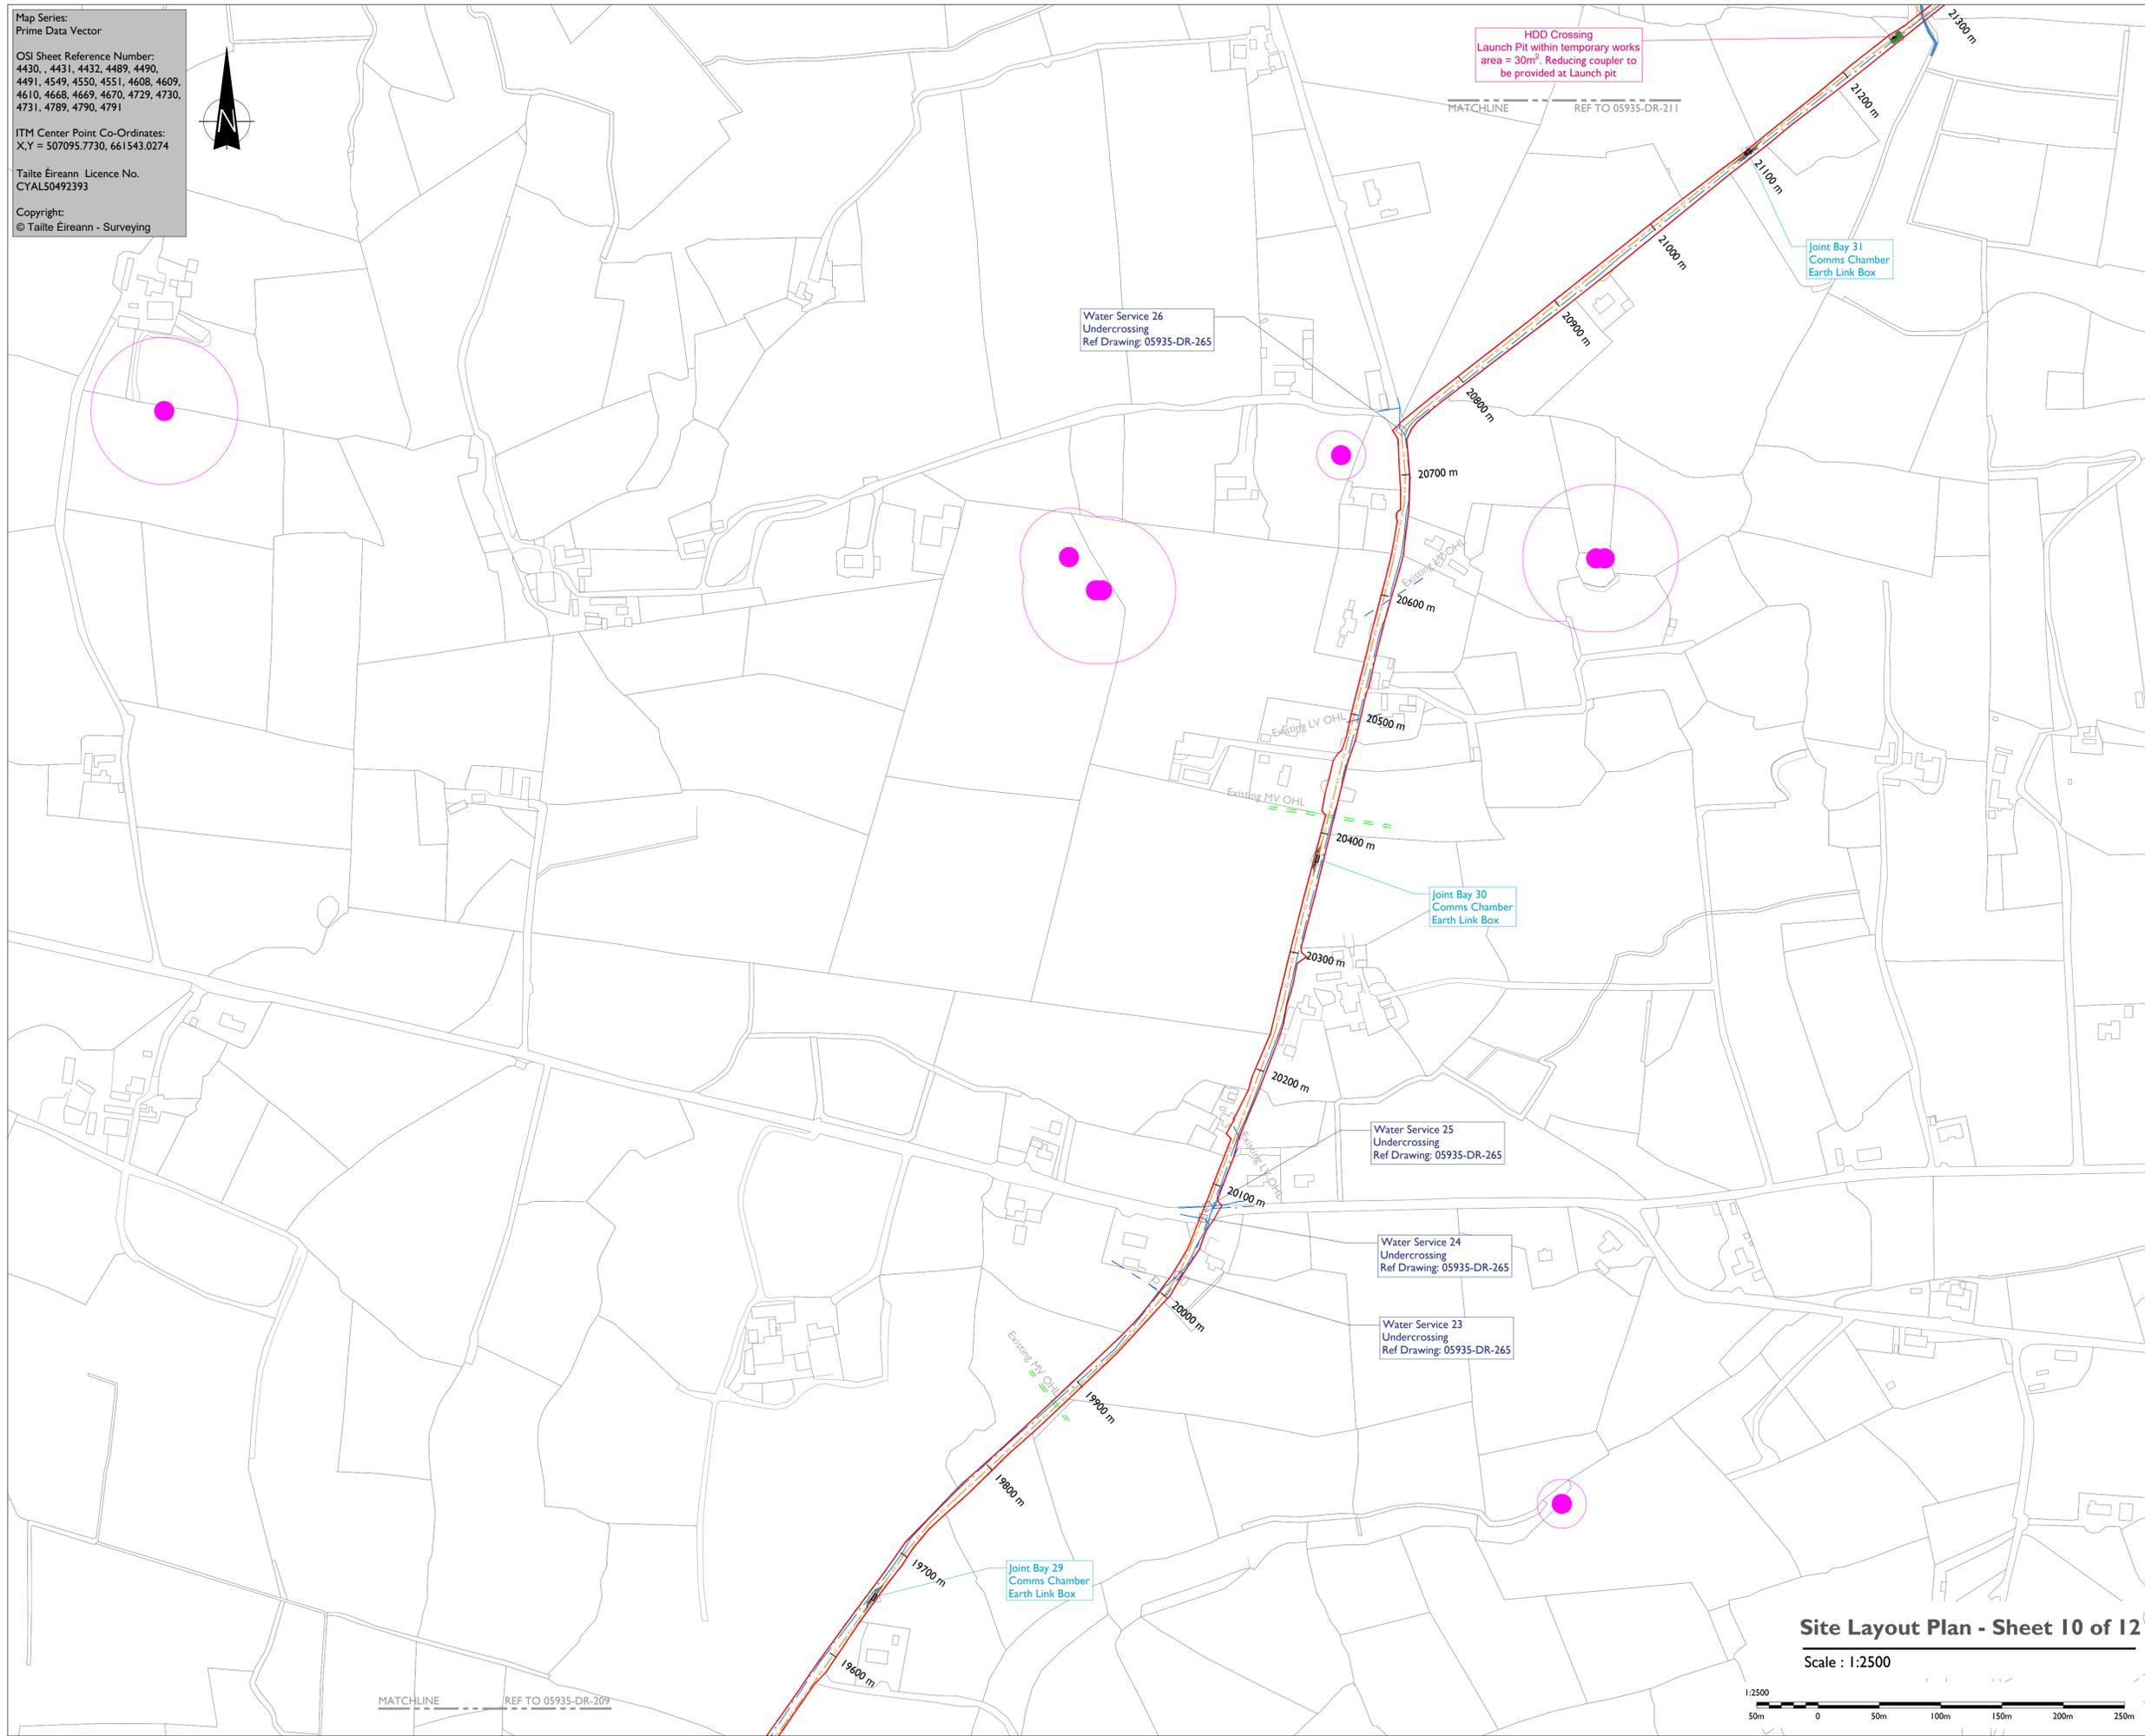

Head Office
 Beenleigh,
 Abbeydonney,
 Tralee, Co. Kerry
 Ireland
 Tel: 00353 66 7135710

Regional Office
 Basepoint Business Centre
 Stroudley Road, Basingstoke,
 Hampshire,
 RG24 8UP, UK
 Tel: 00 44 1256406664

PROJECT

**Cahermurphy West
 Wind Farm 110kV
 Grid Connection**

CLIENT

FuturaEnergy Ireland

CONSULTANTS

MKO

- NOTES: -**
- This drawing is to be used only for the purpose of the planning application and is subject to detailed design.
 - Position of underground cable and location of joint bays, links boxes and comms chambers may vary depending on site conditions.
 - Position of link boxes and comms chambers is to be agreed onsite with EirGrid/ESB.
 - Other services may be encountered on the route.
 - Position of HDD launch/reception shown points are indicative only and will be subject to site investigation works and detailed design.

- LEGEND: -**
- Grid Connection Underground Cable Route - Approx 25.005km
 - Red Line Planning Boundary
 - Existing ESB OHL LV/MV Networks
 - Recorded Monuments & Associated Zone of Notifications shown thus
 - Irish Water Infrastructure shown thus

ISSUE/REVISION

NO	DATE	DESCRIPTION
P1	12.12.25	Issued for Planning
N3	03.11.25	Issued for Information
N2	03.10.25	Issued for Information
N1	15.08.25	Issued for Information
I/R	DATE	DESCRIPTION

PROJECT NUMBER
 05-935

SHEET TITLE
 Site Layout Plan -
 Sheet 10 of 12


SHEET NUMBER
 05935-DR-210

Site Layout Plan - Sheet 10 of 12
 Scale : 1:2500



Project Management Initials: Designer: DMB Checked: DB Approved: RG

ISO A1 594mm x 841mm
 Prime Data Vector
 OSJ Sheet Reference Number:
 4430, 4431, 4432, 4489, 4490,
 4491, 4549, 4550, 4551, 4608, 4609,
 4610, 4668, 4669, 4670, 4729, 4730,
 4731, 4789, 4790, 4791
 ITM Center Point Co-Ordinates:
 X,Y = 507095.7730, 661543.0274
 Tailte Éireann Licence No.
 CYAL50492393
 Copyright:
 © Tailte Éireann - Surveying

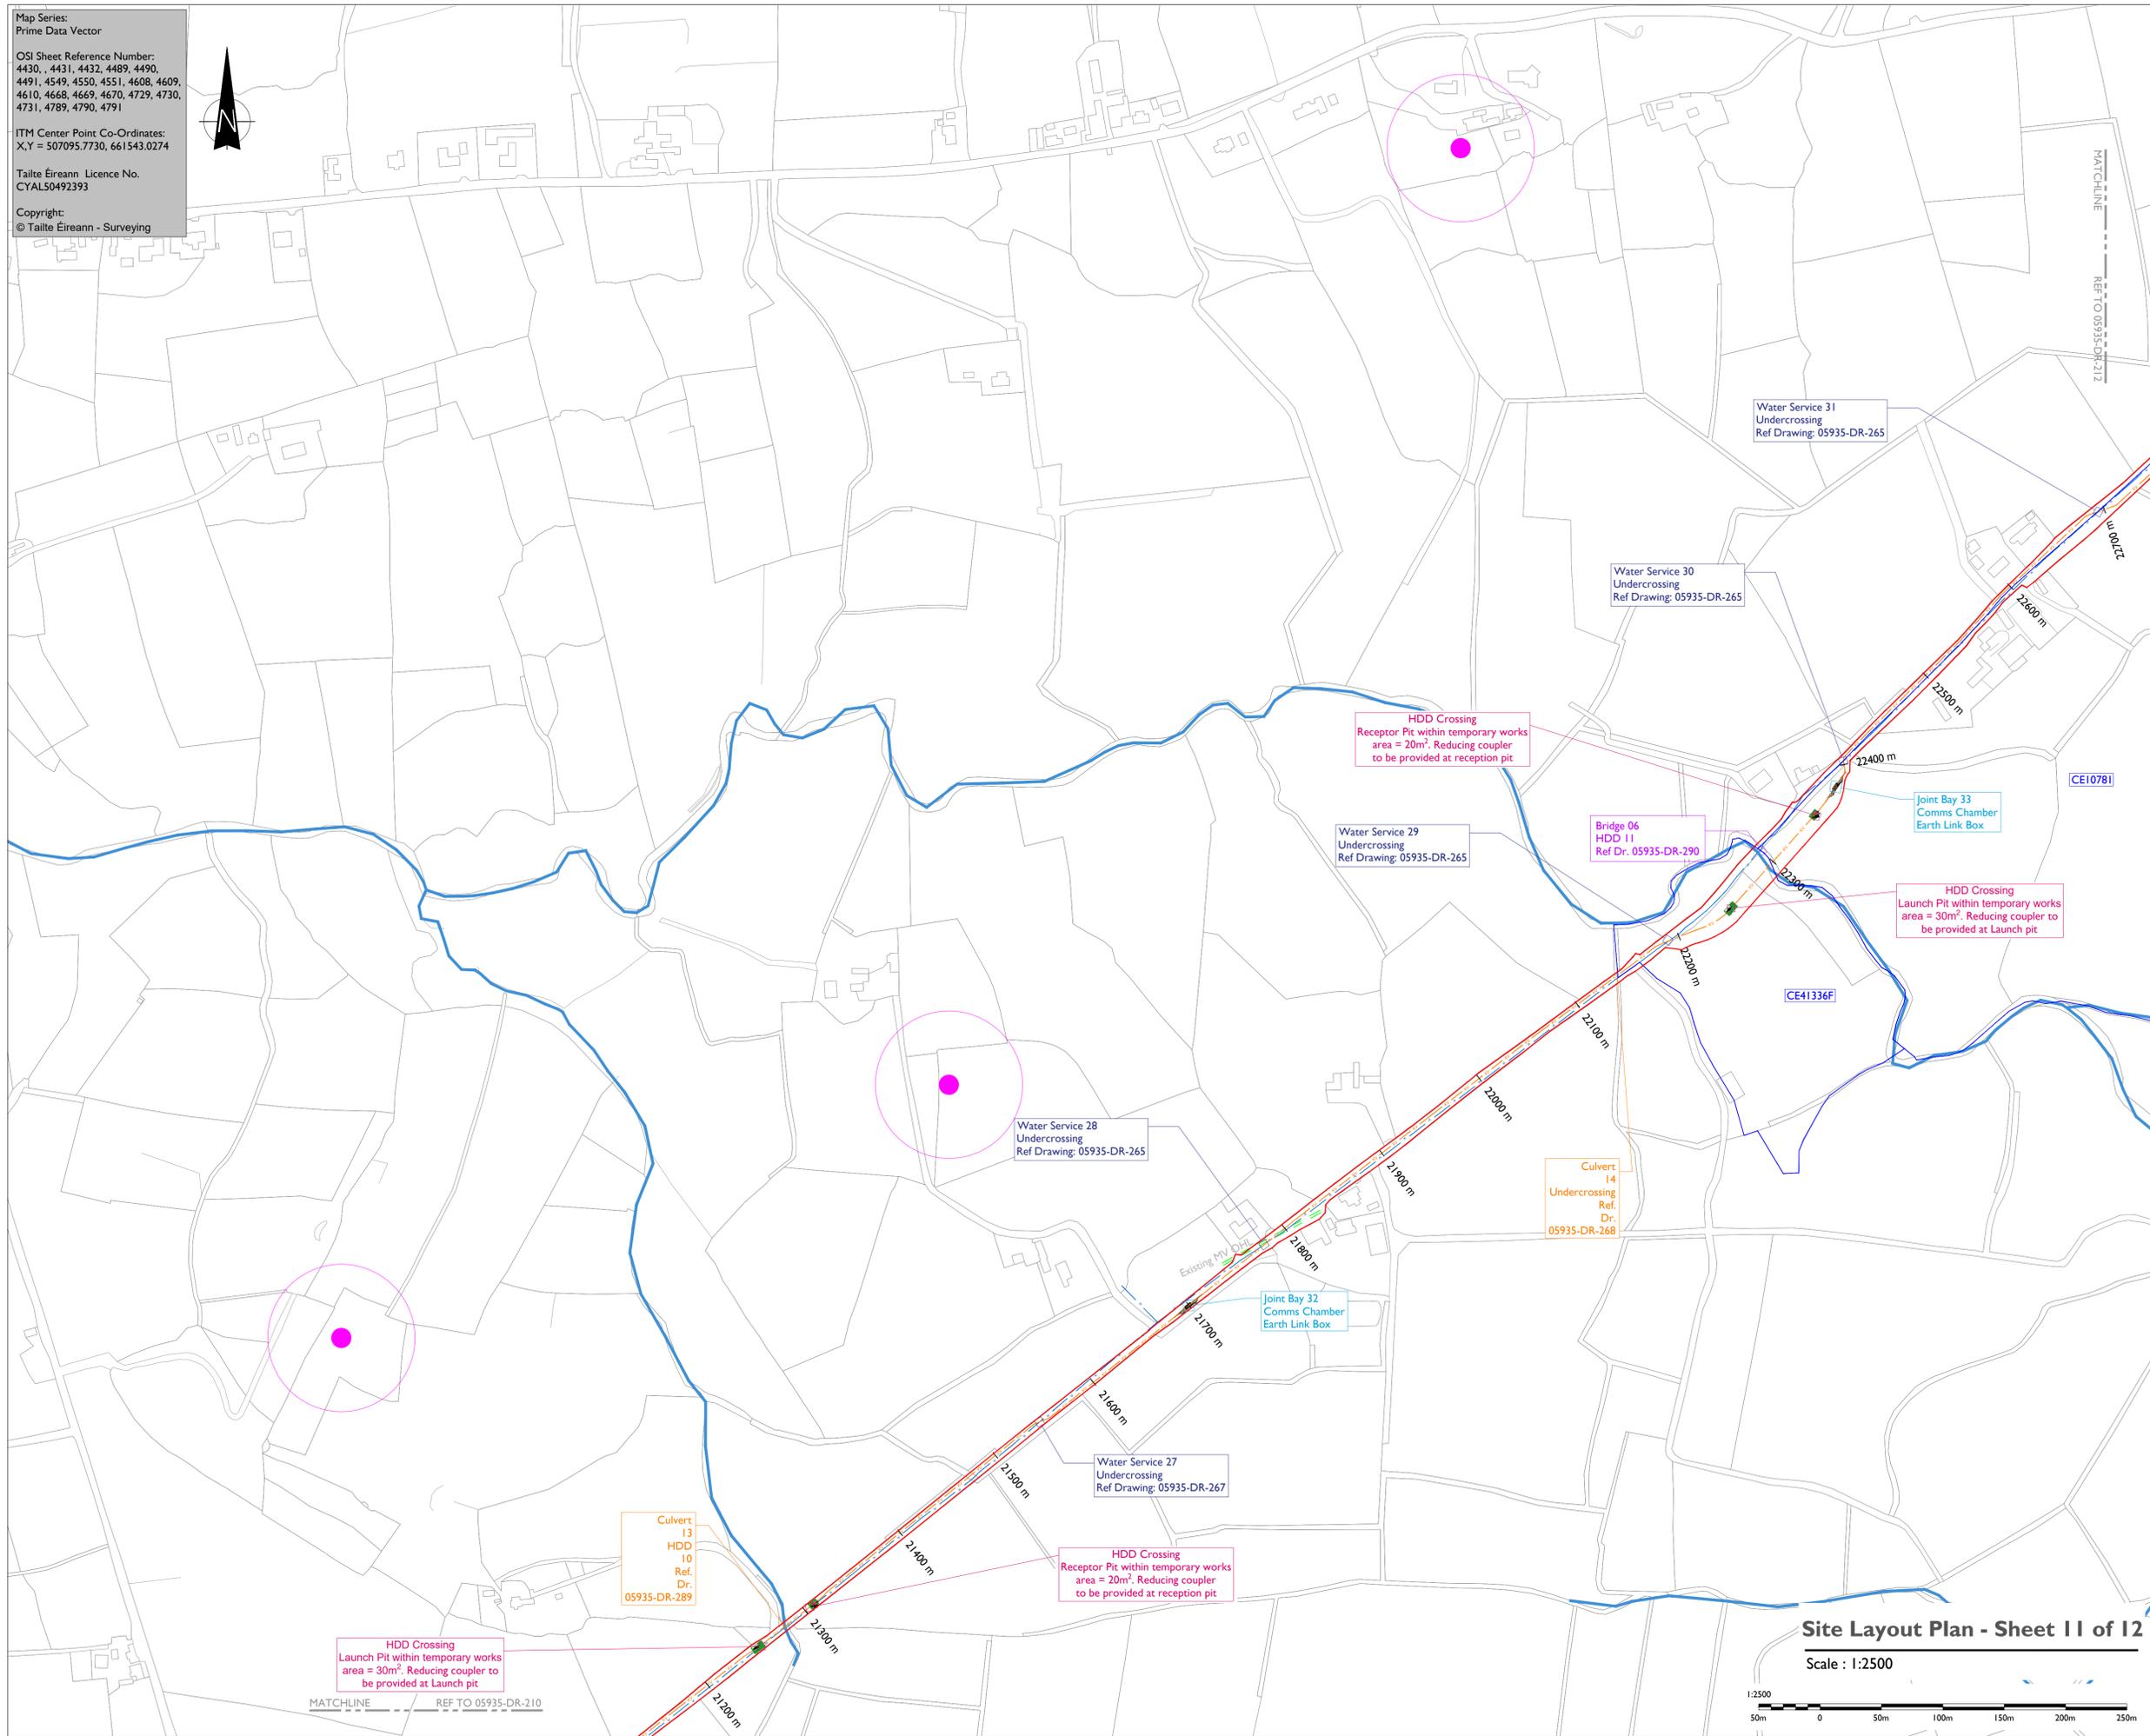

Head Office
 Beenrigh,
 Abbeydonney,
 Tralee, Co. Kerry
 Ireland
 Tel: 00353 66 7135710

Regional Office
 Basepoint Business Centre
 Stroudley Road, Basingstoke,
 Hampshire,
 RG24 8UP, UK
 Tel: 00 44 1256406664

PROJECT

**Cahermurphy West
 Wind Farm 110kV
 Grid Connection**

CLIENT



CONSULTANTS



NOTES: -

- This drawing is to be used only for the purpose of the planning application and is subject to detailed design.
- Position of underground cable and location of joint bays, links boxes and comms chambers may vary depending on site conditions.
- Position of link boxes and comms chambers is to be agreed onsite with EirGrid/ESB.
- Other services may be encountered on the route.
- Position of HDD launch/reception shown points are indicative only and will be subject to site investigation works and detailed design.

LEGEND: -

- Grid Connection Underground Cable Route - Approx 25.005km
- Red Line Planning Boundary
- Existing ESB OHL MV Network
- Optioned Landownership Boundary shown thus
- Existing River Network shown thus
- Recorded Monuments & Associated Zone of Notifications shown thus
- Irish Water Infrastructure shown thus

ISSUE/REVISION

NO	DATE	DESCRIPTION
P1	12.12.25	Issued for Planning
N3	03.11.25	Issued for Information
N2	03.10.25	Issued for Information
N1	15.08.25	Issued for Information
I/R	DATE	DESCRIPTION

PROJECT NUMBER

05-935

SHEET TITLE

Site Location Plan -
 Sheet 11 of 12

SHEET NUMBER


05935-DR-211

Site Layout Plan - Sheet 11 of 12

Scale : 1:2500



Project Management Initials: Designer: DMB Checked: DB Approved: RG

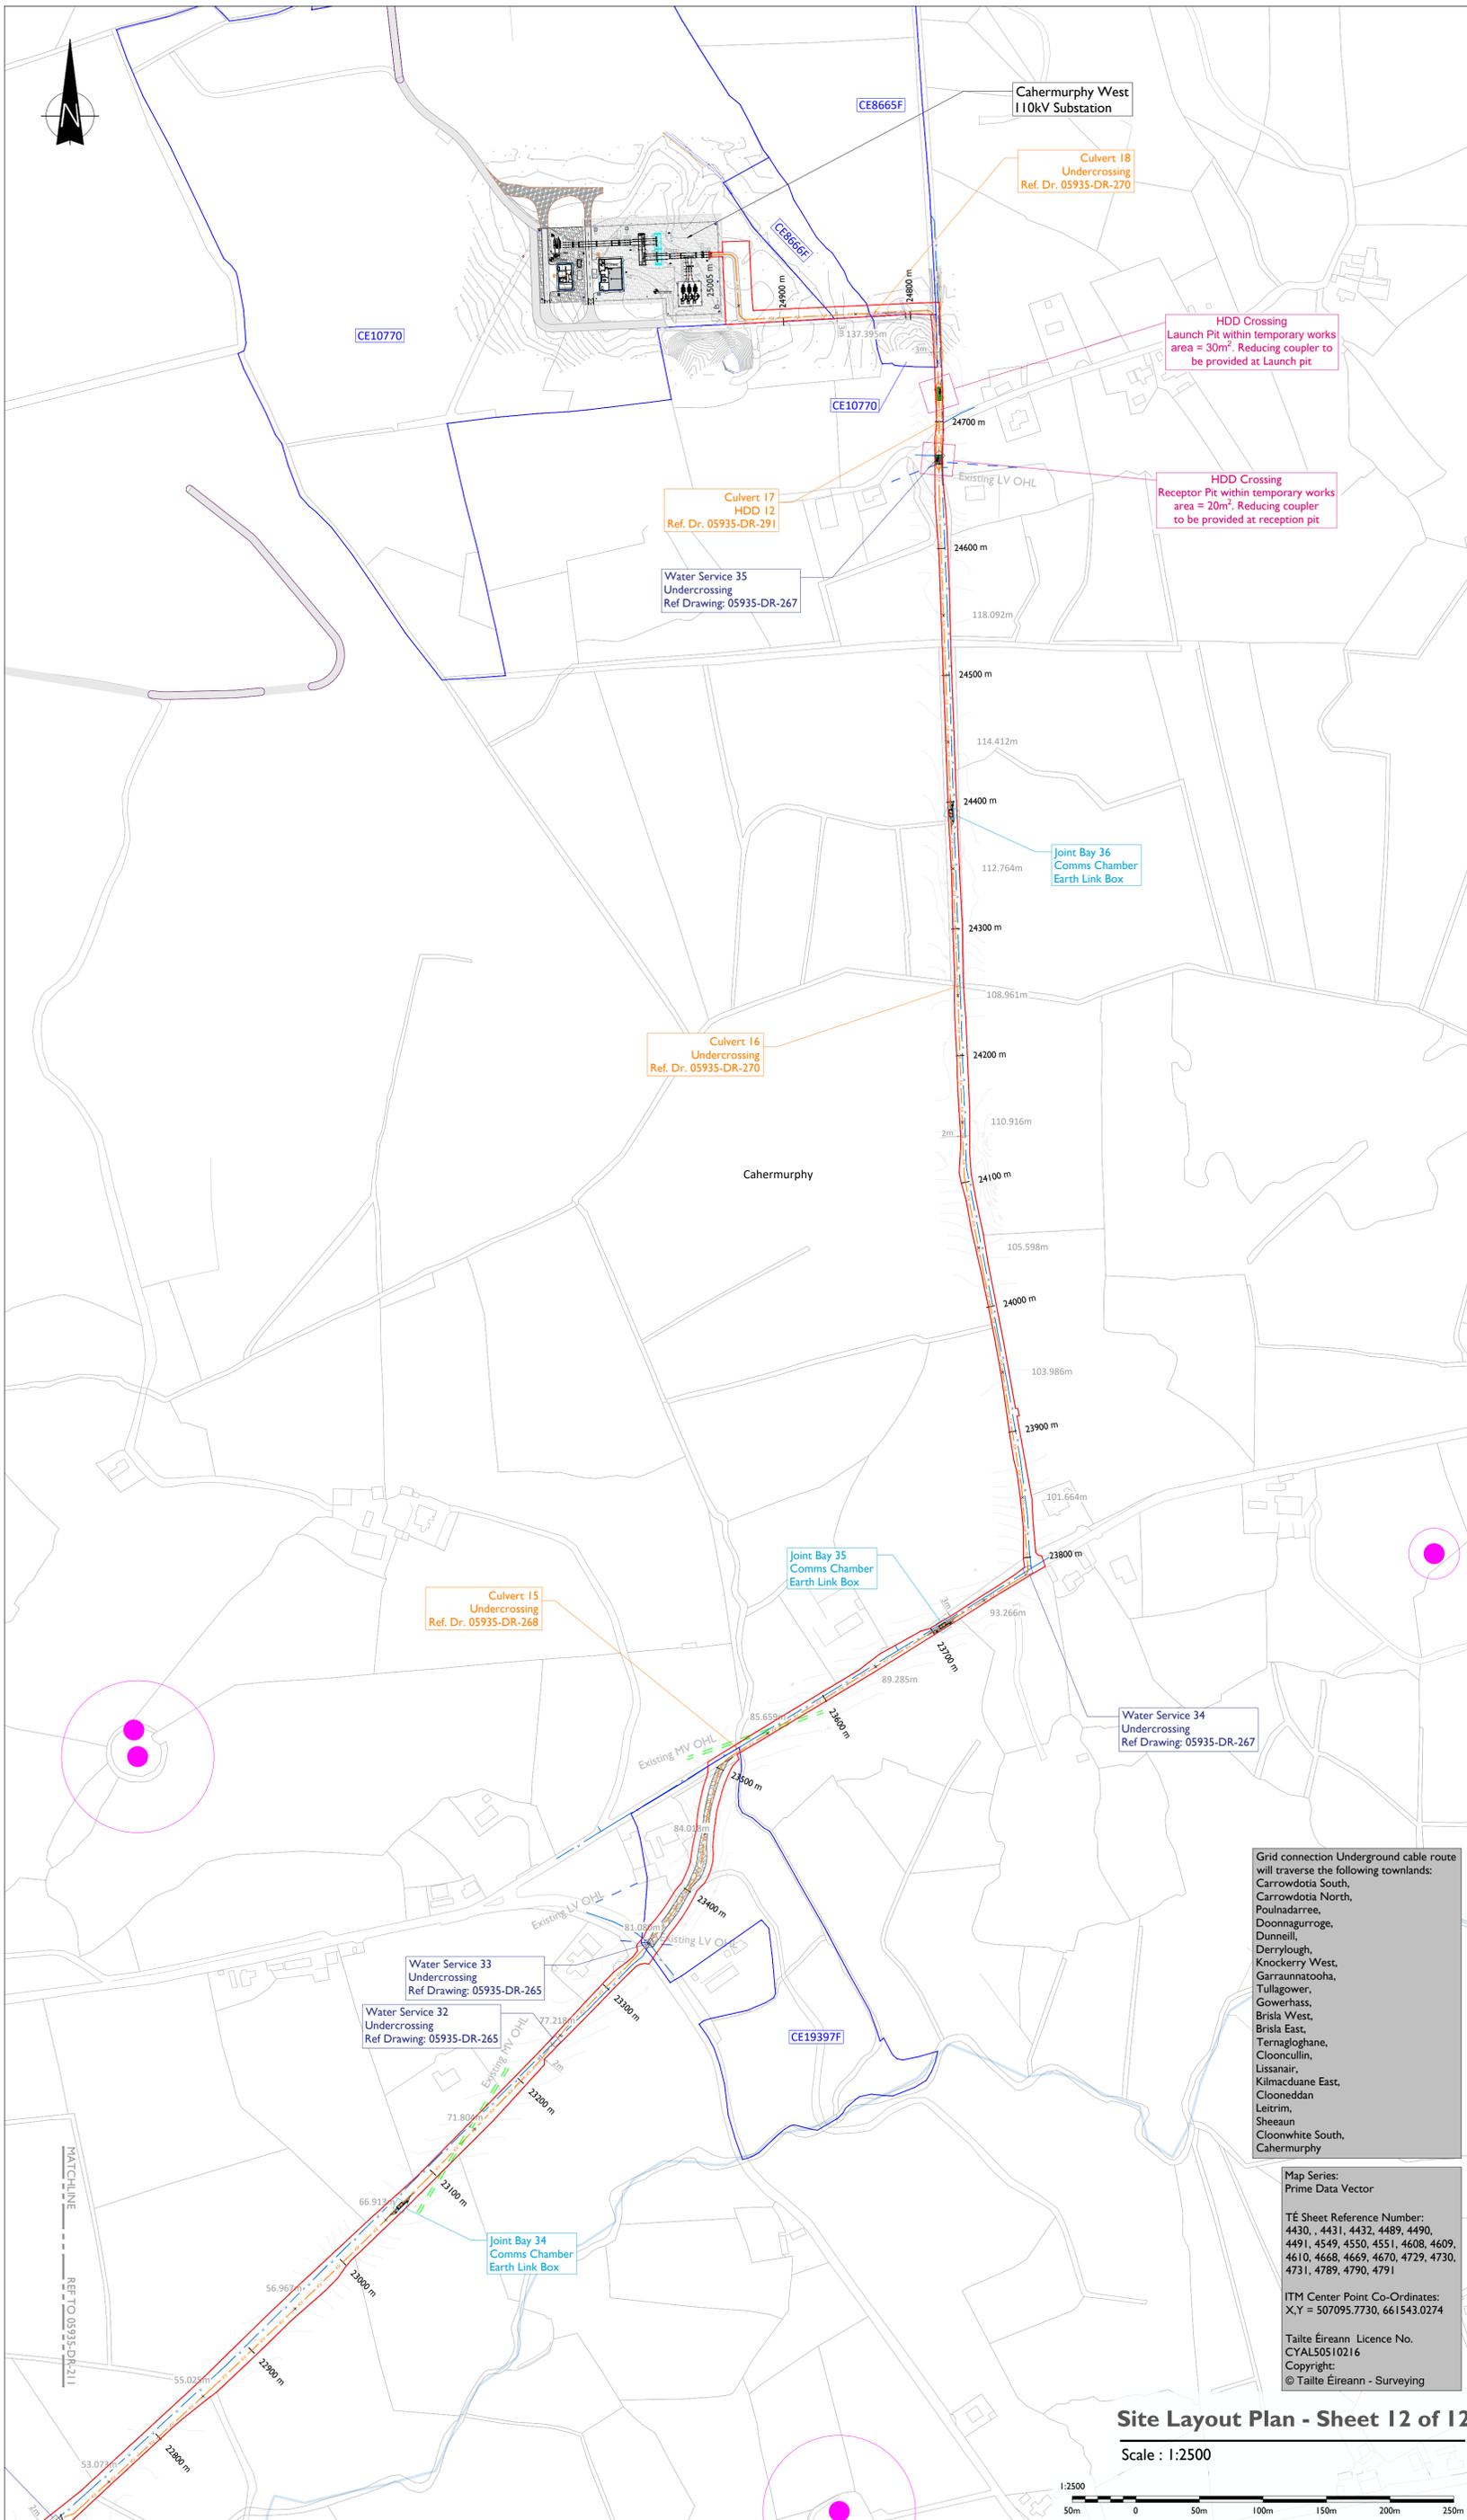

LEGEND: -

- Grid Connection Underground Cable Route - Approx 25.005km —
- Proposed 110kV AirGrid Substation two bay arrangement
- Red Line Planning Boundary —
- Existing ESB OHL LV/MV Networks —
- Recorded Monuments & Associated Zone of Notifications shown thus
- Optioned Landownership Boundary shown thus —
- Inish Water Infrastructure shown thus —
- Proposed Wind Farm track shown thus
- Temporary track shown thus
- Spot heights shown thus x 36.980m
- UGC chainage shown thus
- Distance from Red line boundary to grid connection underground cable 5m

NOTES: -

- This drawing is to be used only for the purpose of the planning application and is subject to detailed design.
- Position of underground cable and location of joint bays, links boxes and comms chambers may vary depending on site conditions.
- Position of link boxes and comms chambers is to be agreed onsite with EirGrid/ESB.
- Other services may be encountered on the route.
- Position of HDD launch/reception shown points are indicative only and will be subject to site investigation works and detailed design.
- Contours derived from DTM elevations referenced to Mean Head Vertical Datum

tli GROUP

Head Office: Beebreigh, Abbeydorney, Tralee, Co. Kerry, Ireland
 Tel: 00353 66 7135710

Regional Office: Basepoint Business Centre, Stroudley Road, Basingstoke, Hampshire, RG24 8UP, UK
 Tel: 00 44 1256406664

PROJECT

Cahermurphy West Wind Farm 110kV Grid Connection

CLIENT

FuturEnergy Ireland

CONSULTANTS

MKO

ISSUE/REVISION

I/R	DATE	DESCRIPTION
P3	13.03.26	Issued for Planning
P2	05.03.26	Issued for Planning
P1	12.12.25	Issued for Planning
N3	03.11.25	Issued for Information
N2	03.10.25	Issued for Information
N1	15.08.25	Issued for Information

PROJECT NUMBER

05-935

SHEET TITLE

Site Layout Plan - Sheet 12 of 12

SHEET NUMBER

05935-DR-212

Grid connection Underground cable route will traverse the following townlands: Carrowdota South, Carrowdota North, Pounadarree, Doonagurroge, Dunneil, Derrylough, Knockerry West, Garraunatooha, Tullagower, Gowerhass, Brisla West, Brisla East, Ternagloghane, Cloonculin, Lissanair, Kilmacduane East, Cloonedan, Leirim, Sheean, Cloonwhite South, Cahermurphy

Map Series: Prime Data Vector

TÉ Sheet Reference Number: 4430, 4431, 4432, 4489, 4490, 4491, 4549, 4550, 4551, 4608, 4609, 4610, 4668, 4669, 4670, 4729, 4730, 4731, 4789, 4790, 4791

ITM Center Point Co-Ordinates: X,Y = 507095.7730, 661543.0274

Taitte Éireann Licence No. CYAL50510216
 Copyright: © Taitte Éireann - Surveying

Site Layout Plan - Sheet 12 of 12

Scale : 1:2500

