

The planned 220kV grid route transverses through the following Townlands listed below

1. Rathmorrissy
2. Pollangroagh
3. Moanbaun
4. Castletambert
5. Knocknacreeva
6. Cararunduff
7. Caherbriskaun
8. Lisheenkyle East
9. Barrettspark
10. Cashla

Map Series:
Prime Data Vector


ITM Centre Point Co-ordinate:
X,Y = 545125.63,728672.74

Tailte Éireann Licence No.
CYAL50510216

Copyright:
© Tailte Éireann, 2026

LEGEND: -

Proposed 220 kV UGC Grid Connection Route (8.1km)	
Planning Boundary	
Site Ownership Boundary	
Existing ESB OHL HV Network	
Existing ESB OHL LV/MV Networks	
Existing ESB UGC Networks	
Existing Eir Network OHL	
Existing Eir Network UGC	
Wayleave Boundary	
Existing Levels	+ 31.105m

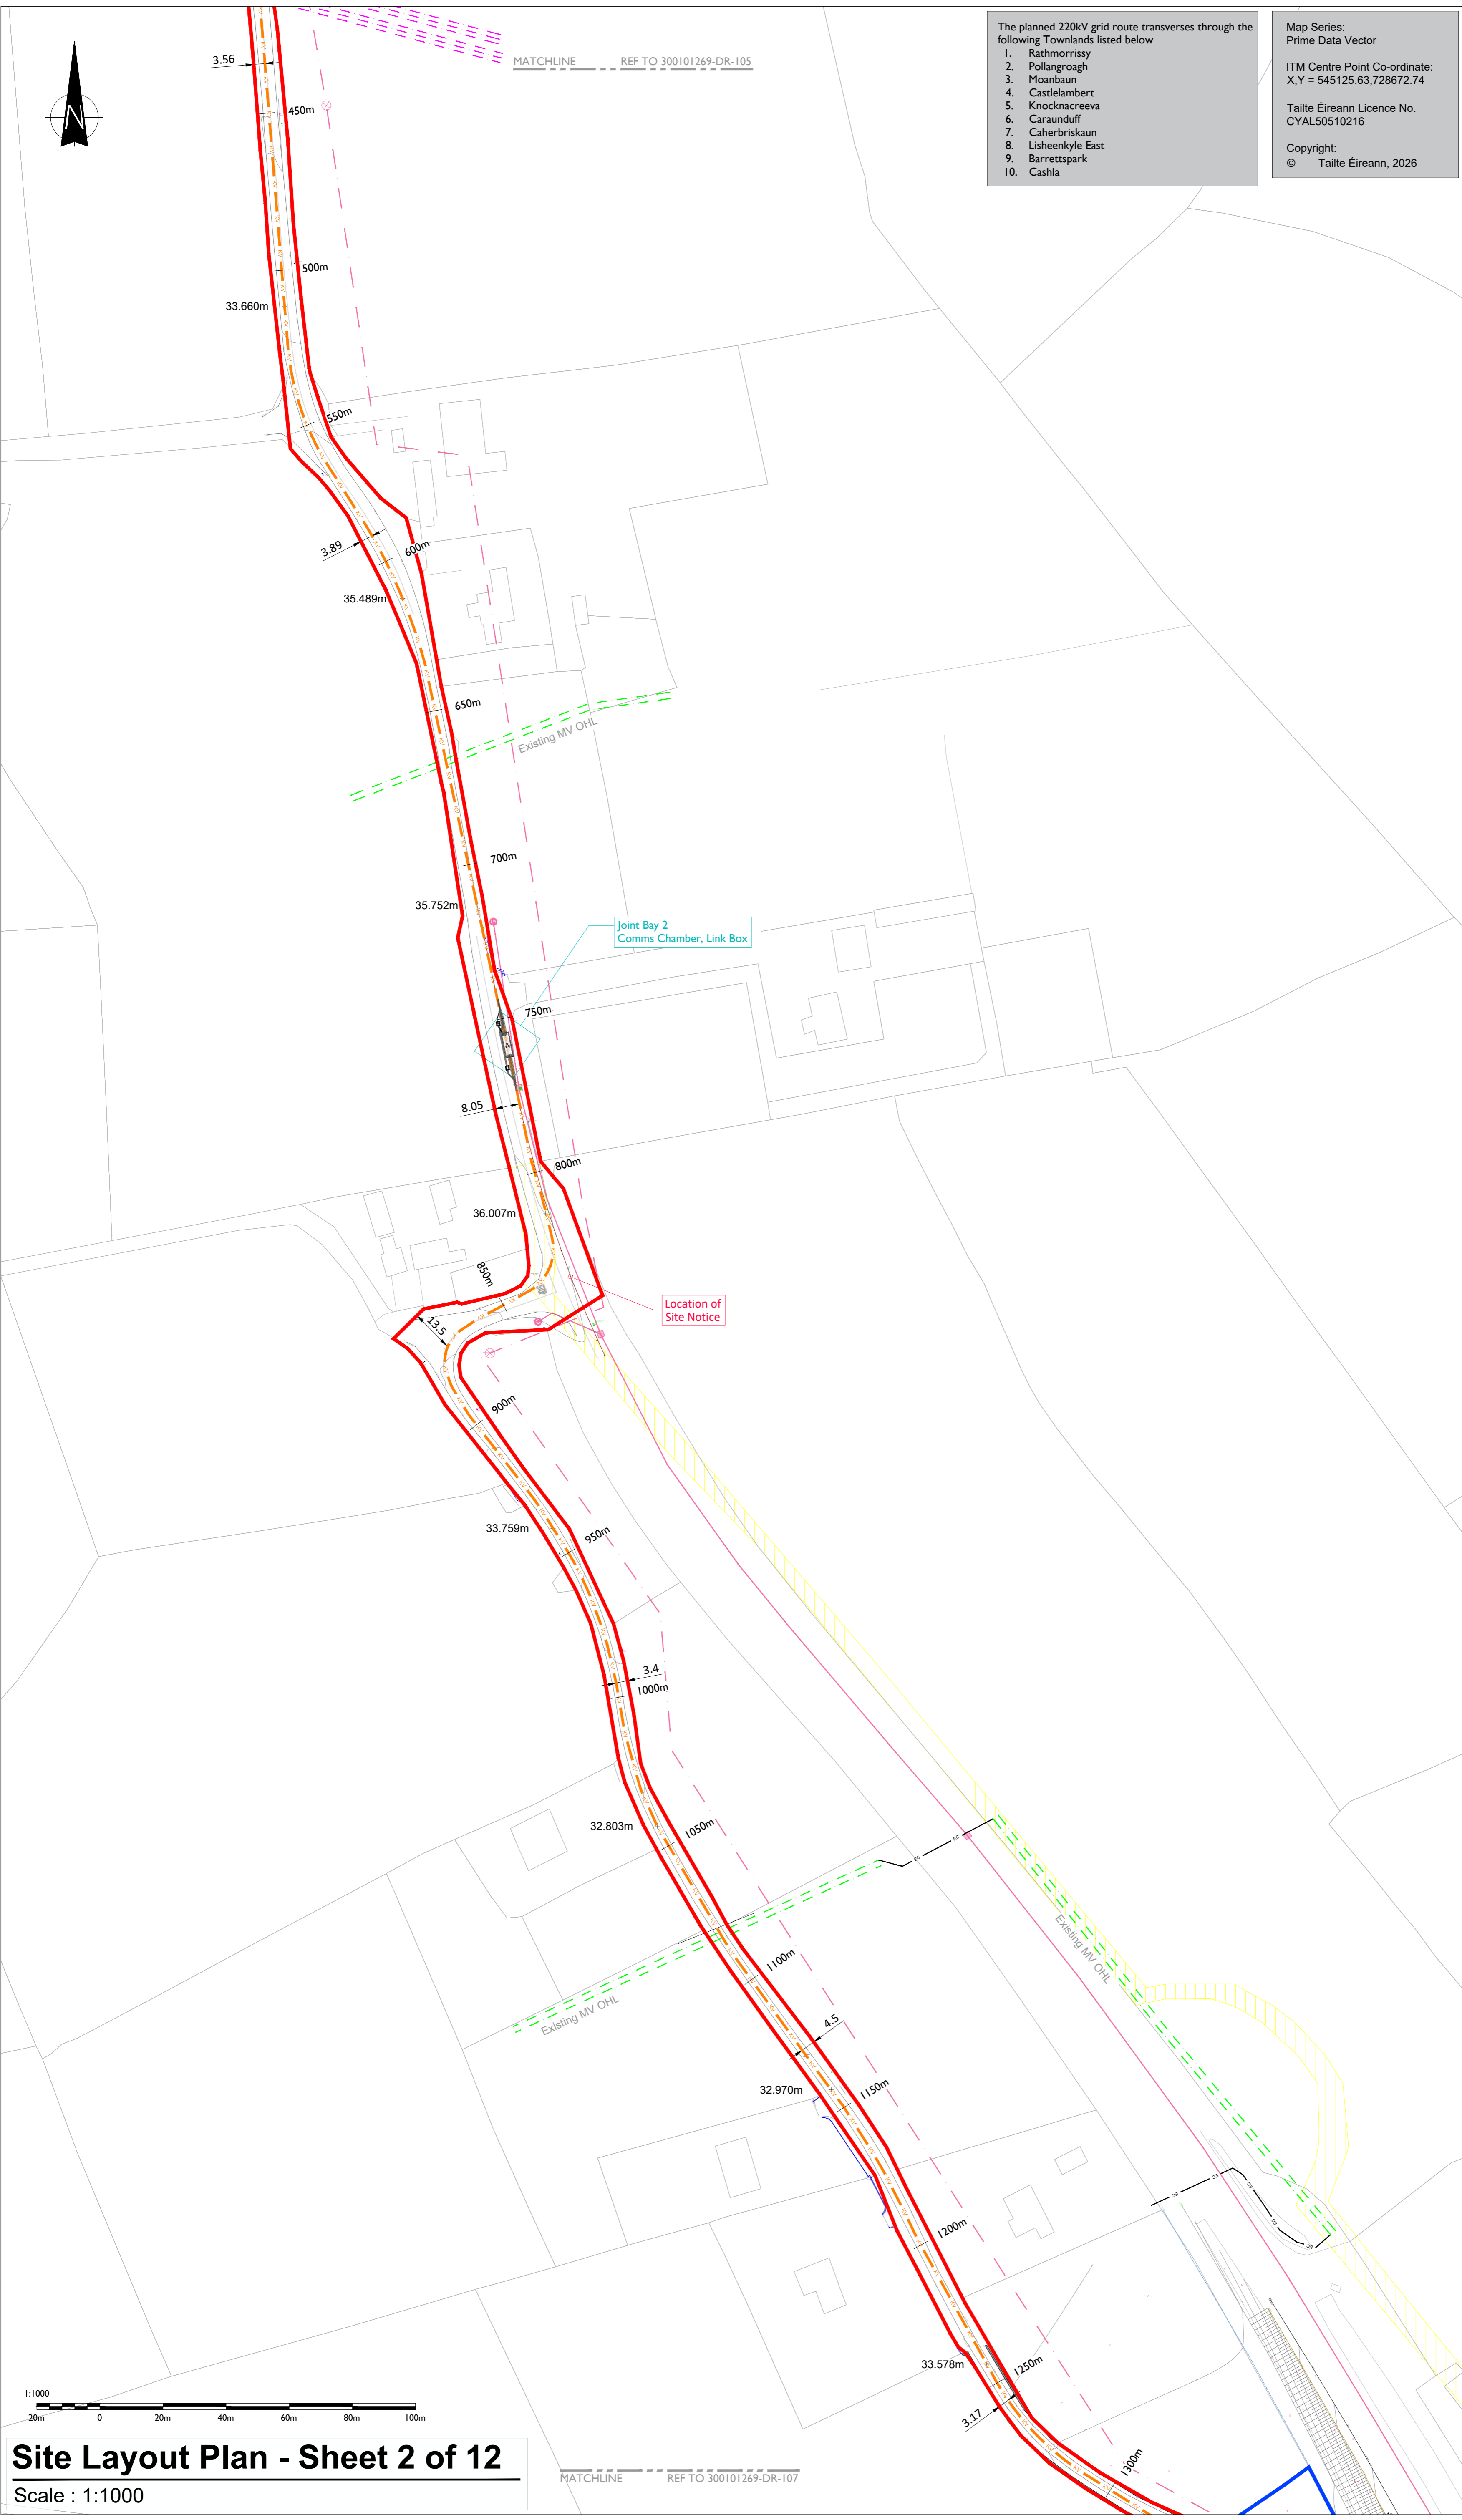

NOTES: -

- This drawing is to be used only for the purpose of the planning application and is subject to detailed design.
- Position of underground cable and location of joint bays, links boxes and comms chambers may vary depending on site conditions.
- Position of link boxes and comms chambers is to be agreed onsite with EirGrid/ESB.
- Other services may be encountered on the route.

tli GROUP

Head Office: Baenreigh, Abbeydorney, Tralee, Co. Kerry, Ireland
Tel: 00353 66 7135710

Regional Office: Baspoint Business Centre, Stroudley Road, Basingstoke, Hampshire, RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

Cashla Peaker Plant 220kV
Grid Connection & Substation

CLIENT

CONSULTANTS

ISSUE/REVISION

Issue/Revision	Date	Description
P3	13.03.26	Issued for Planning
P2	03.02.26	Issued for Information
P1	05.09.25	Issued for Planning
N1	03.06.25	Issued for Information
I/R	DATE	DESCRIPTION

PROJECT NUMBER
300-101269

SHEET TITLE
Site Layout Plan - Sheet 2 of 12

SHEET NUMBER
300101269-DR-106