


Reinstatement details based on Guidelines for Managing Openings in Public Roads - SD4

EXISTING ROAD BUILD-UP TO BE CONFIRMED BY GALWAY COUNTY COUNCIL

EXISTING ROAD BUILD-UP TO BE CONFIRMED BY XXXX CO. COUNCIL

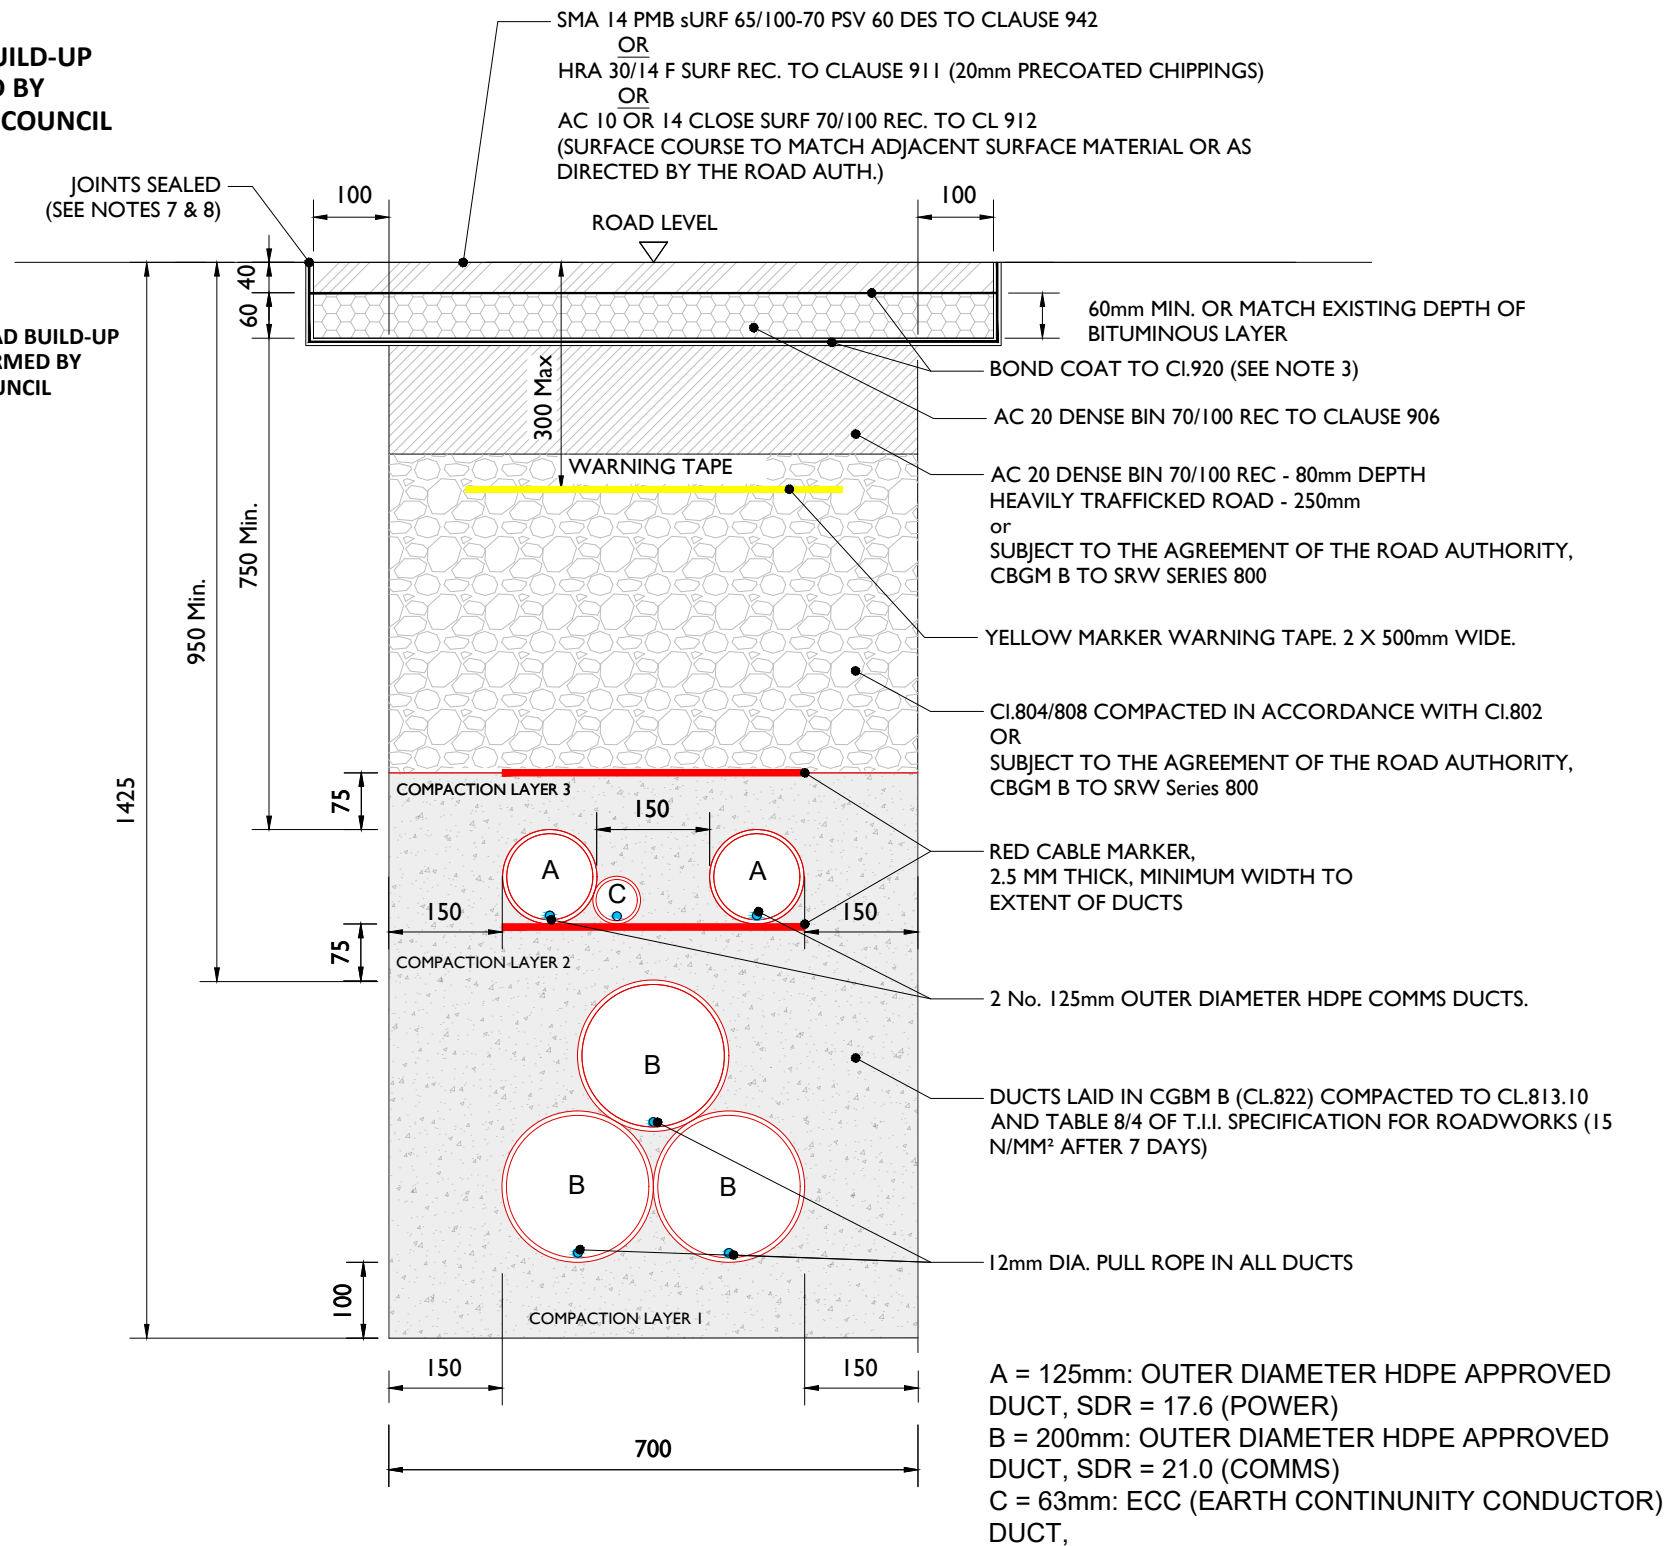

**ALL REINSTATEMENT WORKS ARE TO BE IN ACCORDANCE WITH LOCAL AREA ENGINEERS REQUIREMENTS AND GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS**

**NOTES:**

1. Refer to Guidelines for managing Openings in Public Roads (Purple Book - April 2017), Chapter 6 'Specifications' for guidance on Duct type / colour and Marker Tape type / colour.
2. All bound edges shall be saw cut to expose the full vertical thickness of each layer prior to excavation. All edges shall be essentially straight, smooth and vertical.
3. Where a temporary surface has been used, material shall be planed out to the depth specified in this drawing. The new permanent surface shall be machined laid and mechanically compacted with a vibrating roller.
4. Where the trimmed edge of excavation is within 400mm\* of a joint / edge, ironwork or other reinstatement, this trimmed edge shall be extended to include same and the area of reinstatement shall be extended accordingly (\* increase to 800mm where this is pre-existing practice).
5. Any damaged area adjacent to the opening and resulting from the excavation operation shall be included within the area to be reinstated.
6. Clause 808 or Cement Bound Granular Material surface to be sprayed per clause 920 prior to application of Asphalt Concrete Layer.
7. Joint sealer shall be a hot 40/60 pen bitumen binder or cold thixotropic bitumen 50 -70 pen to be applied to all vertical cuts in accordance with B.S. 594987 prior to application of bituminous materials.
8. Joints sealed with hot bitumen and topped with fine sand/grid to get a minimum 55 skid resistance value as determined by the Portable Skid Resistance Pendulum and shall not exceed 3mm depth and 50mm width or other method approved by the road authority.
9. For roads without asphalt concrete surface (e.g. may be Cl.804 with double surface dressing), the road authority may as its discretion permit the temporary reinstatement surface of asphalt concrete to be regulated in lieu of excavation and reinstatement; and subsequently surface dressed.
10. Surface course to match existing surfaces unless otherwise directed by road authority.
11. The coarse aggregate in the asphalt concrete surface course shall have a polished stone value of not less than 60.

**Typical Section Through Permanent Reinstatement of Longitudinal Opening in Roadway**

SCALE 1:10



Head Office  
Beenreigh,  
Abbeydorney,  
Tralee, Co. Kerry  
Ireland  
Tel: 00353 66 7135710

CLIENT



PROJECT

Cashla Peaker Plant 220kV  
Grid Connection and Substation

PROJECT NUMBER  
300-101269

SHEET NUMBER  
300101269-DR-121

SHEET TITLE

220kV Ducts in Local Road Permanent  
Reinstatement (SD4) With ECC

DRAWING STATUS  
For Planning

ISSUE/REVISION

I/R	DATE	DESCRIPTION
P3	13.03.26	Issued for Planning
P2	03.02.26	Issued for Information
P1	05.09.25	Issued for Planning
N1	03.06.25	Issued for Information