



NOTES:

1. ALL DIMENSION IN MILLIMETERS UNLESS OTHERWISE STATED
2. REINSTATEMENTS TO COMPLY WITH REQUIREMENTS OF THE RELEVANT LOCAL AUTHORITY/ASSET OWNER
3. ALL MATERIALS AND WORKMANSHIP TO BE IN ACCORDANCE WITH NRA/T.I.I. SPECIFICATION FOR ROADWORKS, MAY 2005 & SUBSEQUENT REVISIONS
4. REINFORCED CONCRETE TO BE MINIMUM GRADE C32 / 40, SULPHATE RESISTING CEMENT TO BE USED WHERE AGGRESSIVE SOIL CONDITIONS APPLY, REFER TO TABLE 6.1 OF THE BRITISH STANDARD 8110.
5. CARRAIGEWAY COVERS AND FRAMES TO BE TO B.S EN 124.
6. ALL COVERS SHALL HAVE "ESB" LOGO INCORPORATED IN THEM TO THE APPROVAL OF EIRGRID
7. FURTHER DETAILS WILL BE PROVIDED BY EIRGRID.
8. FINAL POSITION OF EARTH LINK CHAMBERS SHALL BE AGREED WITH EIRGRID
9. THIS DRAWING HAS BEEN PREPARED TO INFORM AN ENVIRONMENTAL IMPACT ASSESSMENT FOR THE CASHLA PEAKER PLANT PROJECT AND IS FOR ILLUSTRATIVE PURPOSES ONLY. FINAL DETAILED DRAWINGS FOR THE PROPOSED 220KV GRID CONNECTION ROUTE AND 220KV SUBSTATION WILL BE SUBMITTED AS PART OF A S.182B PLANNING APPLICATION TO AN COIMISIÚN PLEANÁLA IN DUE COURSE.

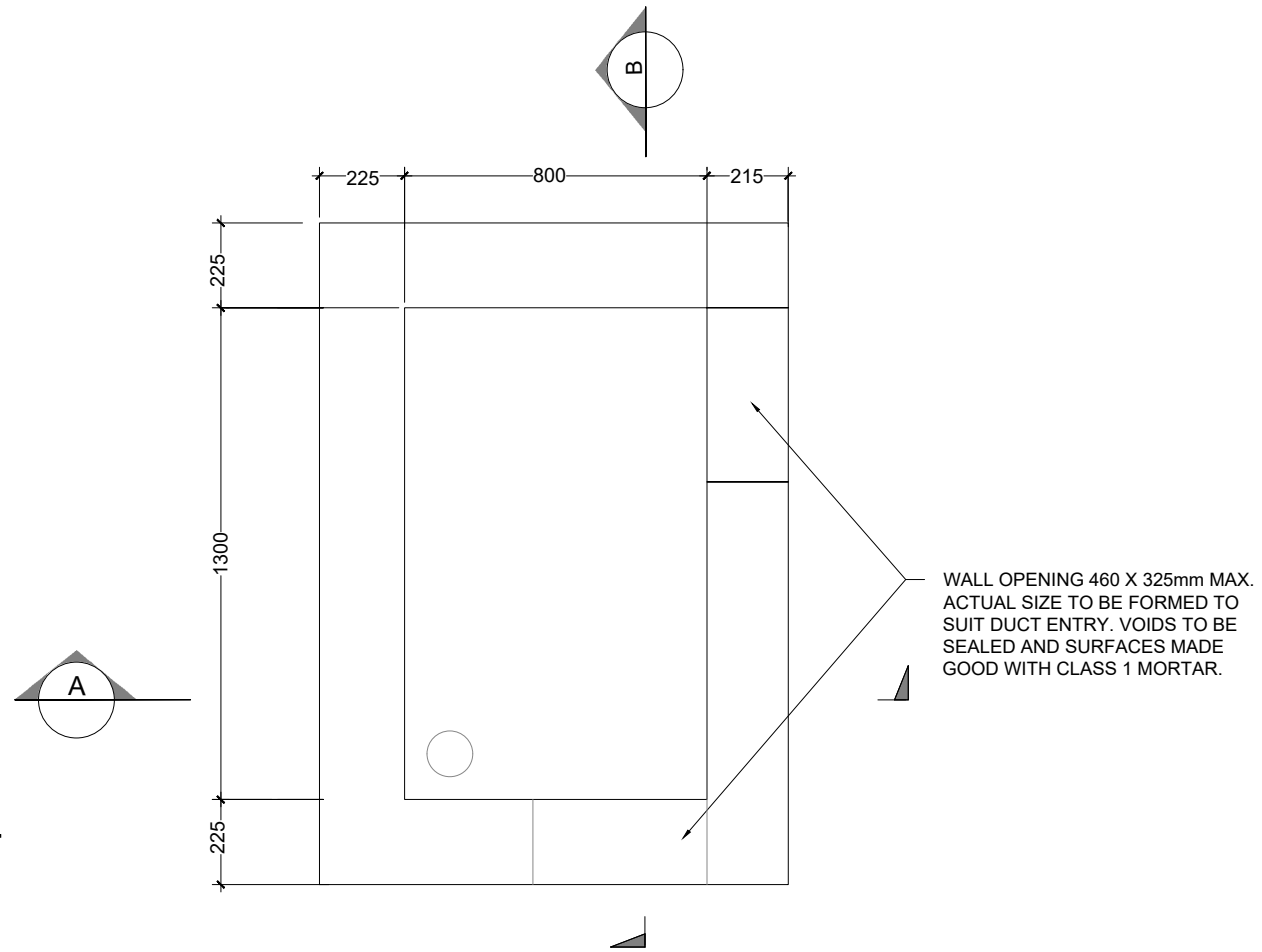

Plan of Earth Link Chamber
SCALE 1:20

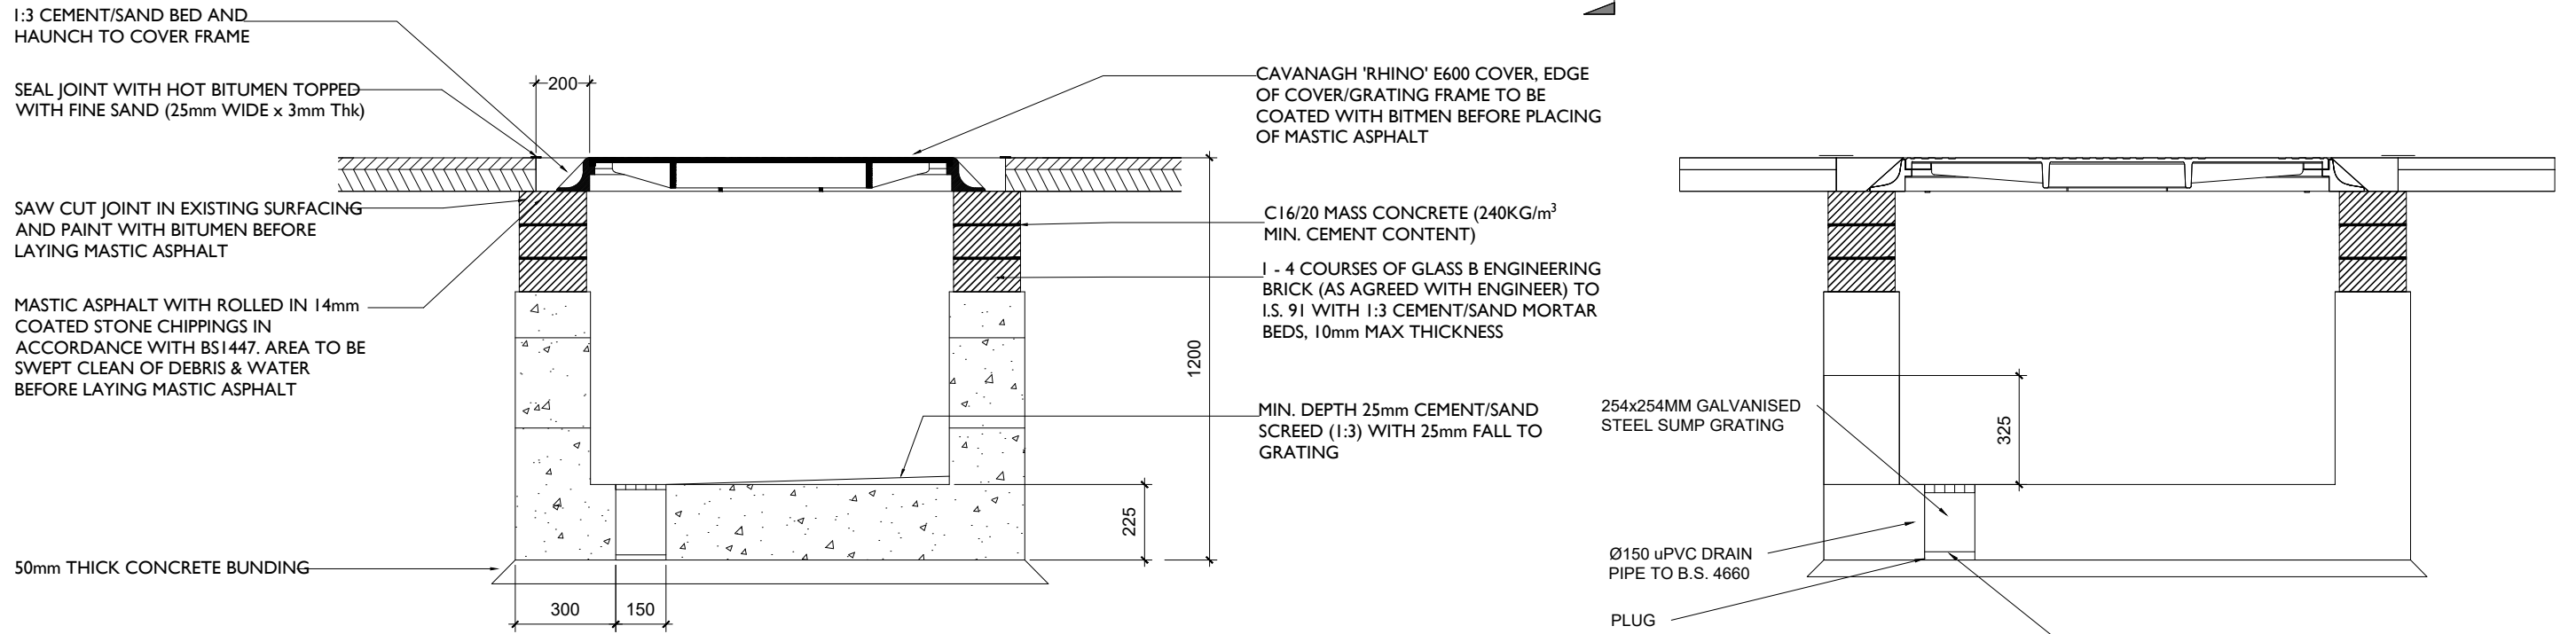

Earth Link Chamber - Section A
SCALE 1:20

Earth Link Chamber - Section B
SCALE 1:20



Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

CLIENT



PROJECT

Cashla Peaker Plant 220kV Grid
Connection and Substation

PROJECT NUMBER
300-101269

SHEET NUMBER
300101269-DR-135

SHEET TITLE

Earth Link
Chamber Details

DRAWING STATUS
For Planning

ISSUE/REVISION

I/R	DATE	DESCRIPTION
P3	13.03.26	Issued for Planning
P2	03.02.26	Issued for Information
P1	05.09.25	Issued for Planning
N1	03.06.25	Issued for Information