









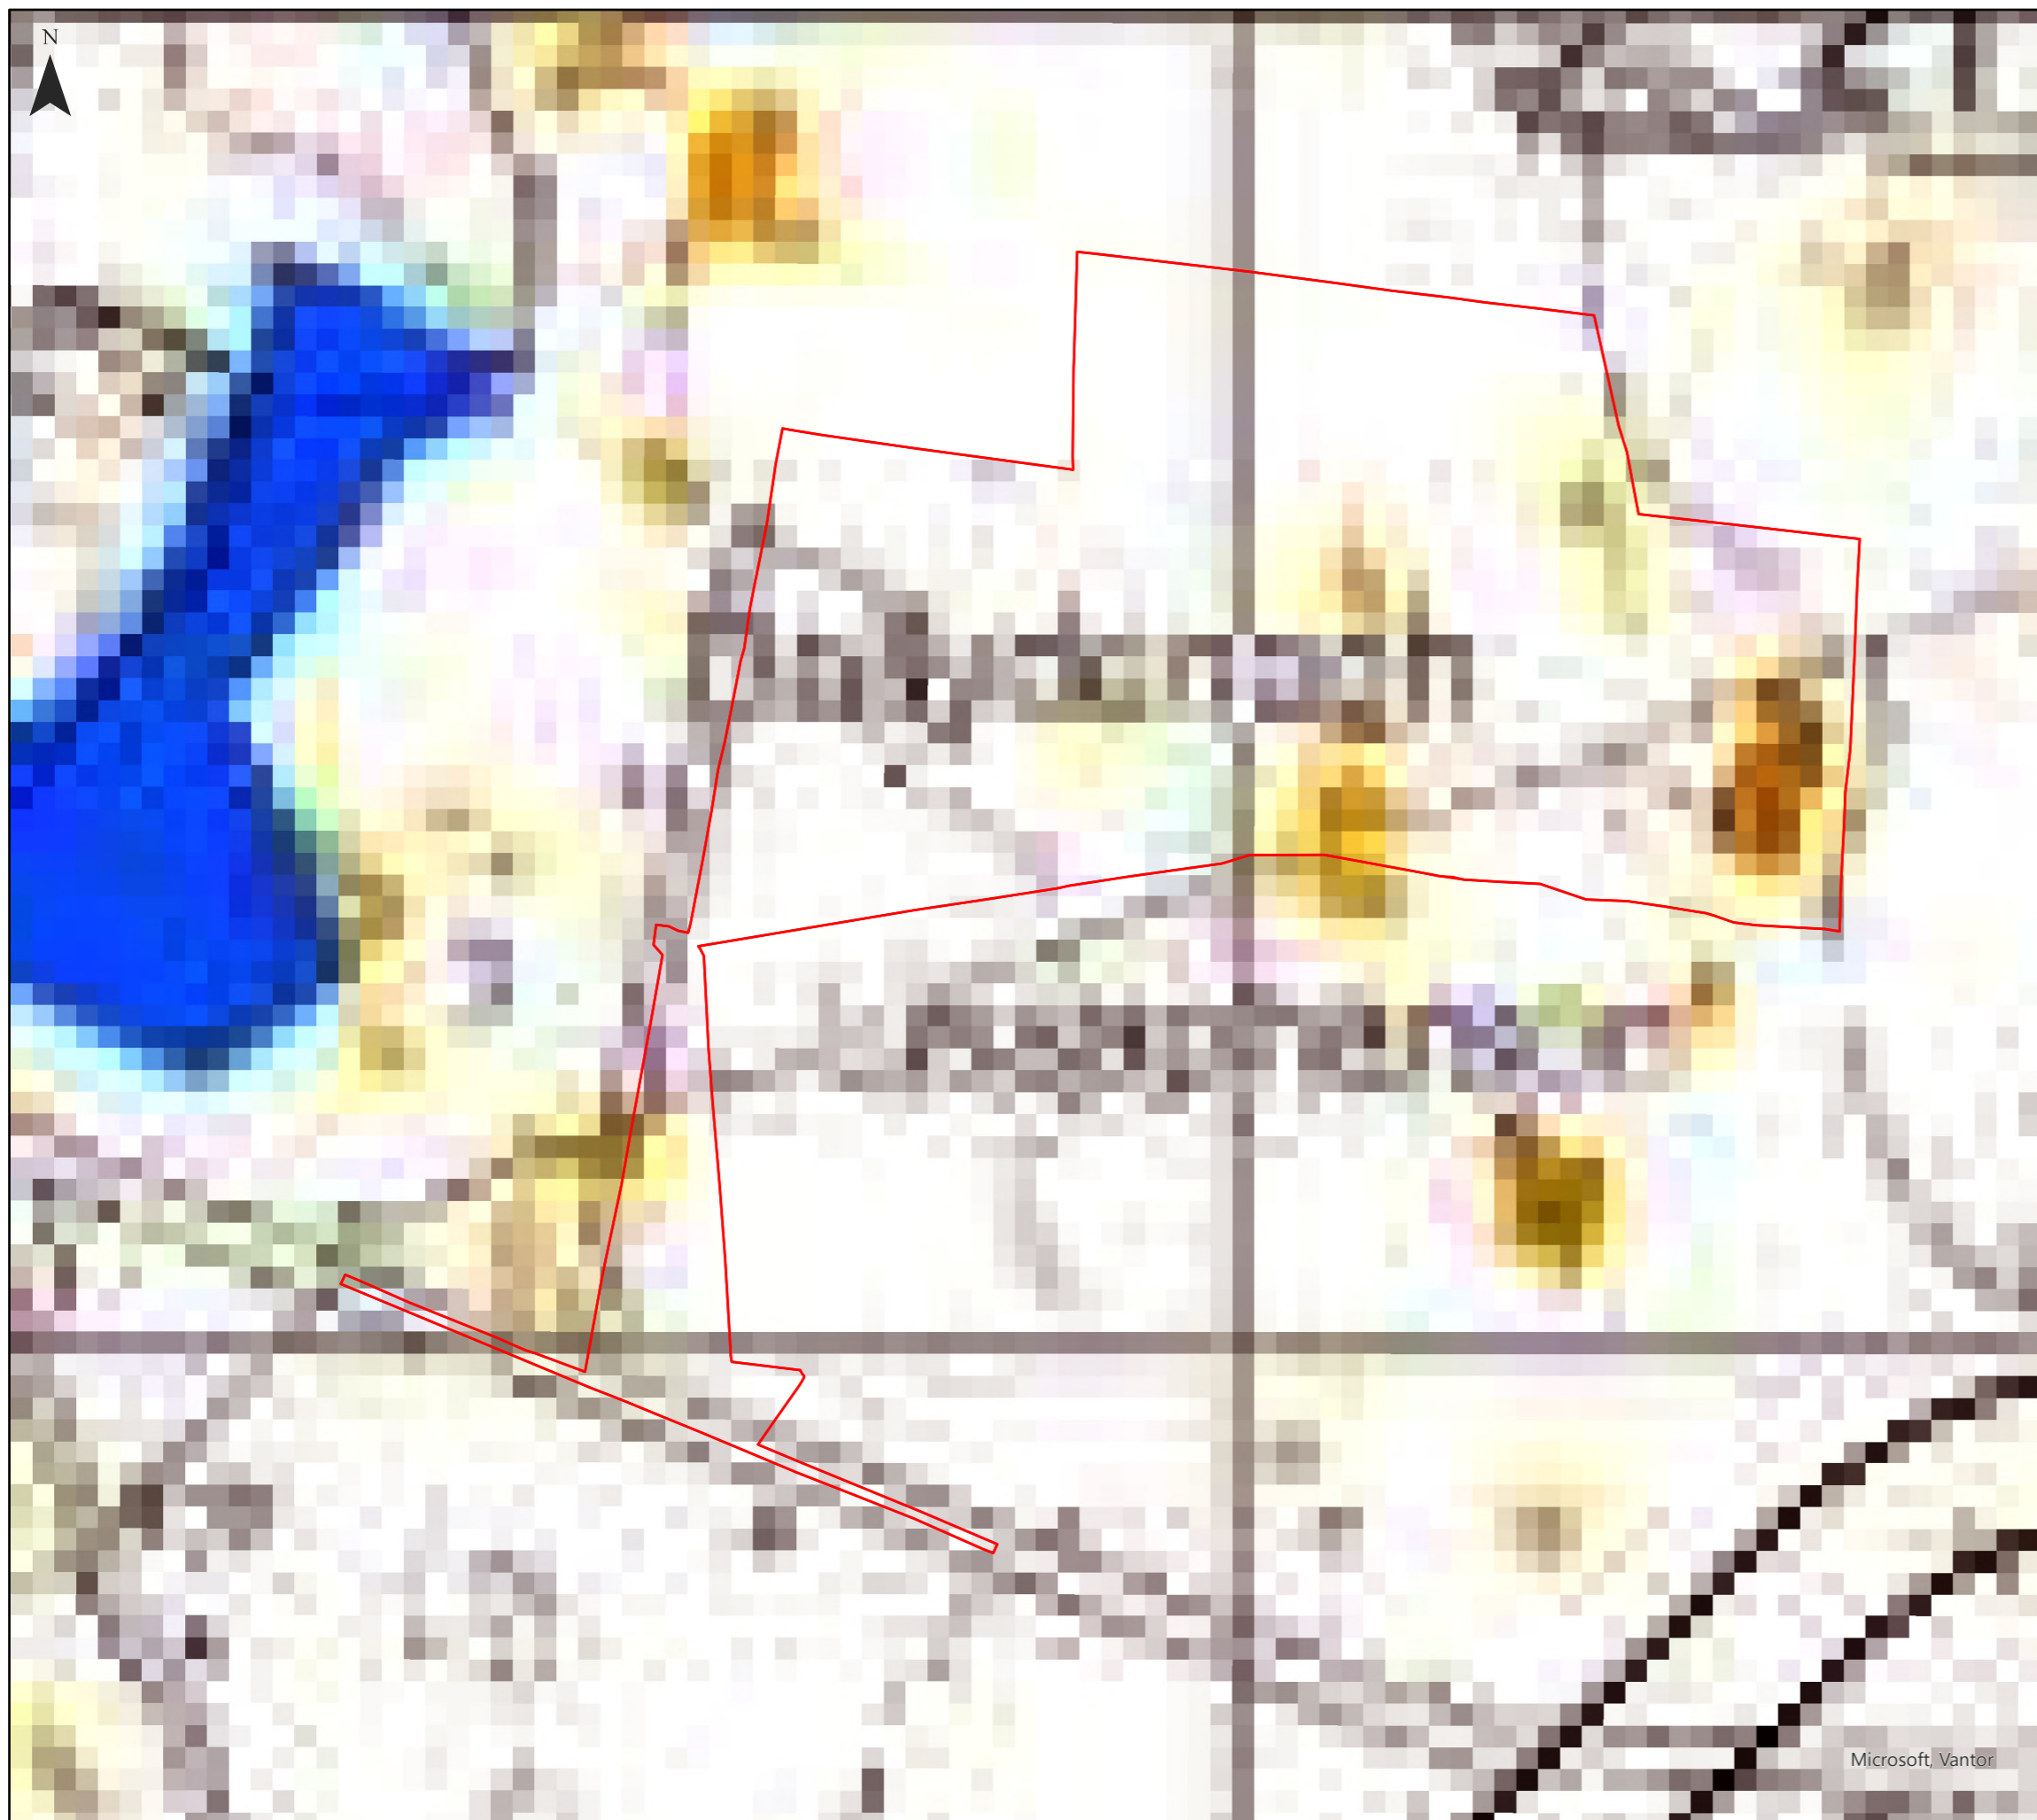

Gortnalug 110kV Substation PFRA Map Figure 4.3





Key

 Development Boundary

Flood Extents

-  Fluvial - Indicative 1% AEP (100-yr) Event
-  Fluvial - Extreme Event
-  Coastal - Indicative 0.5% AEP (200-yr) Event
-  Coastal - Extreme Event
-  Pluvial - Indicative 1% AEP (100-yr) Event
-  Pluvial - Extreme Event
-  Groundwater Flood Extents
-  Lakes / Turloughs

PFRA Outcomes

-  Probable Area for Further Assessment
-  Possible Area for Further Assessment

Neo Office Address:
Johnstown Business Centre, Johnstown House, Naas, Co. Kildare



Microsoft, Vantor

0 0.13 0.25 0.5 Kilometers

Date: 02/02/2026
Drawn By: Tom Saddington
Scale (A3): 1:5,000
Drawing No: NEO01668/0181B

