

PLAN OF JOINT BAY IN WINDFARM SITE
SCALE 1:50


NOTES ON CABLE PULLING AT JOINT BAY

1. CONSTRUCT CABLE TRENCH AND DUCTING THROUGH JOINT BAY LOCATION, WITH MARKER POSTS TO INDICATE LOCATION.
2. BACKFILL CABLE TRENCH AS REQUIRED.
3. WHEN CABLE PULLING IS TO PROCEED, EXCAVATE JOINT BAY TO DIMENSIONS SHOWN OR AS OTHERWISE AGREED WITH THE ELECTRICAL CONTRACTOR.
4. SUPPORT AND CUT DUCTS AS REQUIRED.
5. PULL CABLES THROUGH.
6. REINSTATE DUCTS USING SPLIT DUCT OR SIMILAR.
7. BACKFILL USING MINIMUM 200mm SAND OVER DUCT WITH SUITABLE EXCAVATED MATERIAL ABOVE.

- NOTES:**
- 1 FIGURED DIMENSIONS ONLY TO BE TAKEN FROM THIS DRAWING.
 - 2 ALL DRAWINGS TO BE CHECKED BY THE CONTRACTOR ON SITE.
 - 3 ENGINEER TO BE INFORMED OF ANY DISCREPANCIES BEFORE ANY WORK COMMENCES.
 - 4 THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS AND SPECIFICATIONS.

 Tailte Éireann - Surveying
Includes National Mapping Reproduced
Under Copyright to Tailte Éireann.
Licence Number CYAL 50512615

rev.	date	modifications	D	C	A

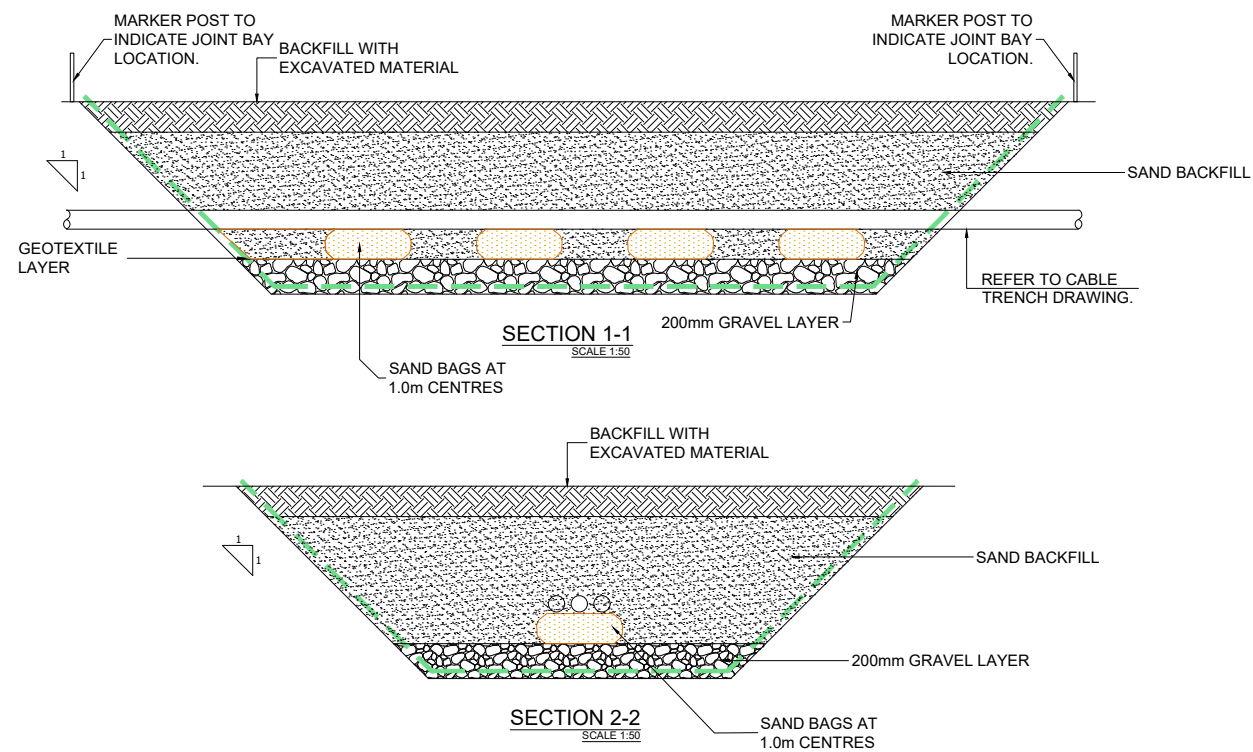

THIS DRAWING IS FOR PLANNING PURPOSES ONLY.

Client Carraig Power LTD.				
Project Carrigeen Renewable Energy Development, Co. Roscommon.				
Stage Planning				
Title Proposed Internal Pulling Bay Details				
Scales 1:50 (A3)				
Surveyed	Prepared	Checked	Approved	Date
.	A.G	J.D	C.G	Mar 2026

 **JENNINGS O'DONOVAN**
an RSK company

© COPYRIGHT OF
JENNINGS O'DONOVAN AND PARTNERS LIMITED
FINISKLIN Tel (+353) 719 161 416
SLIGO Email. info@jodireland.com
IRELAND www.jodireland.com



Job Ref.	Drawing No.	Revision
6575	6575-JOD-CGWF-XX-DR-C-0910	-