


- NOTES**
- FIGURED DIMENSIONS ONLY TO BE TAKEN FROM THIS DRAWING.
 - DRAWING TO BE USED FOR **PLANNING PURPOSES ONLY**.
 - ALL LEVELS REFER TO ORDNANCE DATUM (MALIN HEAD).
 - ENGINEER TO BE INFORMED OF ANY DISCREPANCIES BEFORE ANY WORK COMMENCES.
- Legend**
- Landholding
 - Proposed Site Boundary
 - Proposed 110kV Underground Power Circuit
 - Proposed 110kV Directional Drilled Underground Power Circuit
 - Proposed Joint Bay - Indicative Location
 - Route Chainage (Metres)
 - Proposed 50m Stream Buffer Zone
 - XXm Contour
 - Archeological Sites
 - Stream Crossing Location
 - Watermain Crossing Location
 - ESBN Crossing Location
 - Existing Wayleave Locations
- Existing Services**
- Existing ESBN Overhead Lines
 - Existing ESBN Underground Cables Routes
 - Existing Watermains

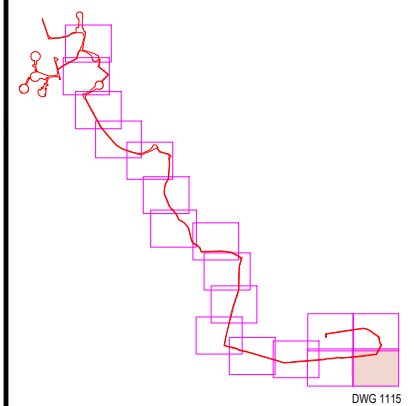

Talite Éireann
 © Talite Éireann - Surveying
 Includes National Mapping Reproduced
 Under Copyright to Talite Éireann.
 Licence Number: CYAL 50445438

rev.	modifications	by	chk	date

Client
Constant Energy Limited

Project
Proposed Tirawley Wind Farm & 110kV Grid Connection Route

Stage
Planning

Title
Grid Connection Route:
Proposed Site Layout Plan
Sheet 15 of 17

Scales
1:2500 @ A3

Surveyed	Drawn	Checked	Approved	Date
	LB	DT/JMG	DK	06/05/2025



© COPYRIGHT OF
 JENNINGS O'DONOVAN AND PARTNERS LIMITED

FINISKLIN Tel (+353) 719 161 416
 SLIGO Email. info@jodireland.com
 IRELAND www.jodireland.com

Drawing No. 6289-PL-GR-1115 Revision

Note No. 1:
 THE LOCATION OF THE JOINT BAYS ARE INDICATIVE AND ARE SUBJECT TO THE APPROVAL OF ESB NETWORKS AND TO ROAD OPENING LICENCE REQUIREMENTS

BALLINTEEAN

For Continuation See Dwg. 6289-PL-GR-1116

For Continuation See Dwg. 6289-PL-GR-1114

Proposed Joint Bay Location
 See Dwg: 6289-PL-GR-1307
 This also will be Launch Pit

Watercourse Crossing (WCC No 7)
 See Dwg: 6289-PL-GR-1208

Watercourse Crossing (WCC No 8)
 See Dwg: 6289-PL-GR-1209

Proposed 110kV Underground
 Grid Connection
 See Dwg: 6289-PL-GR-1303

Proposed Watermain Crossing
 See Dwg: 6289-PL-GR-1313

Proposed Receiver Pit Location

Existing Watermain

Proposed Site Boundary.
 110kV Grid Route

Proposed 50m
 River Buffer Zone

Proposed 50m
 River Buffer Zone

Existing ESBN
 Overhead Lines