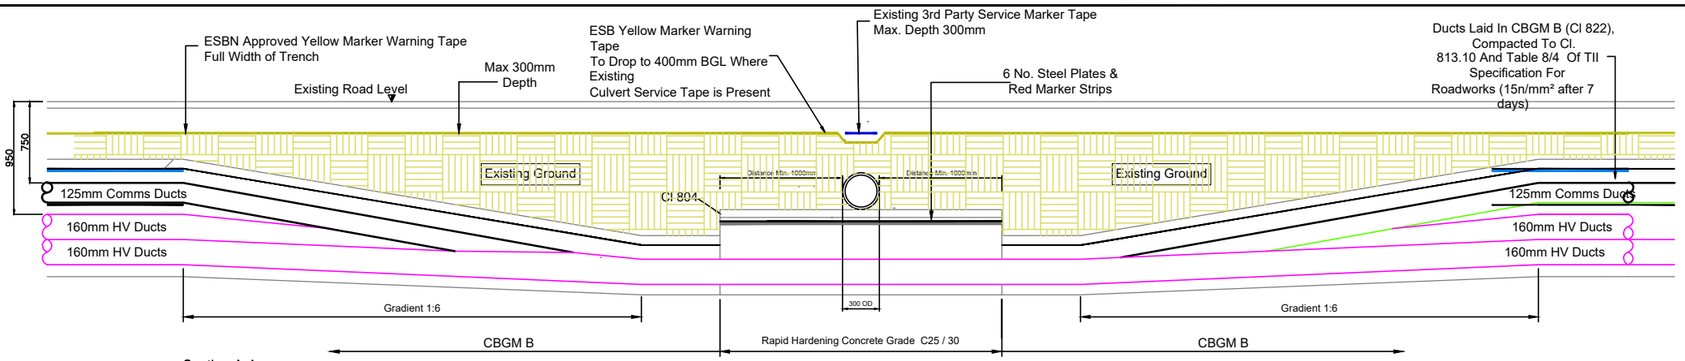

Section A-A
Scale 1:50

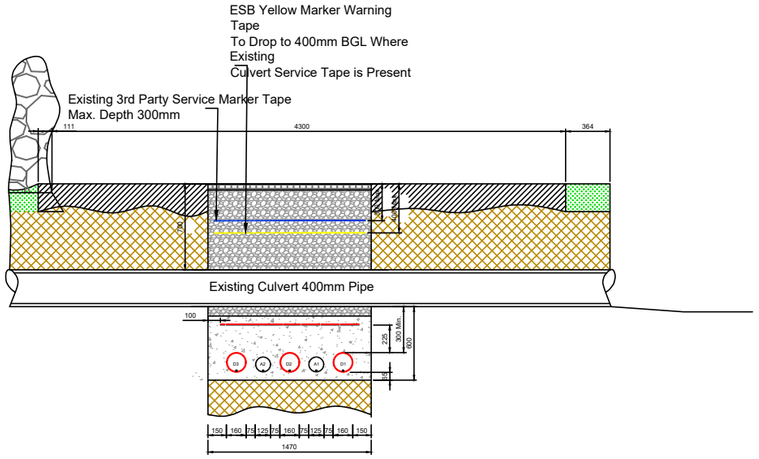

Section B-B
Scale 1:50

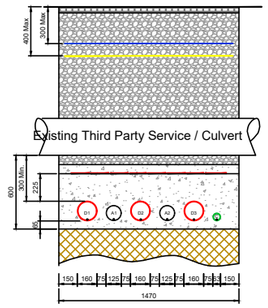

A = 125mm OD HDPE Duct For Communications
B = 160mm OD HDPE Duct for HV Cables
C = 63mm OD HDPE Duct for Earth Continuity When Required

Notes:

1. A surface cable marker (metallic plate; 300mm x150mm to ESB standard) will be placed on the bridge where cable depth is unavoidably shallow.
2. Requirements of Road Engineer will be facilitated at detailed design stage

Image No. 1 (Looking Towards the Wind Farm)
Scale: NTS

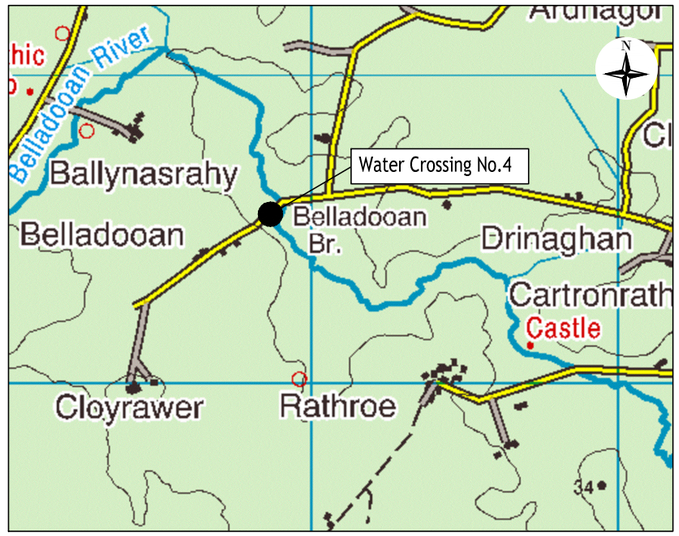

Culvert Crossing Site Location Map
Scale: NTS

rev.	modifications	by	chk	date

Client
Constant Energy Limited

Project
Proposed Tirawley Wind Farm & 110kV Grid Connection Route

Stage
Planning

Title
Grid Connection Route: Watercourse Crossing No. 5 (WCC_05G)

Scales
1:50 & NTS

Surveyed	Drawn	Checked	Approved	Date
	LB	DT/MG	DK	April 2026

JENNINGS O'DONOVAN
an RSK company

© COPYRIGHT OF
JENNINGS O'DONOVAN AND PARTNERS LIMITED
FINISKLIN
SLIGO
IRELAND
Tel (+353) 719 161 416
Email. info@jodireland.com
www.jodireland.com

Drawing No.
6289-PL-GR-1205

Revision