

- Notes:**
- HDD Crossing Design will be Prepared by Specialist Drilling Contractor
 - Final Set Back Distances for the Launch & Receiver Pits confirmed by Site Investigation Contractor
 - Final Duct Cable Depths to be arrangement of the Detailed Design Process

Indicative Horizontal Directional Drilling Borehole with 110kV Ducting

Proposed Directional Drill Bridge Details (Stream Crossing No. 7)
Section A - A
Scale: 1:100


- NOTES**
- FIGURED DIMENSIONS ONLY TO BE TAKEN FROM THIS DRAWING.
 - DRAWING TO BE USED FOR PLANNING PURPOSES ONLY.
 - ALL LEVELS REFER TO ORDNANCE DATUM (MALIN HEAD).
 - ENGINEER TO BE INFORMED OF ANY DISCREPANCIES BEFORE ANY WORK COMMENCES.

LEGEND


█ PLANNING APPLICATION BOUNDARY

Taithe Éireann - Surveying
Includes National Mapping Reproduced Under Copyright to Taithe Éireann. Licence Number CYAL 50382164

rev.	modifications	by	chk	date

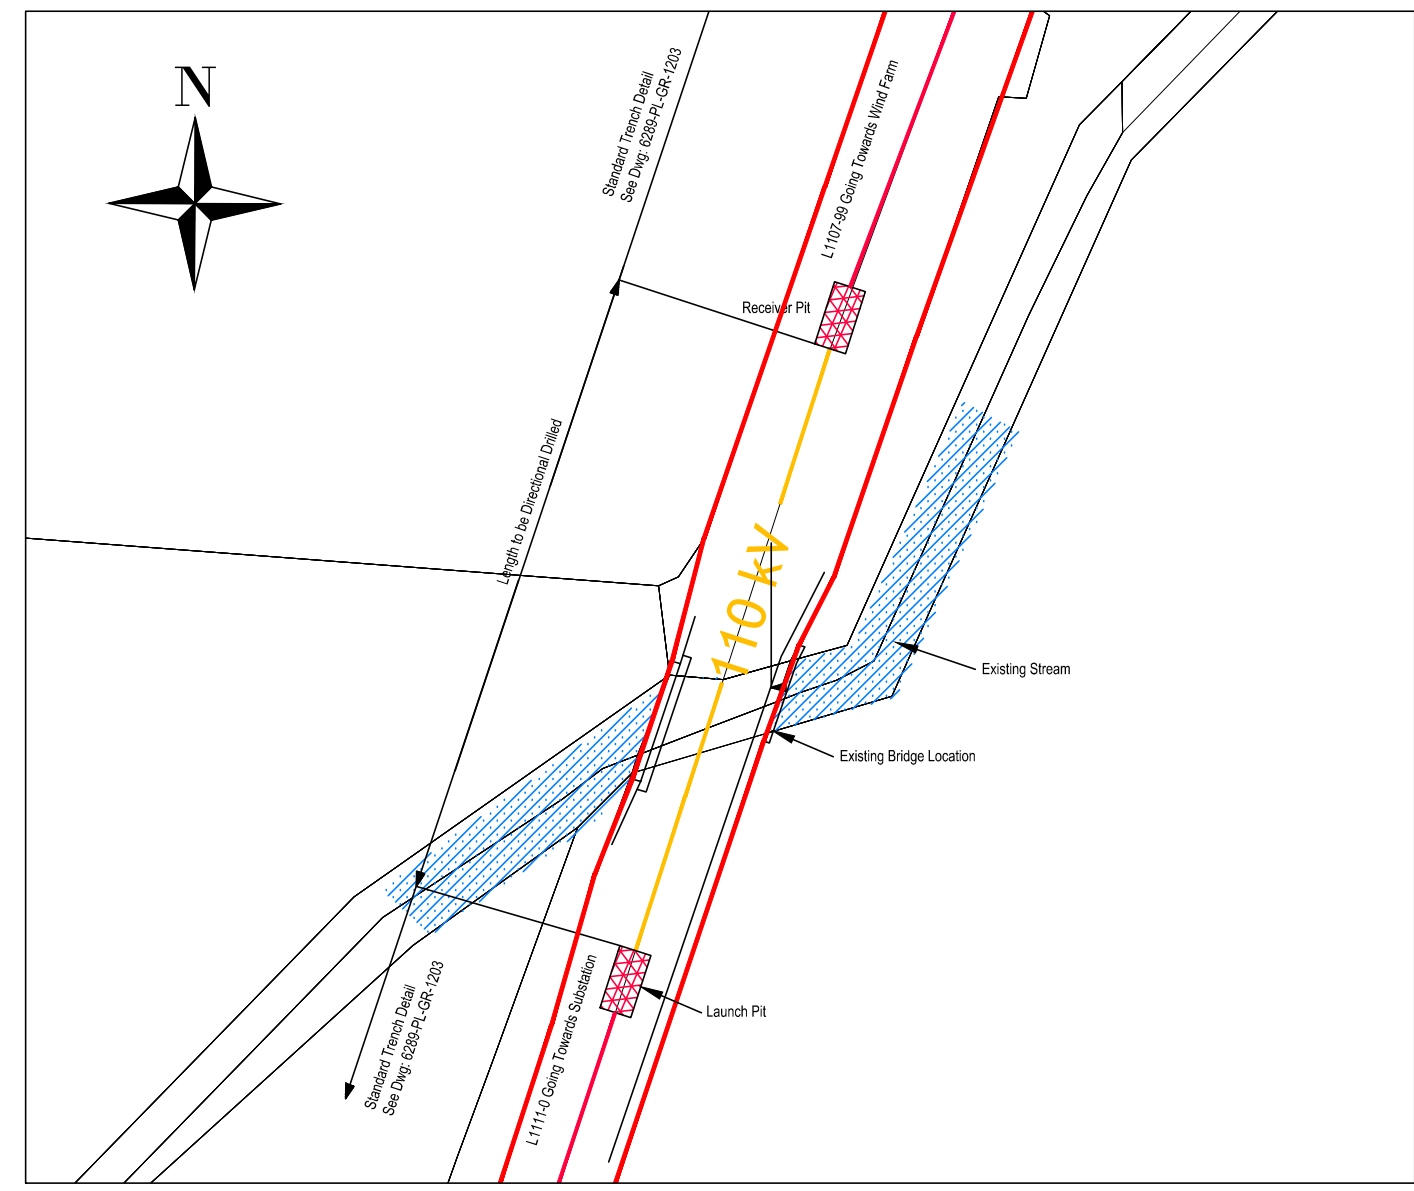

HDD Layout for Stream Crossing No. 5
Scale: 1:500

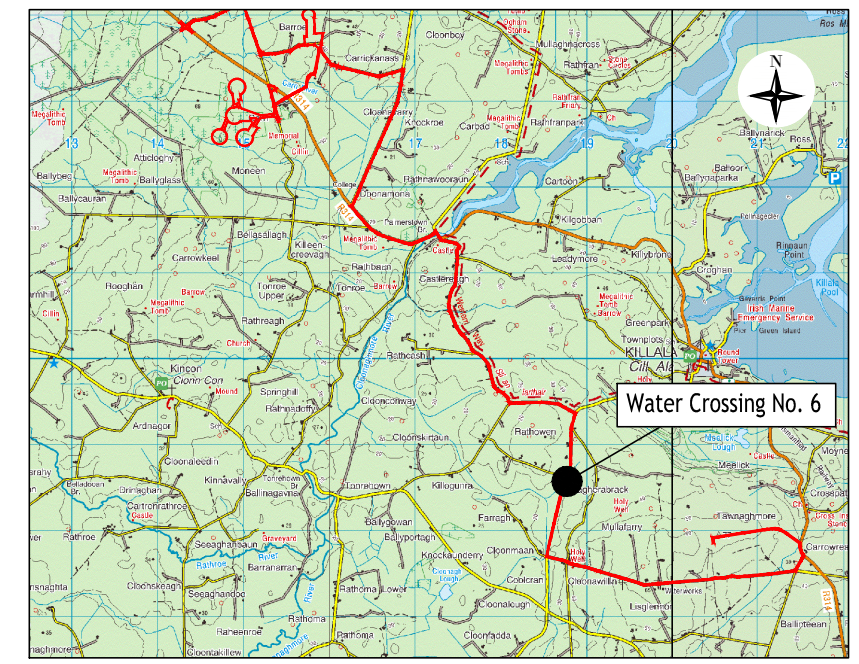

Stream Crossing Site Location Map.
Scale: NTS



Image No. 5
Scale: NTS

Client	Constant Energy Limited			
Project	Proposed Tirawley Wind Farm & 110kV Grid Connection Route			
Stage	Planning			
Title	Grid Connection Route: Watercourse Crossing No. 6 (WCC_06G)			

Scales
1:50, 1:250 & NTS

Surveyed	Drawn	Checked	Approved	Date
	LB	DT/MG	DK	April 2026



© COPYRIGHT OF
JENNINGS O'DONOVAN AND PARTNERS LIMITED
FINISKLIN Tel (+353) 719 161 416
SLIGO Email: info@jodireland.com
IRELAND www.jodireland.com



Drawing No. 6289 - PL - GR - 1206_2	Revision
--	----------