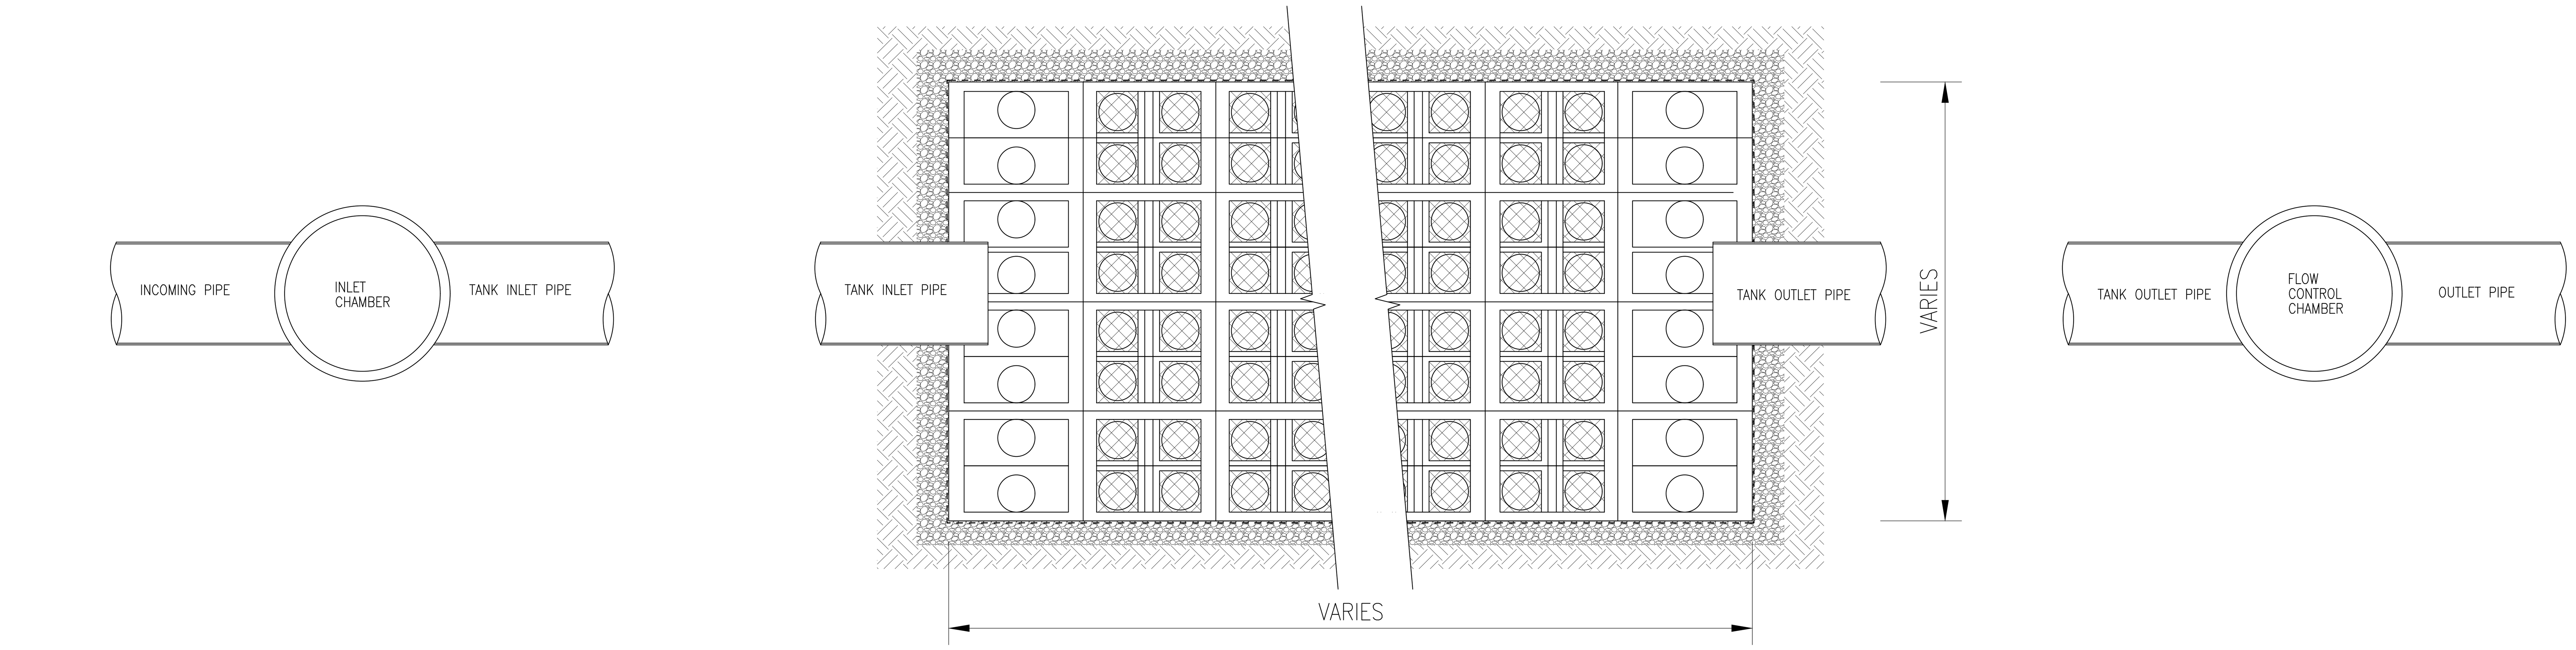

Plan

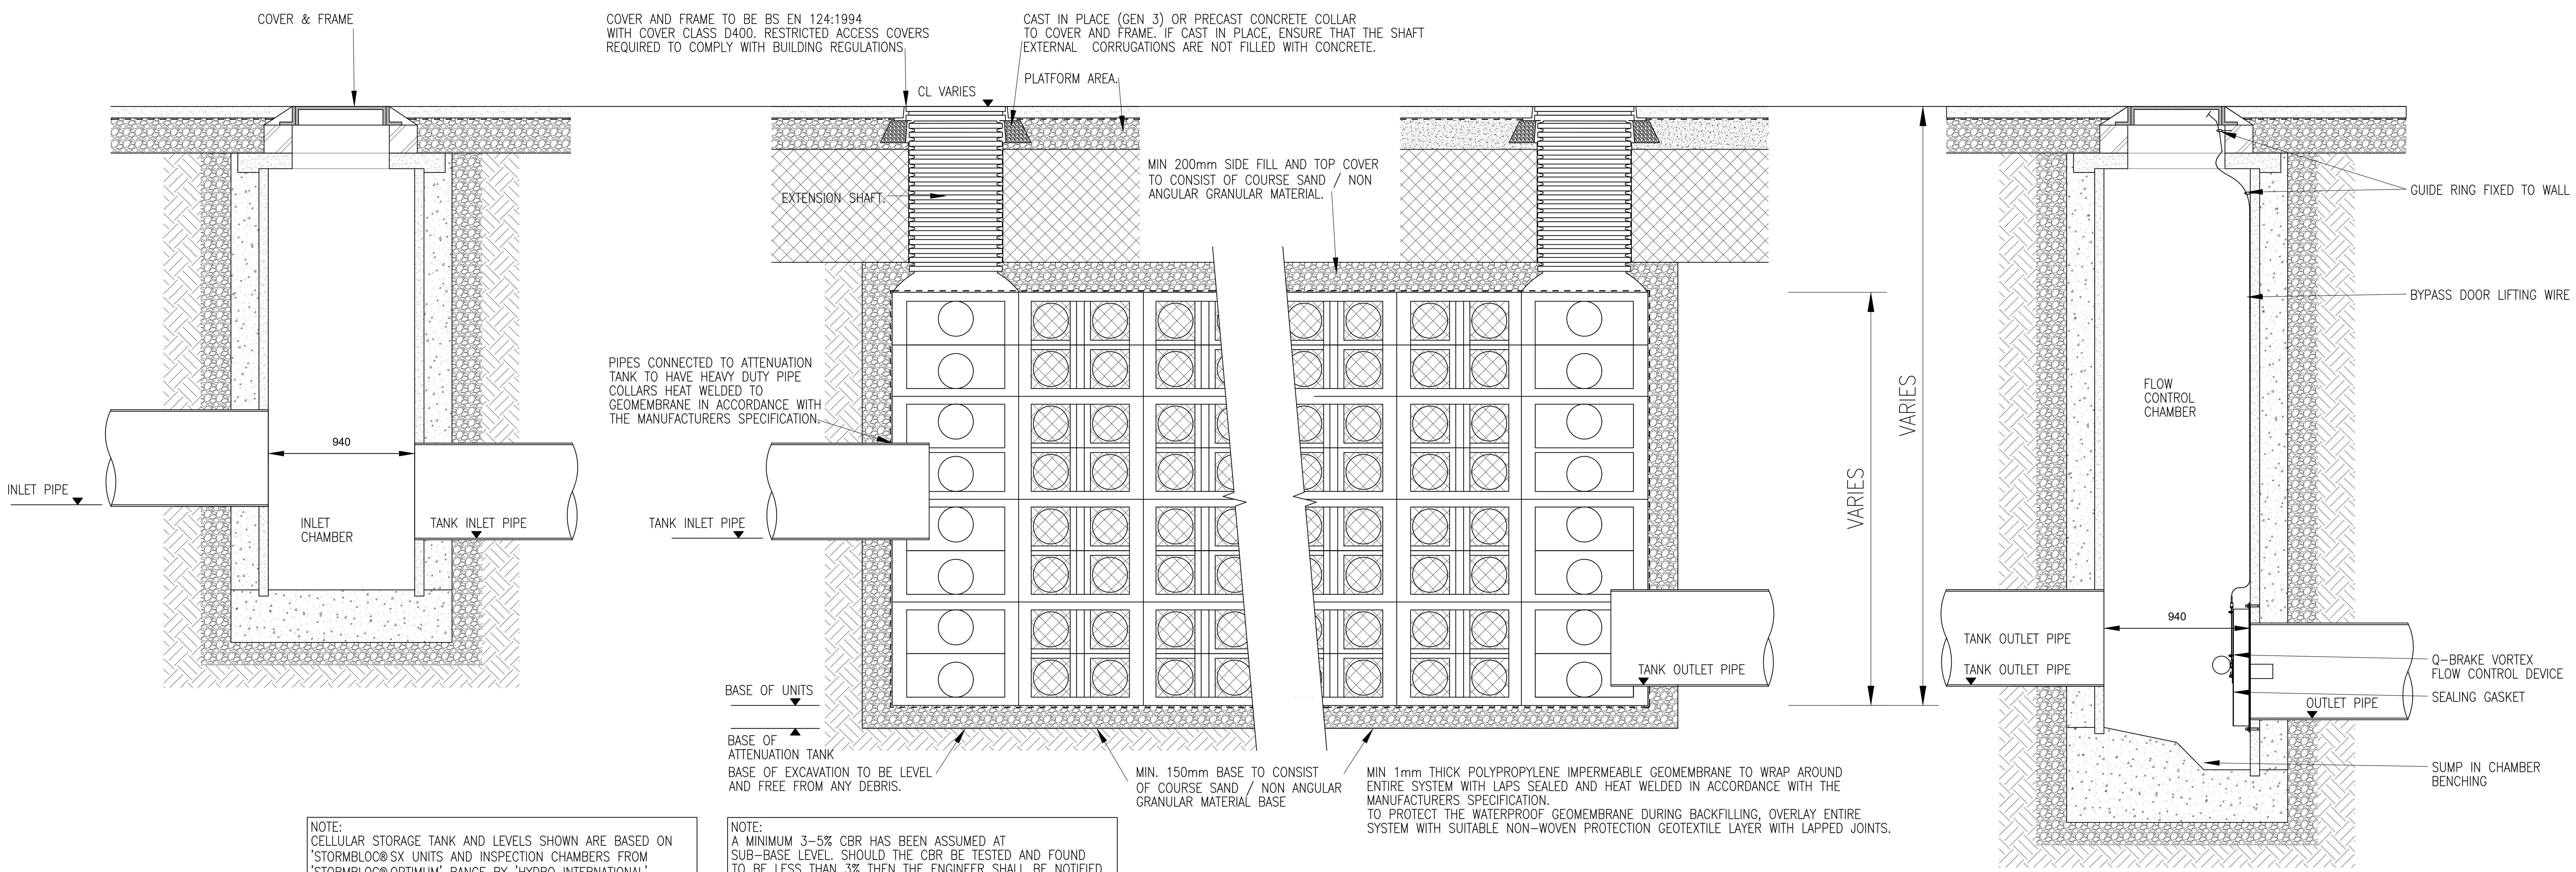

NOTE:
CELLULAR STORAGE TANK AND LEVELS SHOWN ARE BASED ON "STORMBLOC® SX UNITS AND INSPECTION CHAMBERS FROM "STORMBLOC® OPTIMUM" RANGE BY "HYDRO INTERNATIONAL". ALTERNATIVE TANK SUPPLIERS MAY BE USED AS LONG AS THEY ARE OF NO LESSER PERFORMANCE AND STRENGTH. ENGINEER TO APPROVE AN ALTERNATIVE PRODUCT PRIOR TO ORDERING.

NOTE:
A MINIMUM 3-5% CBR HAS BEEN ASSUMED AT SUB-BASE LEVEL. SHOULD THE CBR BE TESTED AND FOUND TO BE LESS THAN 3% THEN THE ENGINEER SHALL BE NOTIFIED. ANY SOFT SPOTS ARE TO BE DUG OUT AND BACKFILLED WITH TYPE 1 GRANULAR FILL COMPACTED IN LAYERS.

Elevation

TYPICAL FIRE WATER STORAGE TANK DETAIL
Scale 1:25

JENNINGS O'DONOVAN an RSK company

© COPYRIGHT OF
JENNINGS O'DONOVAN AND PARTNERS LIMITED

FINISKLIN Tel (+353) 719 161 416
SLIGO Email. info@jodireland.com
IRELAND www.jodireland.com

@JOD_Sligo Jennings O'Donovan & Partners Jennings O'Donovan

NOTES:
1 FIGURED DIMENSIONS ONLY TO BE TAKEN FROM THIS DRAWING.
2 ALL DRAWINGS TO BE CHECKED BY THE CONTRACTOR ON SITE.
3 ENGINEER TO BE INFORMED OF ANY DISCREPANCIES BEFORE ANY WORK COMMENCES.
4 THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS AND SPECIFICATIONS.

THIS DRAWING IS NOT TO BE USED AS A CONSTRUCTION DRAWING.

Rev.	Date	Amendments	D	C	A

Client
CONSTANT ENERGY LTD

Project
TIRAWLEY WIND FARM
CO.MAYO

Title
BESS-
DRAINAGE DETAILS
SHEET 2

Issue Details			
Designed: JOD	Information		
Drawn: JB	Approval	X	
Checked: DT/MG	Tender		
Approved: DK	Construction		
Scale: As shown (A1)	Record		

Office Use Only
Drawing Number: 6289-PL-2008
Date: APRIL 2026
Rev.