

- NOTES:
- 1 FIGURED DIMENSIONS ONLY TO BE TAKEN FROM THIS DRAWING.
 - 2 ALL DRAWINGS TO BE CHECKED BY THE CONTRACTOR ON SITE.
 - 3 ENGINEER TO BE INFORMED OF ANY DISCREPANCIES BEFORE ANY WORK COMMENCES.
 - 4 THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS AND SPECIFICATIONS.

THIS DRAWING IS NOT TO BE USED AS A CONSTRUCTION DRAWING.

KEY

- EXISTING GROUND LEVELS E.G.L. 00.00
- PROPOSED GROUND LEVELS F.L. 00.00
- PROPOSED FINISHED FLOOR LEVELS F.F.L. 00.00


rev	date	modifications	D	C	A

Client	CONSTANT ENERGY LTD				
Project	TIRAWLEY WIND FARM CO.MAYO				
Stage	PLANNING				
Title	PROPOSED ELECTRICAL COMPOUND-SUBSTATION LAYOUT PLAN - 110kV				
Scales	1:200 @ A1				
Surveyed	Drawn	Checked	Approved	Date	
JOD	JB	MG / DT	DK	APRIL 2026	



© COPYRIGHT OF
JENNINGS O'DONOVAN AND PARTNERS LIMITED
FINISKLIN Tel (+353) 719 161 416
SLIGO Email. info@jodireland.com
IRELAND www.jodireland.com

Job Ref.	Drawing No.	Revision
6289	PL-800	0

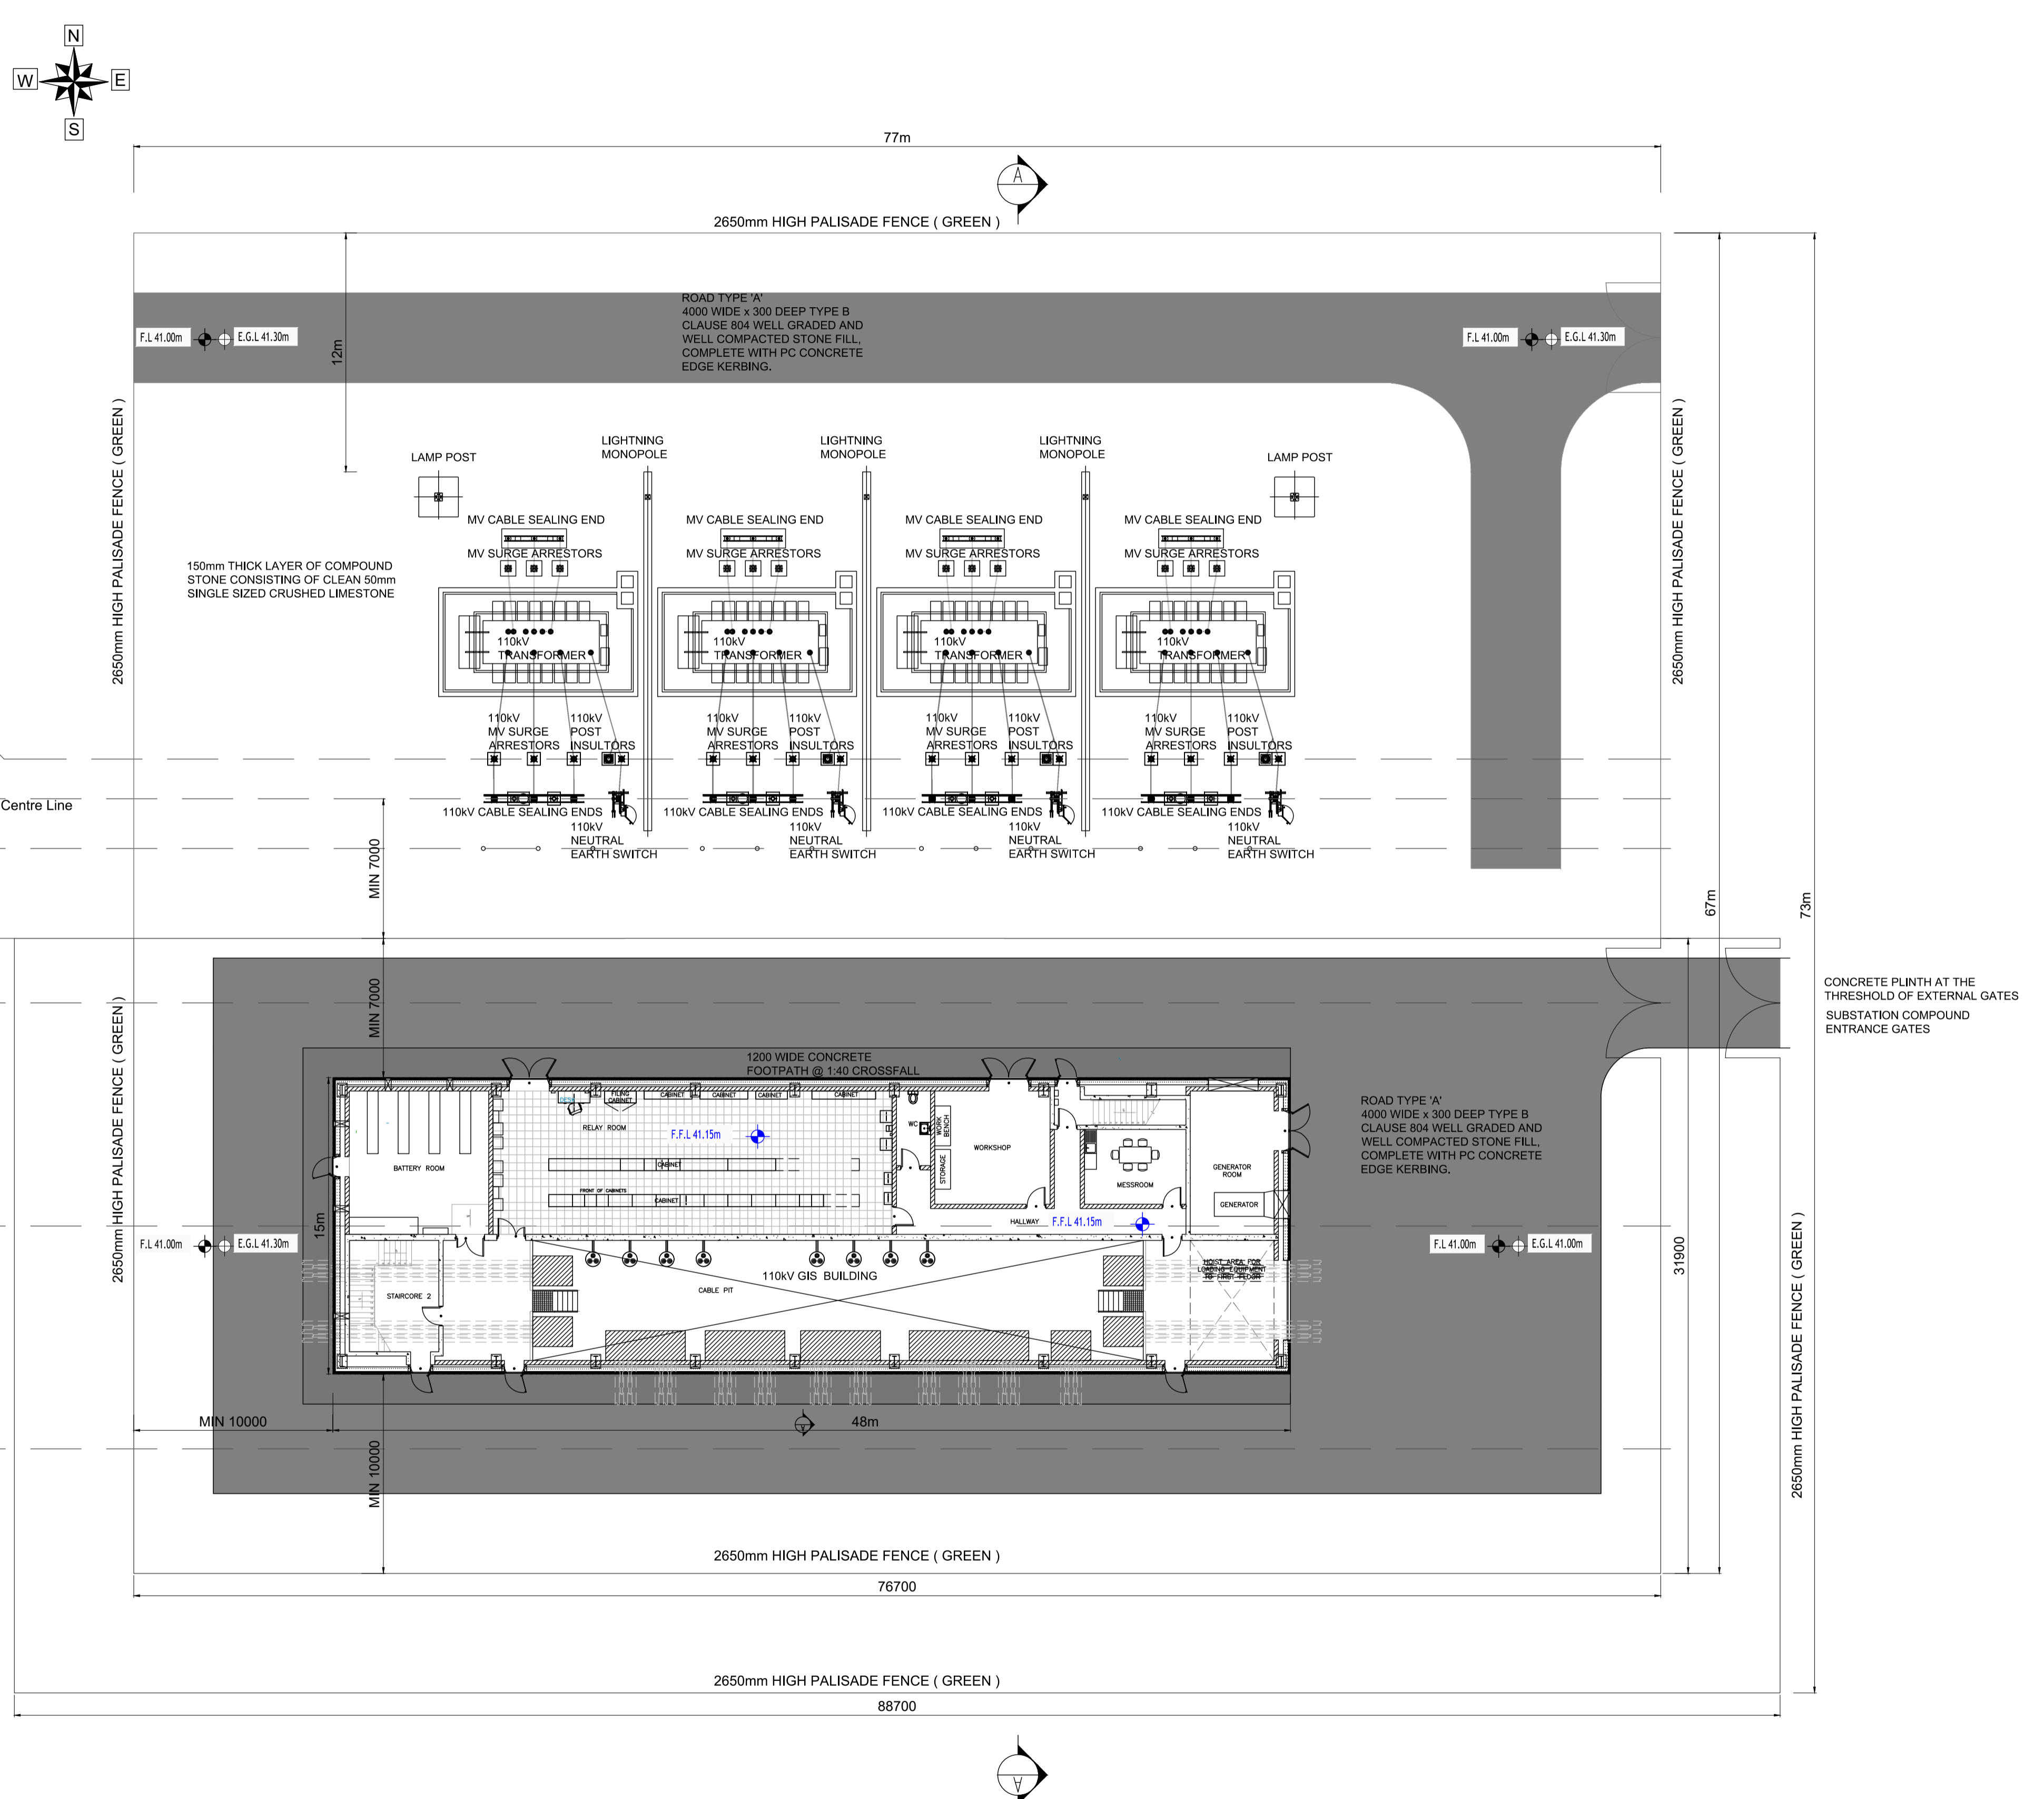

- 110kV SURGE ARRESTORS
- 110kV POST INSULATORS
- 110kV CABLE SEALING END
- 110kV NEUTRAL EARTH SWITCH
- CRASH BARRIERS
- CUSTOMER FENCE
- CUSTOMER ROAD
- 110kV GIS BUILDING
- COMPOUND ROAD

CONCRETE PLINTH AT THE THRESHOLD OF EXTERNAL GATES
SUBSTATION COMPOUND ENTRANCE GATES