


Legend

- NOTES:
- 1 FIGURED DIMENSIONS ONLY TO BE TAKEN FROM THIS DRAWING.
 - 2 ALL DRAWINGS TO BE CHECKED BY THE CONTRACTOR ON SITE.
 - 3 ENGINEER TO BE INFORMED OF ANY DISCREPANCIES BEFORE ANY WORK COMMENCES.
 - 4 THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS AND SPECIFICATIONS.

THIS DRAWING IS NOT TO BE USED AS A CONSTRUCTION DRAWING.

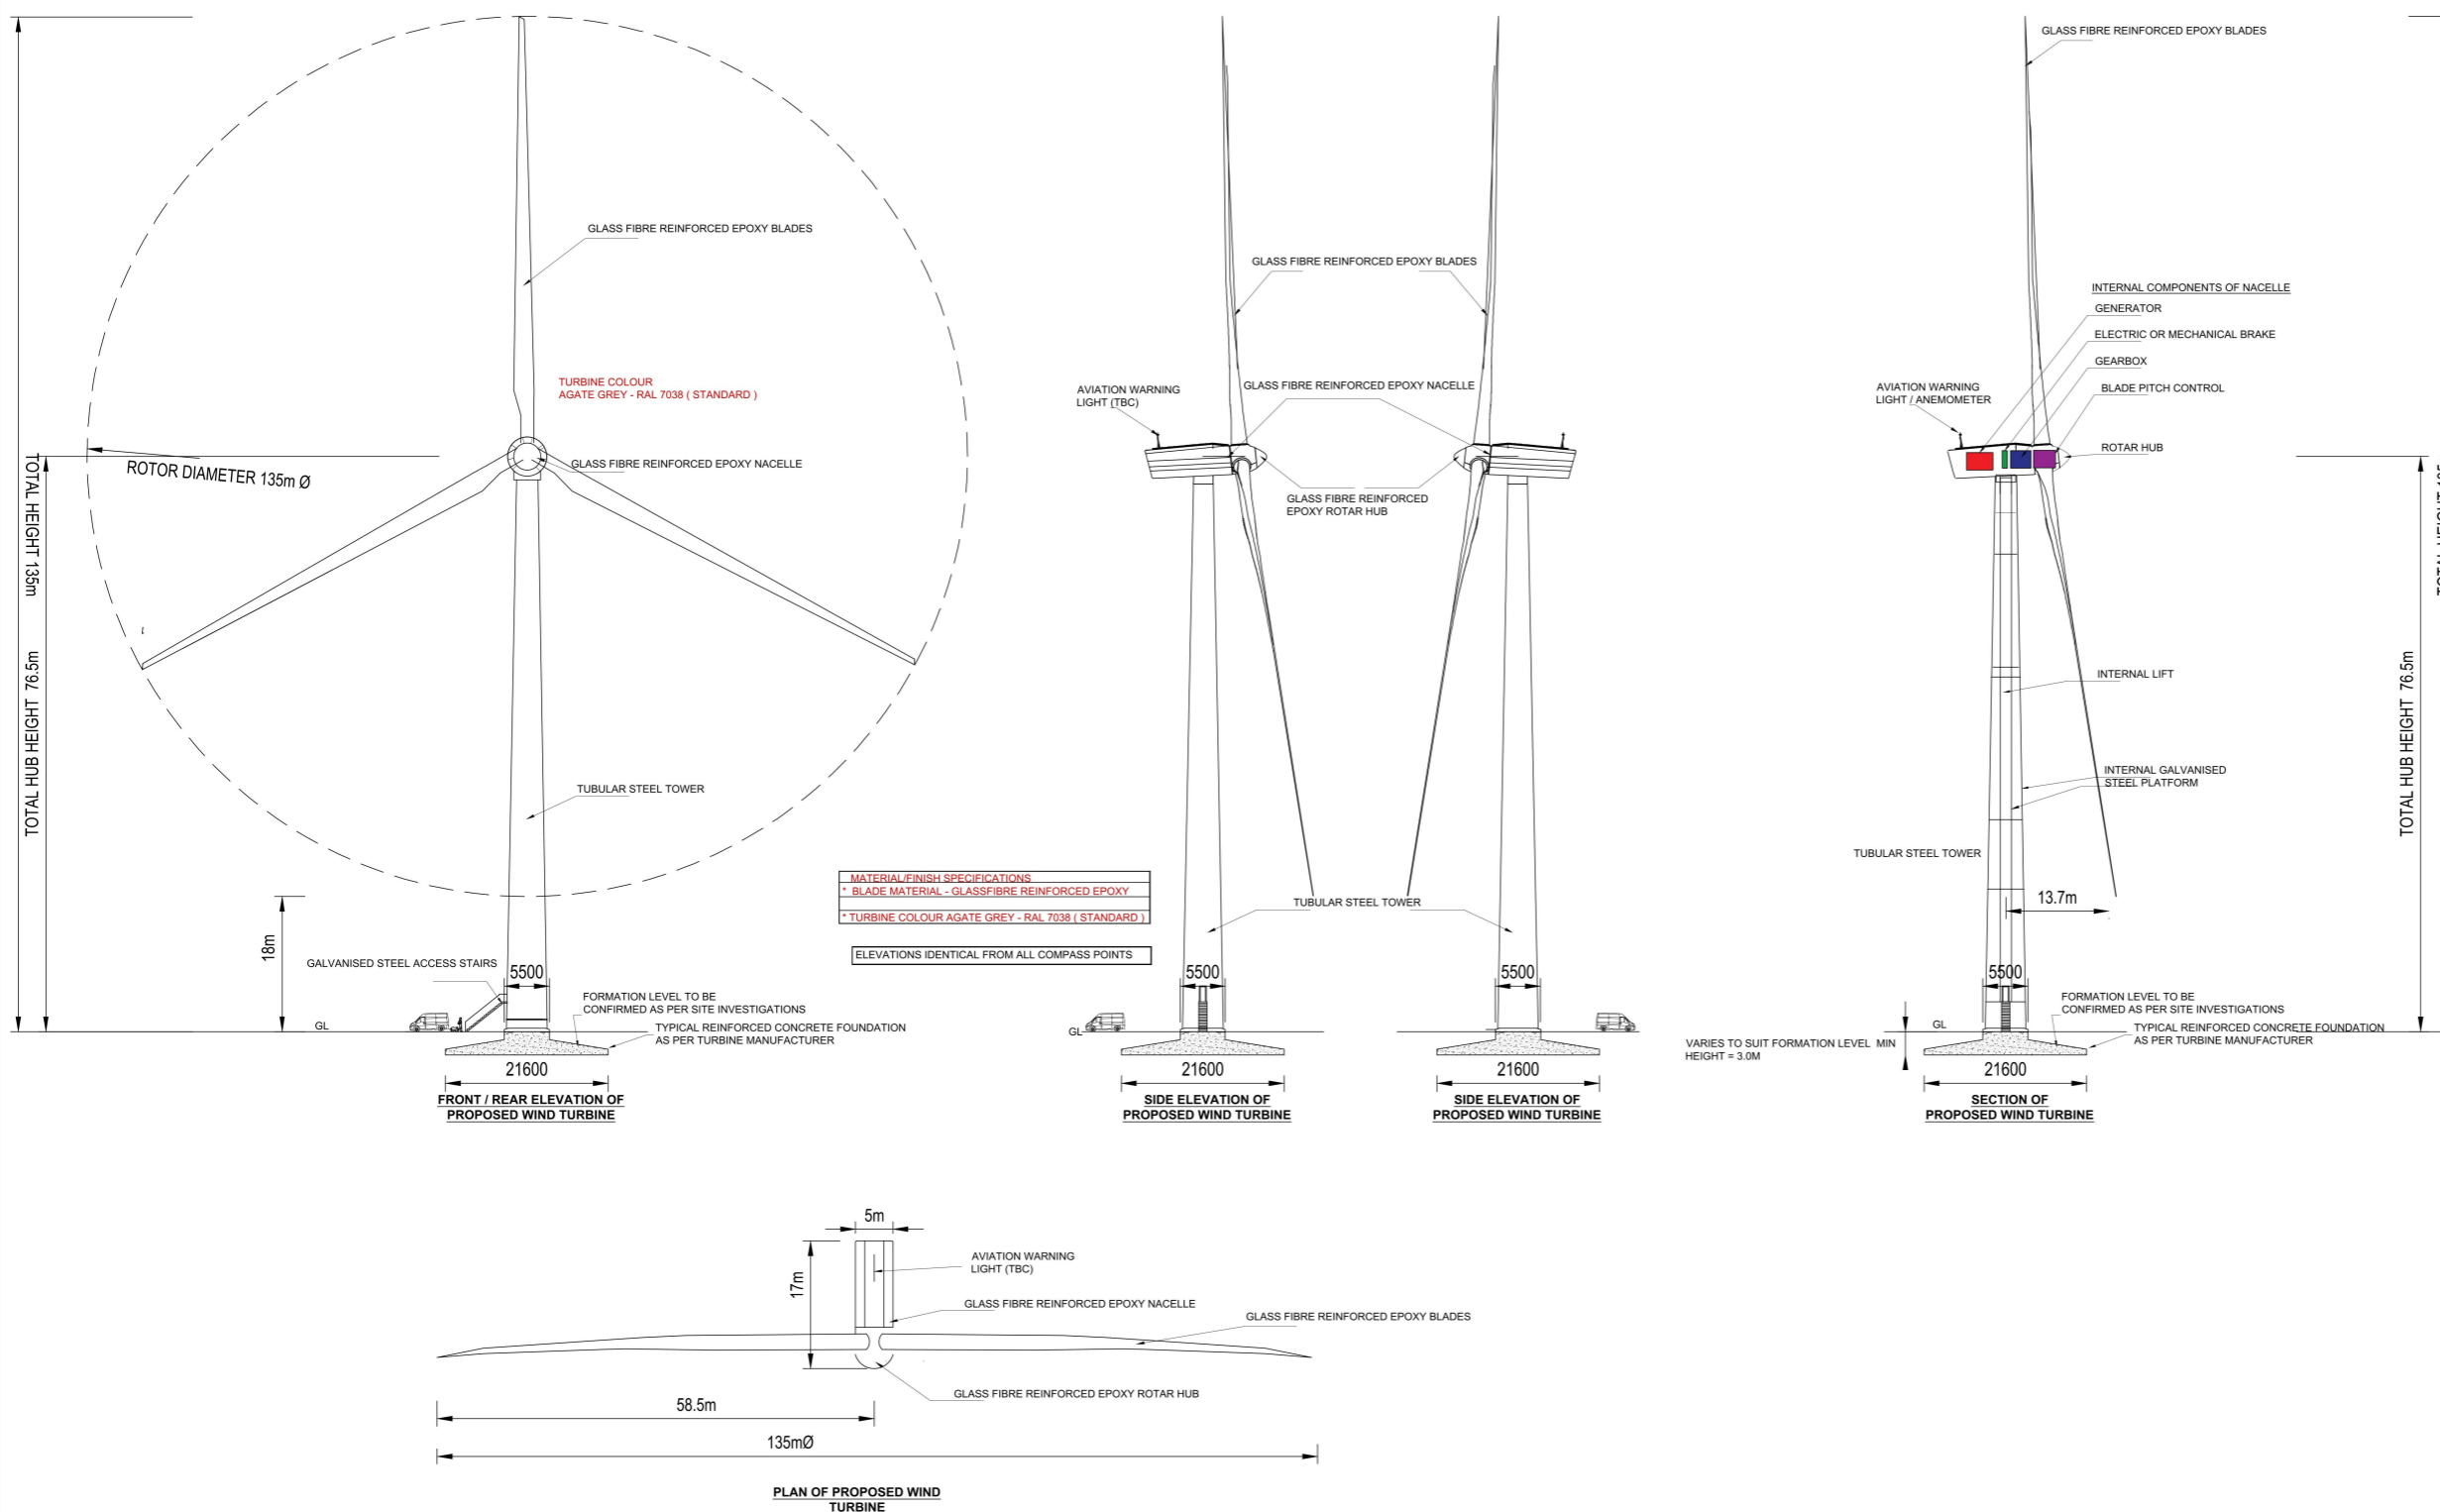

THIS DRAWING SHOWS A TYPICAL TURBINE THAT MAY BE USED FOR THIS DEVELOPMENT, HOWEVER, THE EXACT MAKE AND MODEL OF THE TURBINE WILL BE DICTATED BY THE ENERGY PRODUCTION EFFICIENCIES OF VARIOUS TURBINES ON THE MARKET AT THE PROCUREMENT STAGE, BUT WILL NOT EXCEED THE MAXIMUM SIZE ENVELOPE AS SET OUT WITHIN THE DEVELOPMENT DESCRIPTION (IE A MAXIMUM TIP HEIGHT OF 135m)

Client
CONSTANT ENERGY LIMITED.

Project
TIRAWLEY WIND FARM,
CO. MAYO

Title
VESTAS V117 (4.3 MW)
IEC IIA SCHEMATIC



© COPYRIGHT OF
JENNINGS O'DONOVAN AND PARTNERS LIMITED
FINISKLIN Tel (+353) 719 161 416
SLIGO Email. info@jodireland.com
IRELAND www.jodireland.com

@JOD_Sligo LinkedIn Jennings O'Donovan & Partners Facebook Jennings O'Donovan

Date	21/04/2026	Revision	1	Job No.	6289
Scale	NOT TO SCALE	Stage	Planning	Figure	2.23
Drawing	DT	Checked	MG	Approved	MG