




ALL REINSTATEMENT WORKS ARE TO BE IN ACCORDANCE WITH LOCAL AREA ENGINEERS REQUIREMENTS AND GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS

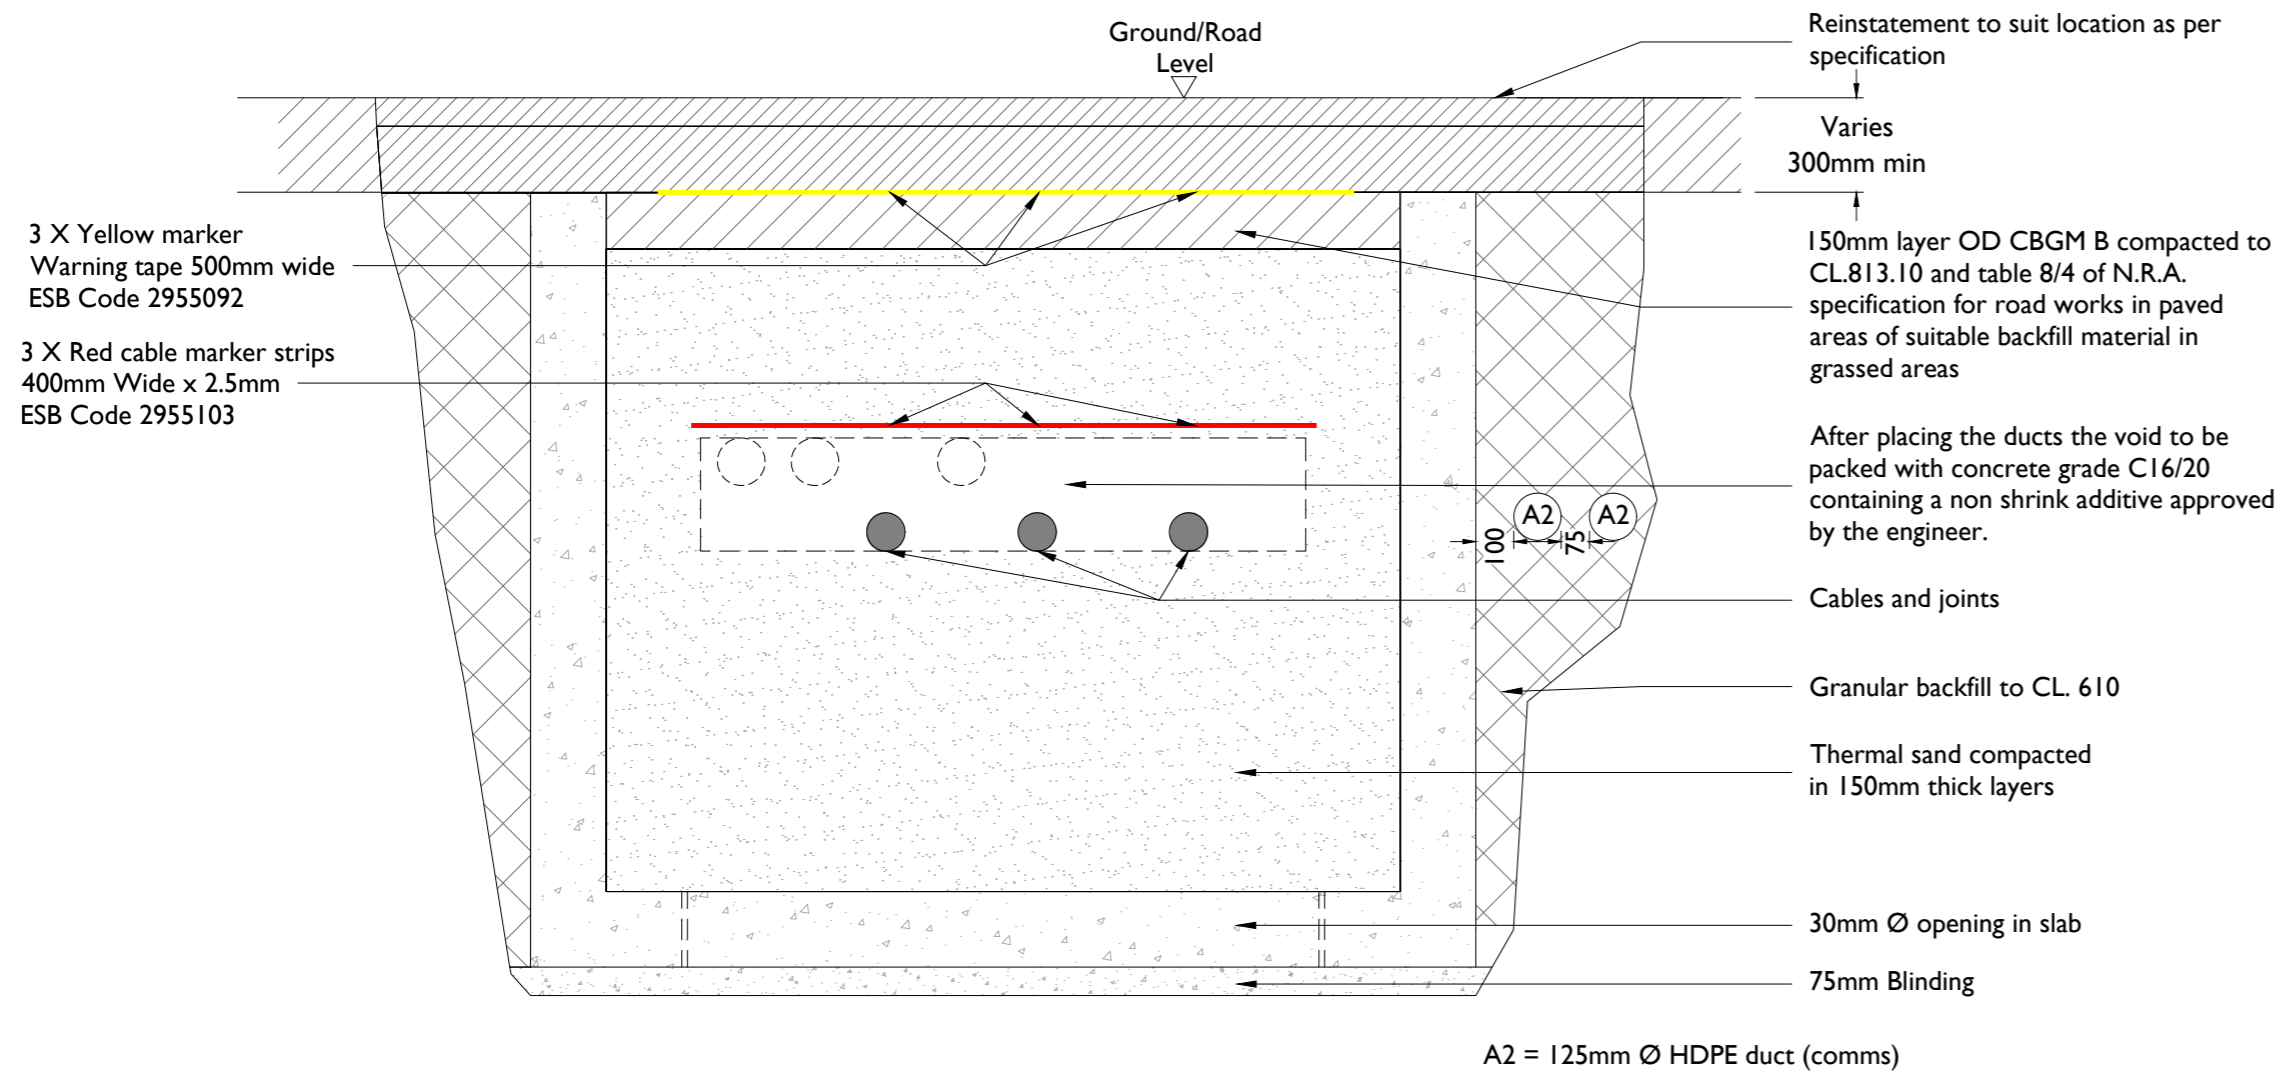

Section A-A Permanent Reinstatement
Scale 1:20

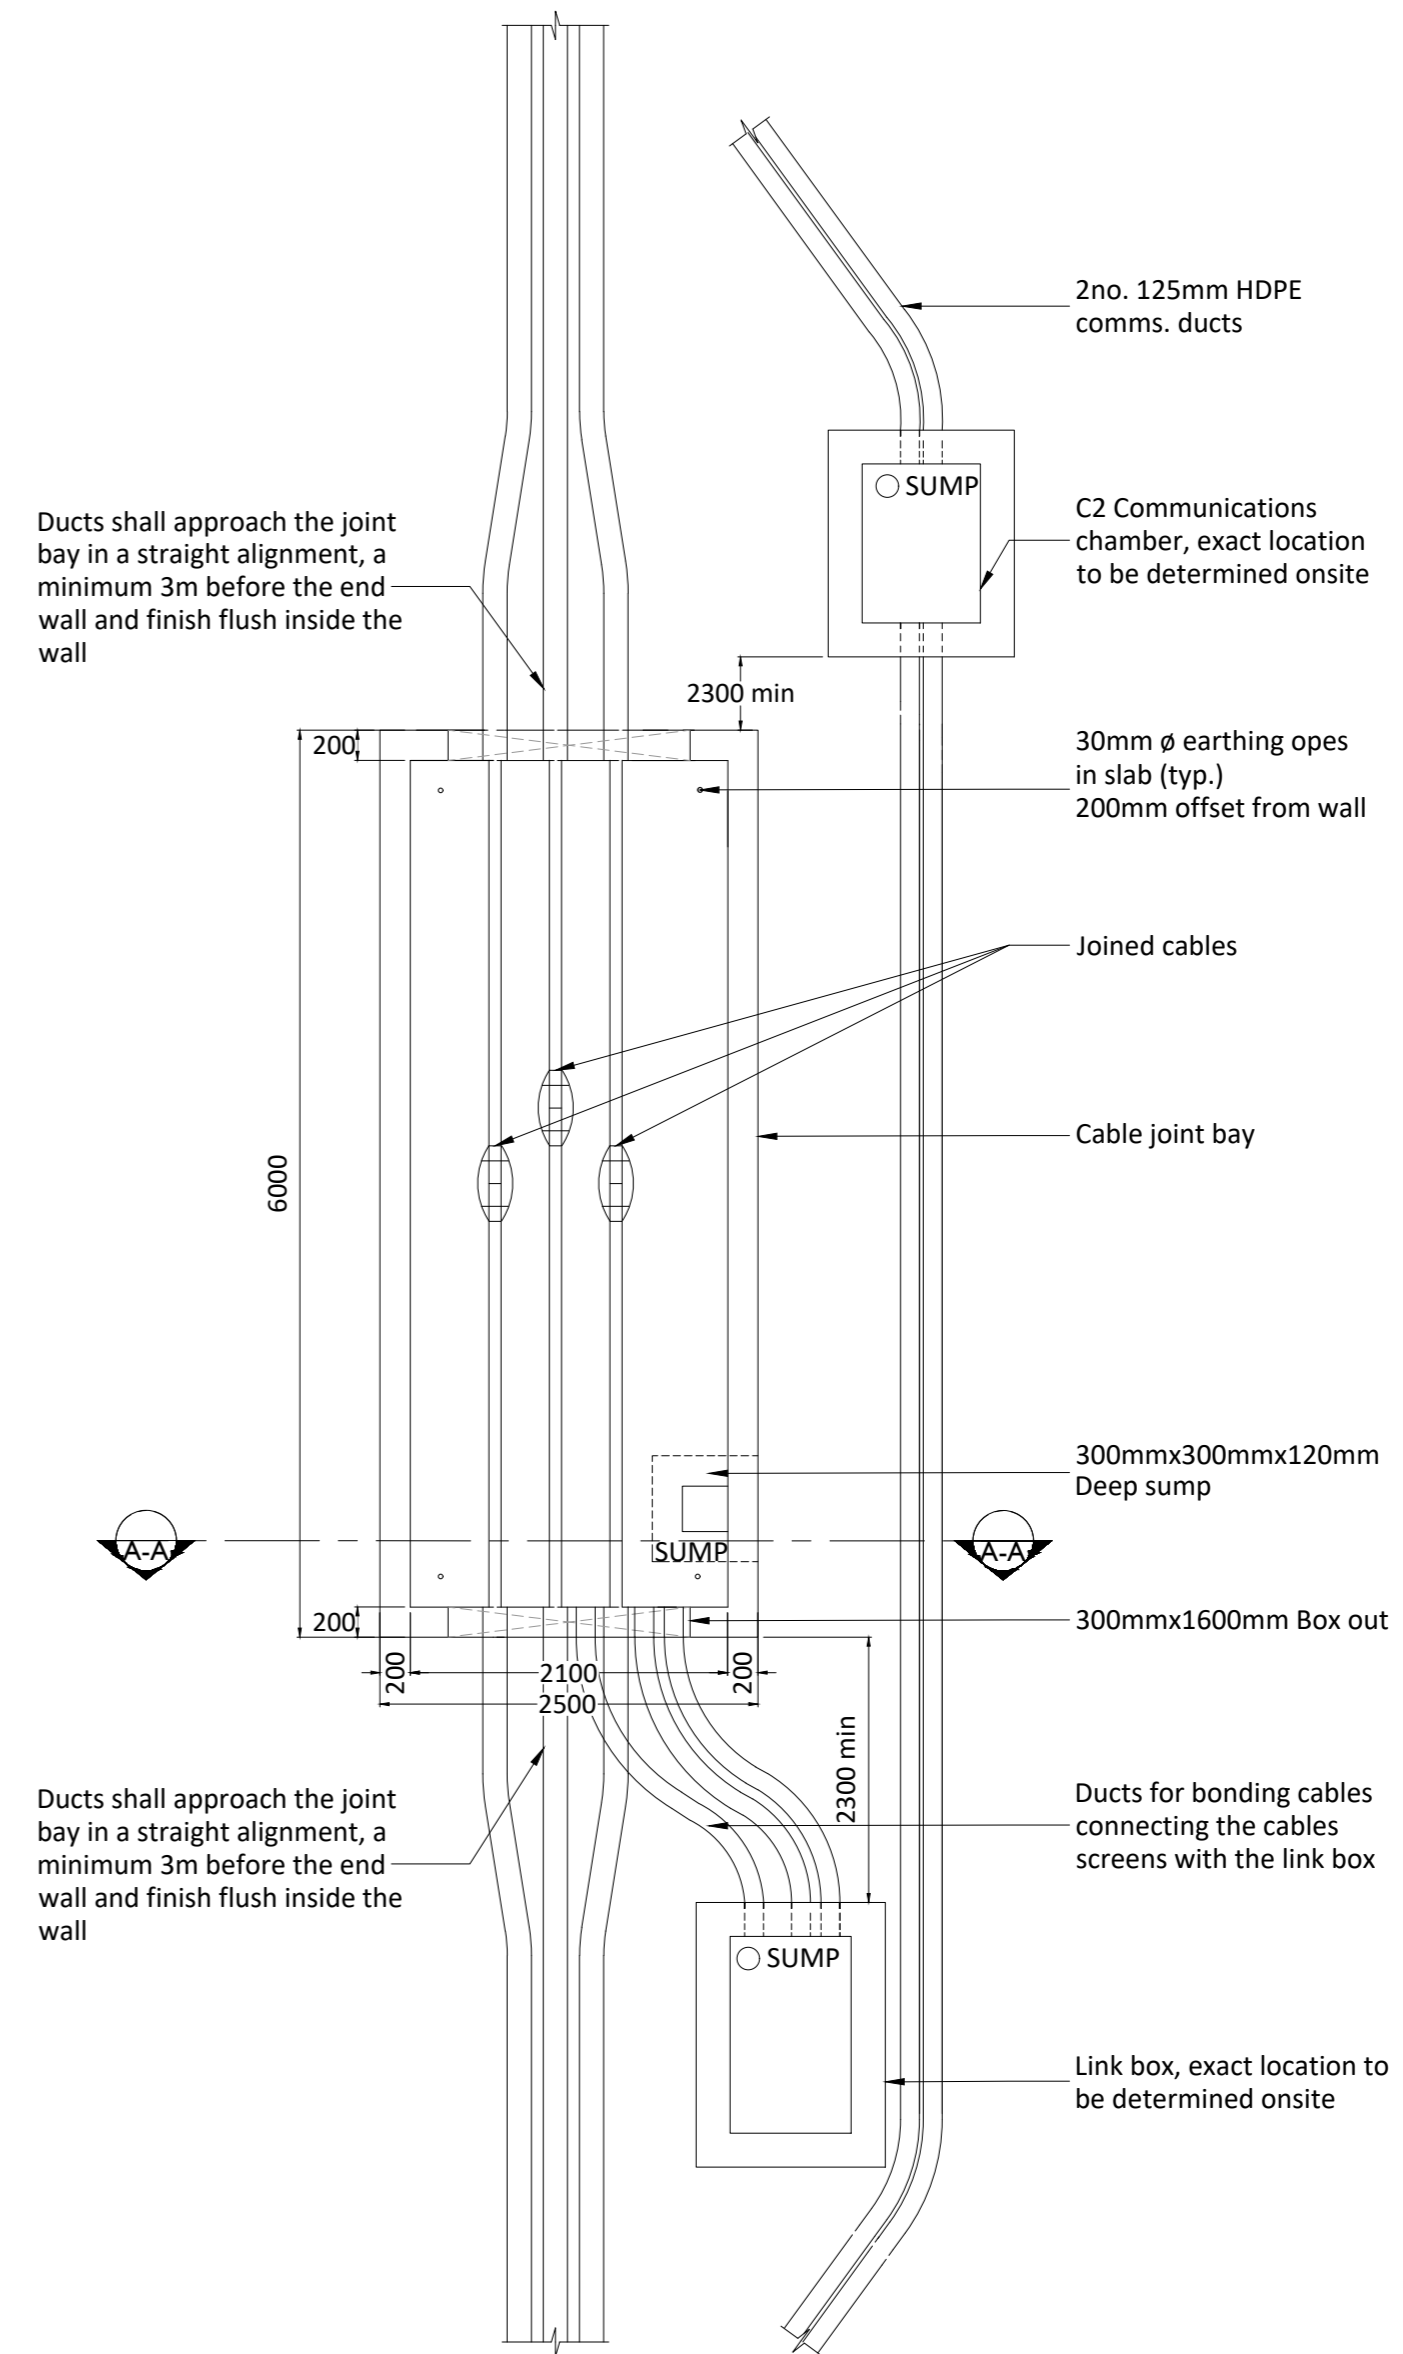

Typical Plan of Joint Bay in Road
Scale 1:50

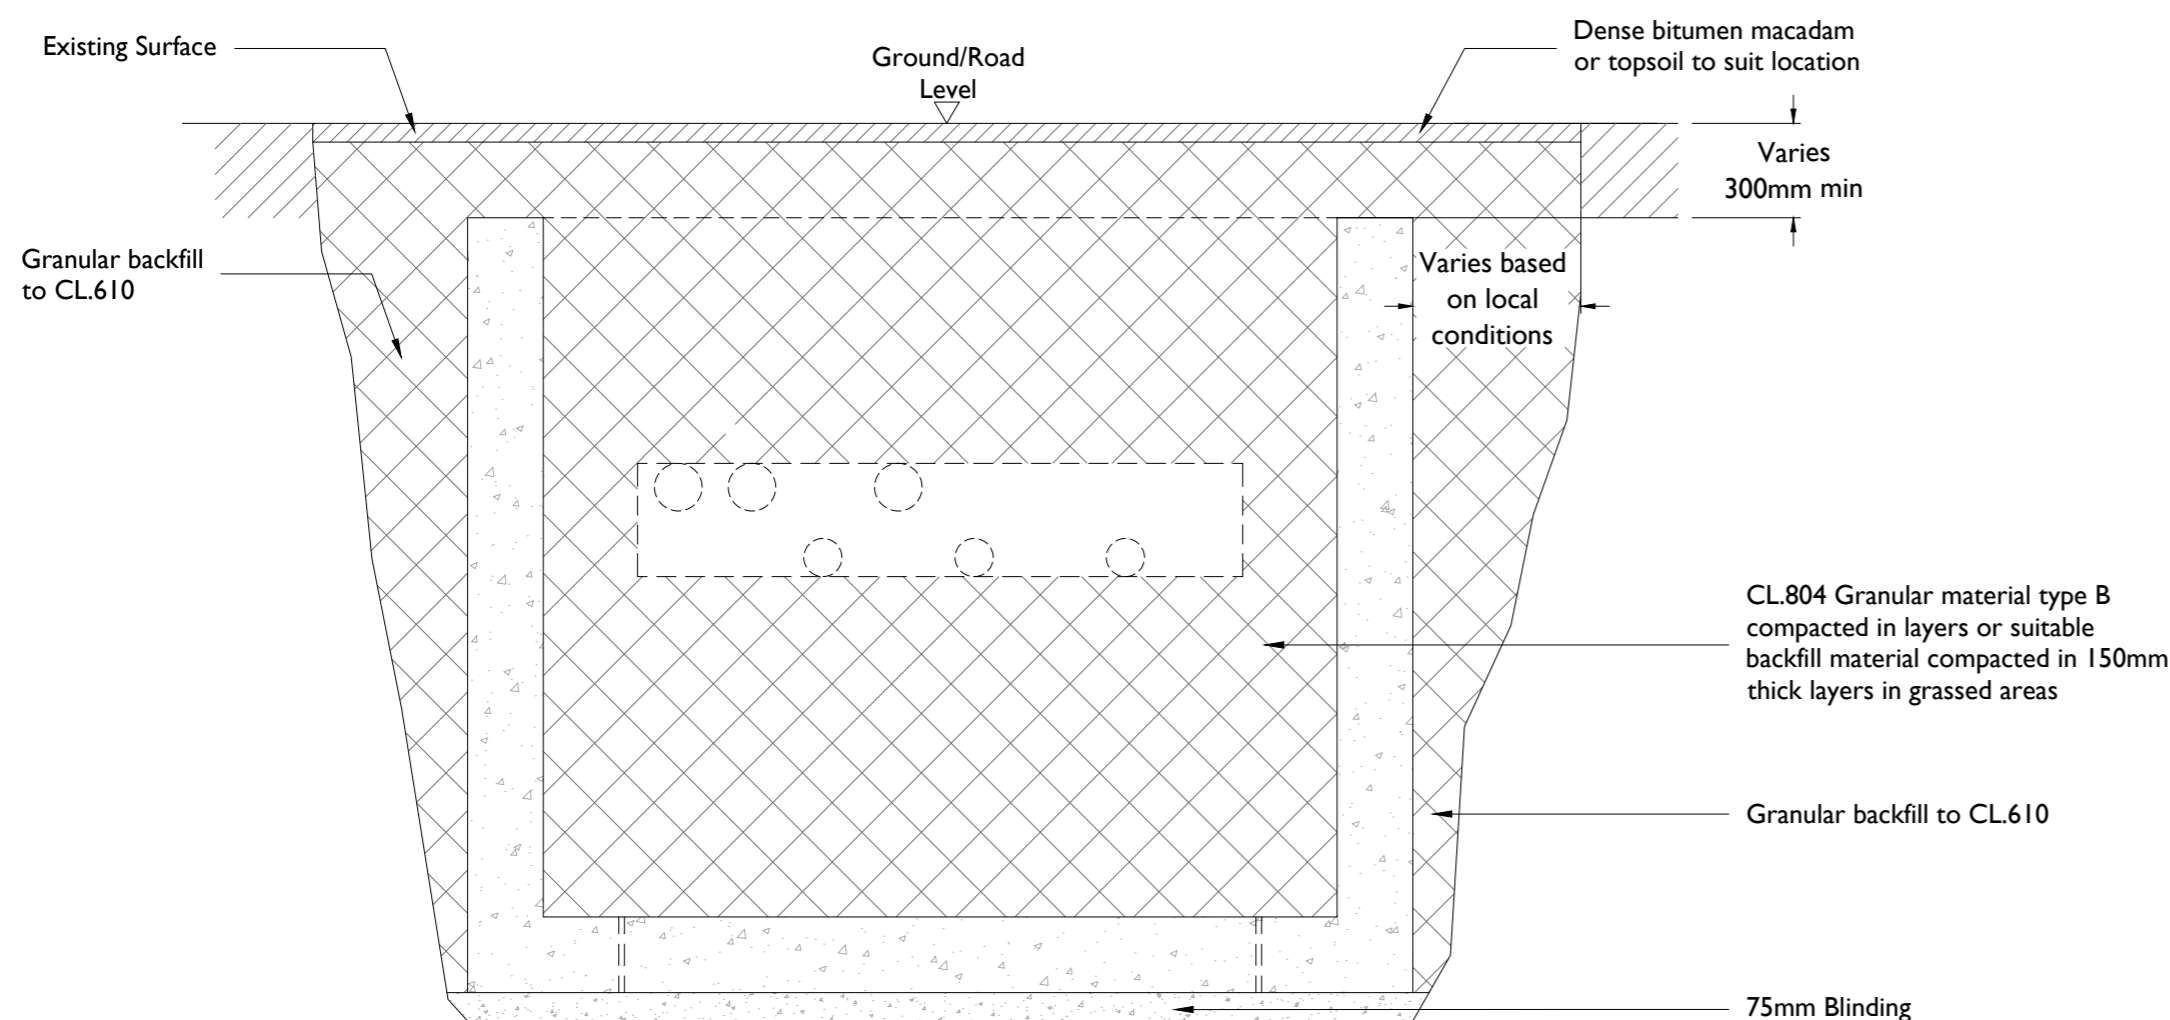

Section A-A Temporary Reinstatement
Scale 1:20

PROJECT

**Coom Green Energy Park
110kV Grid Connection**

CLIENT

**Coom Green Energy
Park Limited**

CONSULTANTS



NOTES: -

- This drawing is to be read in conjunction with relevant drawings, specifications and reports.
- Dimensions are in millimeters, unless noted otherwise.
- Drawings are not to be scaled use figured dimensions only.
- The compaction of backfill material around the cables shall be carried out by hand.
- The contractor shall provide test certificates confirming that the thermal resistivity of the thermal sand is maximum 1.k.m/W.

LEGEND: -

Issued for Planning
29.10.2025

ISSUE/REVISION

I/R	DATE	DESCRIPTION
P1	29.10.25	Issued for Planning
N1	02.04.25	Issued For Information

PROJECT NUMBER

300-I00920

SHEET TITLE

Joint Bay-
Reinstatement

SHEET NUMBER

300I00920-DR-243